



Certified to
NSF/ANSI/CAN 61
& NSF/ANSI 372

CERTIFIED
OPEN & ENCLOSED
LINESHAFT CONFIGURATIONS

SIMFLO®

VERTICAL + SUBMERSIBLE TURBINE PUMP CURVES 3450 & 1770

Effective August 1, 2023



SIMFLO.COM

TABLE OF CONTENTS

For more information,
or the location of your nearest SIMFLO distributor,
please visit www.simflo.com



Turbine PerformanceSection 100
 3450 RPM Section 101, 1-41
 1770 RPMSection 102, 42-105

Bowl Assembly DimensionsSection 200
 Open Lineshaft Bowl Assembly Dimensions..... 106
 Enclosed Lineshaft Bowl Assembly Dimensions..... 107
 Submersible Bowl Assembly Dimensions 108

General InformationSection 300
 Terms & Conditions109-110


3450 RPM Selection Chart

Model Number	Bowl Dia. (in.)	Peak Eff. (full dia.)	BEP Flow (gpm)	BEP Head (ft./ stage)	BEP NPSHr (full dia.)	POR (gpm)	Ns	Nss
SP5XXL	5.25	73.2	96.0	47.3	6.15	67-115	1873	8654
SP5XL	5.25	78.0	102	52.1	7.90	71-122	1797	7394
SP5L	5.25	76.5	120	61.3	10.8	84-144	1726	6344
SP5LO	5.25	75.1	100	46.5	9.27	70-120	1936	6495
SM5M	5.25	69.0	196	31.7	10.3	137-235	3614	8375
SM5H	5.25	72.2	257	37.3	19.3	180-308	3664	6017
SP6LL	6.00	71.7	123	57.5	10.7	86-148	1834	6469
SP6M	6.00	73.4	146	68.1	10.7	102-175	1758	7051
SP6H	6.00	76.5	225	77.8	13.9	158-270	1975	7192
SP6LO	6.00	75.4	164	58.9	16.5	114-196	2074	5389
SP6MO	6.00	75.1	186	62.5	15.5	130-223	2117	6013
SM6M	6.00	76.9	180	57.8	11.8	126-216	2208	7260
SM6H	6.00	79.1	222	68.8	13.6	155-266	2152	7267
SK6HH	5.50	78.9	436	41.8	25.5	305-523	4383	6342
SP7L	7.19	81.6	366	99.1	13.5	256-439	2102	9372
SP7H	7.19	81.7	480	110	18.0	336-575	2224	8645
SK7L	6.56	77.8	401	59.2	21.6	281-481	3236	6900
SK7M	6.56	78.3	452	60.9	6.86	316-542	3364	17300
SK7H	6.56	77.6	581	67.8	10.5	406-697	3519	14210
SM7M	7.00	77.5	509	63.3	22.5	356-611	3468	7539
SP8L	7.88	76.0	280	108	15.3	196-336	1723	7462
SP8M	7.88	77.0	317	106	12.9	222-380	1860	9014
SP8H	7.88	78.0	365	124	17.1	256-438	1770	7852
SM8H	7.69	78.2	560	109	20.6	392-672	2425	8449
SK8H	7.50	78.3	1117	84.8	65.9	782-1340	4128	4983
SM9L	9.50	81.1	559	187	15.1	391-671	1613	7266
SM9M	9.50	82.0	696	206	38.0	487-835	1675	5943
SP9L	9.50	81.1	569	193	18.9	398-683	1591	9077
SP9M	9.50	79.1	633	202	23.4	443-760	1621	8146
SL9H	9.00	79.5	1029	166	42.7	720-1235	2396	6624
SF9H	9.50	80.6	1198	200	66.5	836-1433	2241	5119
SK9M	9.44	77.1	1840	130	44.1	1288-2208	3852	8651
SP10M	10.19	79.7	761	186	32.9	533-913	1892	6917
SP10H	10.19	80.7	913	213	34.0	639-1096	1871	7404
SM10M	10.19	79.5	1282	183	39.5	897-1538	2481	7834
SM10H	10.19	79.5	1447	199	43.6	1013-1736	2472	7732
SM10MO	10.19	79.4	1298	191	40.1	909-1558	2423	7807
SM10HO	10.19	78.0	1426	193	50.7	998-1711	2517	6857
SM11M	10.63	78.9	1325	200	77.0	928-1590	2358	4831
SL11H	10.88	81.9	2022	243	25.2	1415-2426	2524	13809

V23.1



SP5XXL 3450 RPM

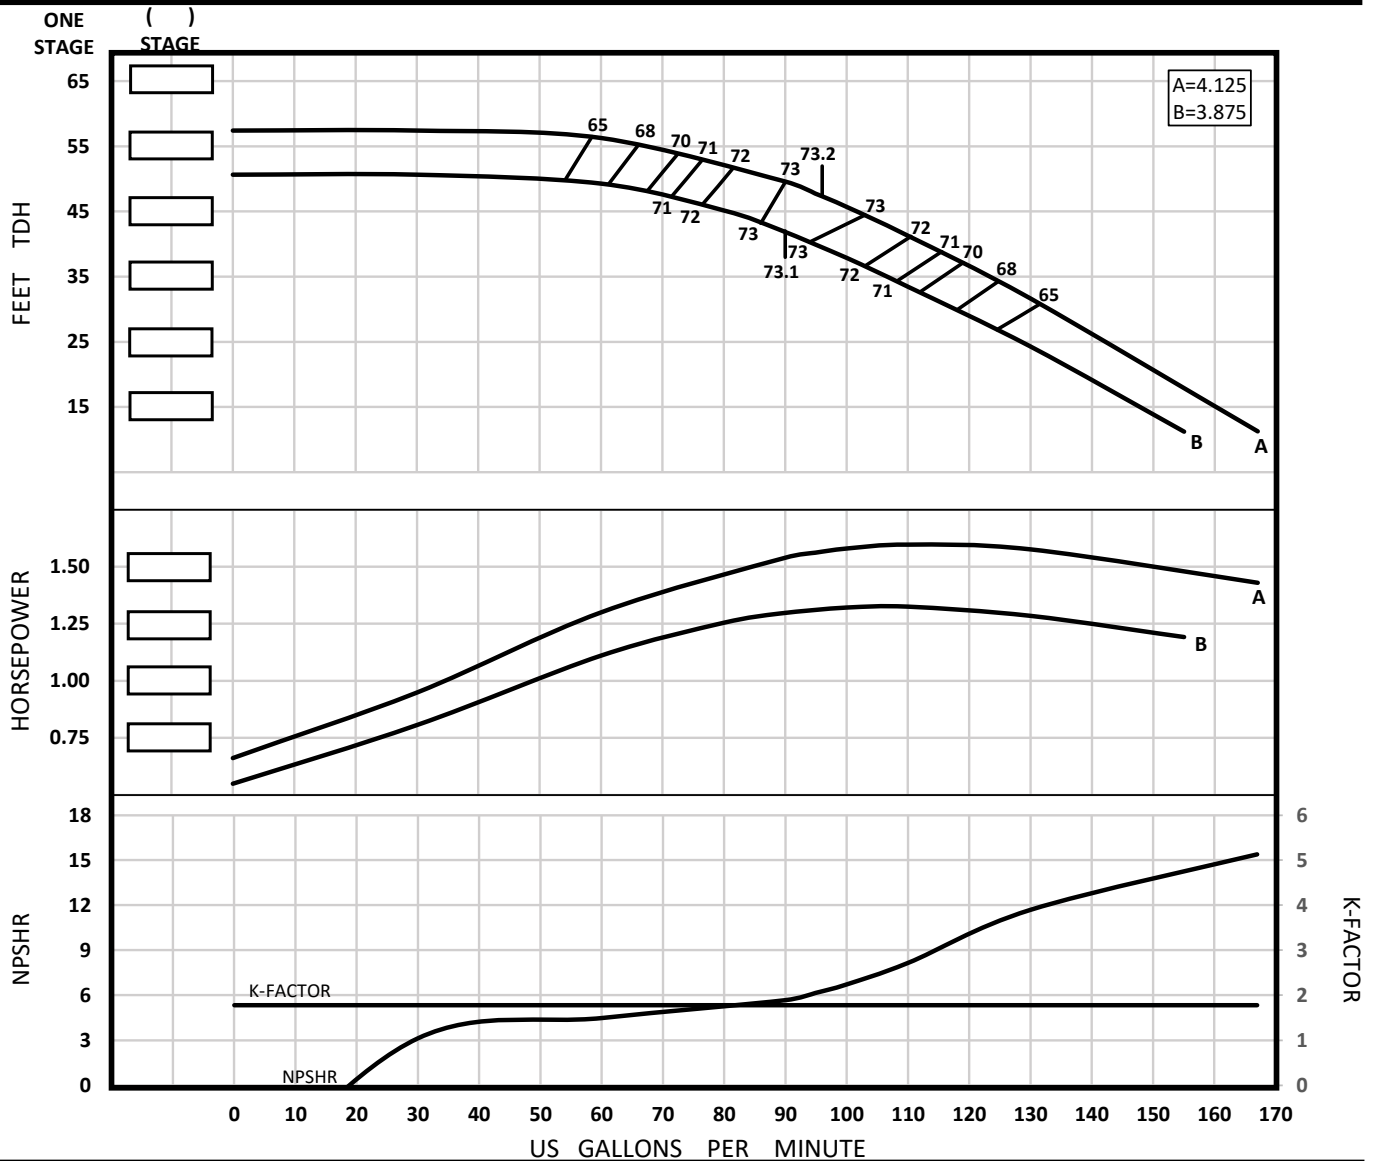

Impeller Type	Enclosed	Bowl OD (in.)	5.25	PEI cl	.890	Qty.	Eff.
Impeller Model	SP5XXL	Thd'd Discharge Size	3" / 4"	Ns	1873	Stages	Change
One Stage Weight (lb)	50.00	Thd'd Suction Size	4"	Nss	8654	1	-4
Add'l Stage Wt. (lb)	14.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	0.875	2	-3
Impeller Wt. (lb)	1.85	Sub. Mtr. Size	4" / 6"	Lateral (in)	.30	3	-2
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	529	Setting (in)	.125	4	-1
One Stage Length (in)	~16.75	D.I. Bowl Rating (psi)	Δ1147	K-Factor (lb/ft tdh)	1.780	5	0
Add'l Stage Length (in)	4.625	S.S. Bowl Rating (psi)	Δ1235	Imp. WR ² (lb-ft ²)	.014		

Δ Consult factory for availability

Rev 2022.10.20


Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SP5XL

3450 RPM

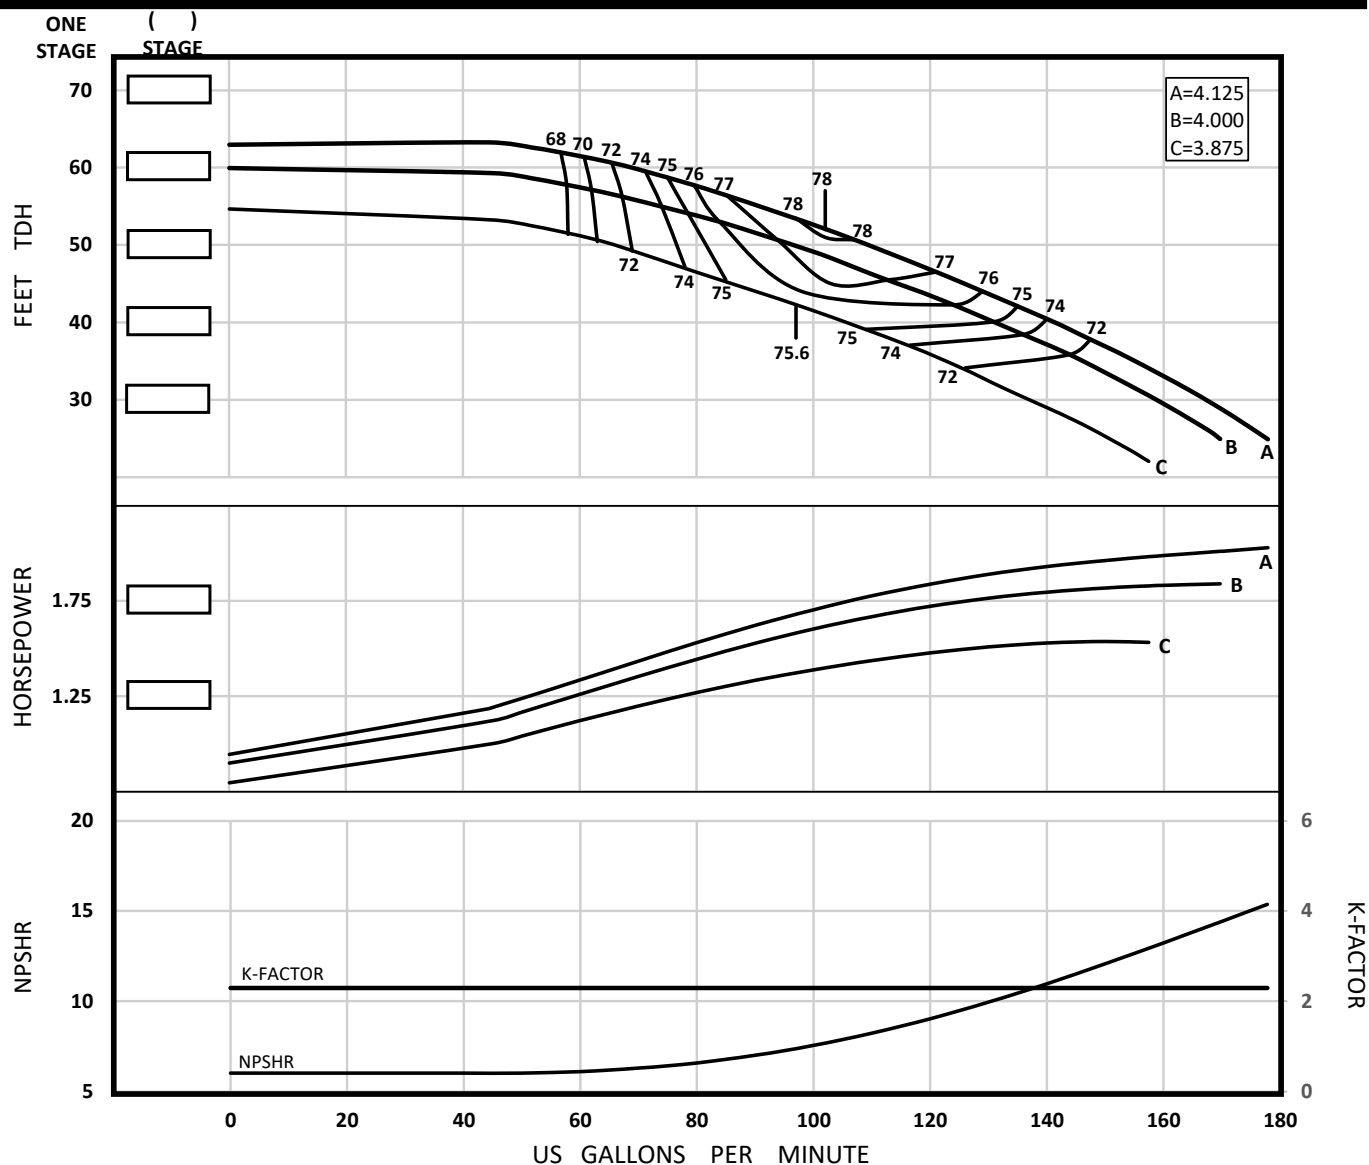

Impeller Type	Enclosed	Bowl OD (in.)	5.25	PEI cl	.845	Qty.	Eff.
Impeller Model	SP5XL	Thd'd Discharge Size	3" / 4"	Ns	1797	Stages	Change
One Stage Weight (lb)	50.00	Thd'd Suction Size	4"	Nss	7394	1	-4
Add'l Stage Wt. (lb)	14.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	0.875	2	-3
Impeller Wt. (lb)	1.70	Sub. Mtr. Size	4" / 6"	Lateral (in)	.30	3	-2
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	529	Setting (in)	.125	4	-1
One Stage Length (in)	~16.75	D.I. Bowl Rating (psi)	Δ1147	K-Factor (lb/ft tdk)	2.300	5	0
Add'l Stage Length (in)	4.625	S.S. Bowl Rating (psi)	Δ1235	Imp. WR ² (lb-ft ²)	.015		

Δ Consult factory for availability


Rev. 2022.10.20

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SP5L 3450 RPM

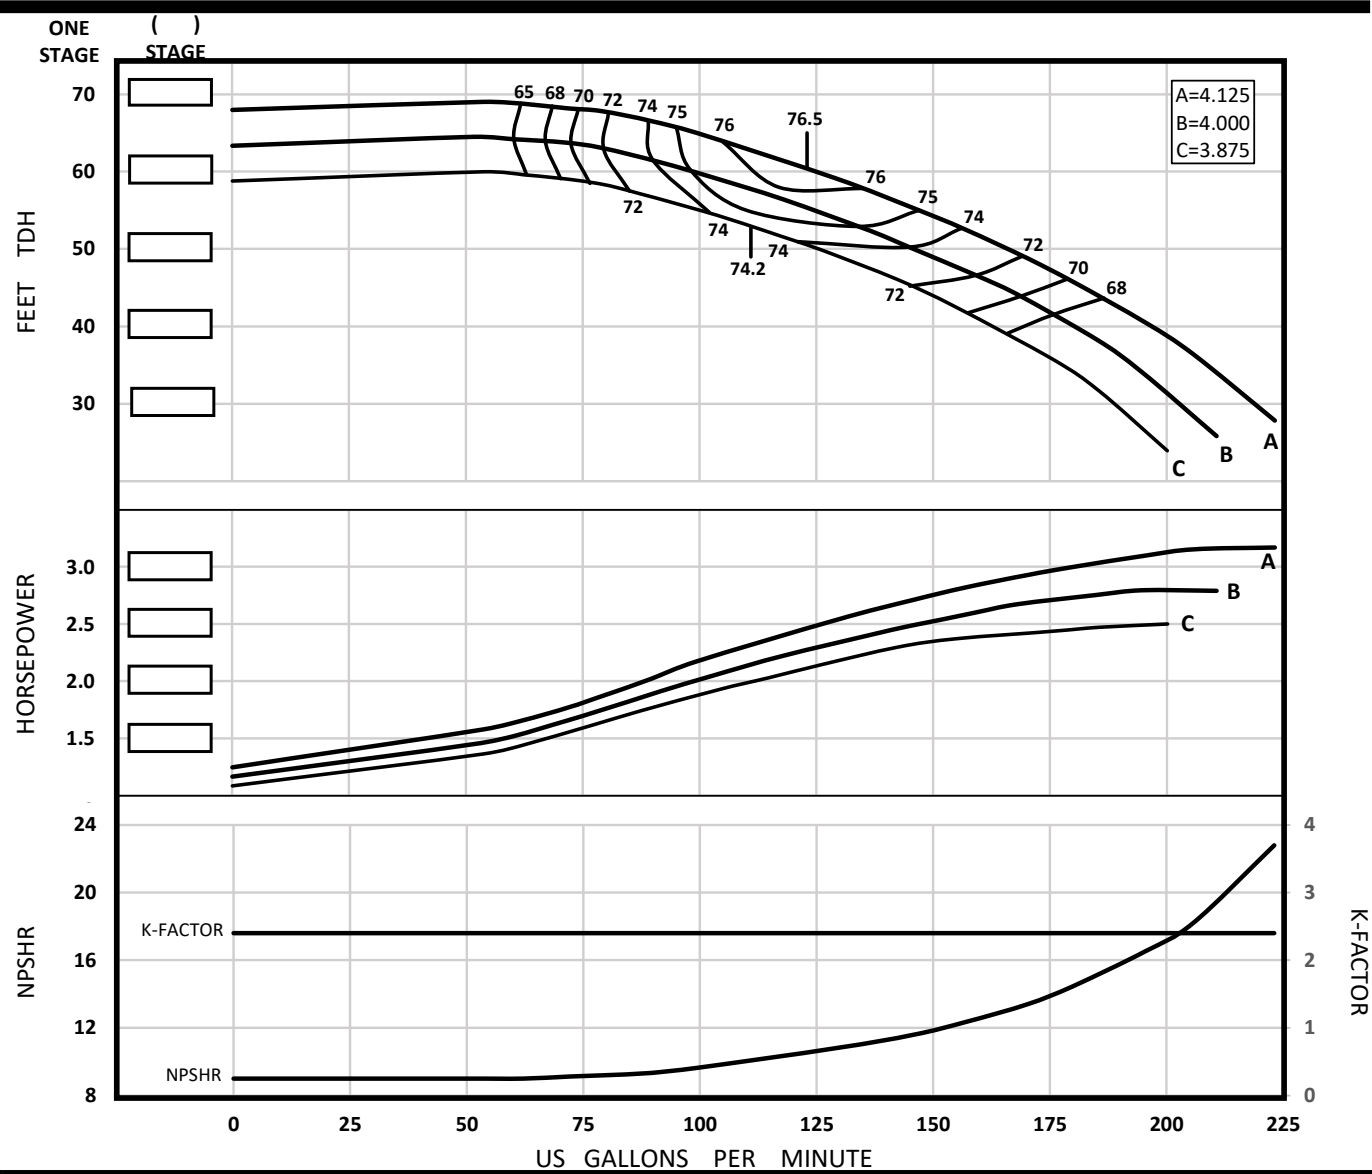


Impeller Type	Enclosed	Bowl OD (in.)	5.25	PEI cl	0.875	Qty.	Eff.
Impeller Model	SP5L	Thd'd Discharge Size	3" / 4"	Ns	1726	Stages	Change
One Stage Weight (lb)	50.00	Thd'd Suction Size	4"	Nss	6344	1	-4
Add'l Stage Wt. (lb)	14.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	0.875	2	-3
Impeller Wt. (lb)	1.75	Sub. Mtr. Size	4" / 6"	Lateral (in)	.30	3	-2
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	529	Setting (in)	.125	4	-1
One Stage Length (in)	~16.75	D.I. Bowl Rating (psi)	Δ1147	K-Factor (lb/ft tdh)	2.400	5	0
Add'l Stage Length (in)	4.625	S.S. Bowl Rating (psi)	Δ1235	Imp. WR ² (lb-ft ²)	.015		

Δ Consult factory for availability
Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.
Weights and lengths listed are approximate and subject to change. Consult factory.

SP5LO

3450 RPM

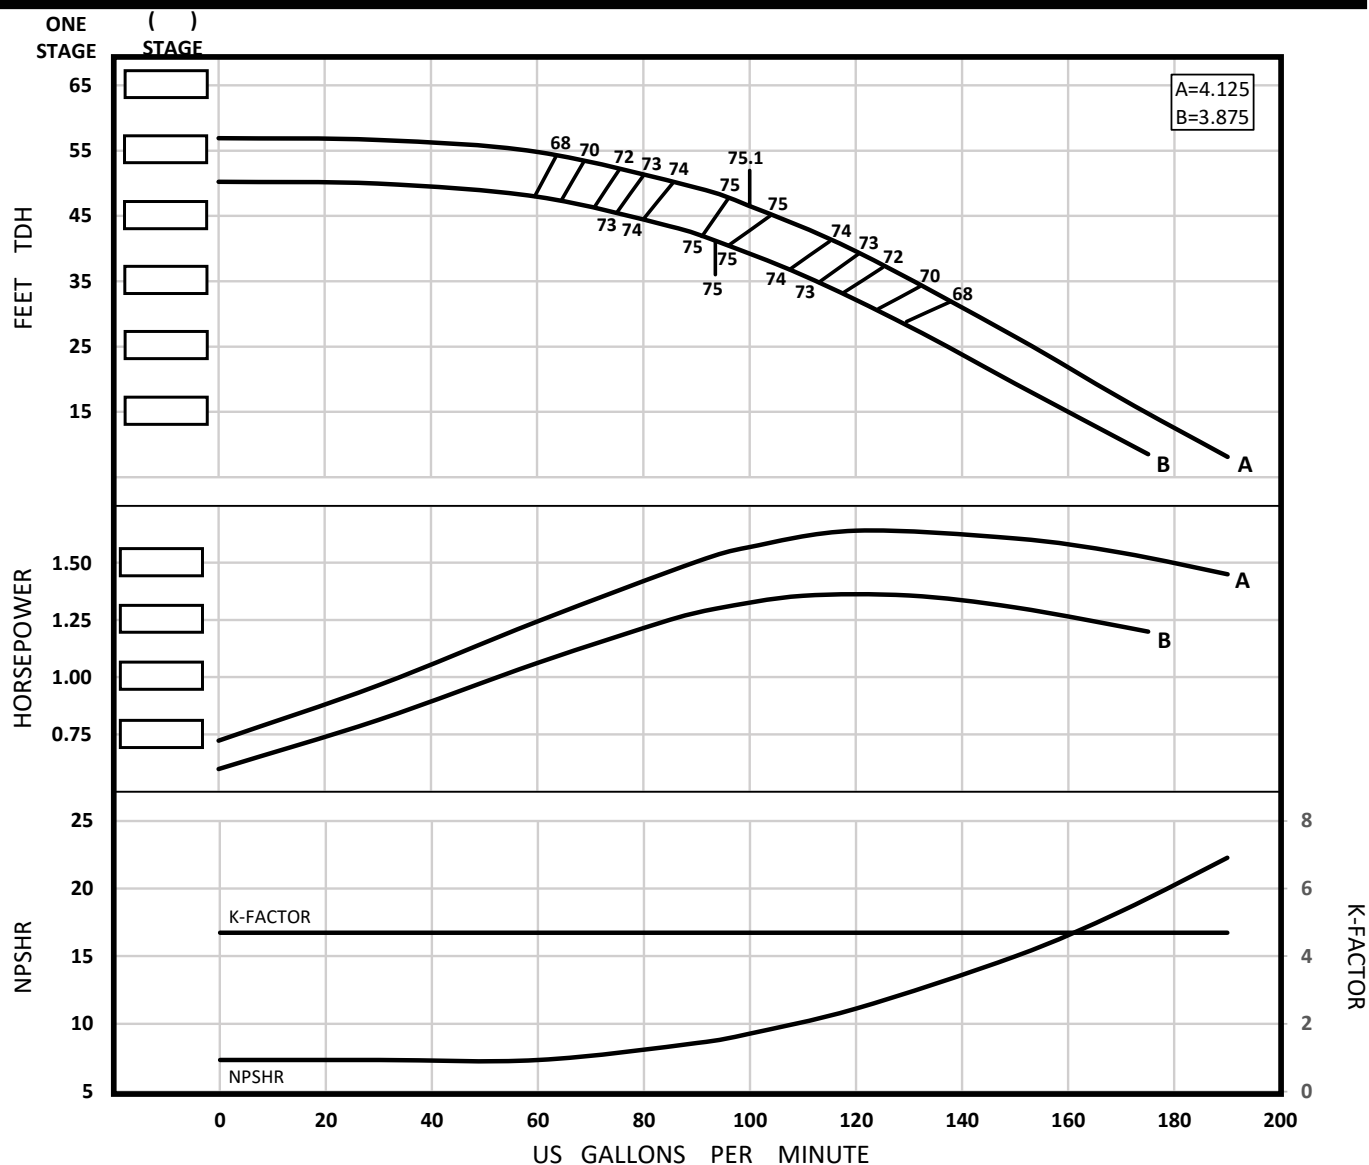

Impeller Type	Semi-Open	Bowl OD (in.)	5.25	PEI cl	0.875	Qty.	Eff.
Impeller Model	SP5LO	Thd'd Discharge Size	3" / 4"	Ns	1936	Stages	Change
One Stage Weight (lb)	50.00	Thd'd Suction Size	4"	Nss	6495	1	-6
Add'l Stage Wt. (lb)	14.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	0.875	2	-4
Impeller Wt. (lb)	1.40	Sub. Mtr. Size	4" / 6"	Lateral (in)	.16	3	-3
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	529	Setting (in)	.03	4	-1.5
One Stage Length (in)	~16.438	D.I. Bowl Rating (psi)	Δ1147	K-Factor (lb/ft tdh)	4.700	5	0
Add'l Stage Length (in)	4.313	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.014		

Δ Consult factory for availability


Rev. 2022.10.20

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SM5M 3450 RPM

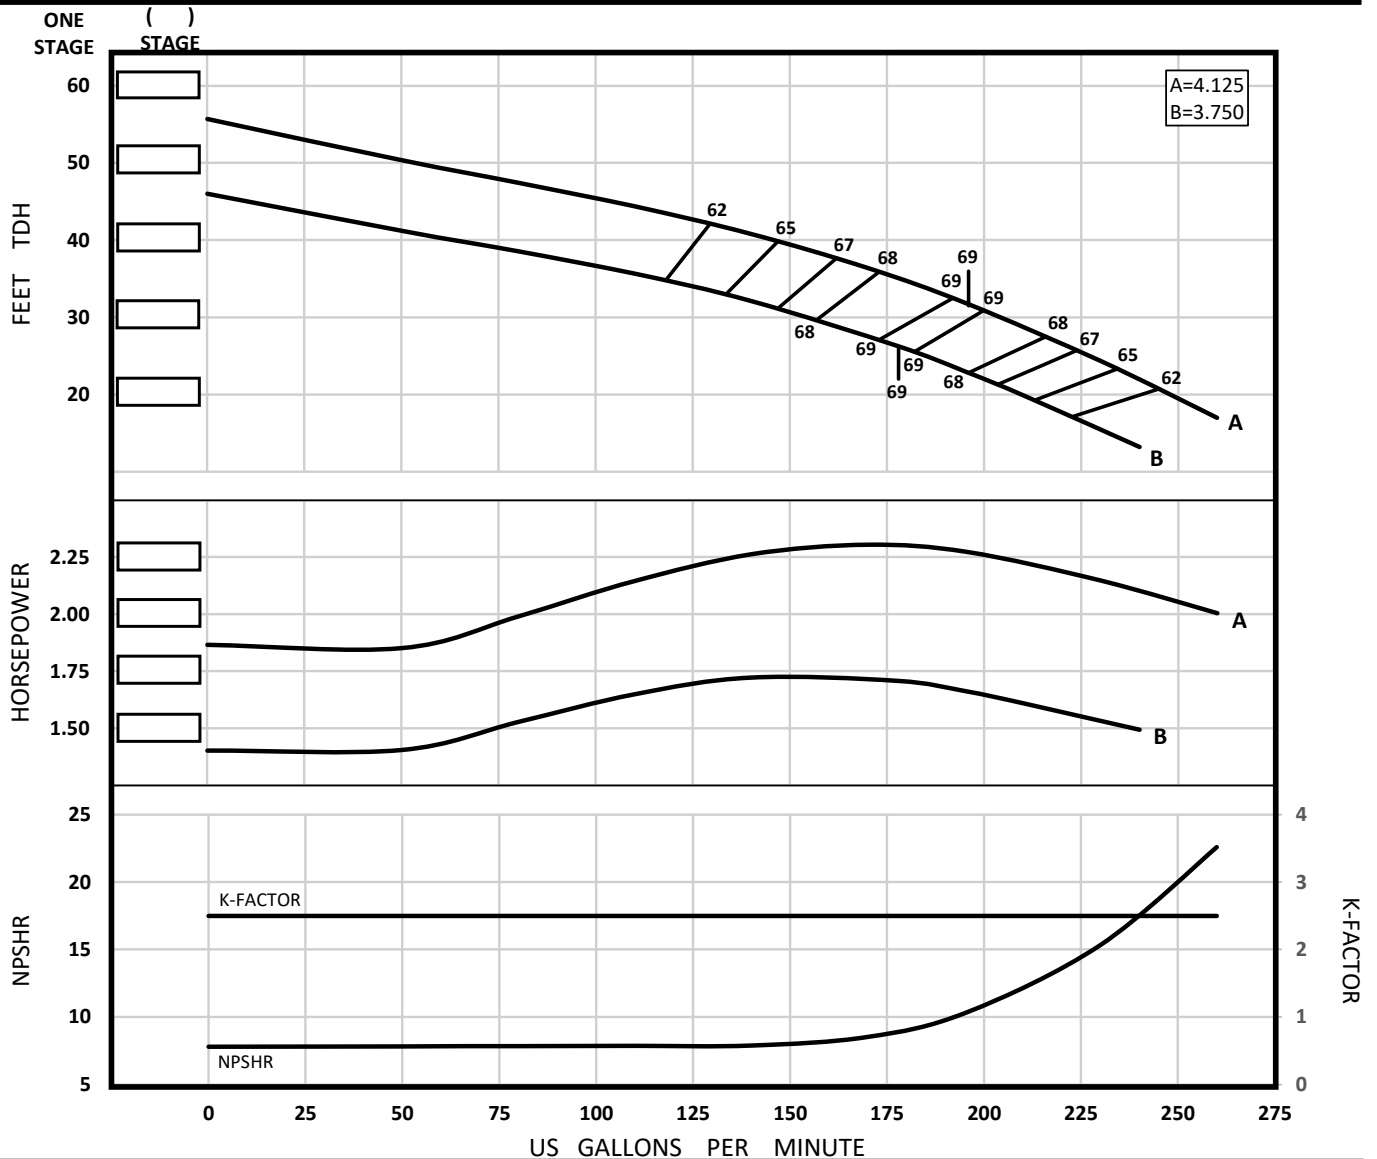

Impeller Type	Enclosed	Bowl OD (in.)	5.25	PEI cl	0.969	Qty.	Eff.
Impeller Model	SM5M	Thd'd Discharge Size	3" / 4"	Ns	3614	Stages	Change
One Stage Weight (lb)	50.00	Thd'd Suction Size	4"	Nss	8375	1	-4
Add'l Stage Wt. (lb)	14.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	0.875	2	-3
Impeller Wt. (lb)	1.85	Sub. Mtr. Size	4" / 6"	Lateral (in)	.55	3	-2
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	697	Setting (in)	.125	4	-1
One Stage Length (in)	~17.00	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	2.500	5	0
Add'l Stage Length (in)	4.875	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.015		

Δ Consult factory for availability


Rev. 2021.06.08

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SM5H 3450 RPM

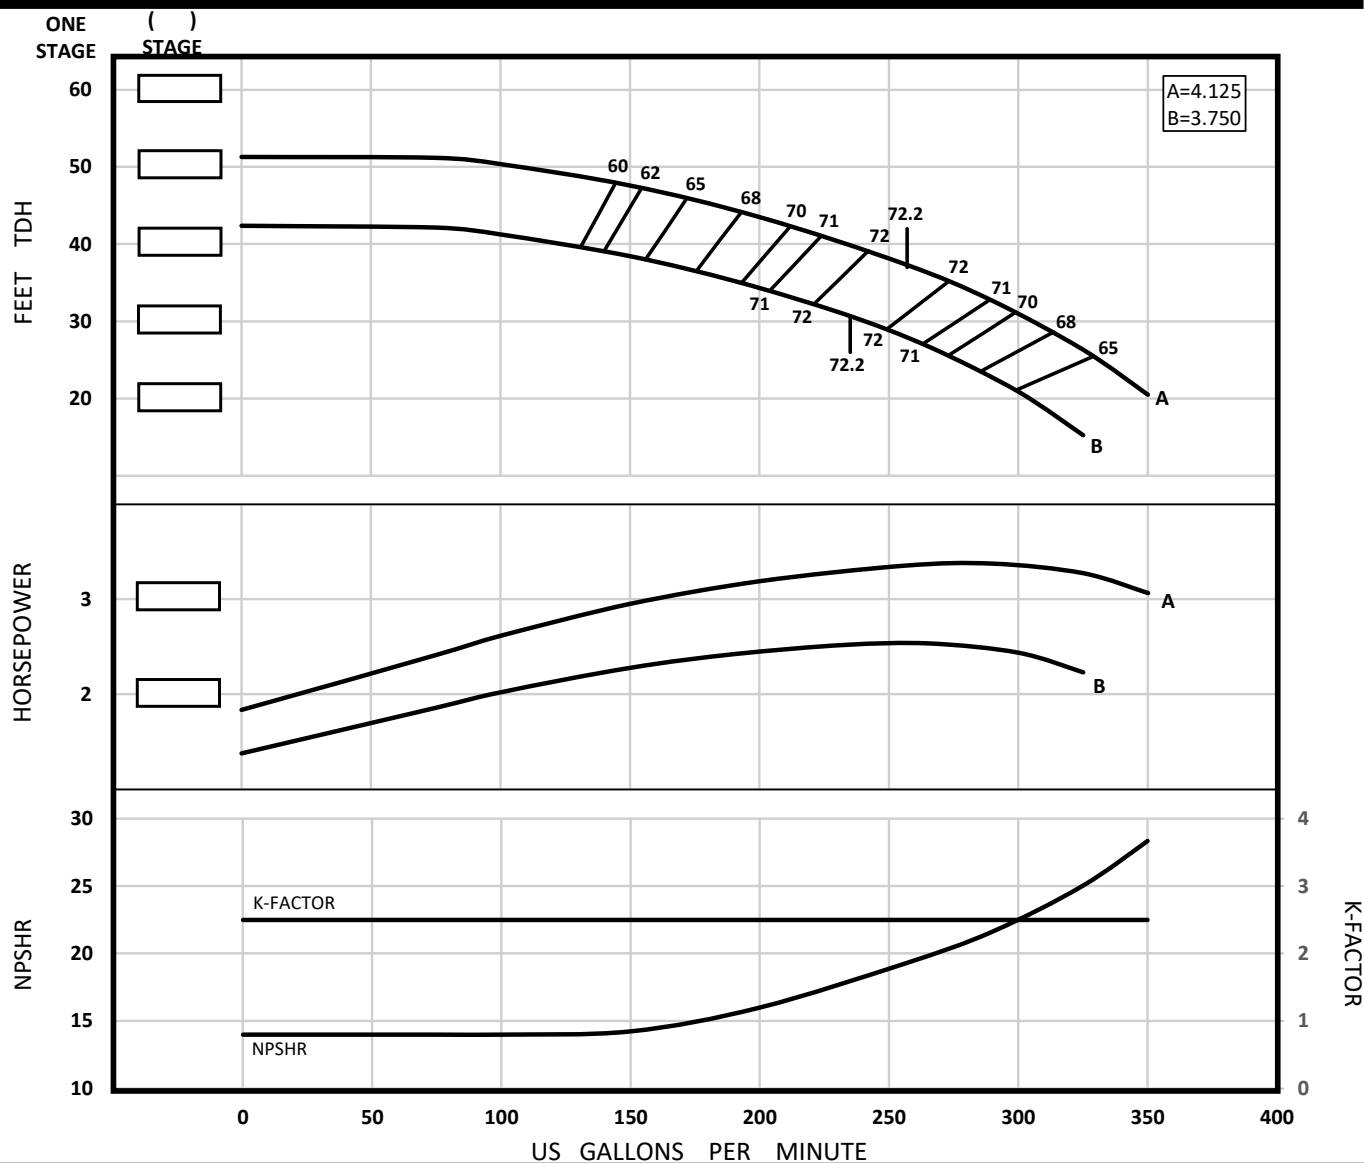

Impeller Type	Enclosed	Bowl OD (in.)	5.25	PEI cl	0.896	Qty.	Eff.
Impeller Model	SM5H	Thd'd Discharge Size	3" / 4"	Ns	3664	Stages	Change
One Stage Weight (lb)	50.00	Thd'd Suction Size	4"	Nss	6017	1	-4
Add'l Stage Wt. (lb)	14.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	0.875	2	-3
Impeller Wt. (lb)	1.95	Sub. Mtr. Size	4" / 6"	Lateral (in)	.55	3	-2
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	697	Setting (in)	.125	4	-1
One Stage Length (in)	~17.00	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	2.500	5	0
Add'l Stage Length (in)	4.875	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.014		

Δ Consult factory for availability


Rev. 2020.07.07

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SP6LL 3450 RPM

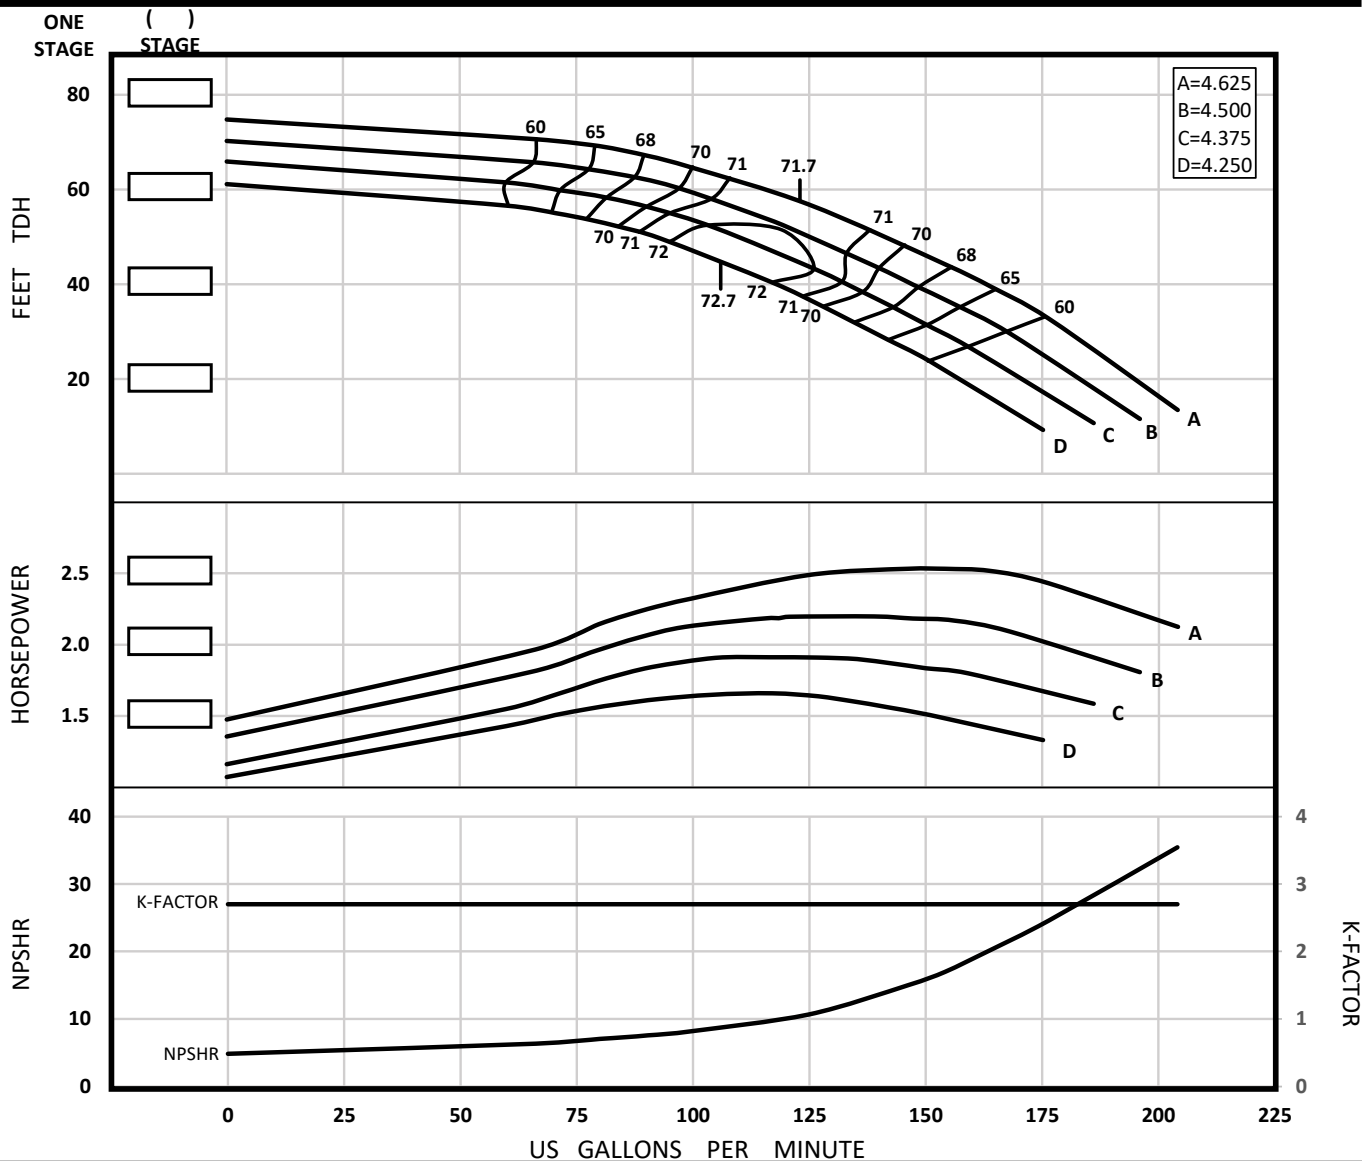

Impeller Type	Enclosed	Bowl OD (in.)	6.00	PEI cl	0.946	Qty.	Eff.
Impeller Model	SP6LL	Thd'd Discharge Size	3" / 4"	Ns	1834	Stages	Change
One Stage Weight (lb)	58.00	Thd'd Suction Size	4"	Nss	6469	1	-4
Add'l Stage Wt. (lb)	18.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	1.000	2	-3
Impeller Wt. (lb)	2.55	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.66	3	-2
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	858	Setting (in)	.125	4	-1
One Stage Length (in)	~17.438	D.I. Bowl Rating (psi)	Δ1859	K-Factor (lb/ft tdh)	2.700	5	0
Add'l Stage Length (in)	4.813	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.037		

Δ Consult factory for availability

Rev. 2022.10.20


Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SP6M

3450 RPM

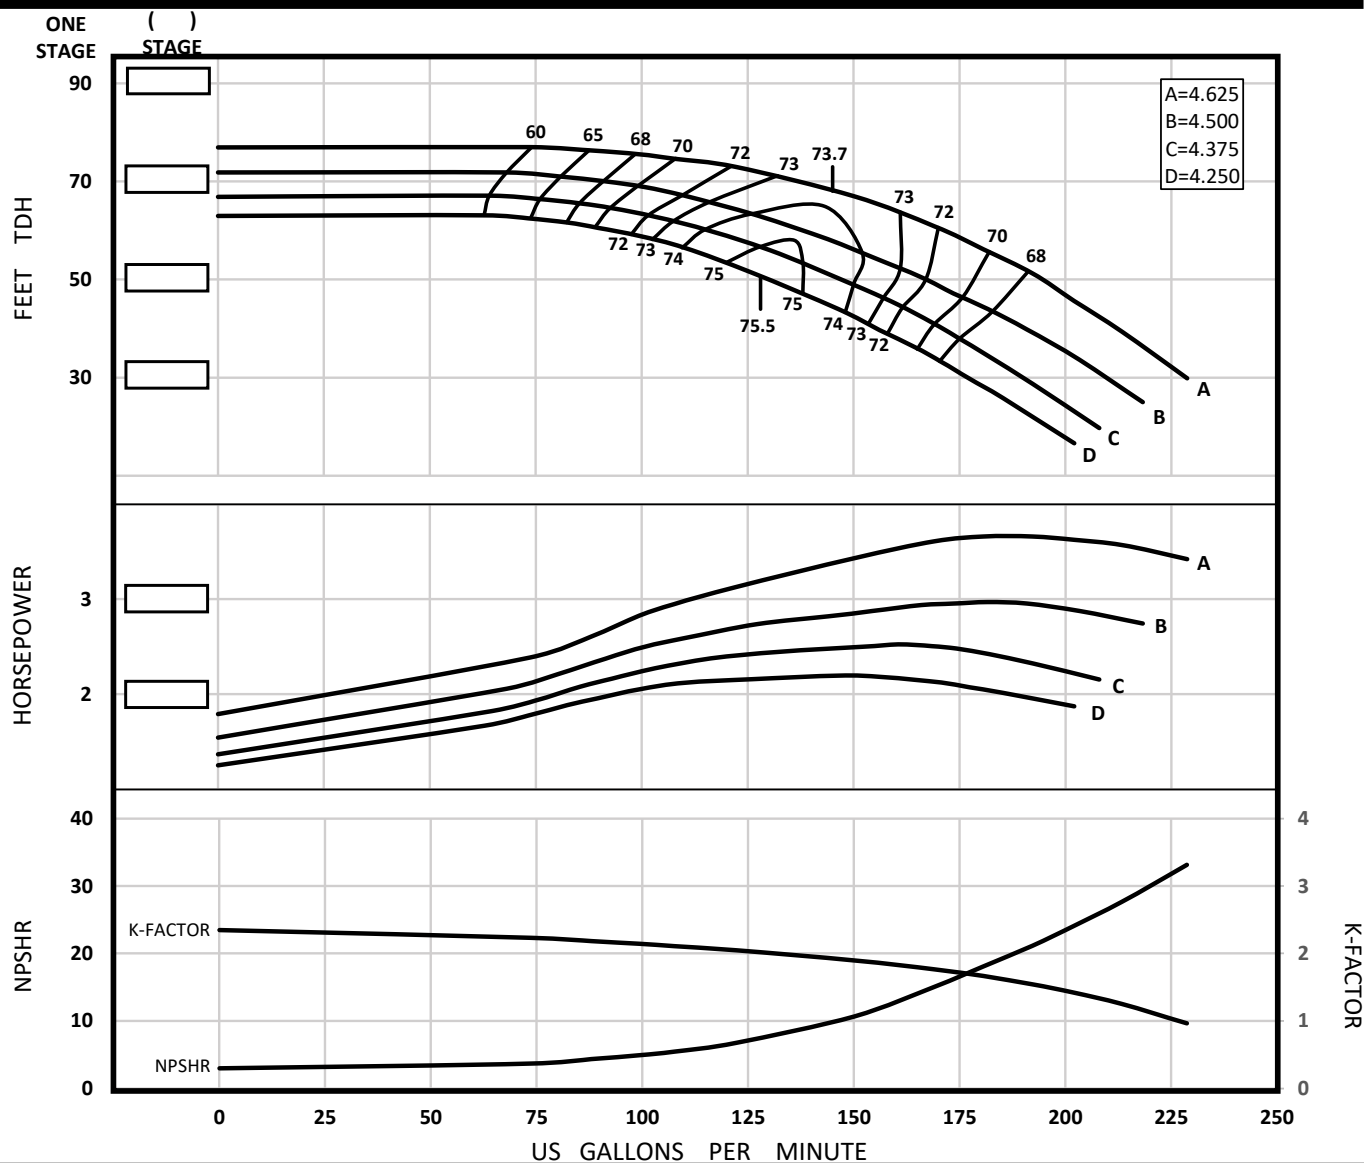

Impeller Type	Enclosed	Bowl OD (in.)	6.00	PEI cl	0.968	Qty.	Eff.
Impeller Model	SP6M	Thd'd Discharge Size	3" / 4"	Ns	1758	Stages	Change
One Stage Weight (lb)	56.00	Thd'd Suction Size	4"	Nss	7051	1	-3
Add'l Stage Wt. (lb)	19.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	1.000	2	-2
Impeller Wt. (lb)	2.95	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.41	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	858	Setting (in)	.125	4	0
One Stage Length (in)	~17.438	D.I. Bowl Rating (psi)	Δ1859	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	4.813	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.303		

Δ Consult factory for availability


Rev. 2022.10.20

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SP6H 3450 RPM

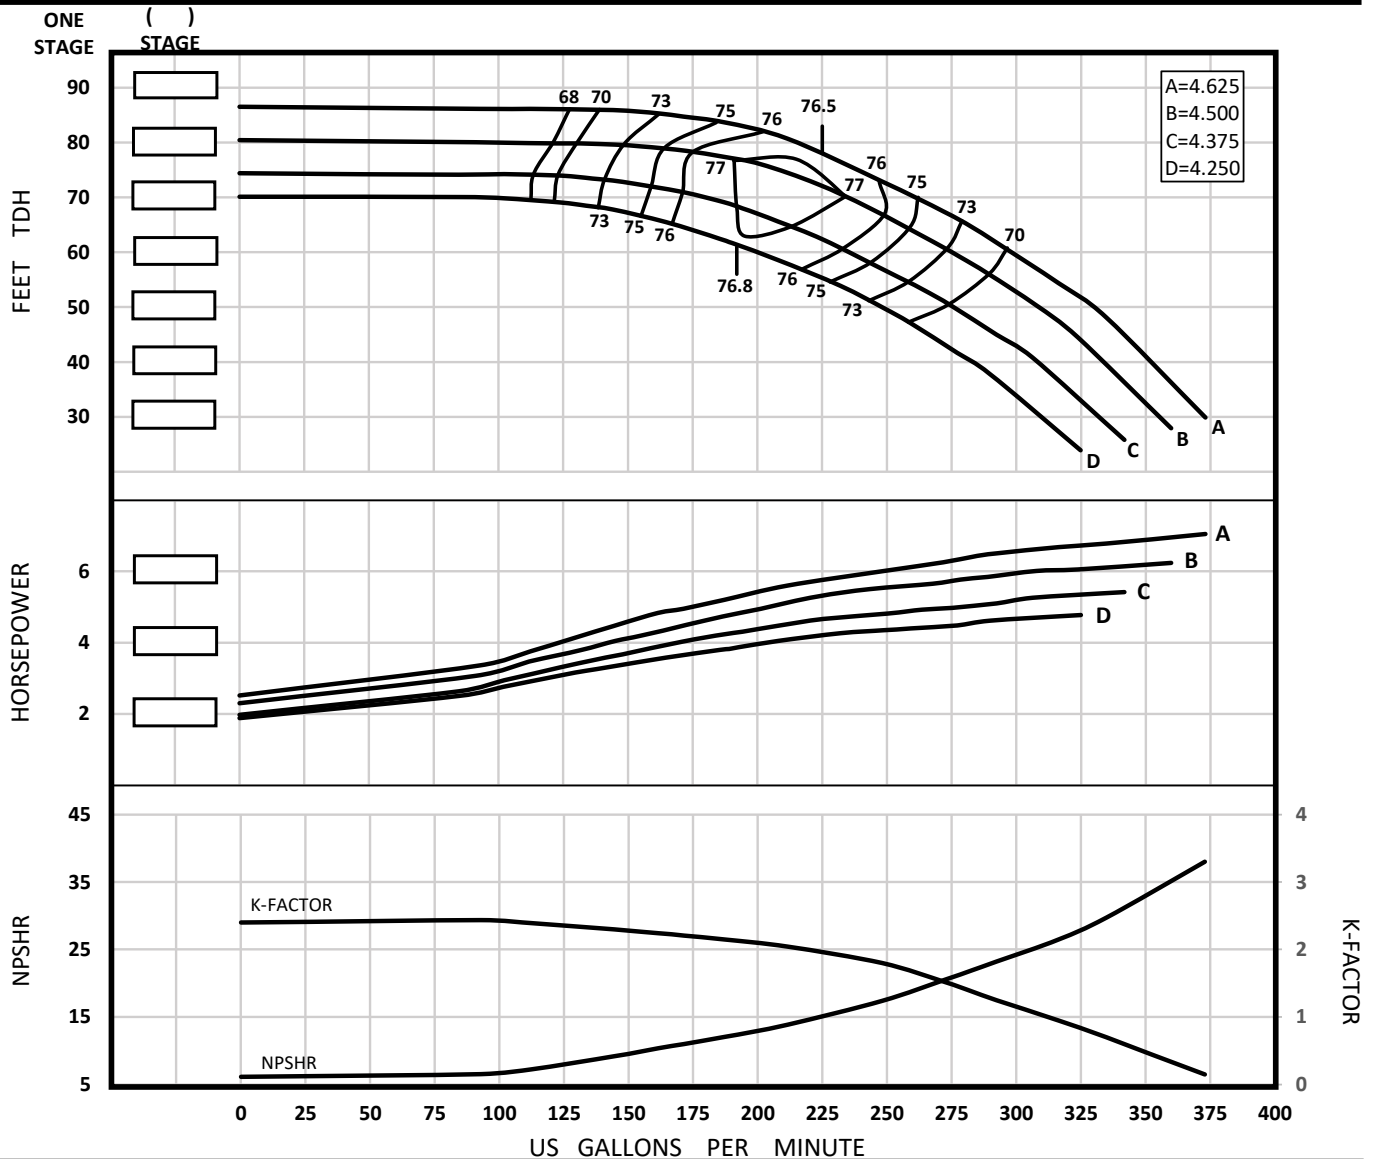


Impeller Type	Enclosed	Bowl OD (in.)	6.00	PEI cl	.966	Qty.	Eff.
Impeller Model	SP6H	Thd'd Discharge Size	3" / 4"	Ns	1975	Stages	Change
One Stage Weight (lb)	55.00	Thd'd Suction Size	4"	Nss	7192	1	-4
Add'l Stage Wt. (lb)	19.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	1.000	2	-3
Impeller Wt. (lb)	2.75	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.38	3	-2
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	858	Setting (in)	.125	4	-1
One Stage Length (in)	~17.438	D.I. Bowl Rating (psi)	Δ1859	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	4.813	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.034		

Δ Consult factory for availability

Rev. 2022.10.20

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

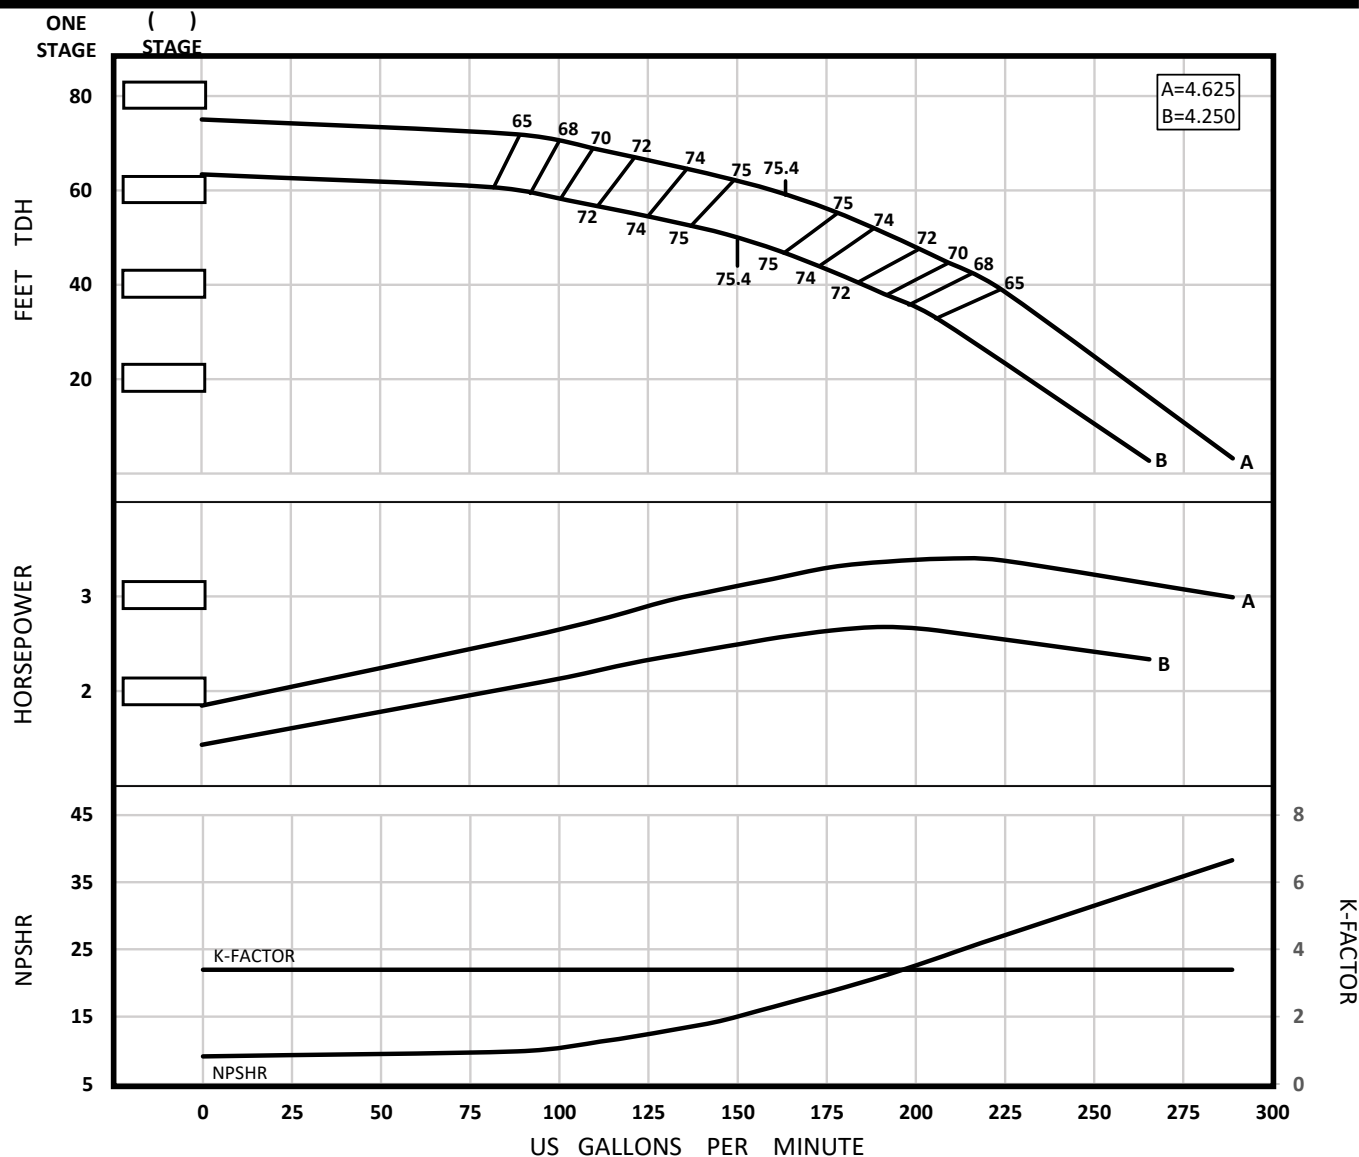SP6LO
3450 RPM

Impeller Type	Semi-Open	Bowl OD (in.)	6.00	PEI cl	.949	Qty.	Eff.
Impeller Model	SP6LO	Thd'd Discharge Size	3" / 4"	Ns	2074	Stages	Change
One Stage Weight (lb)	53.00	Thd'd Suction Size	4"	Nss	5389	1	-5.5
Add'l Stage Wt. (lb)	18.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	1.000	2	-4
Impeller Wt. (lb)	1.60	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.70	3	-3
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	858	Setting (in)	.03	4	-1.5
One Stage Length (in)	~17.438	D.I. Bowl Rating (psi)	Δ1859	K-Factor (lb/ft tdk)	3.400	5	0
Add'l Stage Length (in)	4.813	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.019		

Δ Consult factory for availability


Rev. 2022.10.20

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SP6MO 3450 RPM

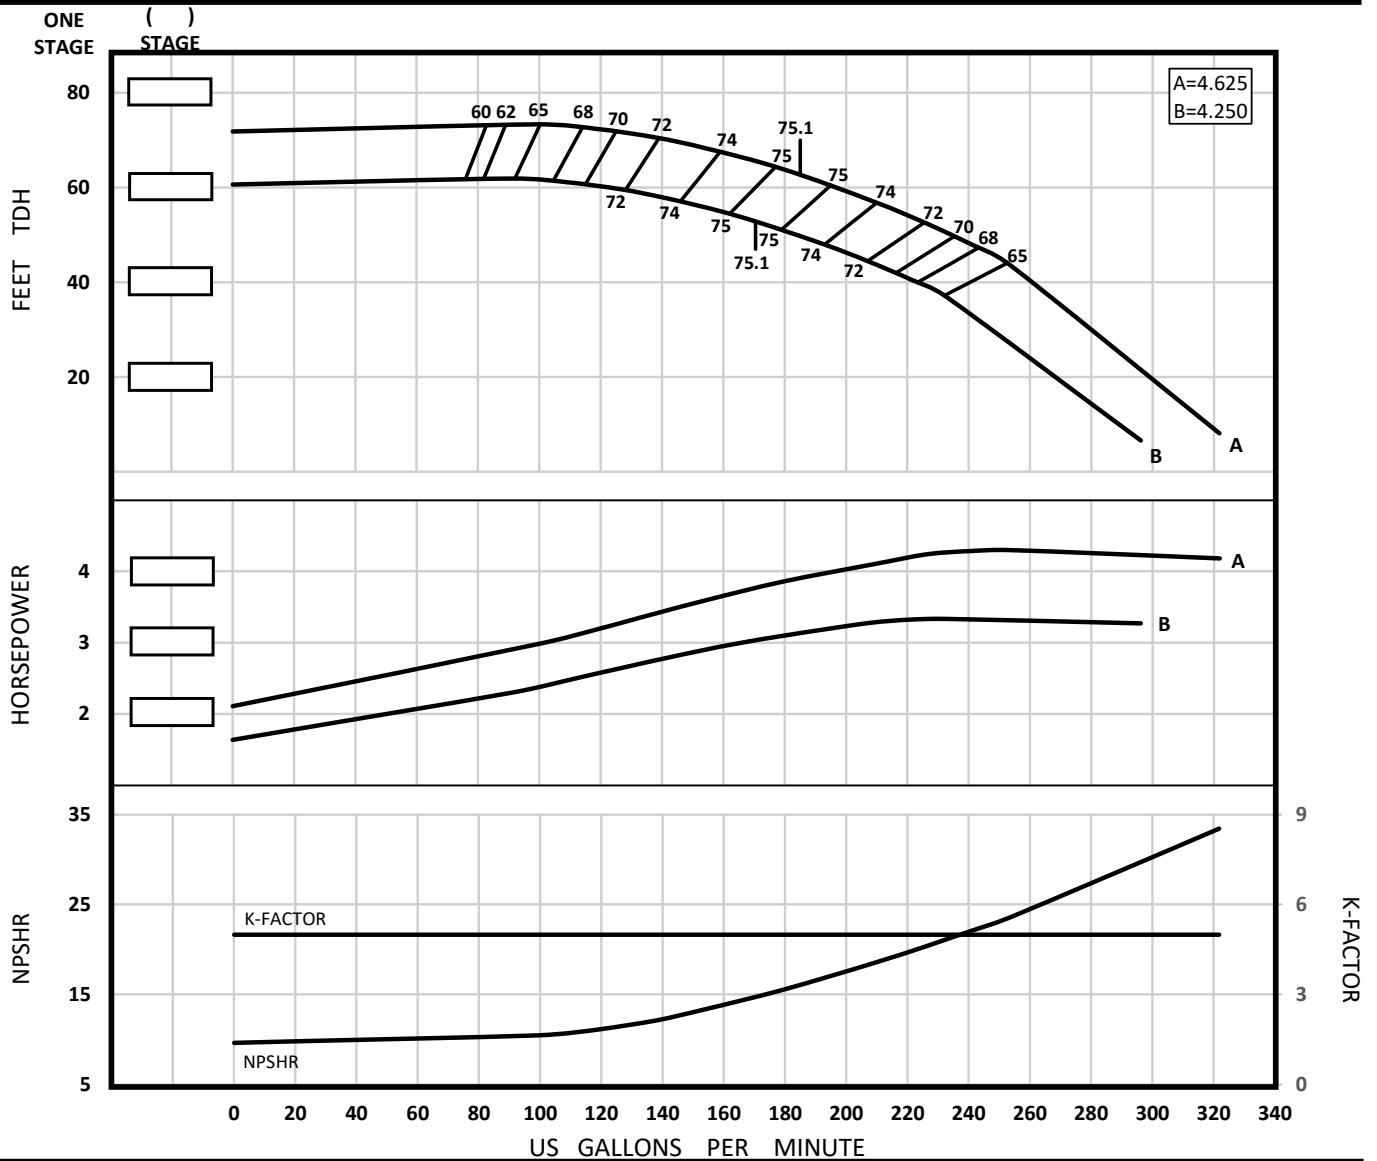

Impeller Type	Semi-Open	Bowl OD (in.)	6.00	PEI cl	N/A	Qty.	Eff.
Impeller Model	SP6MO	Thd'd Discharge Size	3" / 4"	Ns	2117	Stages	Change
One Stage Weight (lb)	53.00	Thd'd Suction Size	4"	Nss	6013	1	-5
Add'l Stage Wt. (lb)	18.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	1.000	2	-4
Impeller Wt. (lb)	1.40	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.56	3	-3
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	858	Setting (in)	.03	4	-1.5
One Stage Length (in)	~17.438	D.I. Bowl Rating (psi)	Δ1859	K-Factor (lb/ft tdh)	5.000	5	0
Add'l Stage Length (in)	4.813	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.018		


Δ Consult factory for availability

Rev. 2022.10.20

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

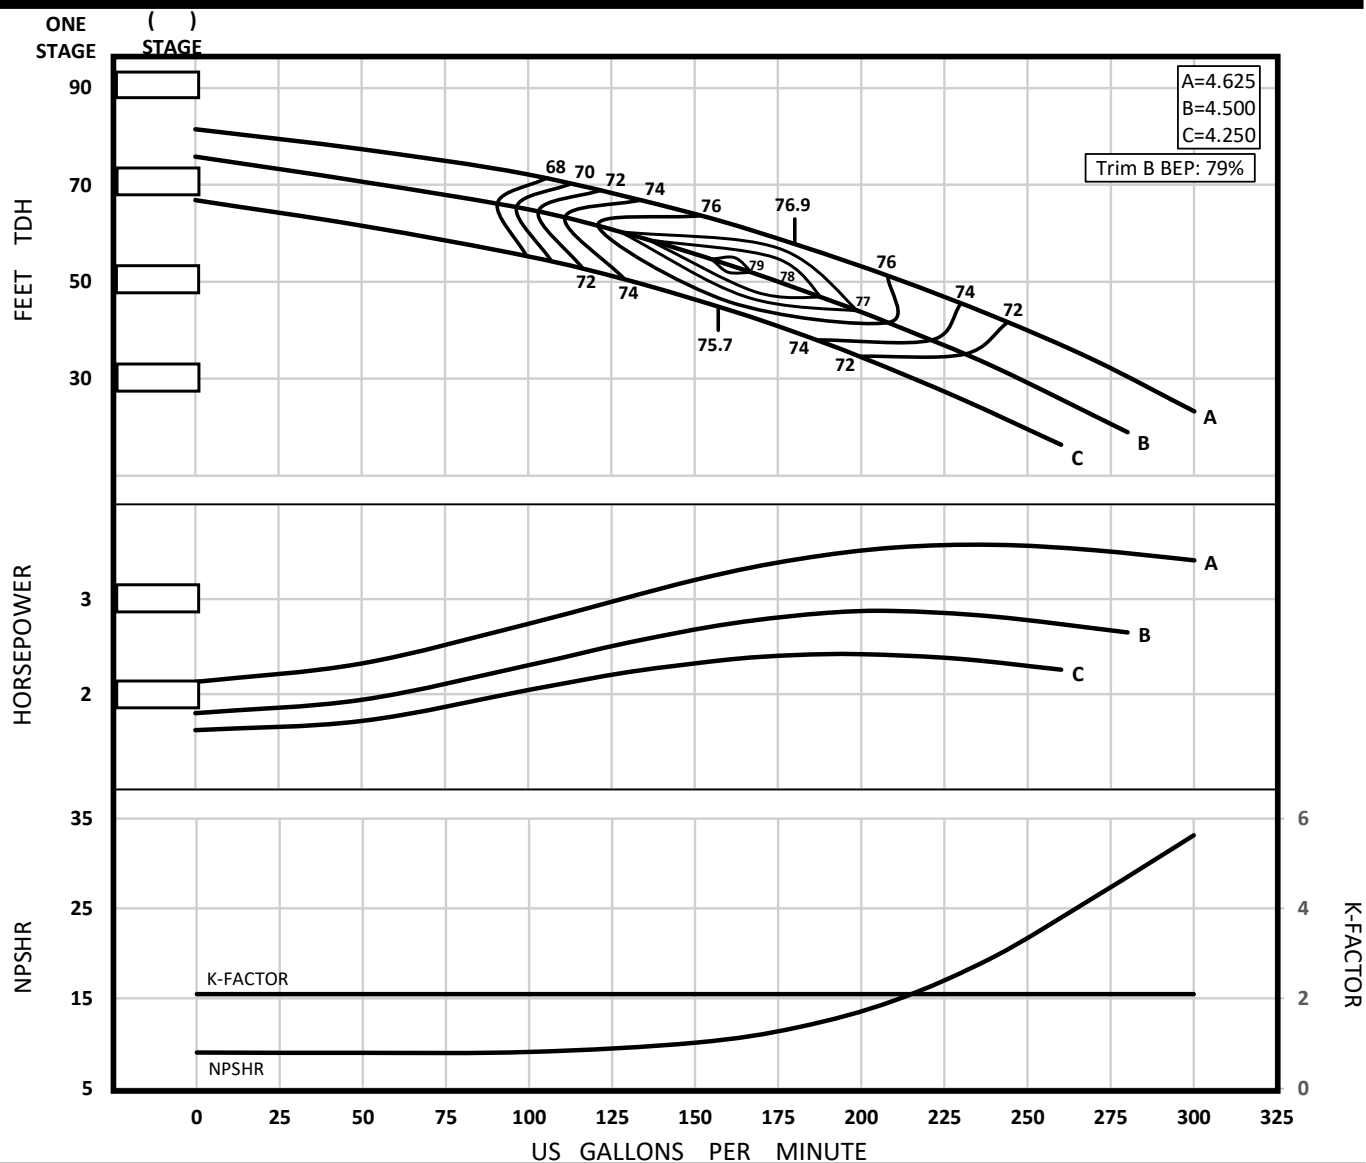

SM6M
3450 RPM

Impeller Type	Enclosed	Bowl OD (in.)	6.00	PEI cl	.884	Qty.	Eff.
Impeller Model	SM6M	Thd'd Discharge Size	3" / 4"	Ns	2208	Stages	Change
One Stage Weight (lb)	58.00	Thd'd Suction Size	4"	Nss	7260	1	-3
Add'l Stage Wt. (lb)	20.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	1.500	2	-2
Impeller Wt. (lb)	2.40	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	1.060	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	615	Setting (in)	.125		
One Stage Length (in)	~17.625	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	2.100		
Add'l Stage Length (in)	5.250	S.S. Bowl Rating (psi)	Δ1434	Imp. WR ² (lb-ft ²)	.039		

Δ Consult factory for availability


Rev. 2022.10.20

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.




SM6H 3450 RPM

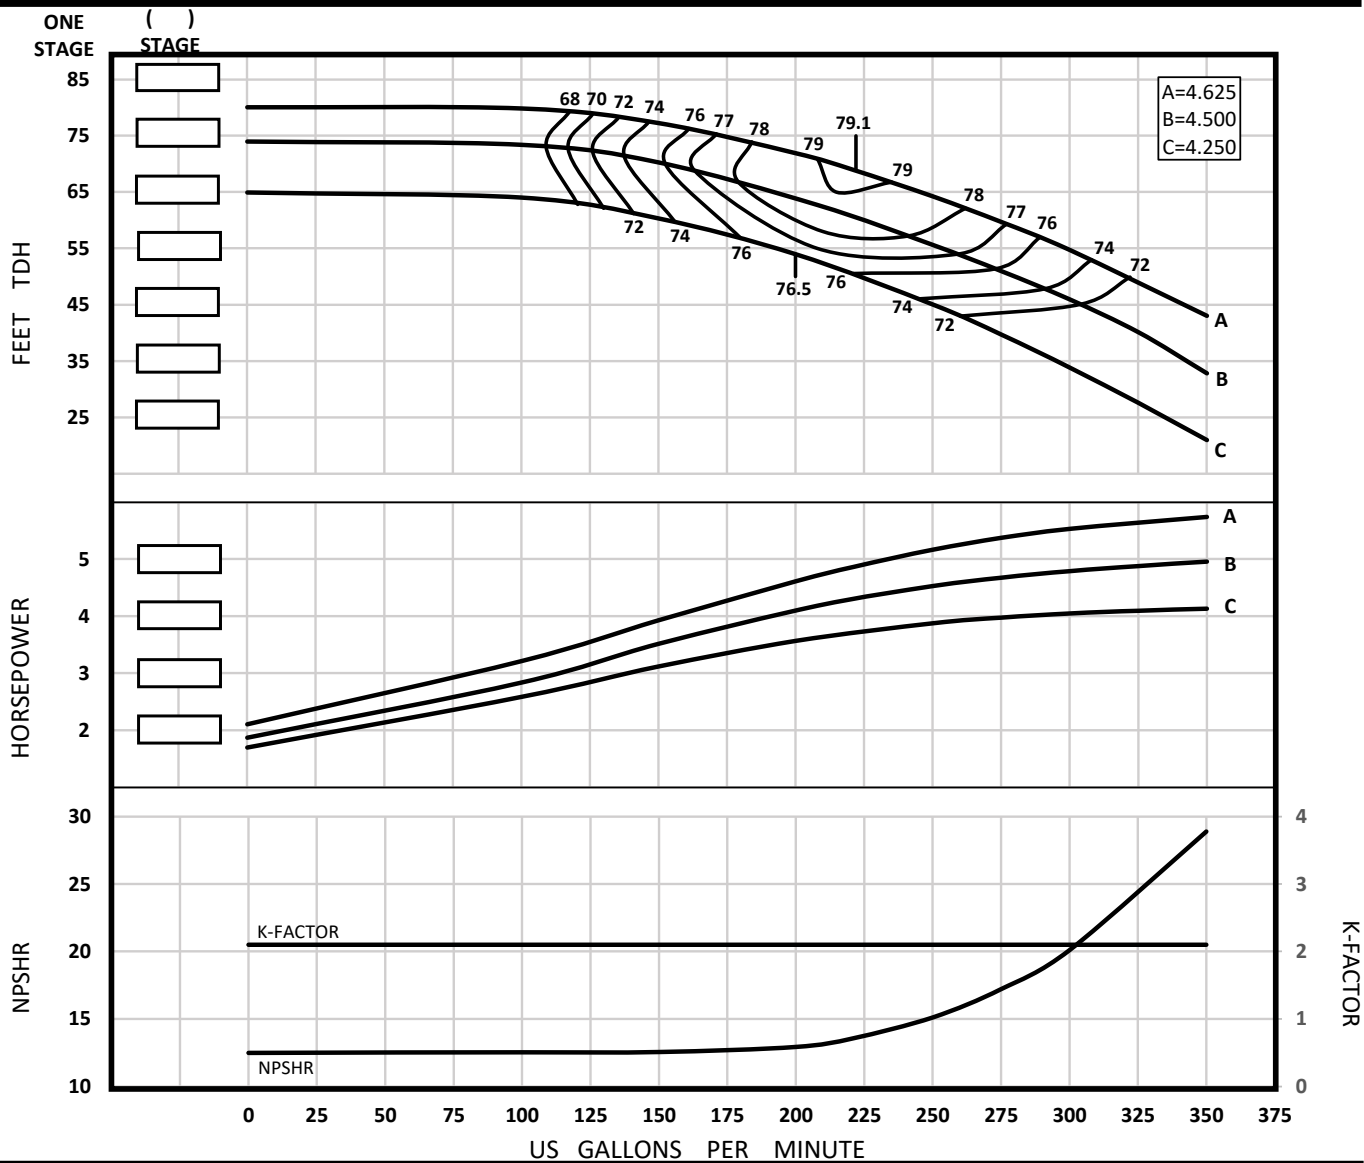

Impeller Type	Enclosed	Bowl OD (in.)	6.00	PEI cl	.882	Qty.	Eff.
Impeller Model	SM6H	Thd'd Discharge Size	3" / 4"	Ns	2152	Stages	Change
One Stage Weight (lb)	58.00	Thd'd Suction Size	4"	Nss	7267	1	-3
Add'l Stage Wt. (lb)	20.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	1.000	2	-2
Impeller Wt. (lb)	2.40	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.56	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	615	Setting (in)	.125	4	0
One Stage Length (in)	~17.625	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	2.100	5	0
Add'l Stage Length (in)	5.250	S.S. Bowl Rating (psi)	Δ1434	Imp. WR ² (lb-ft ²)	.039		

Δ Consult factory for availability
Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.
Weights and lengths listed are approximate and subject to change. Consult factory.

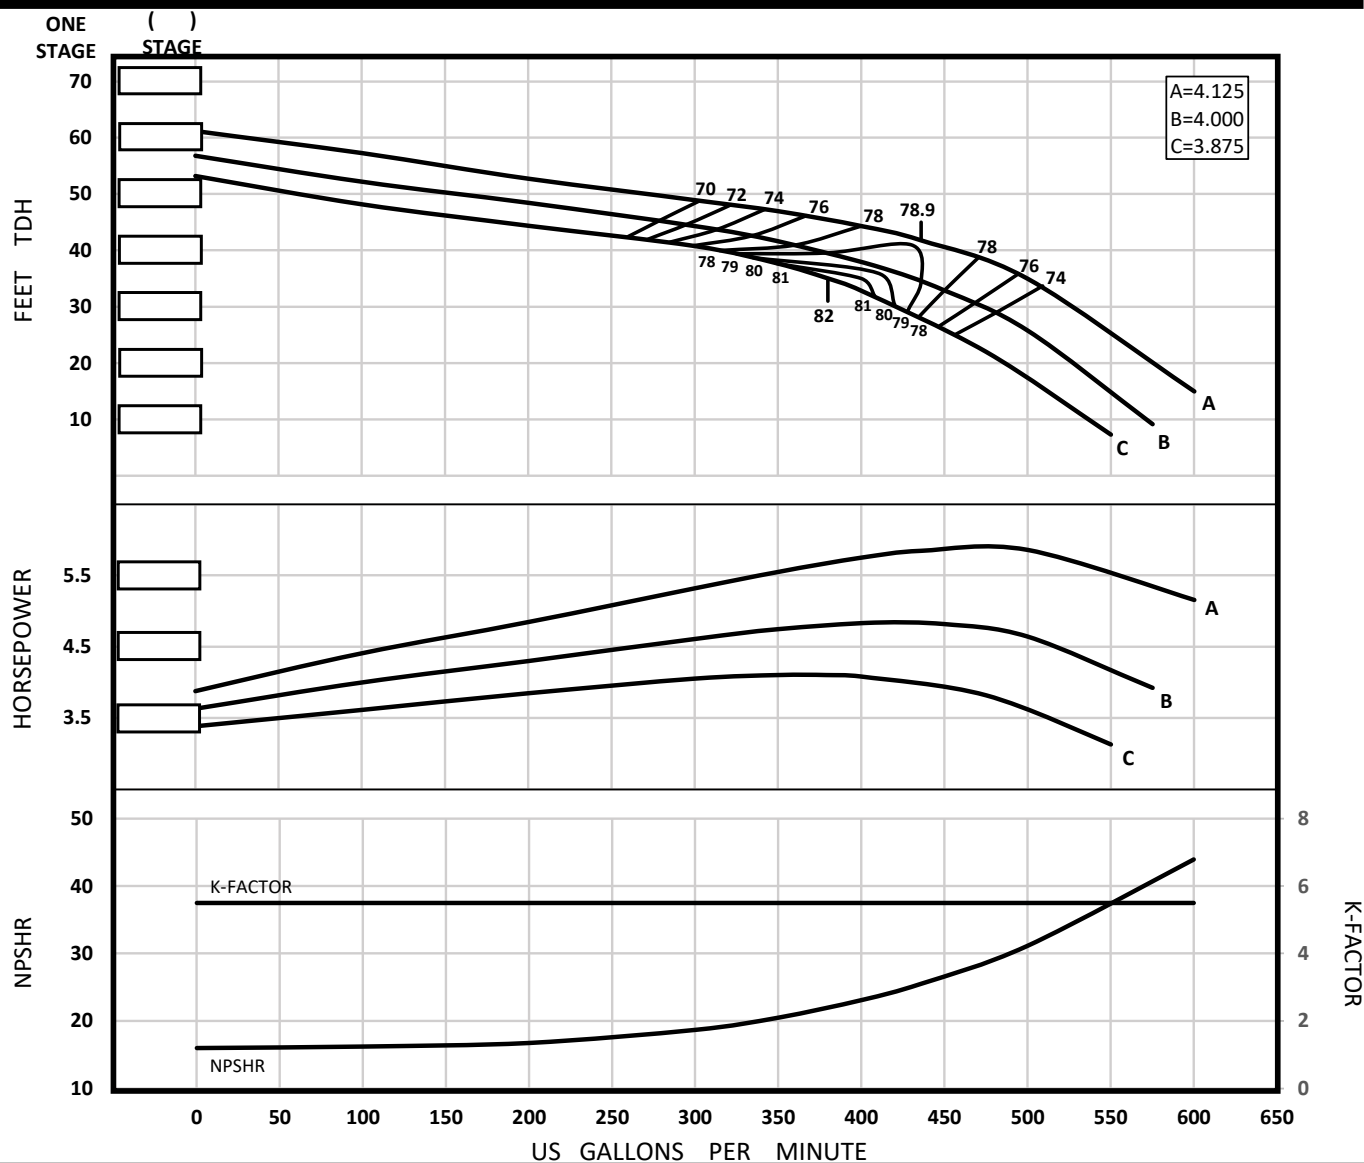SK6HH
3450 RPM

Impeller Type	Enclosed	Bowl OD (in.)	5.50	PEI cl	.905	Qty.	Eff.
Impeller Model	SK6HH	Thd'd Discharge Size	3" / 4"	Ns	4383	Stages	Change
One Stage Weight (lb)	51.00	Thd'd Suction Size	4"	Nss	6342	1	-2
Add'l Stage Wt. (lb)	16.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	1.000	2	-1.5
Impeller Wt. (lb)	2.90	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.50	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	521	Setting (in)	.125	4	0
One Stage Length (in)	~18.125	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	5.500	5	0
Add'l Stage Length (in)	5.500	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.031		

Δ Consult factory for availability


Rev. 2022.10.20

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SP7L 3450 RPM

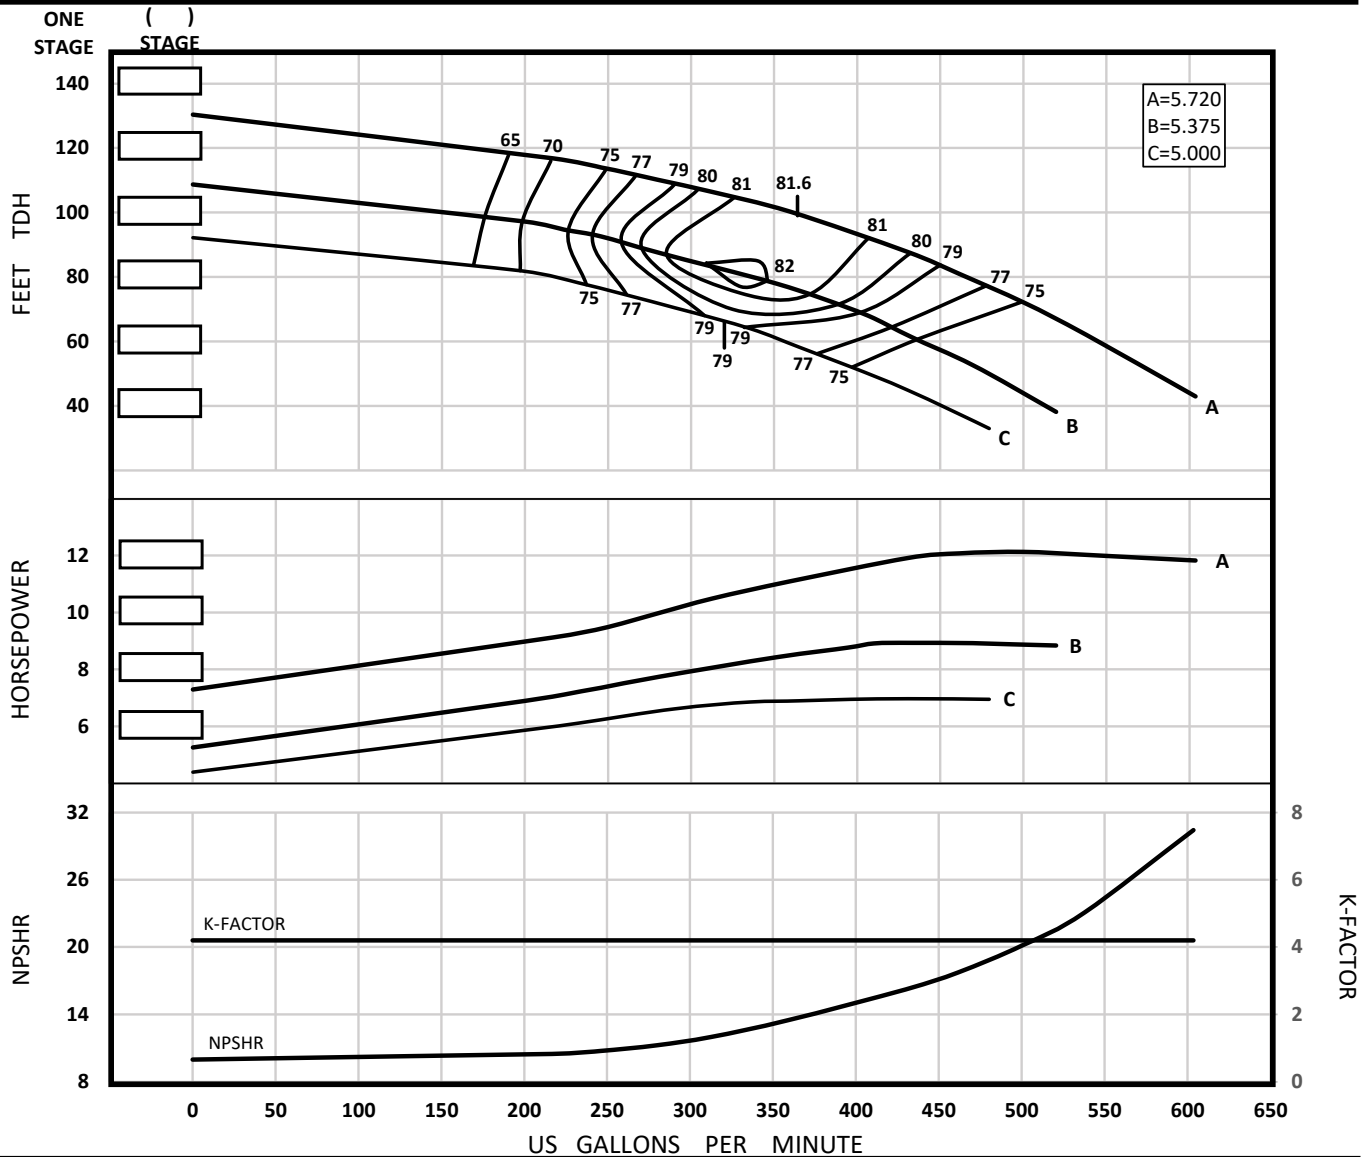

Impeller Type	Enclosed	Bowl OD (in.)	7.19	PEI cl	N/A	Qty.	Eff.
Impeller Model	SP7L	Thd'd Discharge Size	4" / 5" / 6"	Ns	3646	Stages	Change
One Stage Weight (lb)	100.00	Thd'd Suction Size	5"	Nss	6004	1	-4
Add'l Stage Wt. (lb)	34.00	Bell Suction Size	9.38" / 8"	Shaft Size (in.)	1.25	2	-2
Impeller Wt. (lb)	4.05	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.63	3	0
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	378	Setting (in)	.125	4	0
One Stage Length (in)	~19.625	D.I. Bowl Rating (psi)	Δ820	K-Factor (lb/ft tdh)	4.200	5	0
Add'l Stage Length (in)	6.375	S.S. Bowl Rating (psi)	Δ883	Imp. WR ² (lb-ft ²)	.073		

Δ Consult factory for availability

Rev. 2022.10.24


Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SP7H

3450 RPM

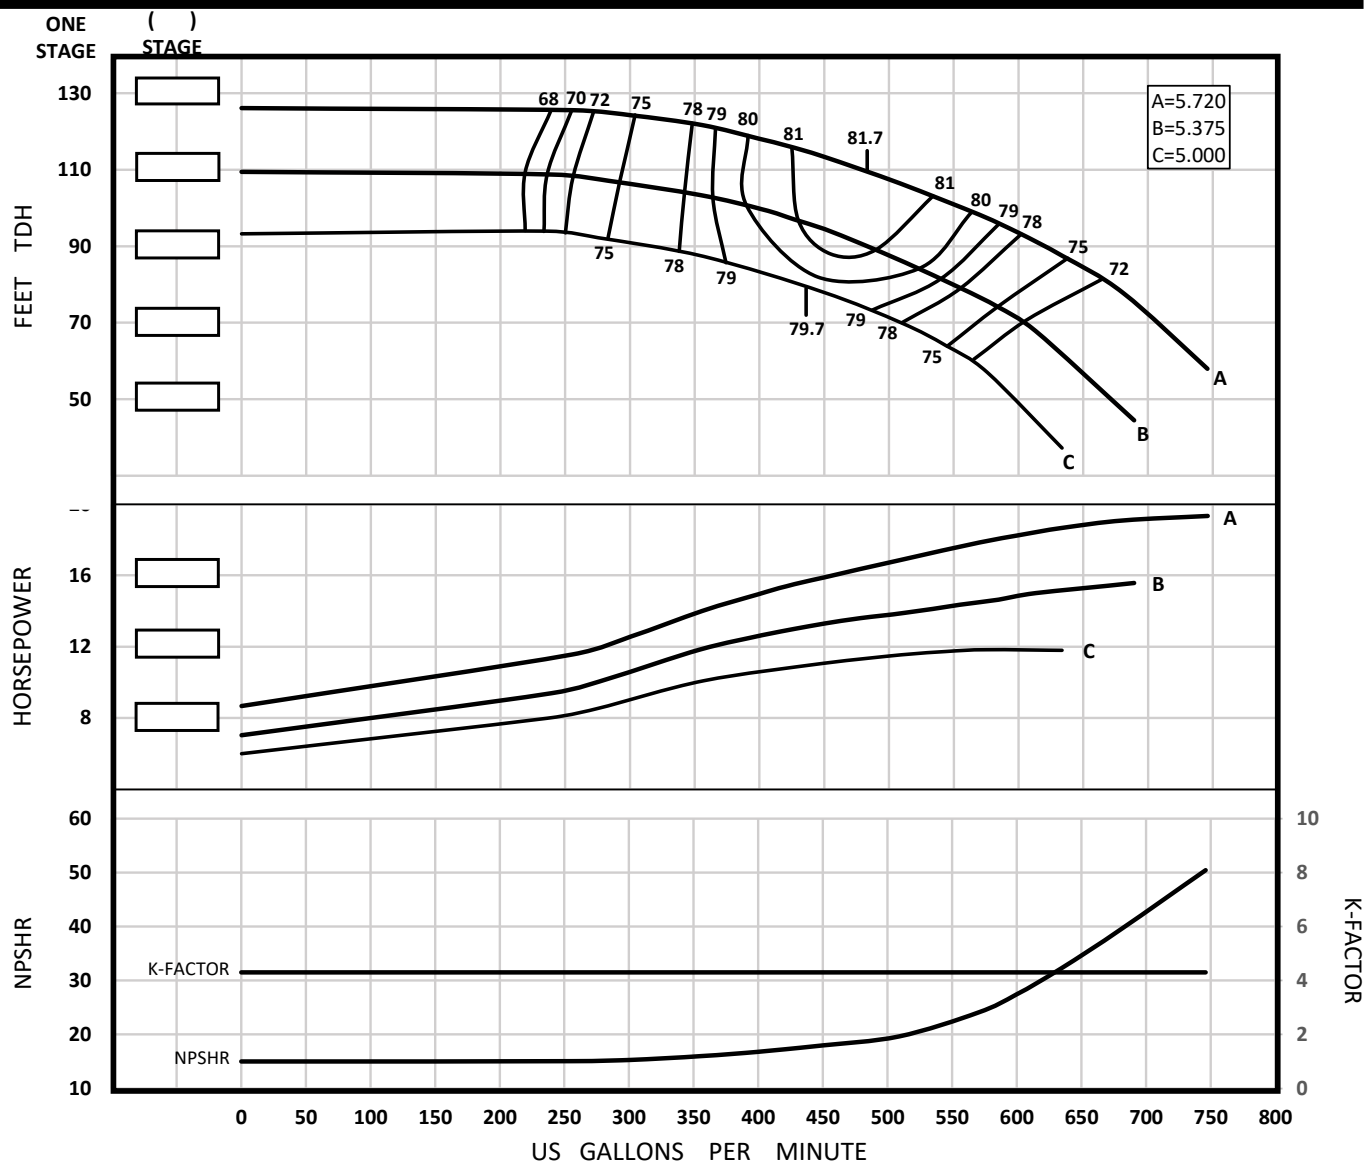

Impeller Type	Enclosed	Bowl OD (in.)	7.19	PEI cl	N/A	Qty.	Eff.
Impeller Model	SP7H	Thd'd Discharge Size	4" / 5" / 6"	Ns	2106	Stages	Change
One Stage Weight (lb)	100.00	Thd'd Suction Size	5"	Nss	8269	1	-3
Add'l Stage Wt. (lb)	34.00	Bell Suction Size	9.38" / 8"	Shaft Size (in.)	1.25	2	-1
Impeller Wt. (lb)	4.00	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.63	3	0
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	378	Setting (in)	.125	4	0
One Stage Length (in)	~19.625	D.I. Bowl Rating (psi)	Δ820	K-Factor (lb/ft tdh)	4.300	5	0
Add'l Stage Length (in)	6.375	S.S. Bowl Rating (psi)	Δ883	Imp. WR ² (lb-ft ²)	.072		

Δ Consult factory for availability


Rev. 2022.10.24

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.




SK7L 3450 RPM

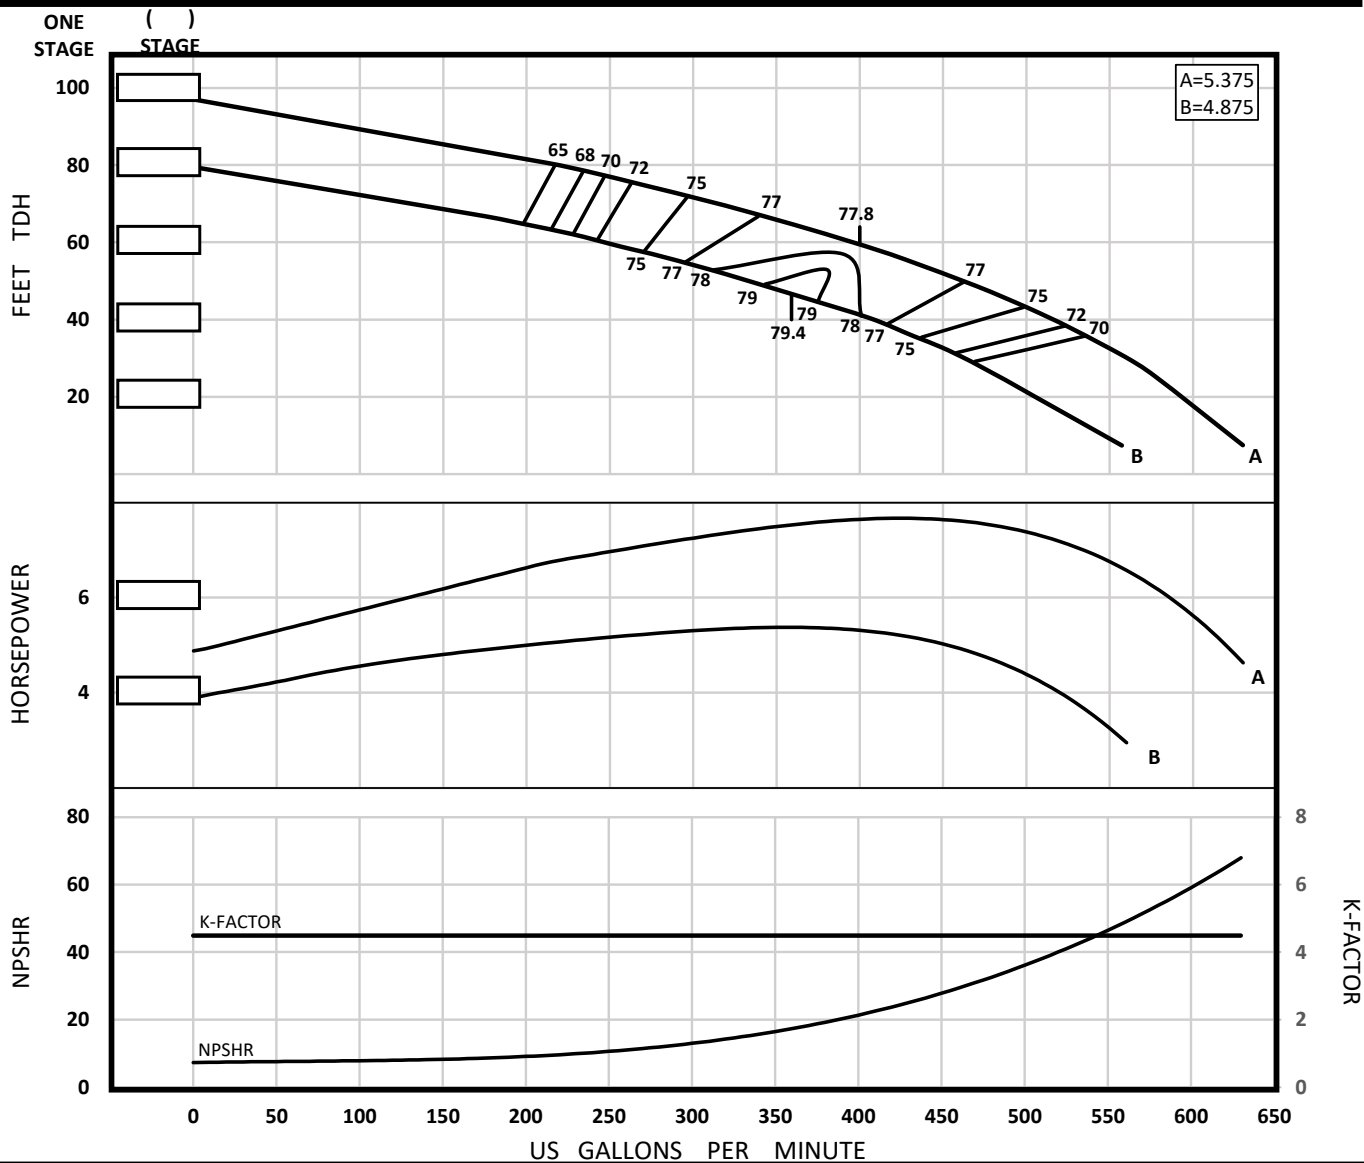

Impeller Type	Enclosed	Bowl OD (in.)	6.56	PEI cl	N/A	Qty.	Eff.
Impeller Model	SK7L	Thd'd Discharge Size	4" / 5" / 6"	Ns	3236	Stages	Change
One Stage Weight (lb)	61.00	Thd'd Suction Size	5"	Nss	6900	1	-3.5
Add'l Stage Wt. (lb)	22.00	Bell Suction Size	9.38" / 8"	Shaft Size (in.)	1.000	2	-2
Impeller Wt. (lb)	3.35	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	0.94	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	515	Setting (in)	.125	4	-0.5
One Stage Length (in)	~16.00	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	4.490	5	0
Add'l Stage Length (in)	6.375	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.051		

Δ Consult factory for availability
Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.
Weights and lengths listed are approximate and subject to change. Consult factory.

SK7M 3450 RPM

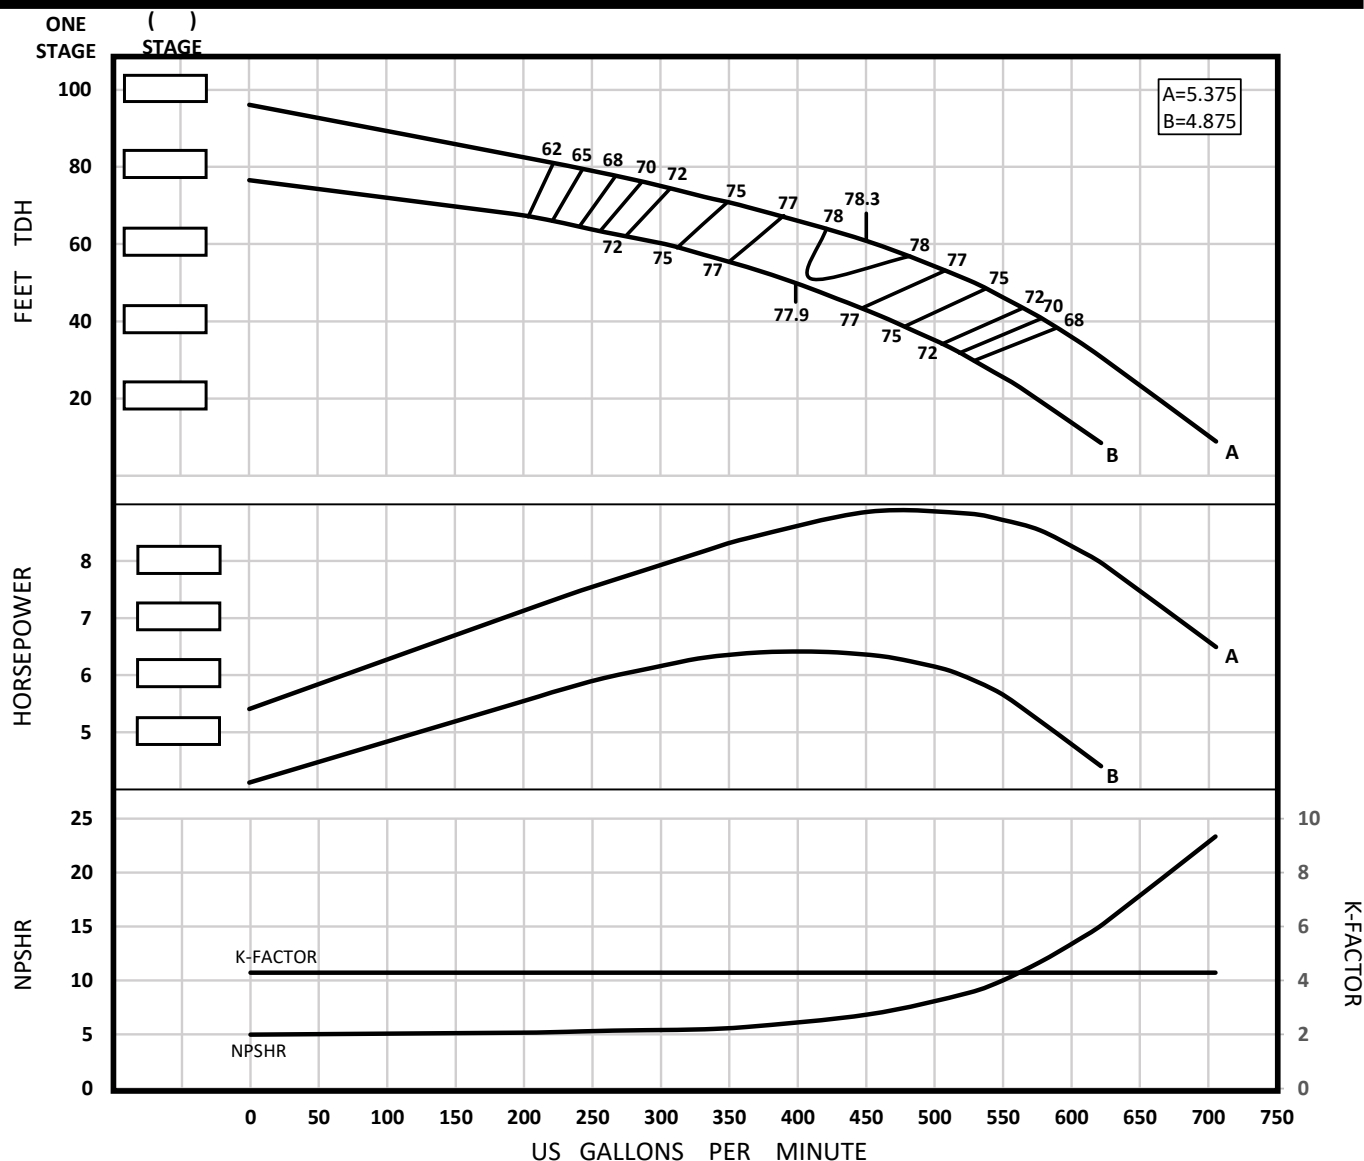

Impeller Type	Enclosed	Bowl OD (in.)	6.56	PEI cl	N/A	Qty.	Eff.
Impeller Model	SK7M	Thd'd Discharge Size	4" / 5" / 6"	Ns	3364	Stages	Change
One Stage Weight (lb)	59.00	Thd'd Suction Size	5"	Nss	17300	1	-3.5
Add'l Stage Wt. (lb)	20.00	Bell Suction Size	8" / 9.38"	Shaft Size (in.)	1.00	2	-2
Impeller Wt. (lb)	2.90	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.94	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	515	Setting (in)	.125	4	-0.5
One Stage Length (in)	~16.00	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	4.290	5	0
Add'l Stage Length (in)	6.375	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.046		

Δ Consult factory for availability


Rev. 2022.10.25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.




SK7H
3450 RPM

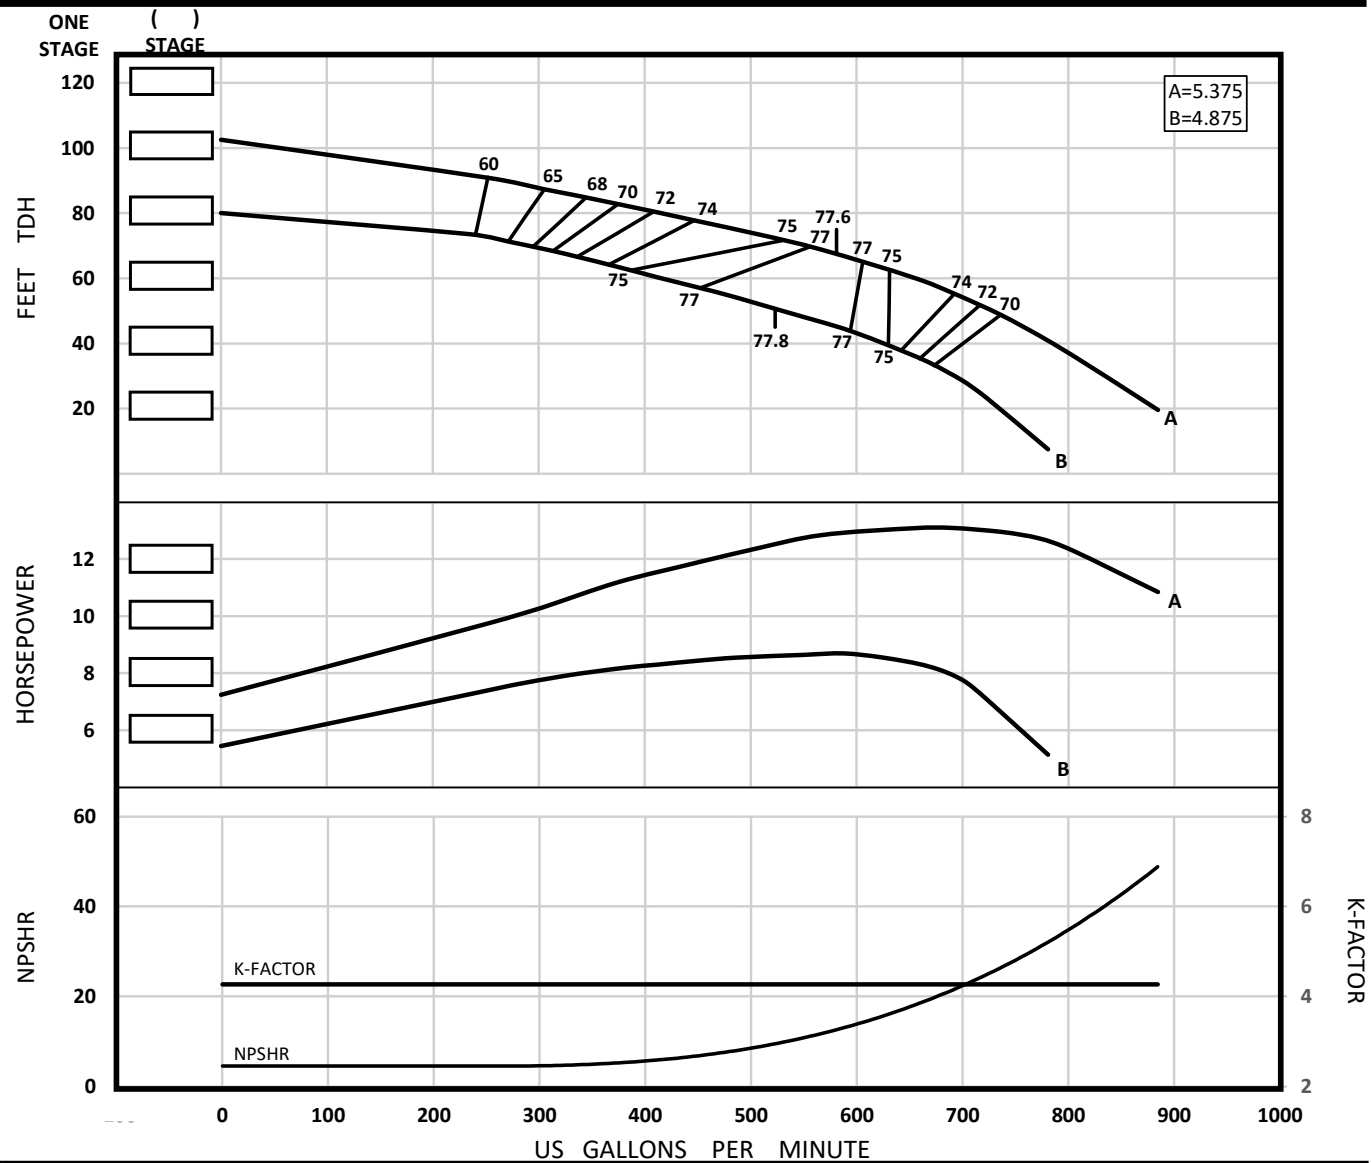

Impeller Type	Enclosed	Bowl OD (in.)	6.56	PEI cl	N/A	Qty.	Eff.
Impeller Model	SK7H	Thd'd Discharge Size	4" / 5" / 6"	Ns	3519	Stages	Change
One Stage Weight (lb)	60.00	Thd'd Suction Size	5"	Nss	14210	1	-3.5
Add'l Stage Wt. (lb)	21.00	Bell Suction Size	9.38" / 8"	Shaft Size (in.)	1.000	2	-2
Impeller Wt. (lb)	3.25	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.75	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	515	Setting (in)	.125	4	-0.5
One Stage Length (in)	~16.00	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	4.270	5	0
Add'l Stage Length (in)	6.375	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.050		

Δ Consult factory for availability
Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.
Weights and lengths listed are approximate and subject to change. Consult factory.

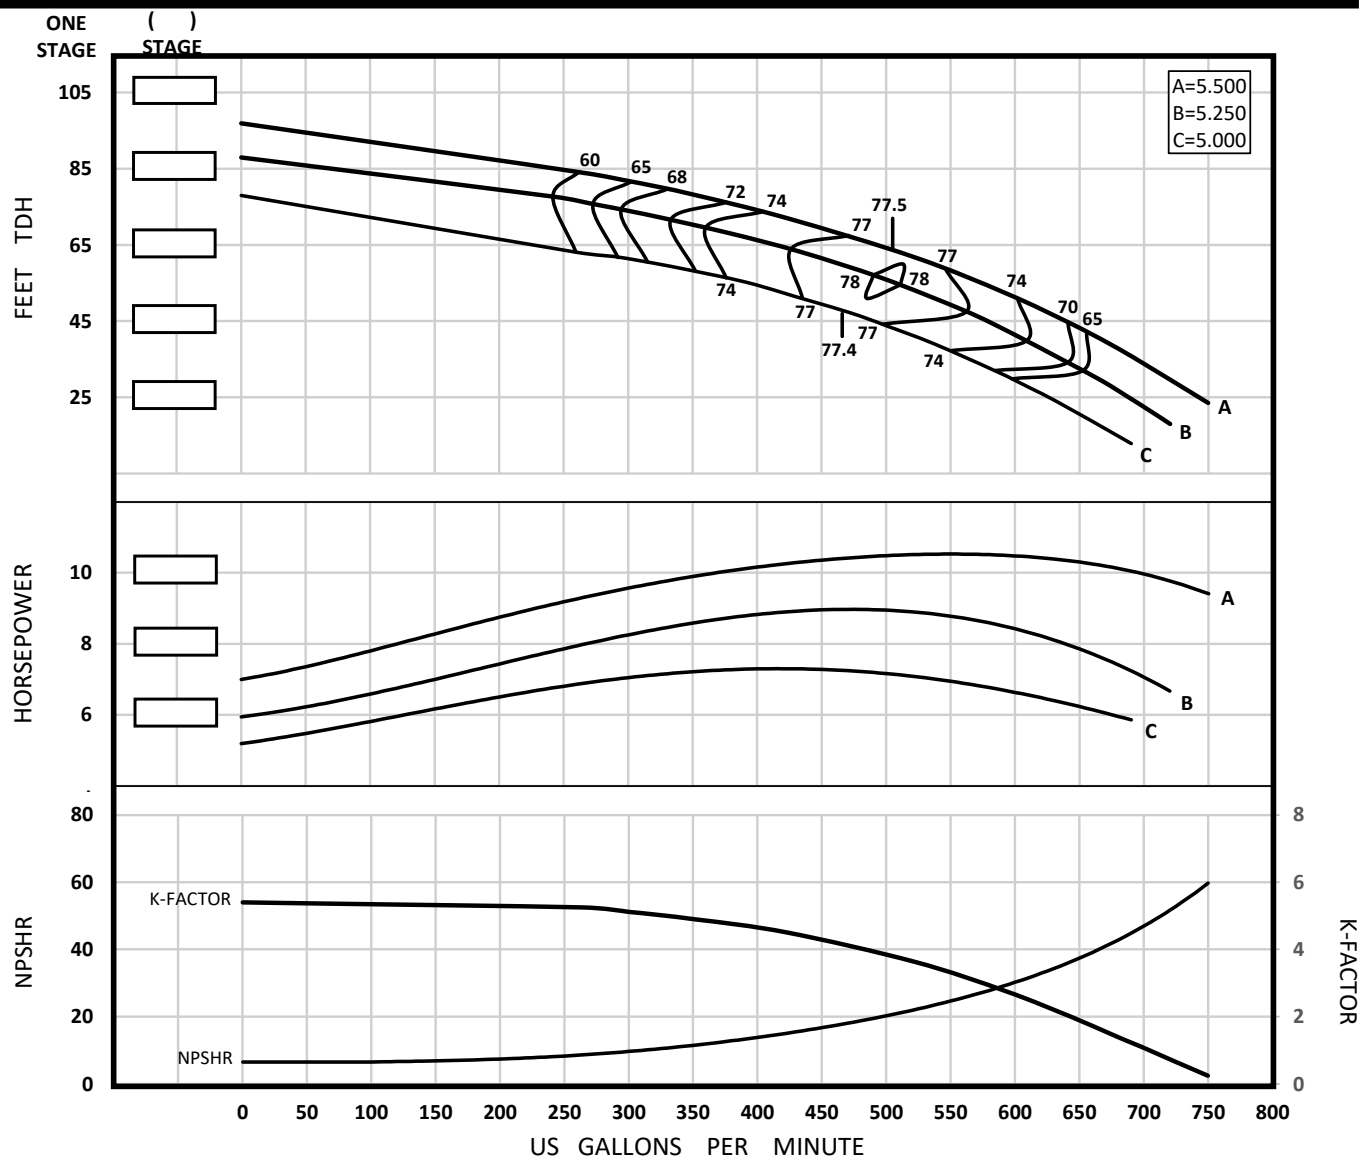SM7M
3450 RPM

Impeller Type	Enclosed	Bowl OD (in.)	7.00	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM7M	Thd'd Discharge Size	4" / 5" / 6"	Ns	3468	Stages	Change
One Stage Weight (lb)	100.00	Thd'd Suction Size	5"	Nss	7539	1	-3
Add'l Stage Wt. (lb)	40.00	Bell Suction Size	9.38" / 8"	Shaft Size (in.)	1.25	2	-2
Impeller Wt. (lb)	6.20	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.94	3	-1
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	536	Setting (in)	.125	4	0
One Stage Length (in)	~20.25	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	7.00	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.100		

Δ Consult factory for availability


Rev. 2022.10.25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SP8L
3450 RPM

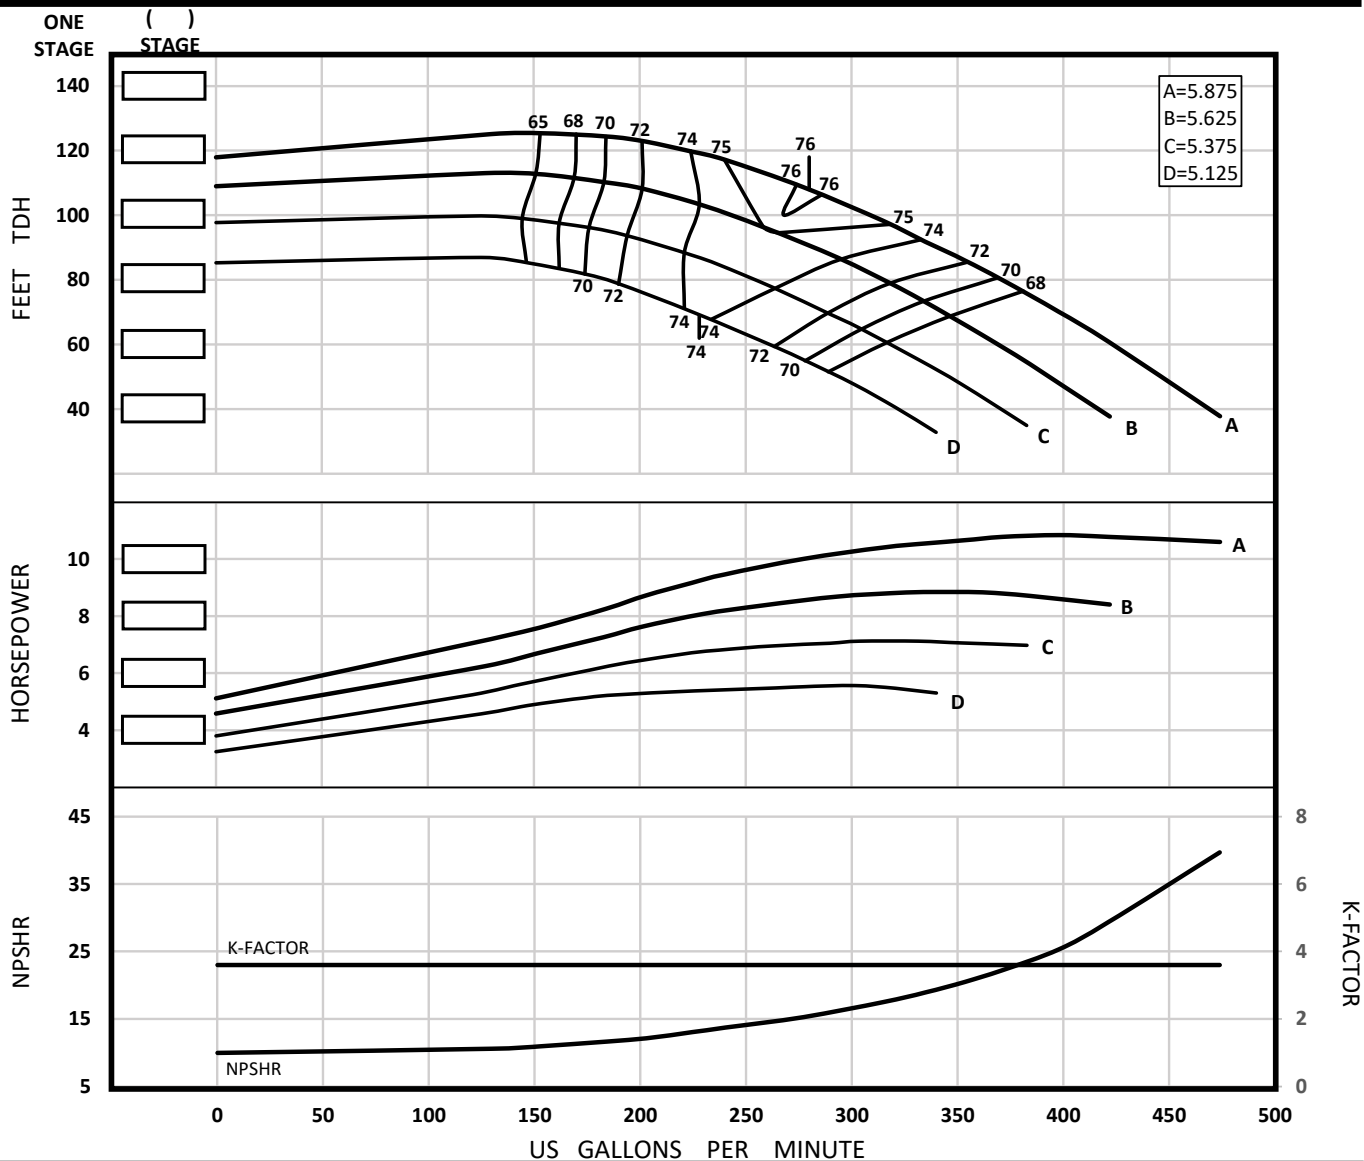


Impeller Type	Enclosed	Bowl OD (in.)	7.88	PEI cl	N/A	Qty.	Eff.
Impeller Model	SP8L	Thd'd Discharge Size	4" / 5" / 6"	Ns	1723	Stages	Change
One Stage Weight (lb)	122.00	Thd'd Suction Size	5"	Nss	7462	1	-4
Add'l Stage Wt. (lb)	40.00	Bell Suction Size	9.38" / 8"	Shaft Size (in.)	1.25	2	-3
Impeller Wt. (lb)	5.40	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.88	3	-2
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	679	Setting (in)	.125	4	-1
One Stage Length (in)	~20.188	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	3.600	5	0
Add'l Stage Length (in)	6.375	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.108		

Δ Consult factory for availability

Rev. 2022.10.25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

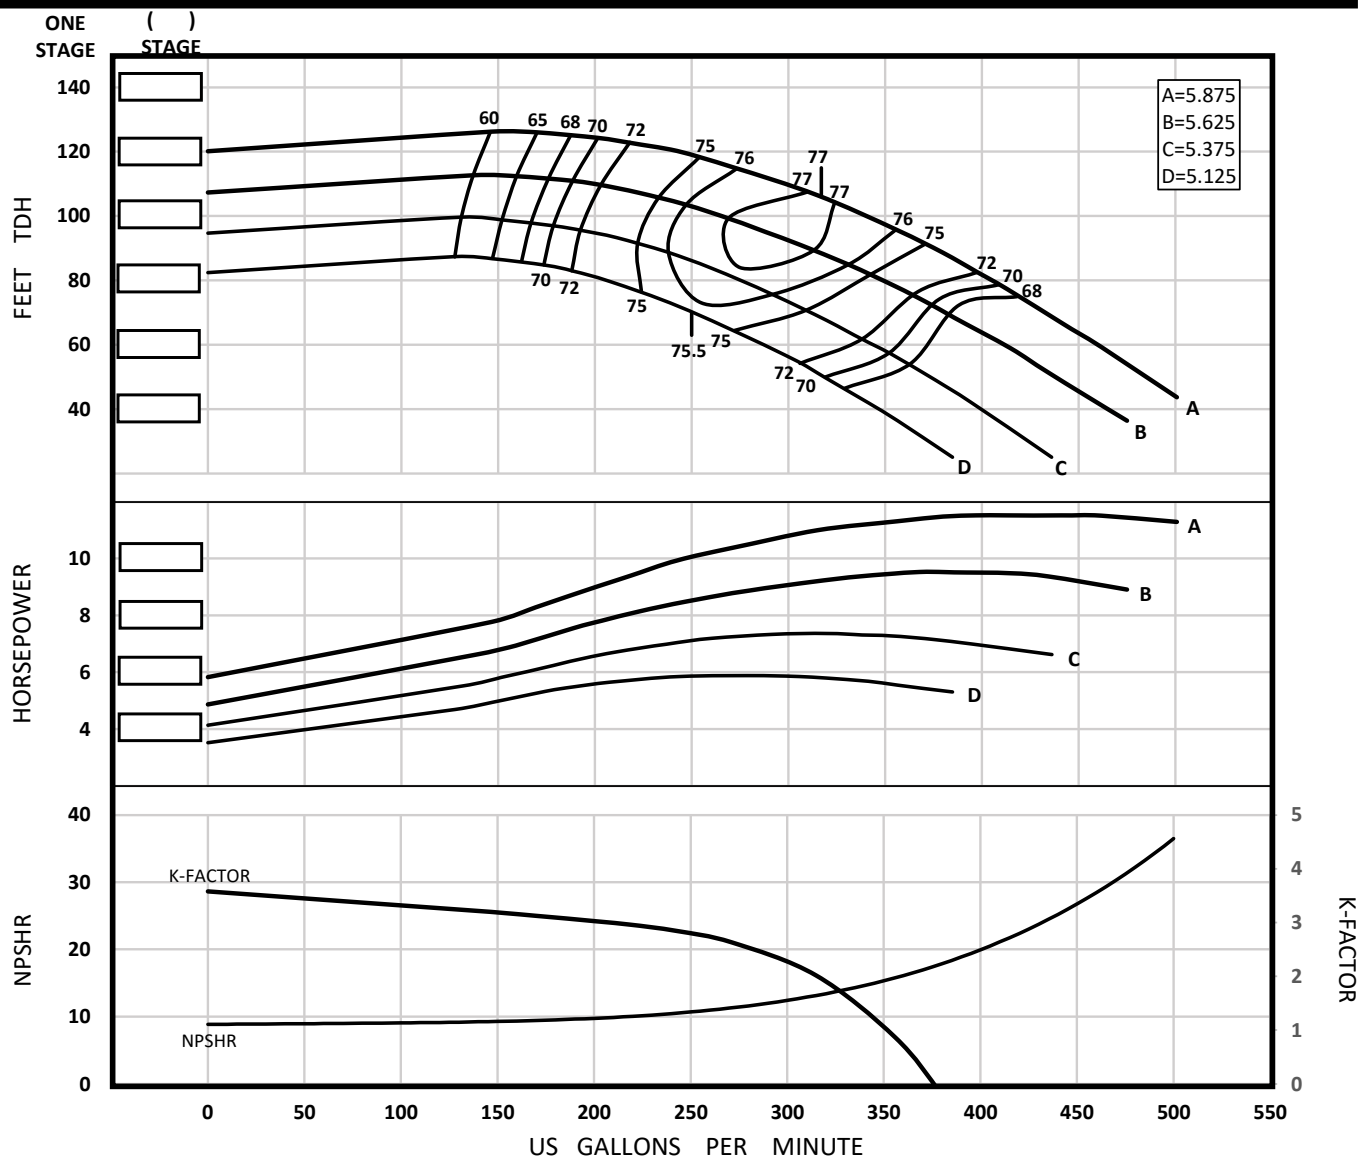SP8M
3450 RPM

Impeller Type	Enclosed	Bowl OD (in.)	7.88	PEI cl	N/A	Qty.	Eff.
Impeller Model	SP8M	Thd'd Discharge Size	4" / 5" / 6"	Ns	1860	Stages	Change
One Stage Weight (lb)	100.00	Thd'd Suction Size	5"	Nss	9014	1	-4
Add'l Stage Wt. (lb)	40.00	Bell Suction Size	9.38" / 8"	Shaft Size (in.)	1.25	2	-3
Impeller Wt. (lb)	5.15	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.75	3	-2
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	679	Setting (in)	.125	4	-1
One Stage Length (in)	~20.188	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	6.375	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.105		

Δ Consult factory for availability


Rev. 2022.10.25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SP8H 3450 RPM

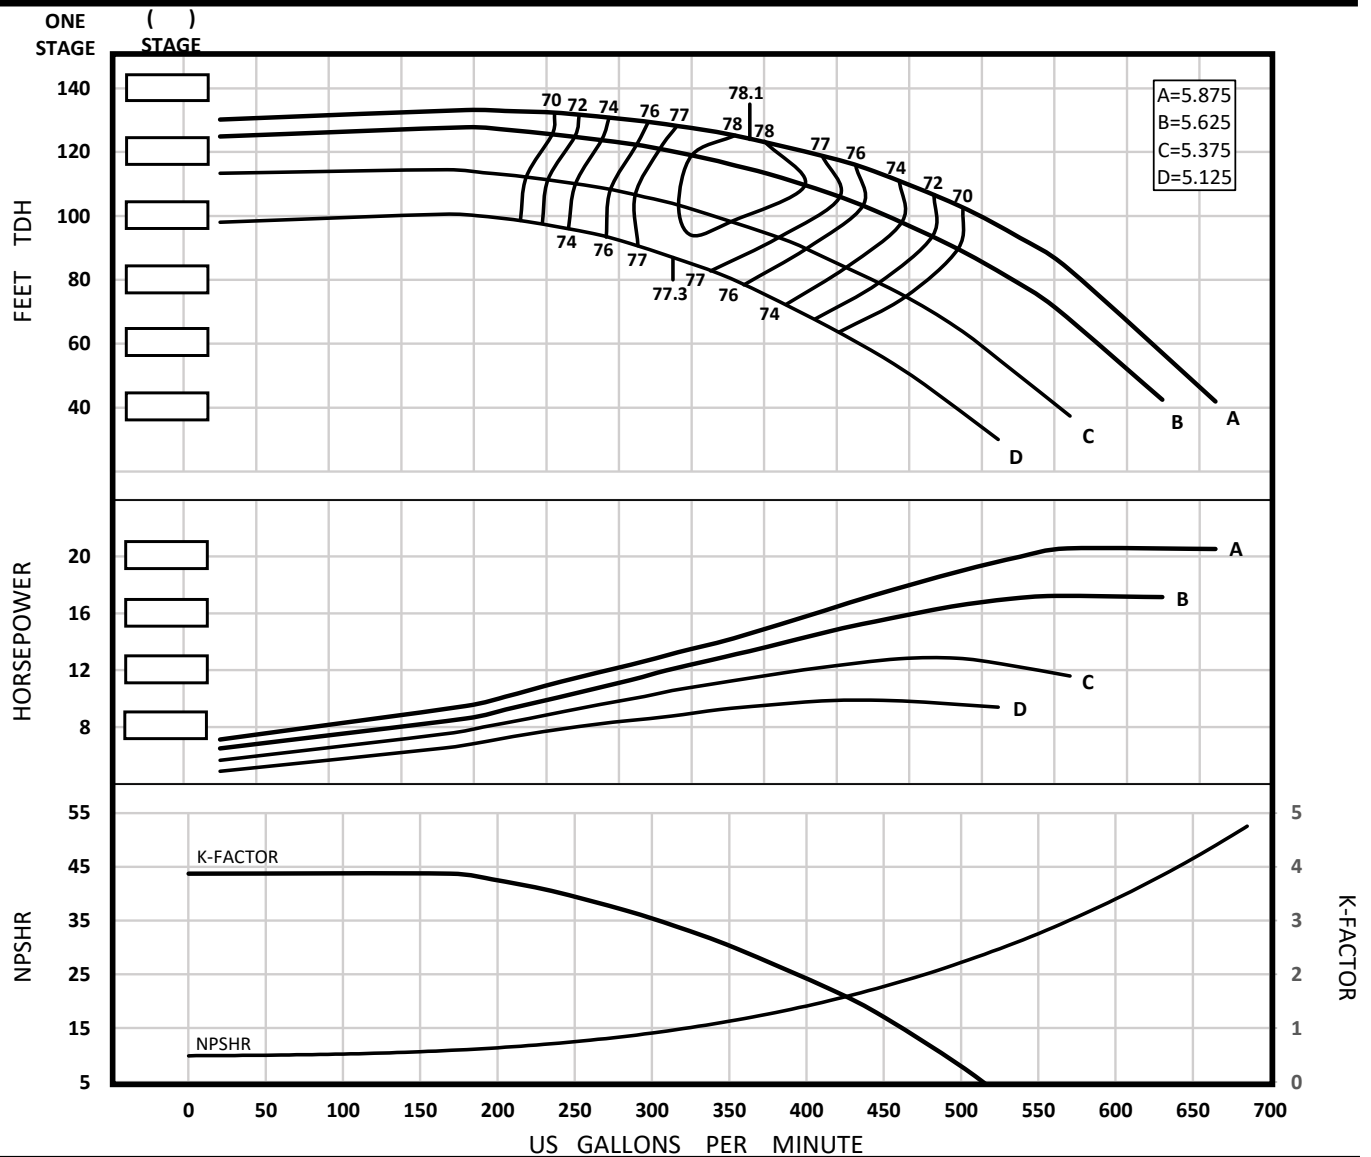

Impeller Type	Enclosed	Bowl OD (in.)	7.88	PEI cl	N/A	Qty.	Eff.
Impeller Model	SP8H	Thd'd Discharge Size	4" / 5" / 6"	Ns	1770	Stages	Change
One Stage Weight (lb)	100.00	Thd'd Suction Size	5"	Nss	7852	1	-4
Add'l Stage Wt. (lb)	40.00	Bell Suction Size	9.38" / 8"	Shaft Size (in.)	1.25	2	-3
Impeller Wt. (lb)	5.20	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.88	3	-2
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	679	Setting (in)	.125	4	-1
One Stage Length (in)	~20.188	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdk)	CURVE	5	0
Add'l Stage Length (in)	6.375	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.105		


Δ Consult factory for availability

Rev. 2022.10.25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

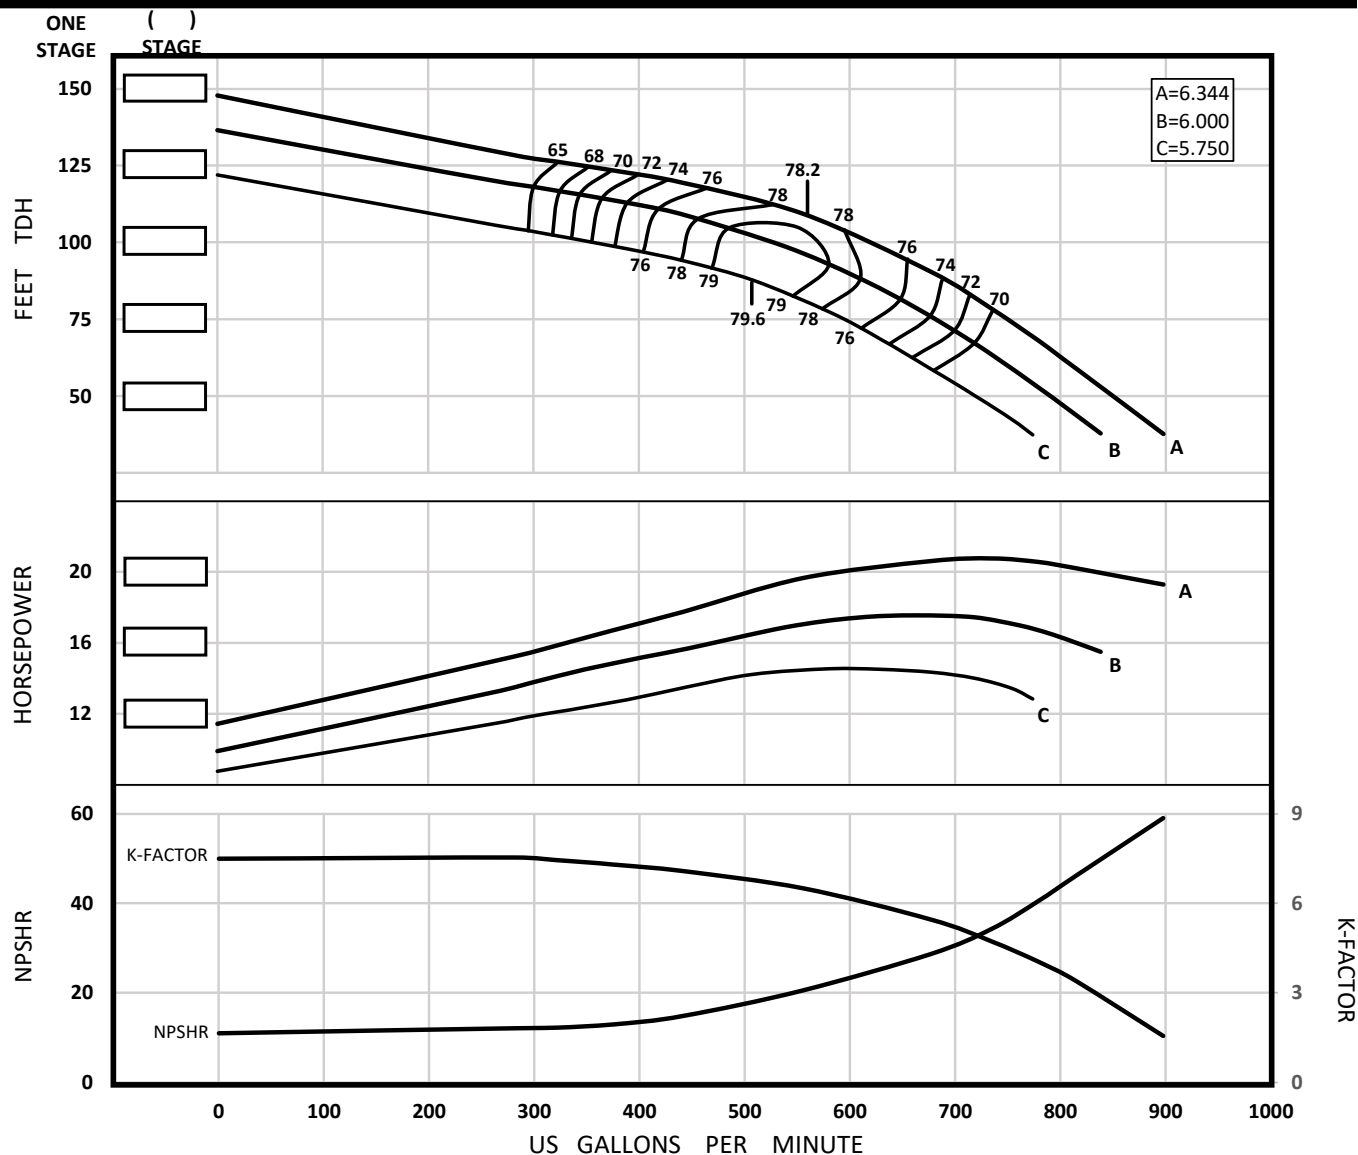

SM8H
3450 RPM

Impeller Type	Enclosed	Bowl OD (in.)	7.69	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM8H	Thd'd Discharge Size	4" / 5" / 6"	Ns	2425	Stages	Change
One Stage Weight (lb)	100.00	Thd'd Suction Size	5"	Nss	8449	1	-4
Add'l Stage Wt. (lb)	40.00	Bell Suction Size	9.38" / 8"	Shaft Size (in.)	1.25	2	-3
Impeller Wt. (lb)	7.30	Sub. Mtr. Size	6" / 8"	Lateral (in)	.58	3	-2
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	376	Setting (in)	.125	4	-1
One Stage Length (in)	~19.813	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	6.000	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.158		

Δ Consult factory for availability


Rev. 2022.10.25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SK8H
3450 RPM

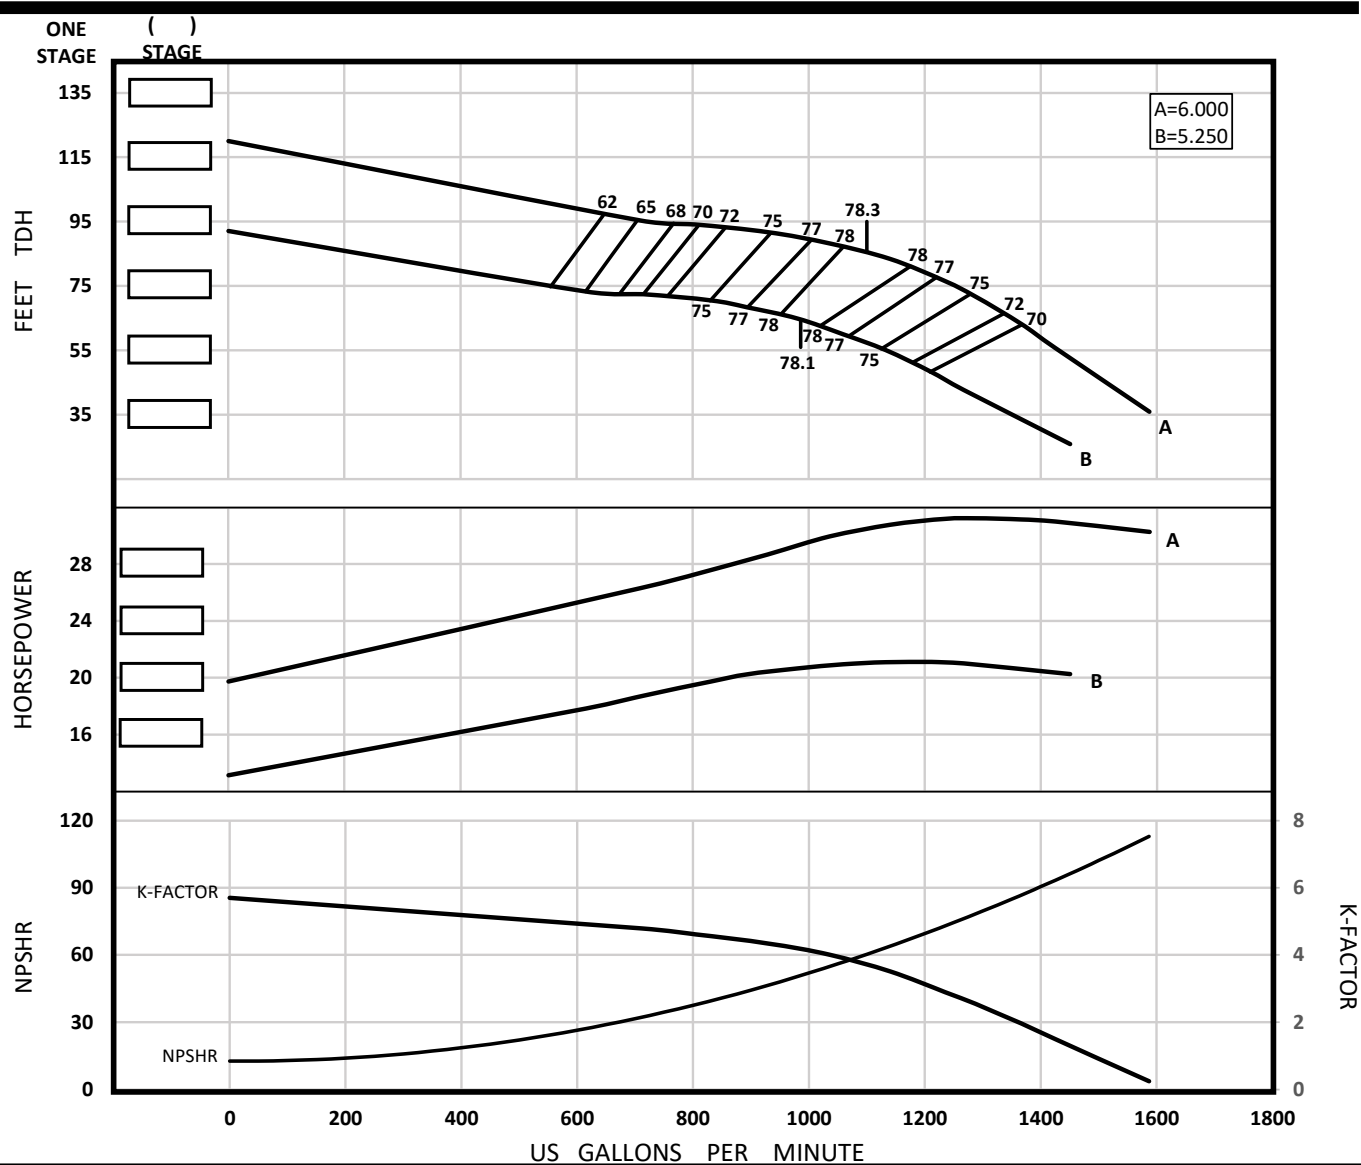


Impeller Type	Enclosed	Bowl OD (in.)	7.50	PEI cl	N/A	Qty.	Eff. Change
Impeller Model	SK8H	Thd'd Discharge Size	6"	Ns	4128	Stages	
One Stage Weight (lb)	180.00	Thd'd Suction Size	6"	Nss	4983	1	-4
Add'l Stage Wt. (lb)	60.00	Bell Suction Size	N/A	Shaft Size (in.)	1.50	2	-3
Impeller Wt. (lb)	6.60	Sub. Mtr. Size	6" / 8"	Lateral (in)	1.00	3	-2
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	652	Setting (in)	.125	4	-1
One Stage Length (in)	~25.25	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	9.000	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.133		

Δ Consult factory for availability

Rev. 2022.10.25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

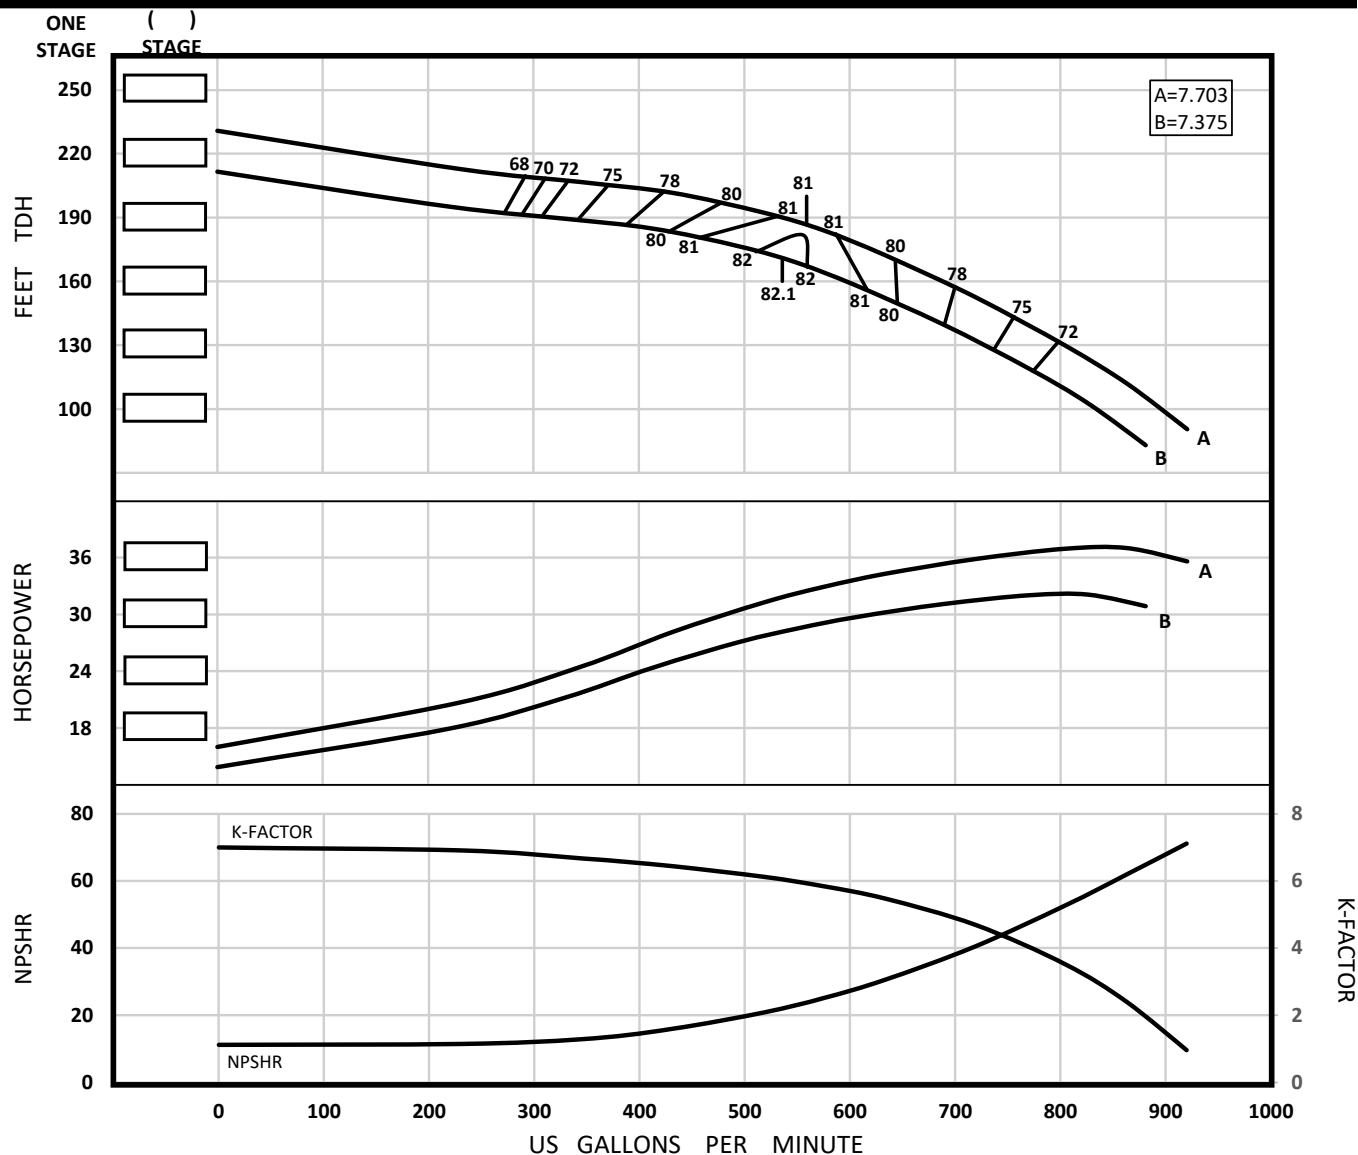SM9L
3450 RPM

Impeller Type	Enclosed	Bowl OD (in.)	9.50	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM9L	Thd'd Discharge Size	4" / 6" / 8"	Ns	1613	Stages	Change
One Stage Weight (lb)	150.00	Thd'd Suction Size	6"	Nss	7266	1	-3
Add'l Stage Wt. (lb)	60.00	Bell Suction Size	10"	Shaft Size (in.)	1.50	2	-2
Impeller Wt. (lb)	9.00	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	.88	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	408	Setting (in)	.31	4	0
One Stage Length (in)	~23.125	D.I. Bowl Rating (psi)	Δ884	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	7.750	S.S. Bowl Rating (psi)	Δ952	Imp. WR ² (lb-ft ²)	.286		

Δ Consult factory for availability


Rev. 2022.10.25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.




SM9M
3450 RPM

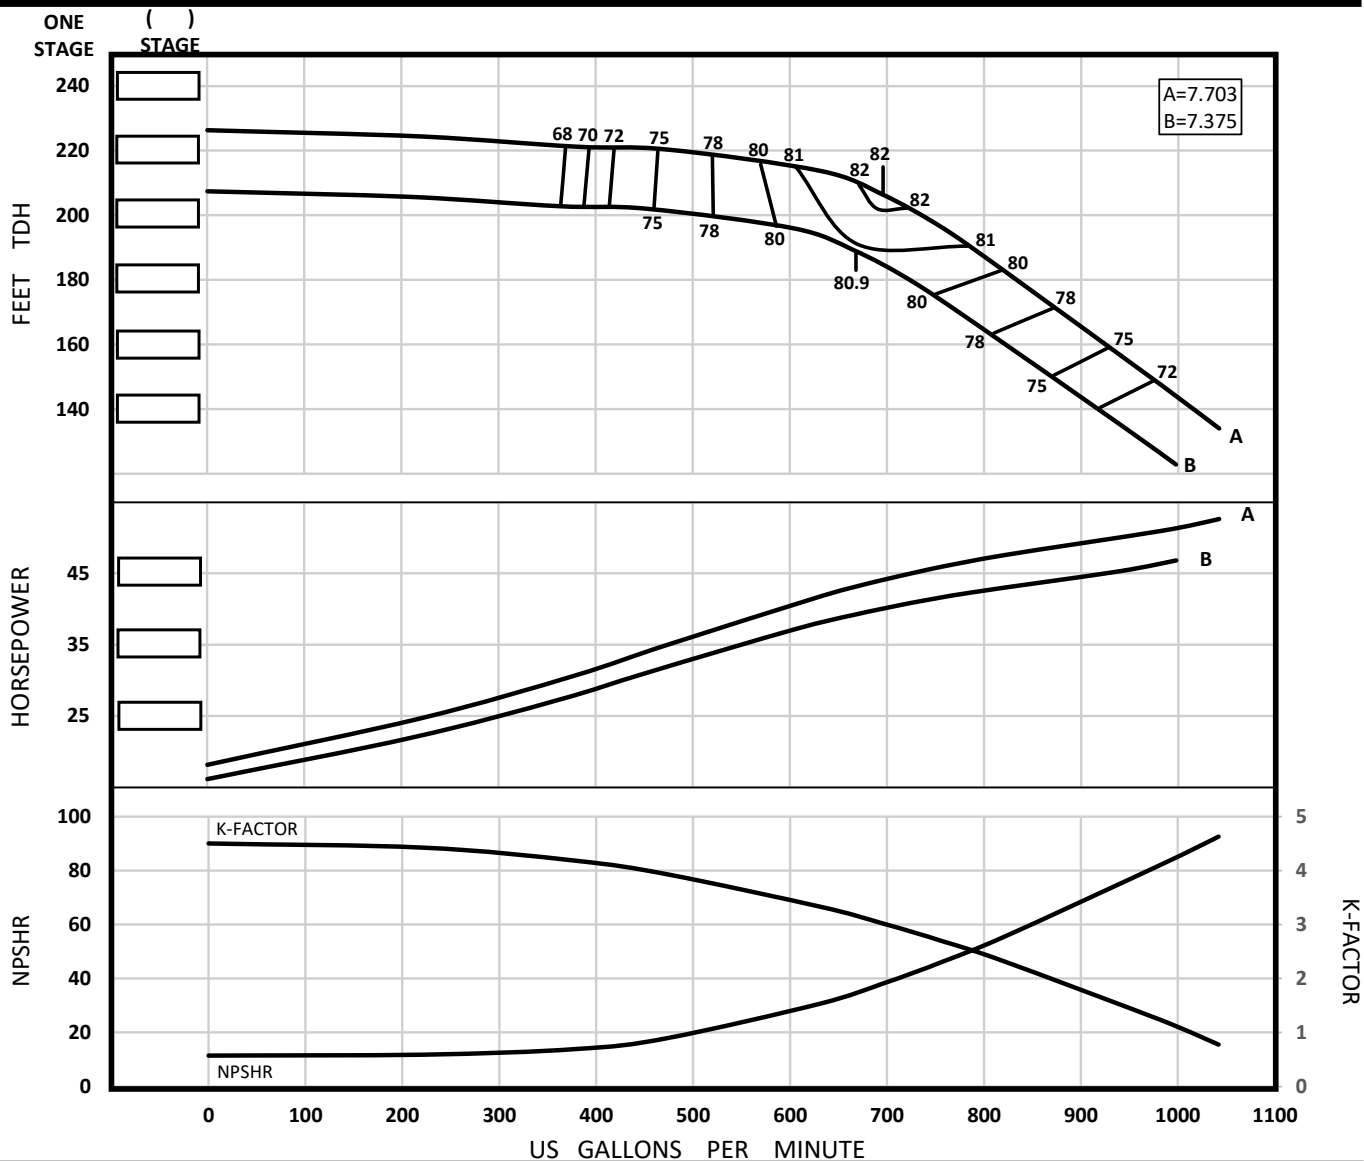

Impeller Type	Enclosed	Bowl OD (in.)	9.50	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM9M	Thd'd Discharge Size	4" / 6" / 8"	Ns	1675	Stages	Change
One Stage Weight (lb)	150.00	Thd'd Suction Size	6"	Nss	5943	1	-3
Add'l Stage Wt. (lb)	60.00	Bell Suction Size	10"	Shaft Size (in.)	1.50	2	-2
Impeller Wt. (lb)	9.50	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	.88	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	408	Setting (in)	.31	4	0
One Stage Length (in)	~23.125	D.I. Bowl Rating (psi)	Δ884	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	7.750	S.S. Bowl Rating (psi)	Δ952	Imp. WR ² (lb-ft ²)	.303		

Δ Consult factory for availability
Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.
Weights and lengths listed are approximate and subject to change. Consult factory.

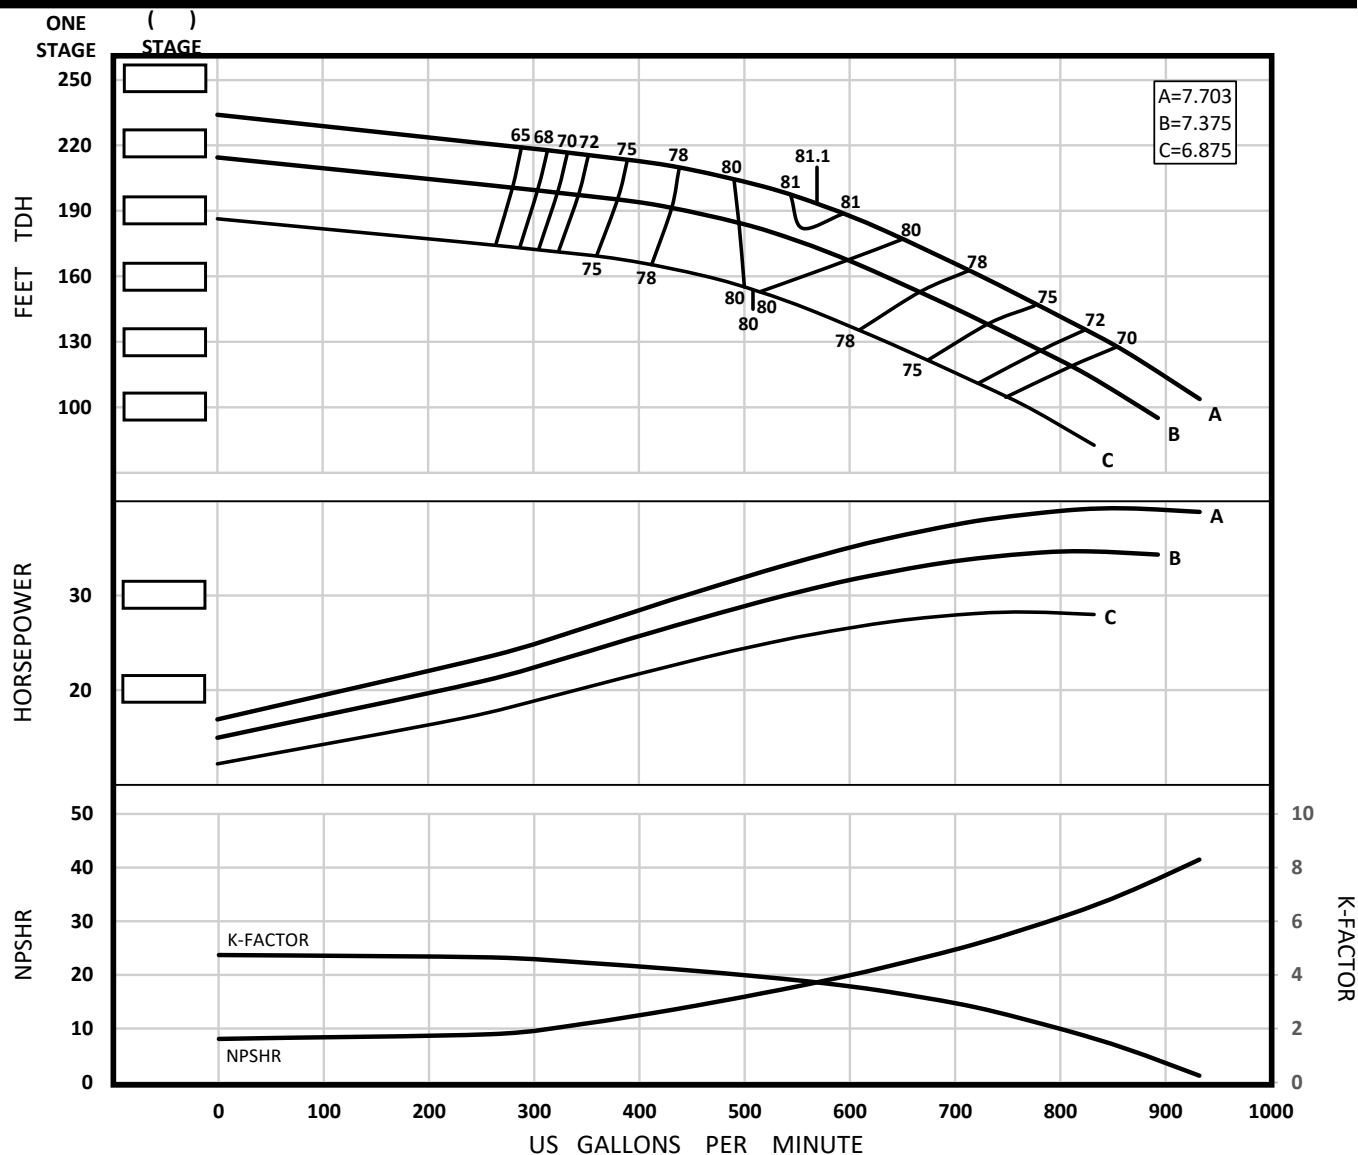SP9L
3450 RPM

Impeller Type	Enclosed	Bowl OD (in.)	9.50	PEI cl	N/A	Qty.	Eff.
Impeller Model	SP9L	Thd'd Discharge Size	4" / 6" / 8"	Ns	1591	Stages	Change
One Stage Weight (lb)	150.00	Thd'd Suction Size	6"	Nss	9077	1	-3
Add'l Stage Wt. (lb)	60.00	Bell Suction Size	10"	Shaft Size (in.)	1.50	2	-2
Impeller Wt. (lb)	9.00	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	.94	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	409	Setting (in)	.31	4	0
One Stage Length (in)	~23.125	D.I. Bowl Rating (psi)	Δ887	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	7.750	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.286		

Δ Consult factory for availability


Rev. 2022.10.25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.




SP9M
3450 RPM

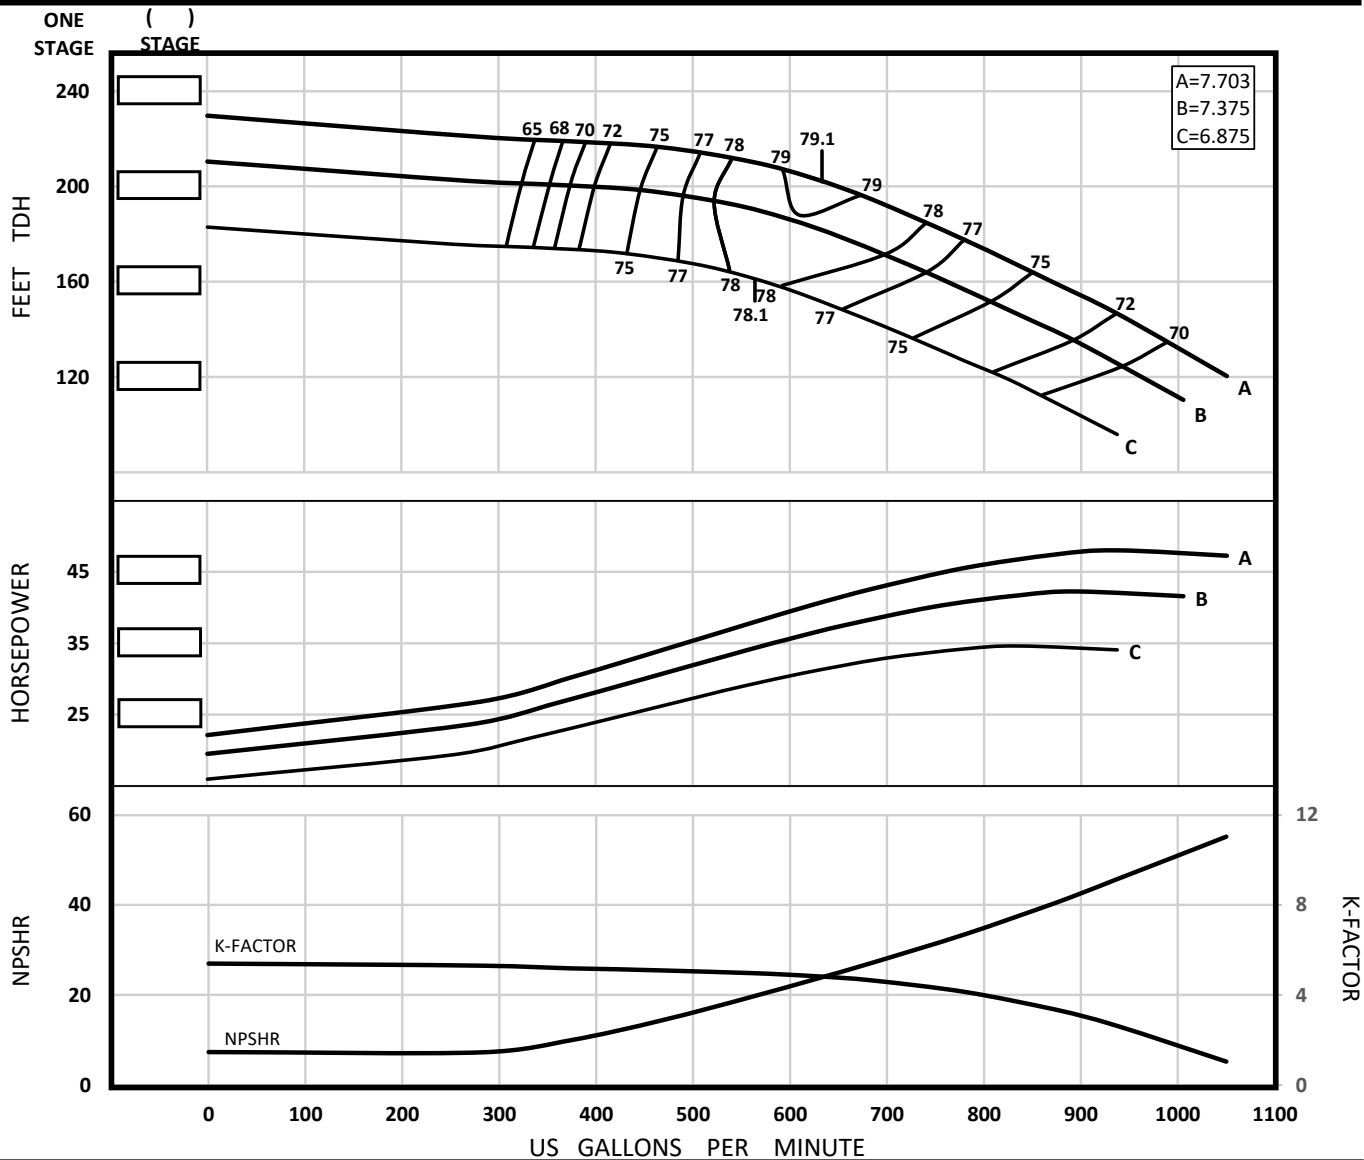

Impeller Type	Enclosed	Bowl OD (in.)	9.50	PEI cl	N/A	Qty.	Eff.
Impeller Model	SP9M	Thd'd Discharge Size	4" / 6" / 8"	Ns	1621	Stages	Change
One Stage Weight (lb)	150.00	Thd'd Suction Size	6"	Nss	8146	1	-3
Add'l Stage Wt. (lb)	60.00	Bell Suction Size	10"	Shaft Size (in.)	1.50	2	-2
Impeller Wt. (lb)	9.50	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	.94	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	409	Setting (in)	.31	4	0
One Stage Length (in)	~23.125	D.I. Bowl Rating (psi)	Δ887	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	7.750	S.S. Bowl Rating (psi)	Δ	Imp. WR² (lb-ft²)	.303		

Δ Consult factory for availability
Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.
Weights and lengths listed are approximate and subject to change. Consult factory.

SL9H 3450 RPM

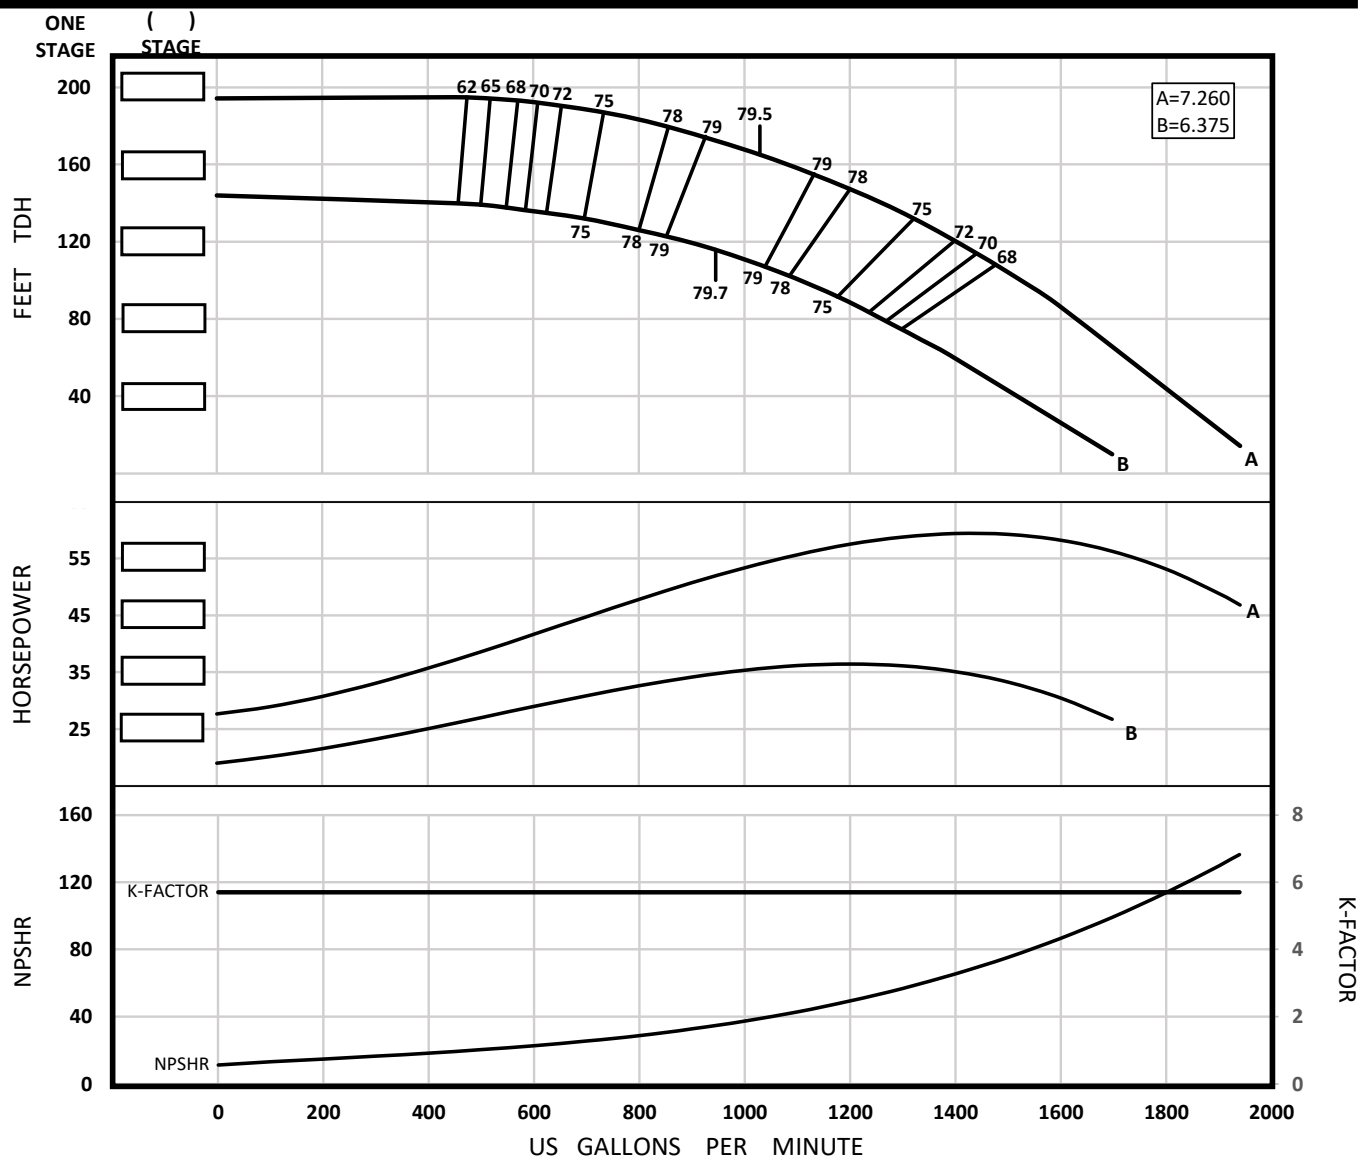

Impeller Type	Enclosed	Bowl OD (in.)	9.00	PEI cl	N/A	Qty.	Eff.
Impeller Model	SL9H	Thd'd Discharge Size	4" / 6" / 8"	Ns	2396	Stages	Change
One Stage Weight (lb)	135.00	Thd'd Suction Size	6"	Nss	6624	1	-3
Add'l Stage Wt. (lb)	53.00	Bell Suction Size	10"	Shaft Size (in.)	1.50	2	-2
Impeller Wt. (lb)	8.65	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	1.00	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	428	Setting (in)	.125	4	0
One Stage Length (in)	~23.875	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	5.700	5	0
Add'l Stage Length (in)	8.500	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.248		

Δ Consult factory for availability


Rev. 2022.10.25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SF9H 3450 RPM

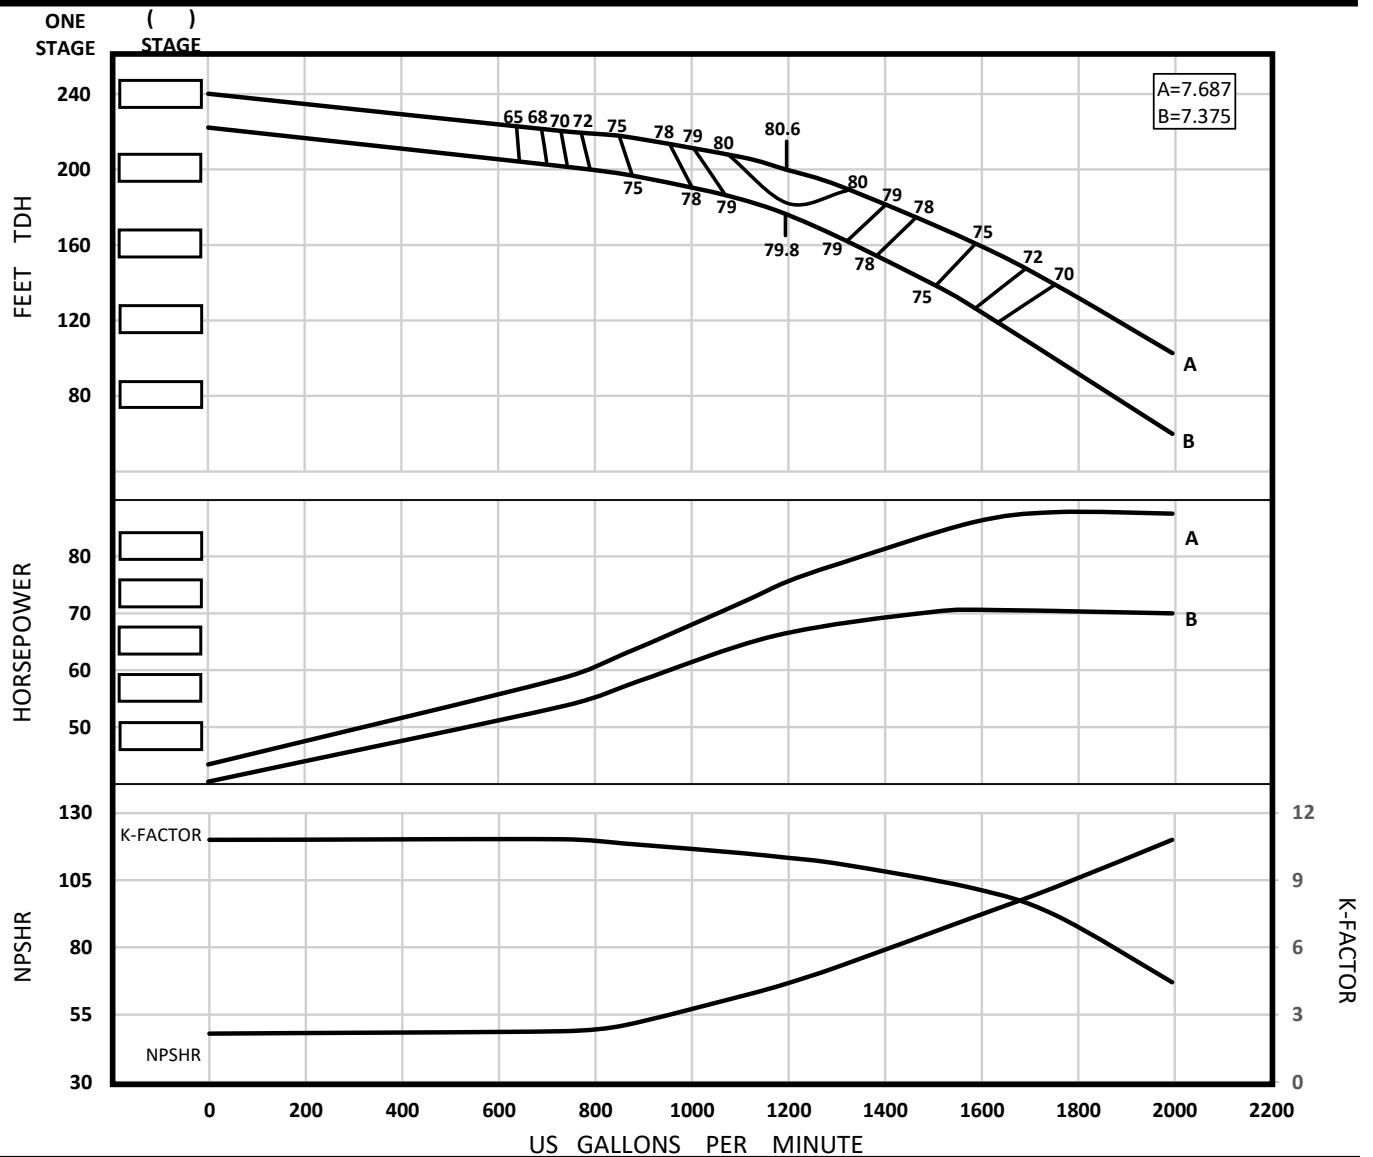

Impeller Type	Enclosed	Bowl OD (in.)	9.50	PEI cl	N/A	Qty.	Eff.
Impeller Model	SF9H	Thd'd Discharge Size	4" / 6" / 8"	Ns	2241	Stages	Change
One Stage Weight (lb)	185.00	Thd'd Suction Size	6"	Nss	5119	1	-3
Add'l Stage Wt. (lb)	67.00	Bell Suction Size	10"	Shaft Size (in.)	1.50	2	-2
Impeller Wt. (lb)	9.00	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	.94	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	377	Setting (in)	.125	4	0
One Stage Length (in)	~22.875	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	7.500	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.291		


Δ Consult factory for availability

Rev. 2022.10.25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

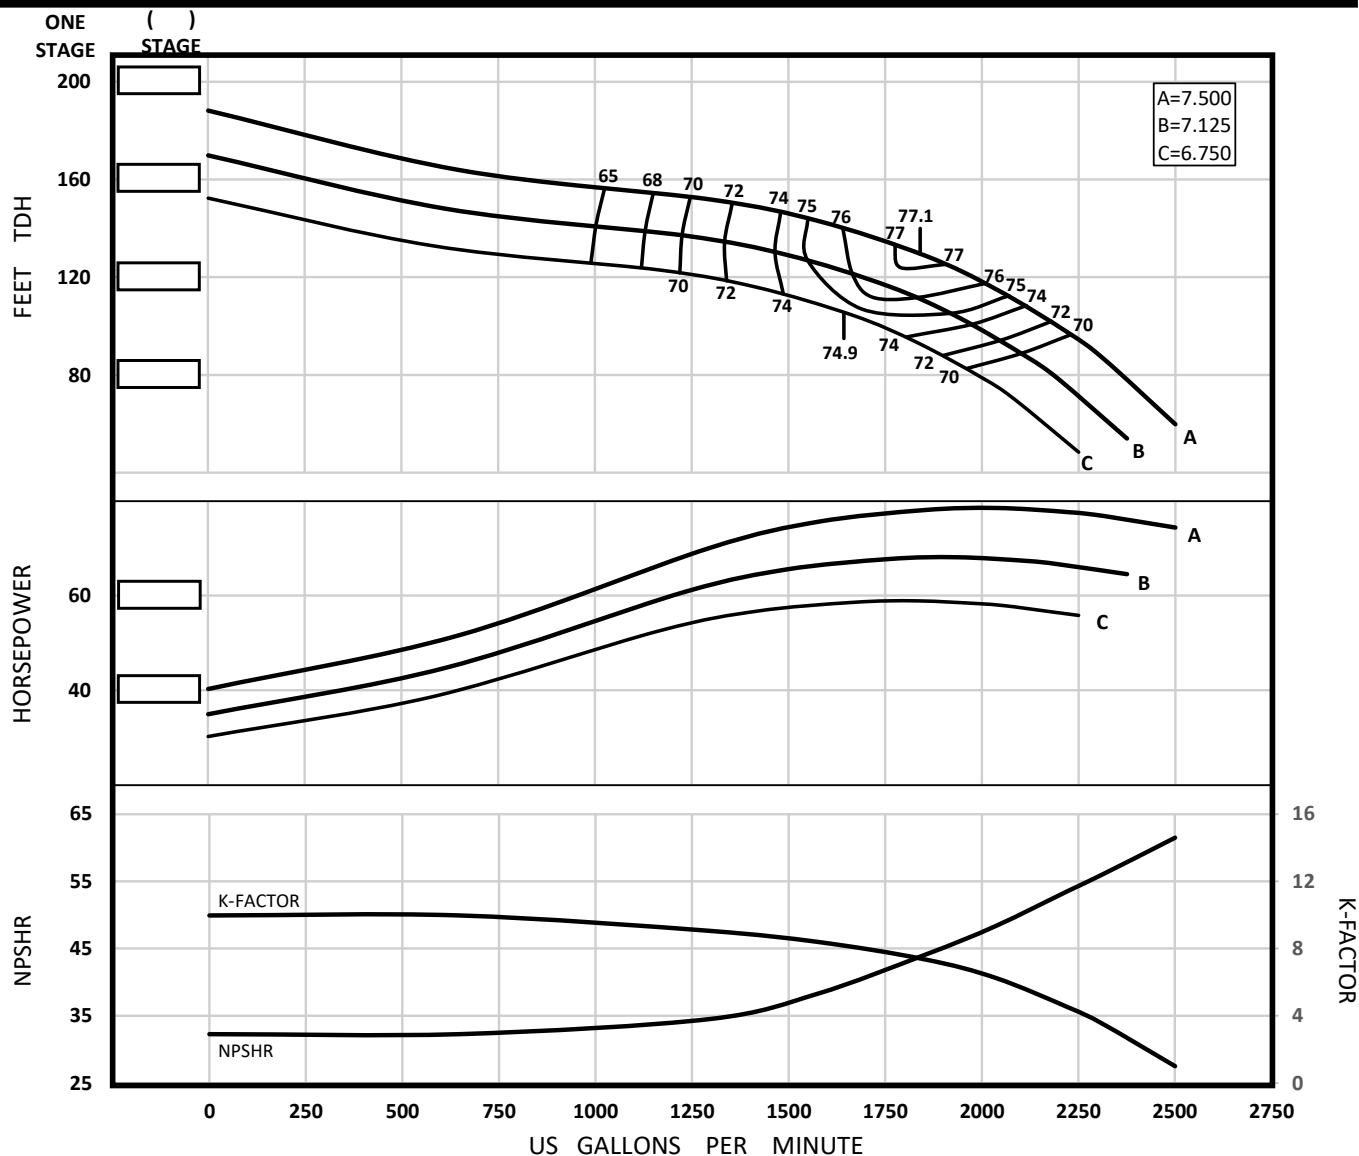

SK9M
3450 RPM

Impeller Type	Enclosed	Bowl OD (in.)	9.44	PEI cl	N/A	Qty.	Eff.
Impeller Model	SK9M	Thd'd Discharge Size	4" / 6" / 8"	Ns	3852	Stages	Change
One Stage Weight (lb)	250.00	Thd'd Suction Size	8"	Nss	8651	1	-4
Add'l Stage Wt. (lb)	85.00	Bell Suction Size	N/A	Shaft Size (in.)	1.6875	2	-3
Impeller Wt. (lb)	14.90	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	1.44	3	-2
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	526	Setting (in)	.125	4	-1
One Stage Length (in)	~27.00	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	10.625	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.462		

Δ Consult factory for availability


Rev. 2022.10.25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.




SP10M
3450 RPM

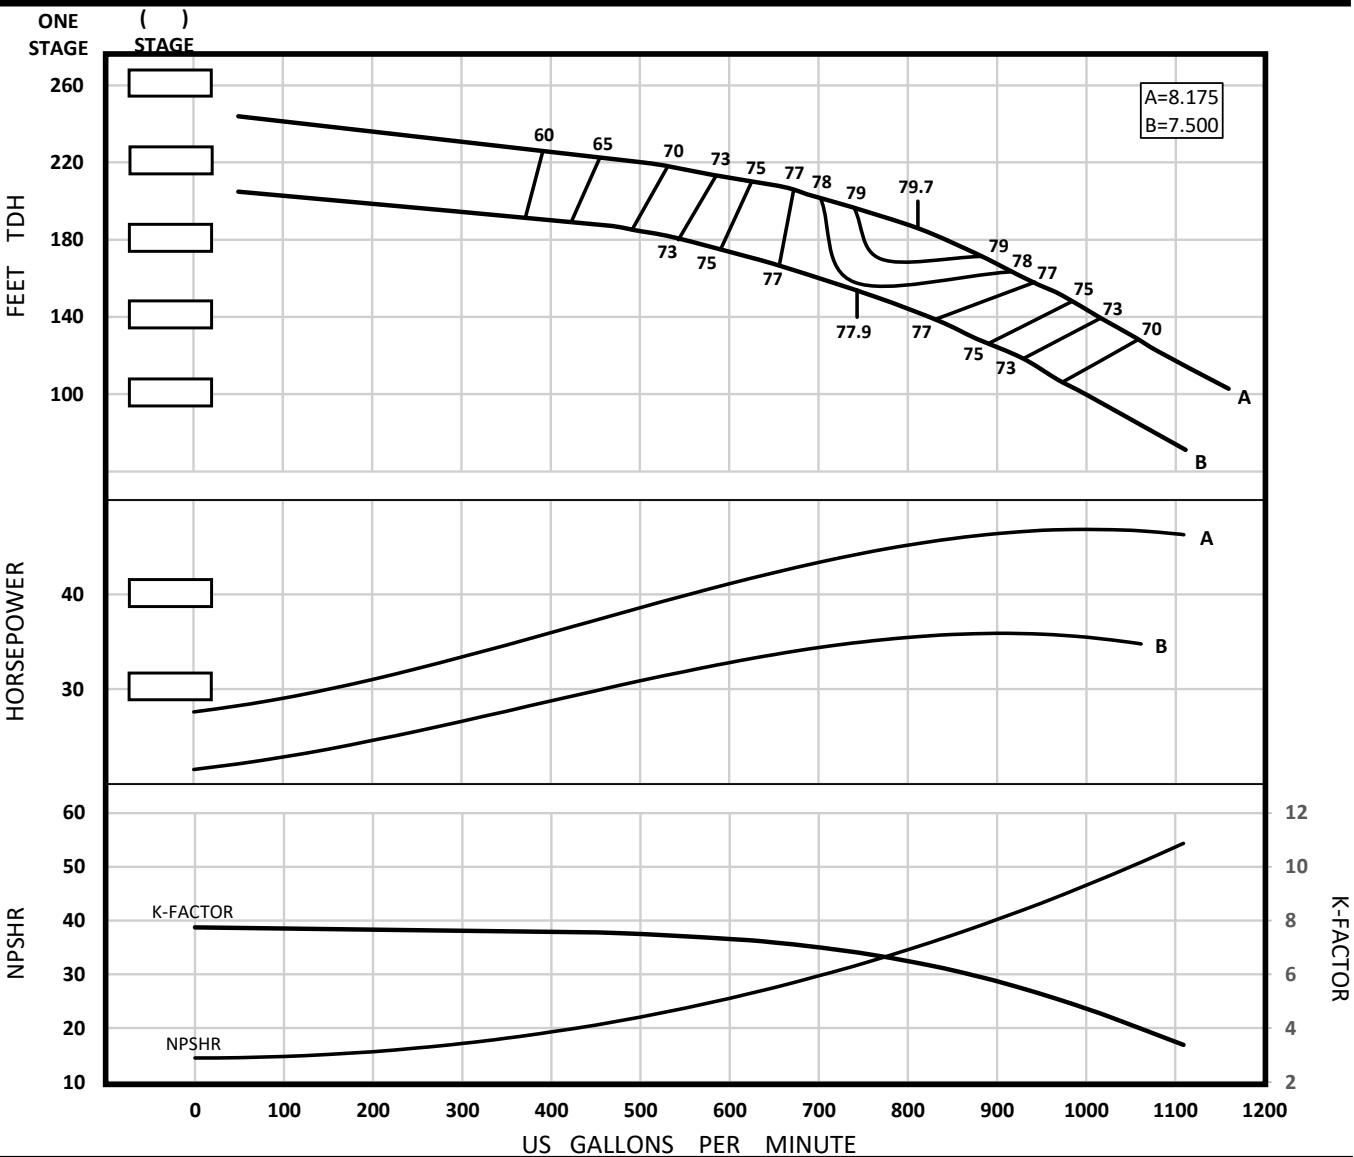

Impeller Type	Enclosed	Bowl OD (in.)	10.19	PEI cl	N/A	Qty.	Eff. Change
Impeller Model	SP10M	Thd'd Discharge Size	4" / 6" / 8"	Ns	1892	Stages	
One Stage Weight (lb)	190.00	Thd'd Suction Size	6"	Nss	6917	1	-4
Add'l Stage Wt. (lb)	75.00	Bell Suction Size	10"	Shaft Size (in.)	1.50	2	-3
Impeller Wt. (lb)	8.85	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	.94	3	-2
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	731	Setting (in)	.125	4	-1
One Stage Length (in)	~22.375	D.I. Bowl Rating (psi)	Δ1583	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	7.250	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.347		

Δ Consult factory for availability
Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.
Weights and lengths listed are approximate and subject to change. Consult factory.

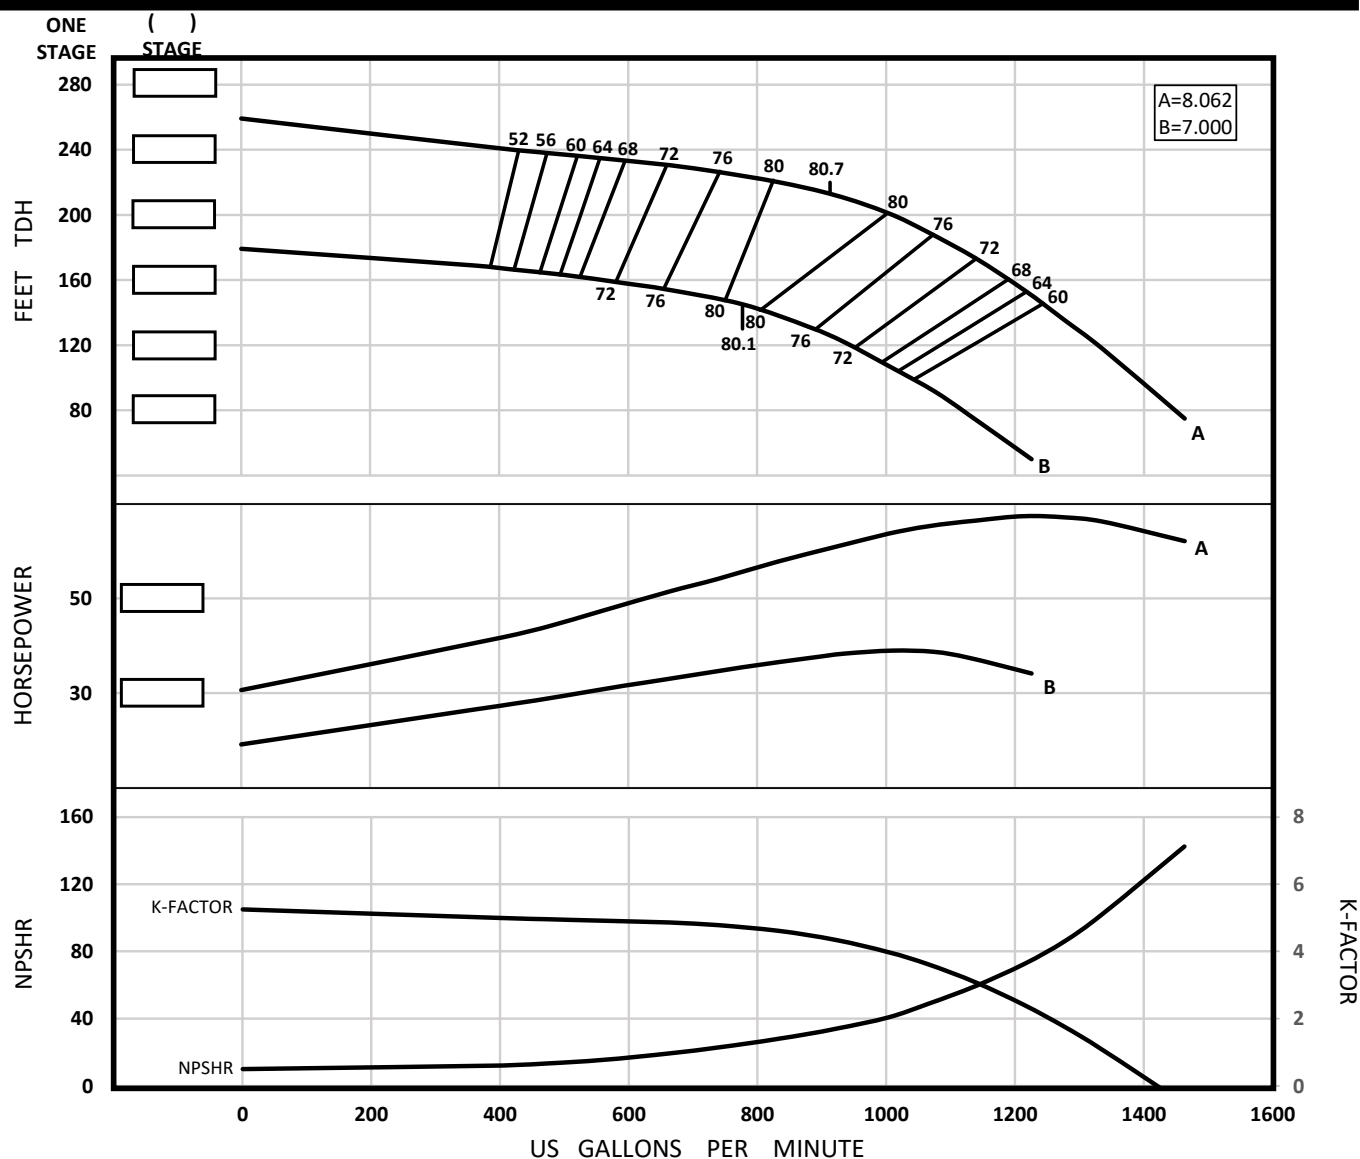SP10H
3450 RPM

Impeller Type	Enclosed	Bowl OD (in.)	10.19	PEI cl	N/A	Qty.	Eff.
Impeller Model	SP10H	Thd'd Discharge Size	4" / 6" / 8"	Ns	1871	Stages	Change
One Stage Weight (lb)	190.00	Thd'd Suction Size	6"	Nss	7404	1	-3
Add'l Stage Wt. (lb)	75.00	Bell Suction Size	10"	Shaft Size (in.)	1.50	2	-2
Impeller Wt. (lb)	9.00	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	.63	3	-1
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	731	Setting (in)	.125	4	0
One Stage Length (in)	~22.375	D.I. Bowl Rating (psi)	Δ1583	K-Factor (lb/ft tdk)	CURVE	5	0
Add'l Stage Length (in)	7.250	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.315		

Δ Consult factory for availability


Rev. 2022.10.25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SM10M 3450 RPM

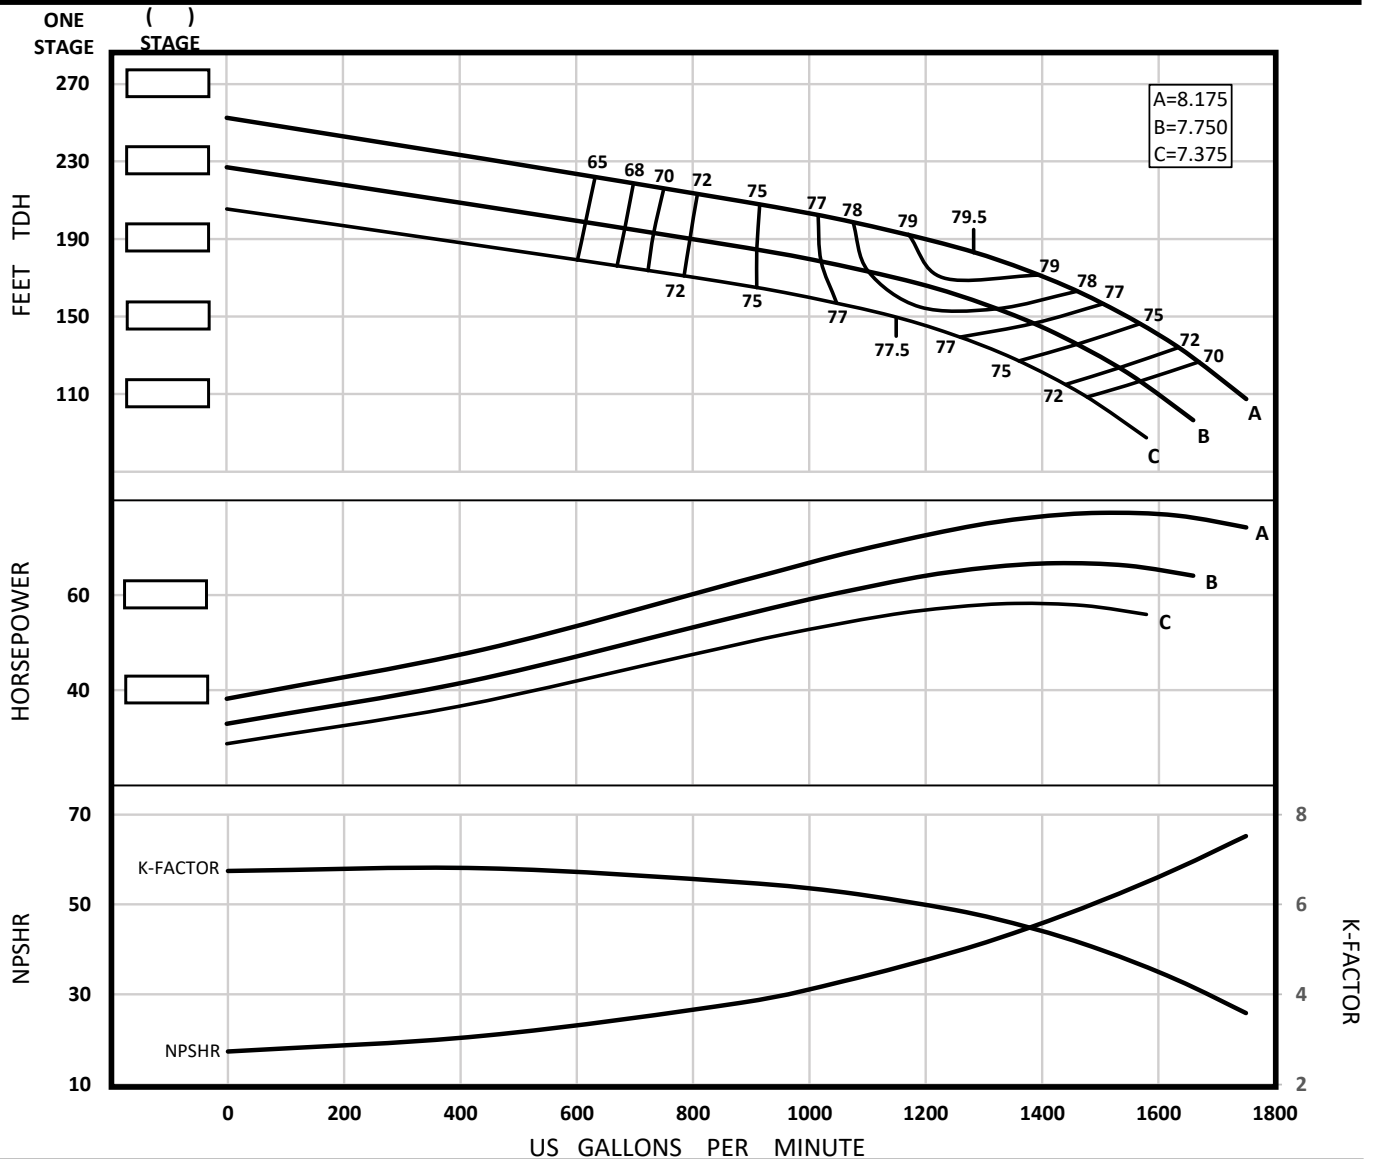

Impeller Type	Enclosed	Bowl OD (in.)	10.19	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM10M	Thd'd Discharge Size	4" / 6" / 8"	Ns	2481	Stages	Change
One Stage Weight (lb)	195.00	Thd'd Suction Size	6"	Nss	7834	1	-4
Add'l Stage Wt. (lb)	75.00	Bell Suction Size	10"	Shaft Size (in.)	1.50	2	-3
Impeller Wt. (lb)	9.70	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	1.06	3	-2
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	489	Setting (in)	.125	4	-1
One Stage Length (in)	~25.125	D.I. Bowl Rating (psi)	Δ1059	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	8.875	S.S. Bowl Rating (psi)	Δ1141	Imp. WR ² (lb-ft ²)	.347		

Δ Consult factory for availability

Rev. 2021.06.08


Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SM10H

3450 RPM

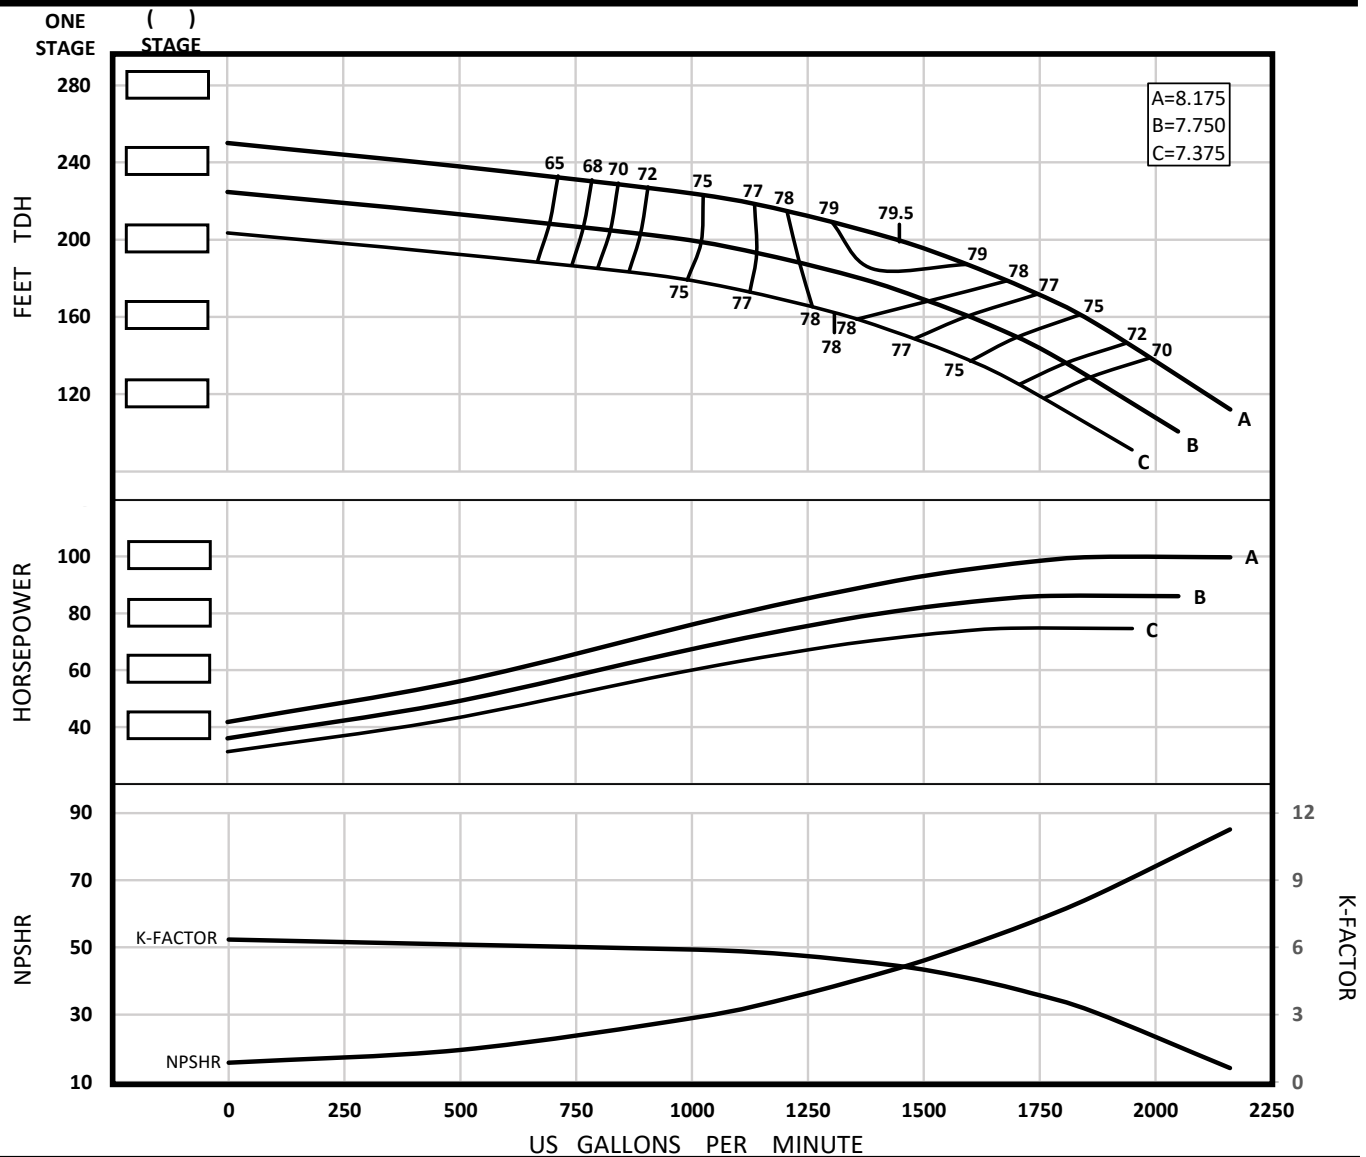

Impeller Type	Enclosed	Bowl OD (in.)	10.19	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM10H	Thd'd Discharge Size	4" / 6" / 8"	Ns	2472	Stages	Change
One Stage Weight (lb)	195.00	Thd'd Suction Size	6"	Nss	7732	3	-4
Add'l Stage Wt. (lb)	76.00	Bell Suction Size	10"	Shaft Size (in.)	1.50	2	-3
Impeller Wt. (lb)	10.80	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	1.06	3	-2
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	489	Setting (in)	.125	4	-1
One Stage Length (in)	~25.125	D.I. Bowl Rating (psi)	Δ1059	K-Factor (lb/ft tdk)	CURVE	5	0
Add'l Stage Length (in)	8.875	S.S. Bowl Rating (psi)	Δ1141	Imp. WR ² (lb-ft ²)	.386		

Δ Consult factory for availability


Rev. 2022.10.25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SM10MO 3450 RPM

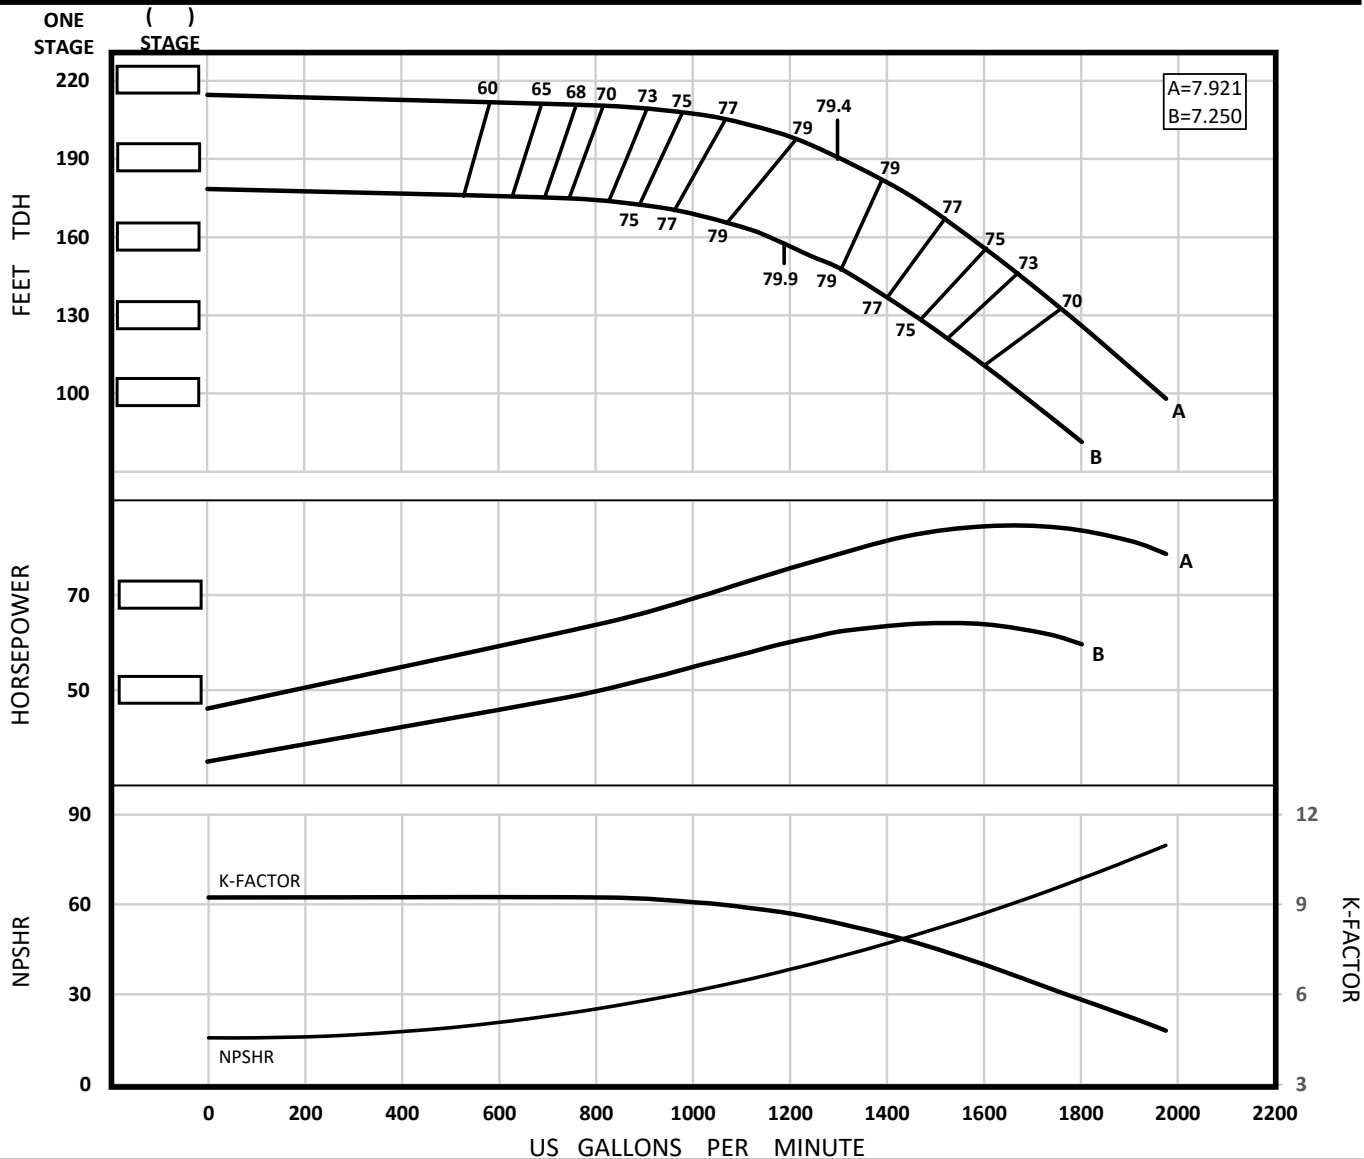


Impeller Type	Semi-Open	Bowl OD (in.)	10.19	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM10MO	Thd'd Discharge Size	4" / 6" / 8"	Ns	2423	Stages	Change
One Stage Weight (lb)	190.00	Thd'd Suction Size	6"	Nss	7807	1	-4
Add'l Stage Wt. (lb)	75.00	Bell Suction Size	10"	Shaft Size (in.)	1.50	2	-3
Impeller Wt. (lb)	6.10	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	1.56	3	-2
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	489	Setting (in)	.02	4	-1
One Stage Length (in)	~25.875	D.I. Bowl Rating (psi)	Δ1059	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	8.875	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.217		

Δ Consult factory for availability

Rev. 2022.10.25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

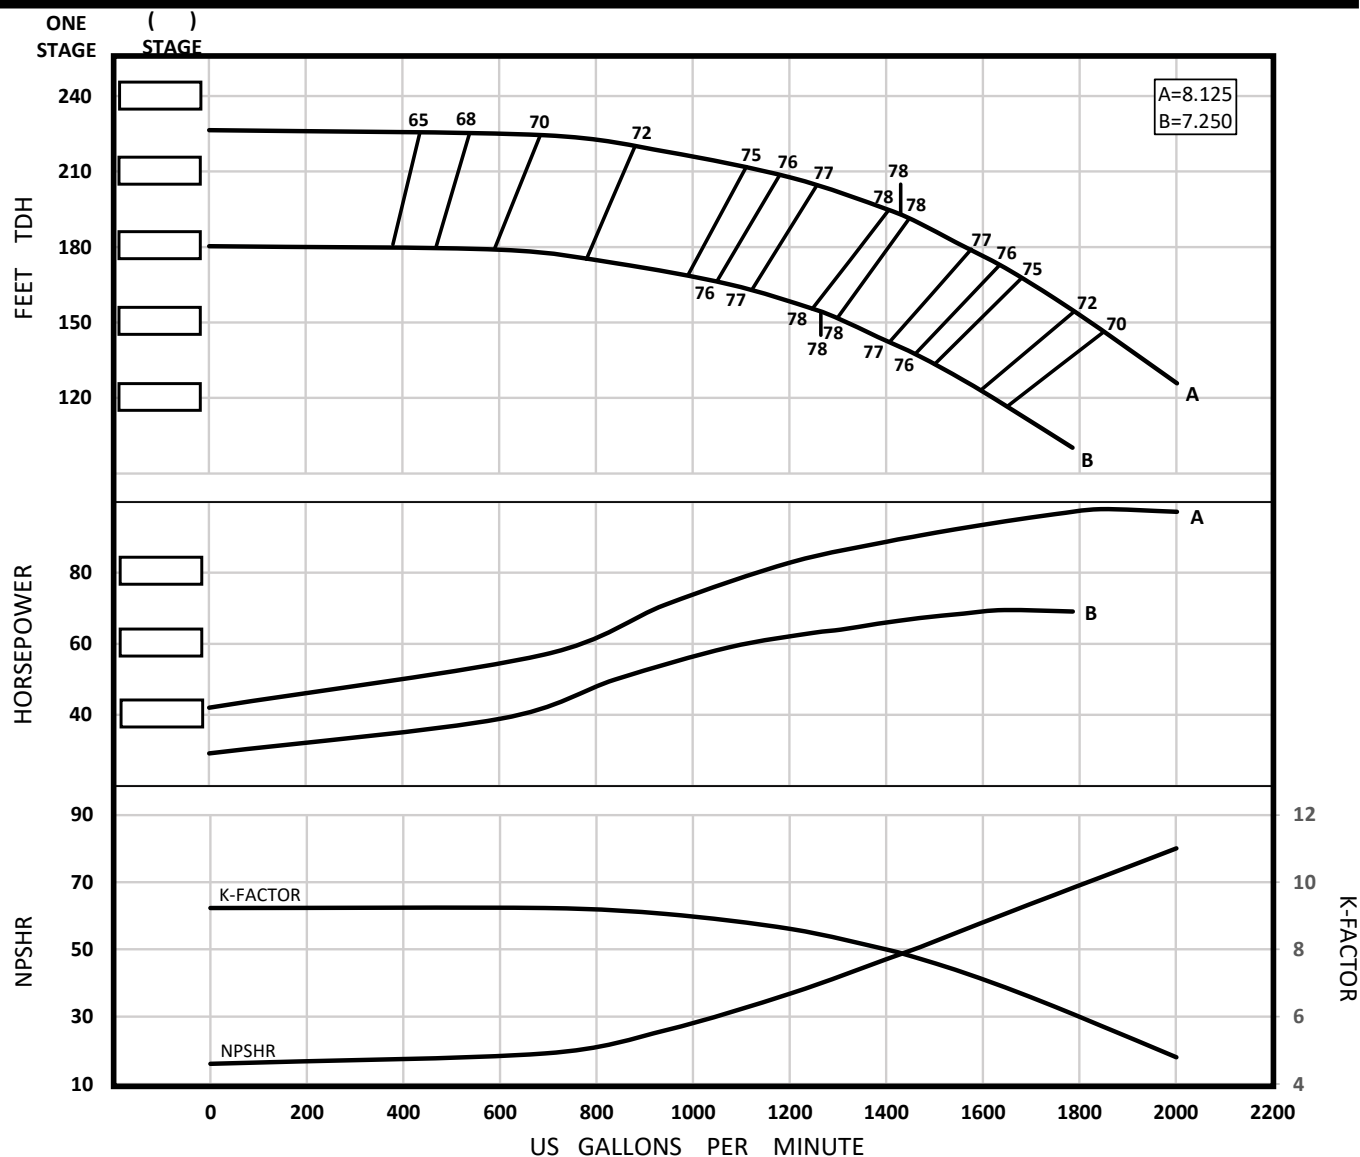SM10HO
3450 RPM

Impeller Type	Semi-Open	Bowl OD (in.)	10.19	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM10HO	Thd'd Discharge Size	4" / 6" / 8"	Ns	2517	Stages	Change
One Stage Weight (lb)	190.00	Thd'd Suction Size	6"	Nss	6857	1	-4
Add'l Stage Wt. (lb)	75.00	Bell Suction Size	10"	Shaft Size (in.)	1.50	2	-3
Impeller Wt. (lb)	6.10	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	1.25	3	-2
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	489	Setting (in)	.02	4	-1
One Stage Length (in)	~25.875	D.I. Bowl Rating (psi)	Δ1059	K-Factor (lb/ft tdk)	CURVE	5	0
Add'l Stage Length (in)	8.875	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.217		

Δ Consult factory for availability


Rev. 2022.10.25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SM11M 3450 RPM

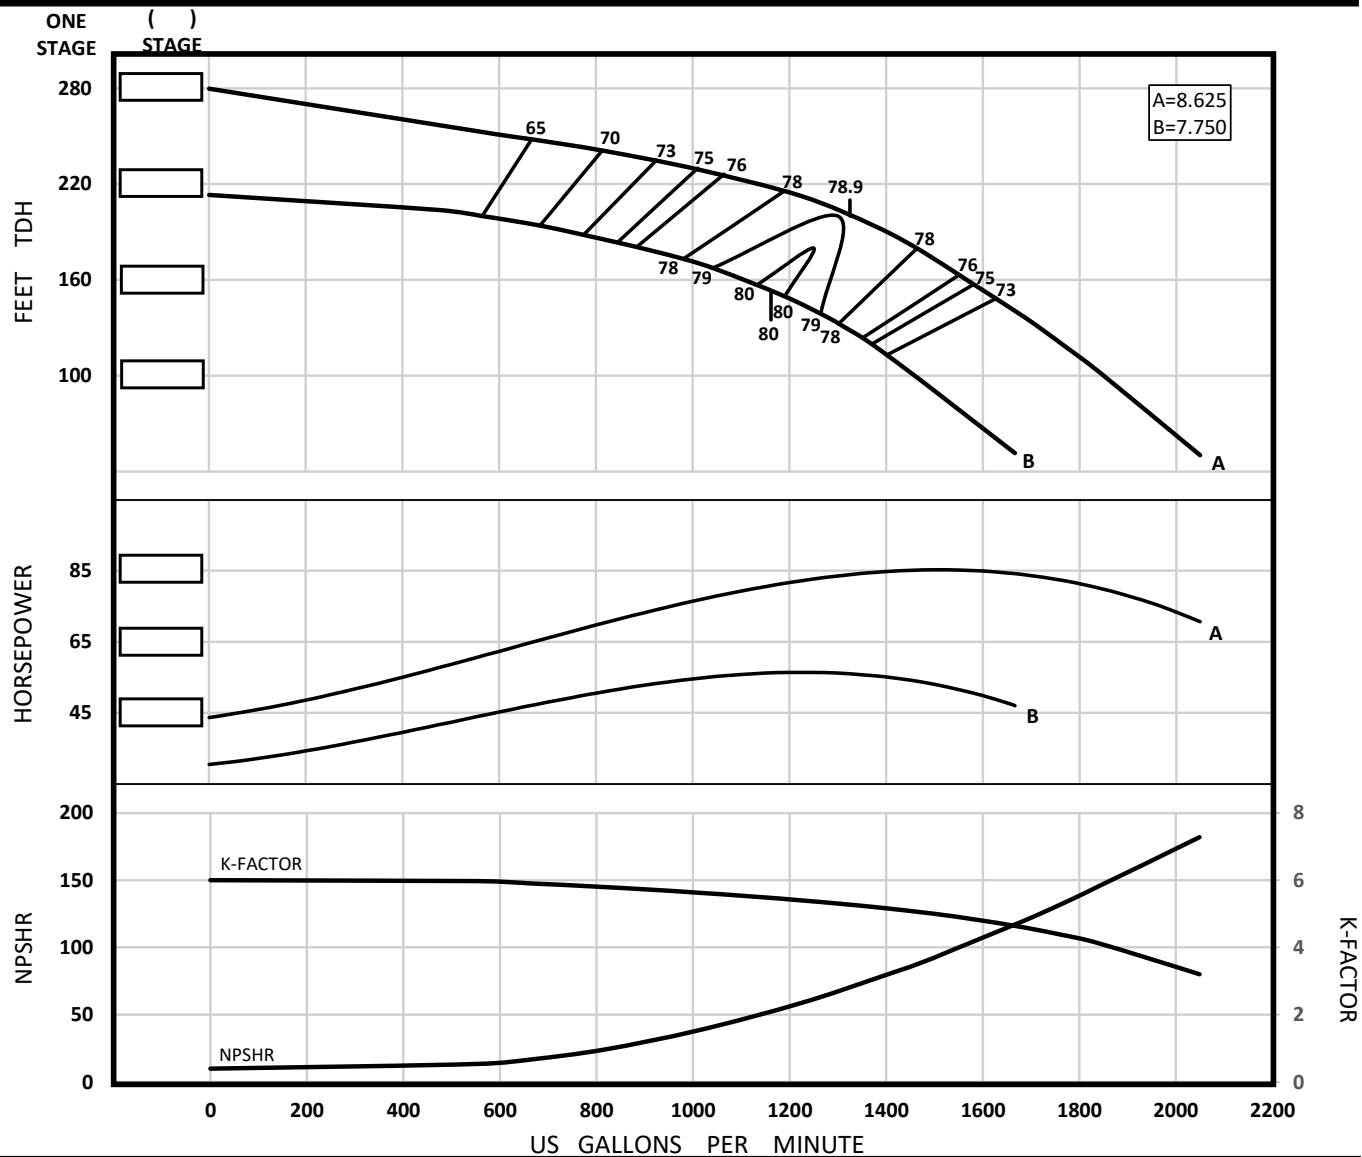

Impeller Type	Enclosed	Bowl OD (in.)	10.63	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM11M	Thd'd Discharge Size	4" / 6" / 8"	Ns	2358	Stages	Change
One Stage Weight (lb)	195.00	Thd'd Suction Size	8"	Nss	4831	1	-3
Add'l Stage Wt. (lb)	75.00	Bell Suction Size	11.38"	Shaft Size (in.)	1.50	2	-2
Impeller Wt. (lb)	9.50	Sub. Mtr. Size	8" / 10" / 12"	Lateral (in)	.88	3	-1
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	420	Setting (in)	.13	4	0
One Stage Length (in)	~25.125	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	8.625	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.303		


Δ Consult factory for availability

Rev. 2022.10.25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

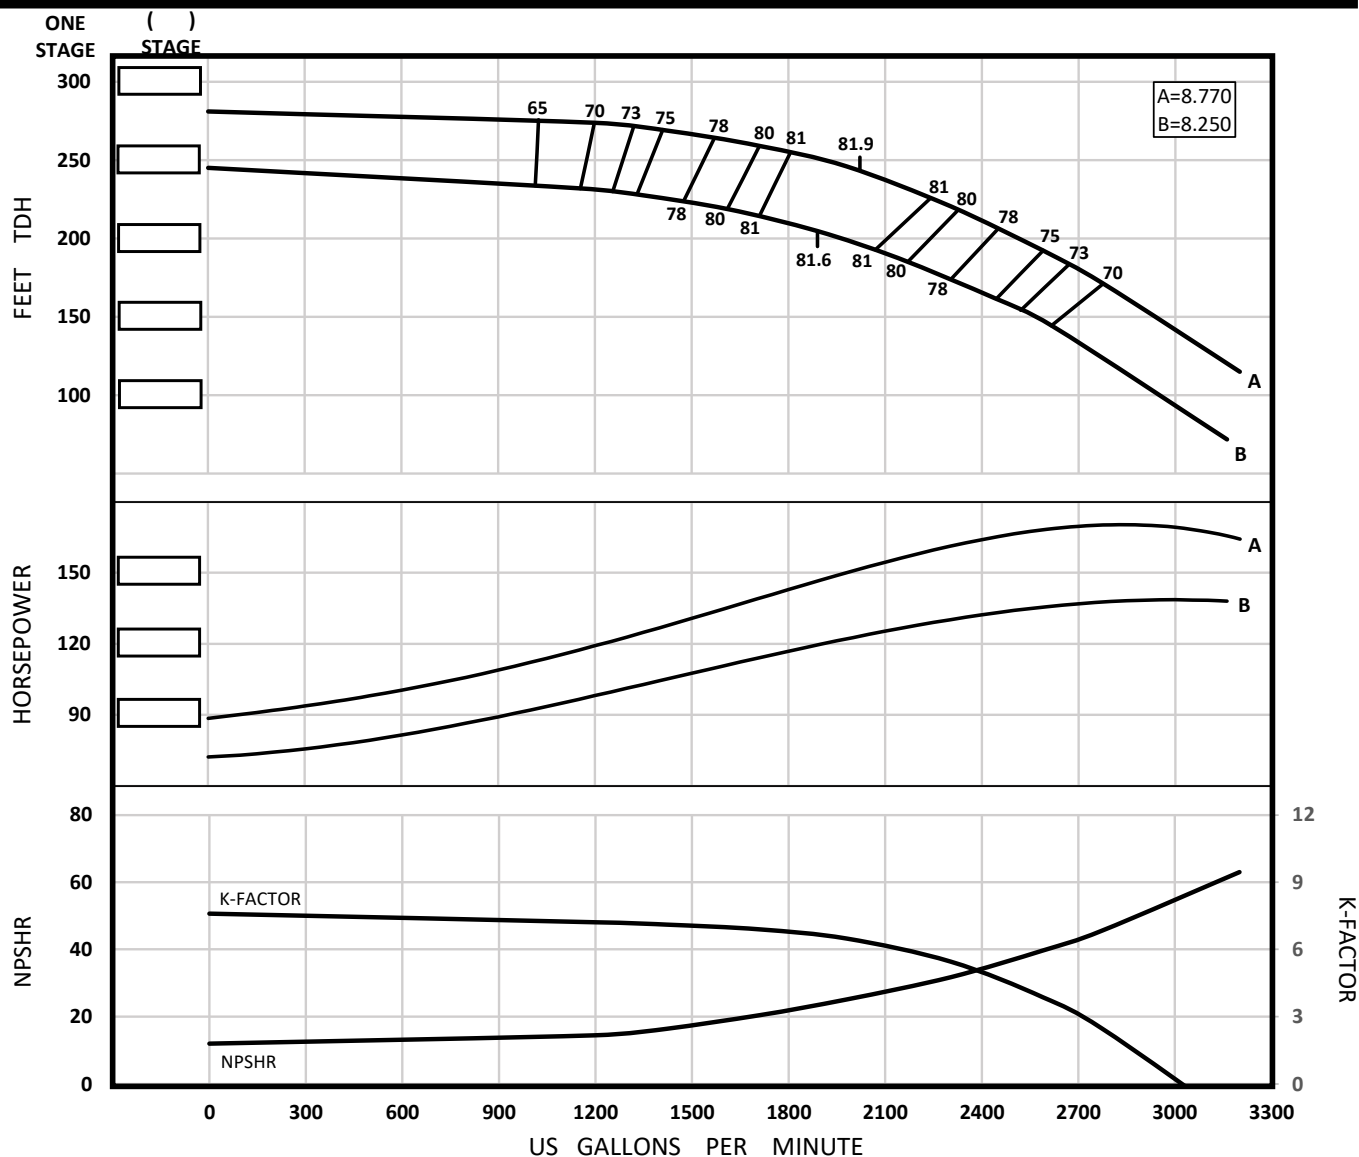

SL11H
3450 RPM

Impeller Type	Enclosed	Bowl OD (in.)	10.88	PEI cl	N/A	Qty.	Eff.
Impeller Model	SL11H	Thd'd Discharge Size	4" / 6" / 8"	Ns	2524	Stages	Change
One Stage Weight (lb)	200.00	Thd'd Suction Size	8"	Nss	13809	1	-3
Add'l Stage Wt. (lb)	81.00	Bell Suction Size	11.38"	Shaft Size (in.)	1.6875	2	-2
Impeller Wt. (lb)	13.00	Sub. Mtr. Size	8" / 10" / 12"	Lateral (in)	1.44	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	489	Setting (in)	.125	4	0
One Stage Length (in)	~25.813	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	10.000	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.532		

Δ Consult factory for availability

Rev. 2022.10.25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



1770 RPM Selection Chart

Model Number	Bowl Dia. (in.)	Peak Eff. (full dia.)	BEP Flow (gpm)	BEP Head (ft./ stage)	BEP NPSHr (full dia.)	POR (gpm)	Ns	Nss
SP5XXL	5.25	66.4	49.5	13.0	1.50	35-59	1816	9188
SP5XL	5.25	78.0	52.0	13.7	2.07	36-62	1791	7385
SP5L	5.25	76.3	62.5	16.1	2.06	44-75	1744	8153
SP5LO	5.25	76.6	49.0	13.4	2.20	34-59	1773	6859
SM5M	5.25	77.8	102	7.83	3.42	71-122	3810	7089
SM5H	5.25	77.9	139	9.95	4.59	97-167	3725	6656
SP6LL	6.00	65.6	74.0	14.7	3.75	52-89	2030	5650
SP6M	6.00	68.1	87.0	17.5	3.75	61-104	1929	6126
SP6H	6.00	69.3	116	19.6	14.4	81-139	2042	2576
SP6LO	6.00	75.8	82.8	15.6	4.20	58-99	2047	5488
SP6MO	6.00	75.4	95.0	16.6	3.90	67-114	2098	6216
SK6HH	5.50	72.9	212	11.8	4.47	148-254	4041	8387
SK7L	6.56	78.9	206	17.6	7.71	144-247	2951	5488
SK7M	6.56	78.4	232	16.1	2.46	162-278	3347	13714
SK7H	6.56	76.5	281	20.3	3.00	197-337	3103	13016
SP7L	7.19	79.1	213	24.4	3.79	149-256	2285	9357
SP7H	7.19	81.7	266	28.9	5.85	186-319	2311	7670
SM7M	7.00	77.9	286	16.8	4.34	200-343	3602	9958
SP8L	7.88	75.6	140	29.1	9.65	98-168	1670	3818
SP8M	7.88	78.0	166	29.3	2.90	116-199	1812	10262
SP8H	7.88	77.7	208	31.6	8.00	146-249	1916	1366
SM8H	7.69	79.5	292	28.6	9.20	204-350	2445	5726
SK8H	7.50	78.2	569	22.3	18.9	398-683	4117	4648
SM9L	9.50	83.1	282	49.8	6.62	197-338	1584	7199
SM9M	9.50	82.9	357	54.7	10.2	250-428	1661	5850
SM9H	9.50	81.8	425	50.8	11.1	298-510	1916	6011
SP9L	9.50	81.9	293	51.1	4.98	205-352	1584	9094
SP9M	9.50	80.0	323	53.8	61.7	226-388	1600	8122
SL9H	9.00	78.6	542	52.9	9.5	379-650	2455	7612
SF9H	9.50	80.7	630	51.7	17.0	441-756	2304	5306
SK9M	9.44	77.1	941	34.2	11.6	659-1129	3836	8659
SK9H	9.44	77.1	1240	36.8	20.1	868-1488	4171	6576
SP10M	10.19	78.6	393	48.4	8.72	275-472	1911	6915
SP10H	10.19	83.0	492	54.7	9.02	344-590	1953	7543
SM10MO	10.19	80.5	652	50.2	9.90	456-782	2398	8098
SM10HO	10.19	78.2	727	51.1	11.0	509-872	2496	7901
SM10M	10.19	82.5	656	48.3	10.4	459-787	2474	7839
SM10H	10.19	81.0	744	72.5	11.5	521-893	2475	7724

V23.1




1770 RPM
Selection Chart

Model Number	Bowl Dia. (in.)	Peak Eff. (full dia.)	BEP Flow (gpm)	BEP Head (ft./ stage)	BEP NPSHr (full dia.)	POR (gpm)	Ns	Nss
SM11M	10.63	81.6	650	56.1	12.2	455-780	2202	6903
SM11H	10.63	81.8	752	56.8	19.4	526-902	2347	5258
SR11MO	11.50	81.2	948	66.7	18.8	664-1138	2335	6031
SR11HO	11.50	83.0	1162	75.5	19.5	813-1394	2355	6513
SL11H	10.88	81.8	1035	64.1	7.30	725-1242	2512	12814
SP11L	11.25	83.1	1040	52.9	10.6	764-1310	2907	9693
SP11M	11.25	83.1	1214	53.9	9.75	850-1457	3102	11177
SP11H	11.25	82.2	1528	58.3	17.5	1070-1834	3277	8095
SW12L	11.63	85.3	521	69.4	8.73	365-625	1681	7957
SW12M	11.63	85.6	592	84.5	9.42	414-710	1555	8034
SL12M	11.75	83.0	792	64.7	8.18	554-950	2184	10297
SL12H	11.75	82.3	888	72.8	8.93	622-1066	2128	10207
SJ12M	12.00	83.4	1287	72.3	18.5	901-1544	2560	7113
SJ12H	12.00	81.5	1498	79.6	24.7	1079-1798	2571	6176
SM14LL	14.00	81.3	1810	73.9	15.7	1267-2172	2989	9533
SM14M	14.00	84.7	2317	80.3	19.2	1622-2780	3175	9292
SM14H	14.00	84.6	2679	87.3	23.6	1875-3215	3207	8555
SM14HH	14.00	83.4	2982	89.4	23.0	2087-3578	3324	9203
SM16MO	15.25	86.3	3717	96.1	21.9	2602-4460	3517	10660
SM16HO	15.25	86.8	4367	102	28.1	3057-5240	3641	9584
SM16M	15.25	84.7	3990	95.5	22.3	2793-4788	3661	10894
SM16H	15.25	87.4	4706	108	28.6	3294-5647	3294	5647
SM20M	19.25	84.9	6314	156	46.9	4420-7577	3193	7848
SM20H	19.25	84.9	6857	167	62.0	4800-8228	3160	6634

V23.1



SP5XXL 1770 RPM

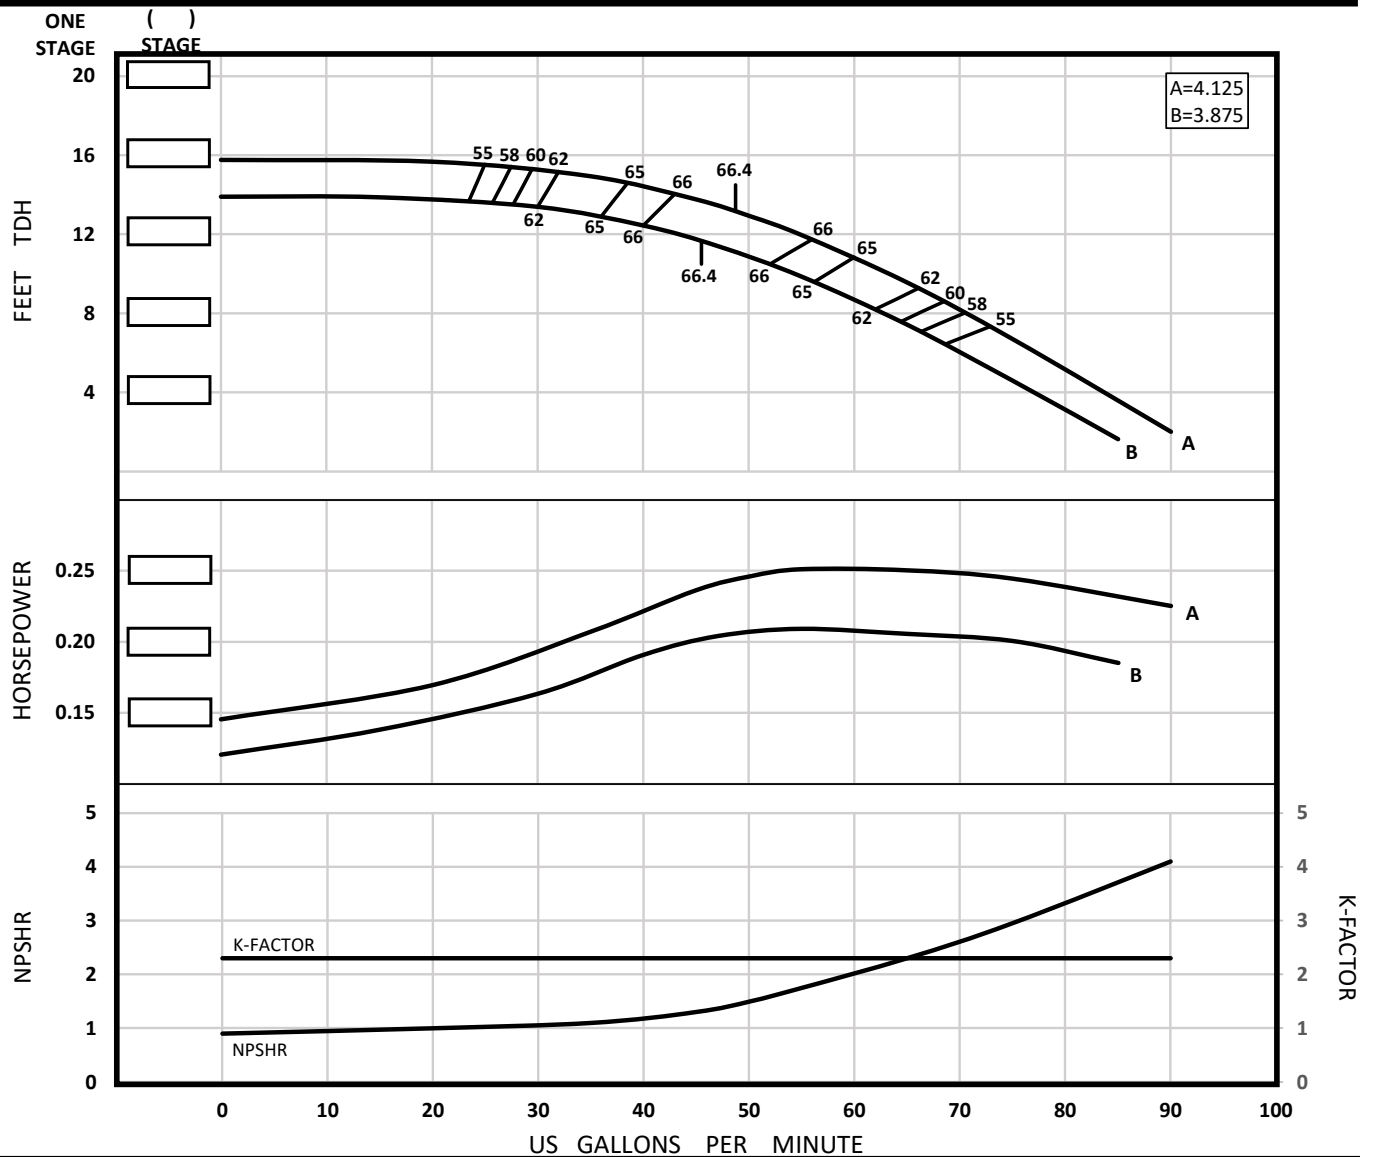

Impeller Type	Enclosed	Bowl OD (in.)	5.25	PEI cl	.819	Qty.	Eff.
Impeller Model	SP5XXL	Thd'd Discharge Size	3" / 4"	Ns	1816	Stages	Change
One Stage Weight (lb)	50.00	Thd'd Suction Size	4"	Nss	9188	1	-4
Add'l Stage Wt. (lb)	14.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	0.875	2	-3
Impeller Wt. (lb)	1.85	Sub. Mtr. Size	4" / 6"	Lateral (in)	.30	3	-2
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	529	Setting (in)	.125	4	-1
One Stage Length (in)	~16.75	D.I. Bowl Rating (psi)	Δ1147	K-Factor (lb/ft tdh)	2.300	5	0
Add'l Stage Length (in)	4.625	S.S. Bowl Rating (psi)	Δ1235	Imp. WR ² (lb-ft ²)	.014		


Δ Consult factory for availability

Rev. 2020.08.20

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.


SP5XL
1770 RPM

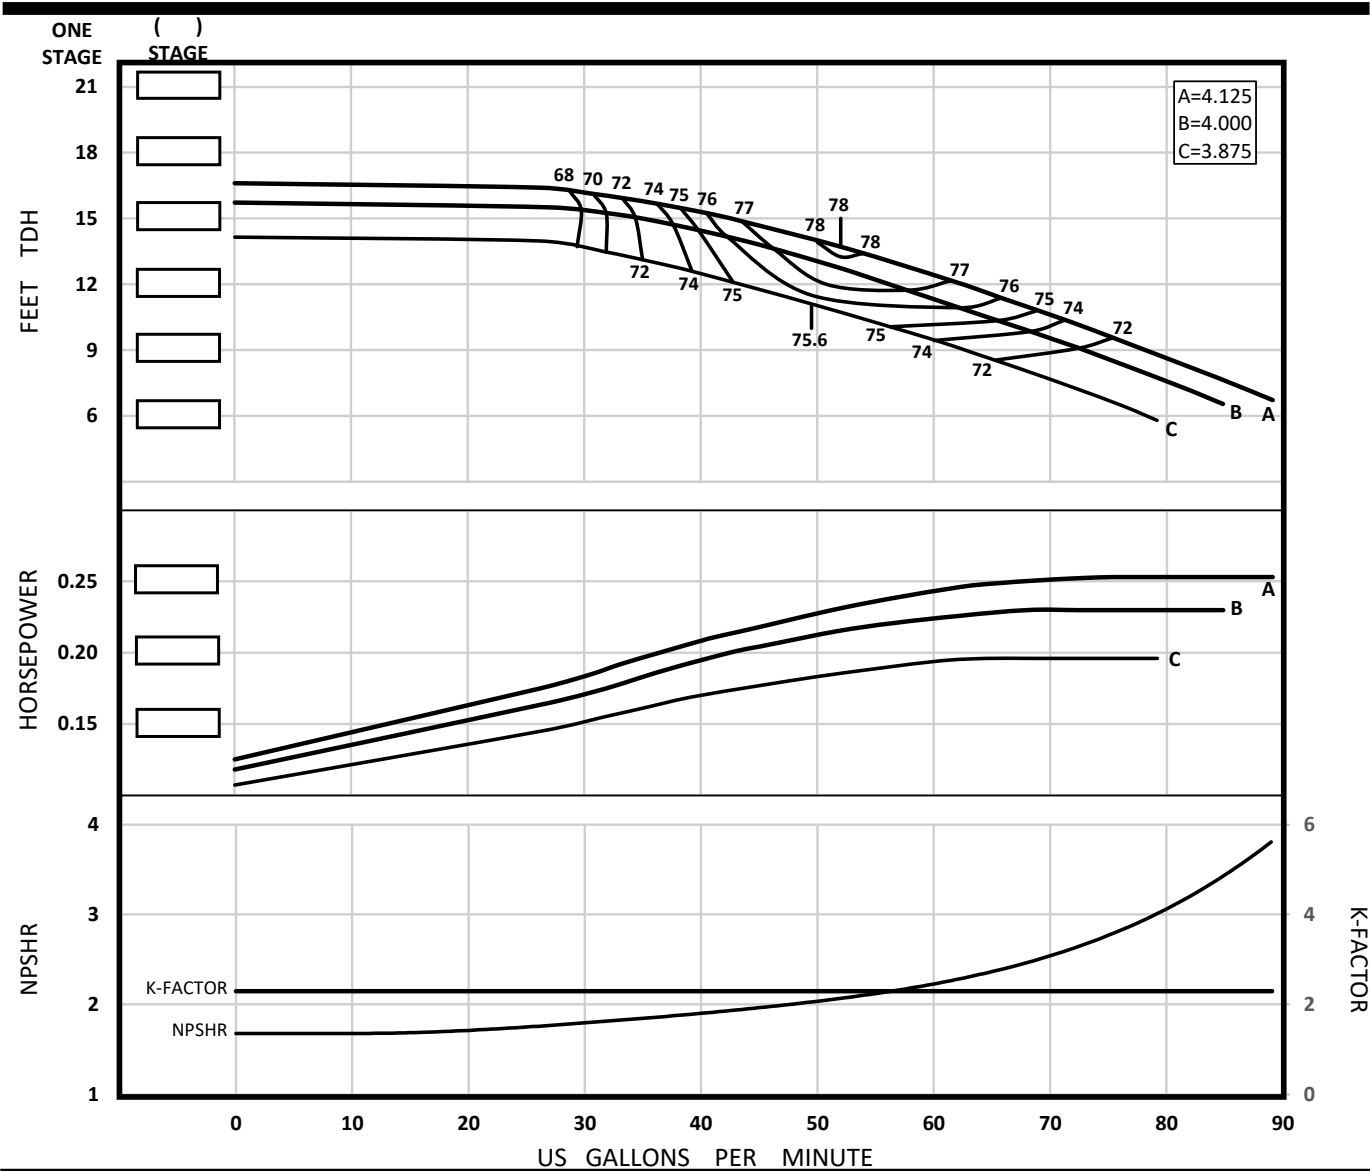

Impeller Type	Enclosed	Bowl OD (in.)	5.25	PEI cl	.834	Qty.	Eff.
Impeller Model	SP5XL	Thd'd Discharge Size	3" / 4"	Ns	1791	Stages	Change
One Stage Weight (lb)	50.00	Thd'd Suction Size	4"	Nss	7385	1	-4
Add'l Stage Wt. (lb)	14.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	0.875	2	-3
Impeller Wt. (lb)	1.70	Sub. Mtr. Size	4" / 6"	Lateral (in)	.30	3	-2
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	529	Setting (in)	.125	4	-1
One Stage Length (in)	~16.75	D.I. Bowl Rating (psi)	Δ1147	K-Factor (lb/ft tdh)	2.300	5	0
Add'l Stage Length (in)	4.625	S.S. Bowl Rating (psi)	Δ1235	Imp. WR² (lb-ft²)	.015		

Δ Consult factory for availability
Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.
Weights and lengths listed are approximate and subject to change. Consult factory.

SP5L 1770 RPM

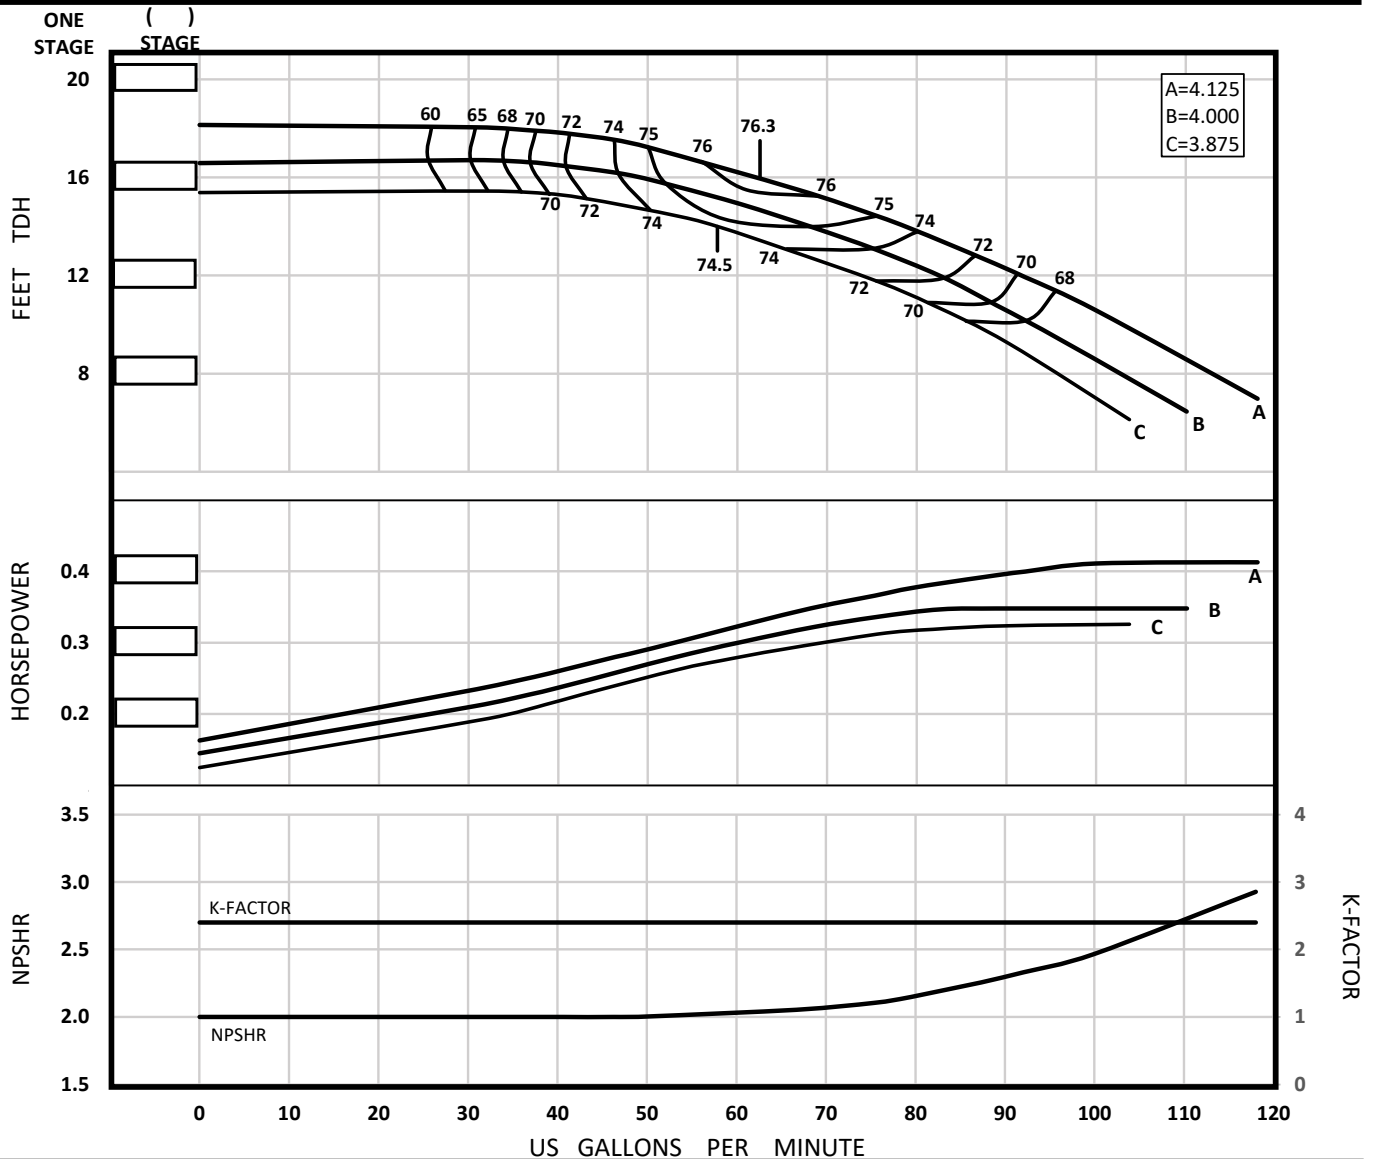


Impeller Type	Enclosed	Bowl OD (in.)	5.25	PEI cl	.840	Qty.	Eff.
Impeller Model	SP5L	Thd'd Discharge Size	3" / 4"	Ns	1744	Stages	Change
One Stage Weight (lb)	50.00	Thd'd Suction Size	4"	Nss	8153	1	-4
Add'l Stage Wt. (lb)	14.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	0.875	2	-3
Impeller Wt. (lb)	1.75	Sub. Mtr. Size	4" / 6"	Lateral (in)	.30	3	-2
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	529	Setting (in)	.125	4	-1
One Stage Length (in)	~16.75	D.I. Bowl Rating (psi)	Δ1147	K-Factor (lb/ft tdh)	2.400	5	0
Add'l Stage Length (in)	4.625	S.S. Bowl Rating (psi)	Δ1235	Imp. WR ² (lb-ft ²)	.015		

Δ Consult factory for availability

Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

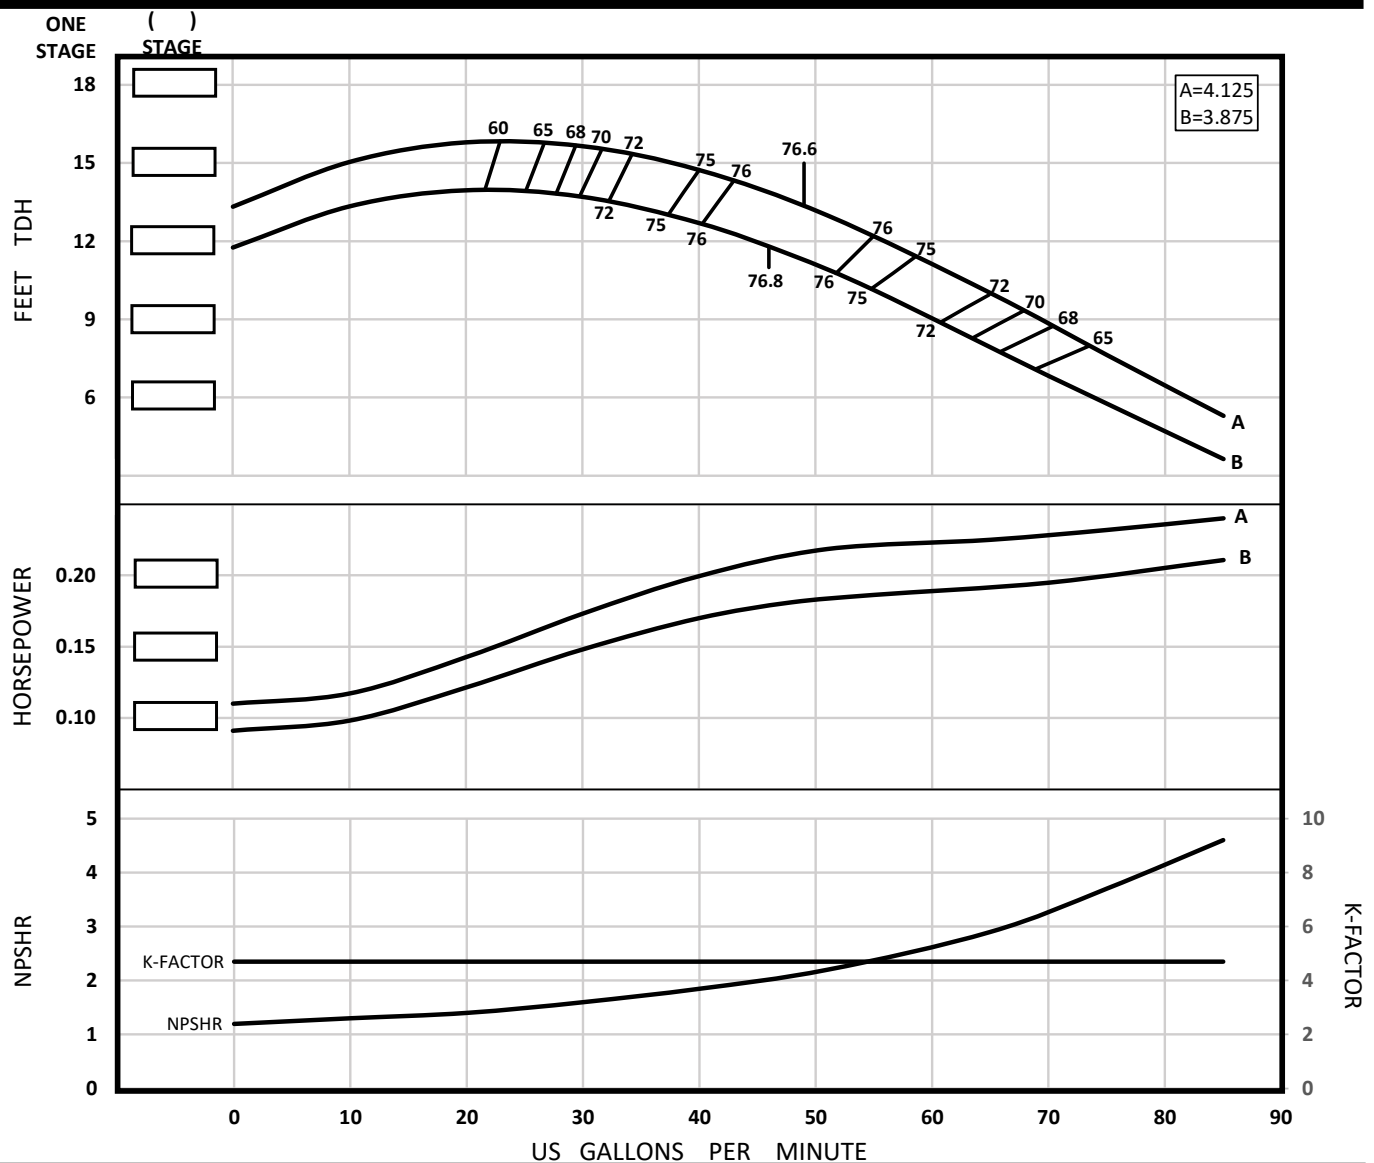SP5LO
1770 RPM

Impeller Type	Semi-Open	Bowl OD (in.)	5.25	PEI cl	.765	Qty.	Eff.
Impeller Model	SP5LO	Thd'd Discharge Size	3" / 4"	Ns	1773	Stages	Change
One Stage Weight (lb)	50.00	Thd'd Suction Size	4"	Nss	6859	1	-6
Add'l Stage Wt. (lb)	14.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	0.875	2	-4
Impeller Wt. (lb)	1.40	Sub. Mtr. Size	4" / 6"	Lateral (in)	.16	3	-3
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	529	Setting (in)	.03	4	-1.5
One Stage Length (in)	~16.438	D.I. Bowl Rating (psi)	Δ1147	K-Factor (lb/ft tdh)	4.700	5	0
Add'l Stage Length (in)	4.313	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.014		

Δ Consult factory for availability


Rev. 2020.08.20

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.




SM5M
1770 RPM

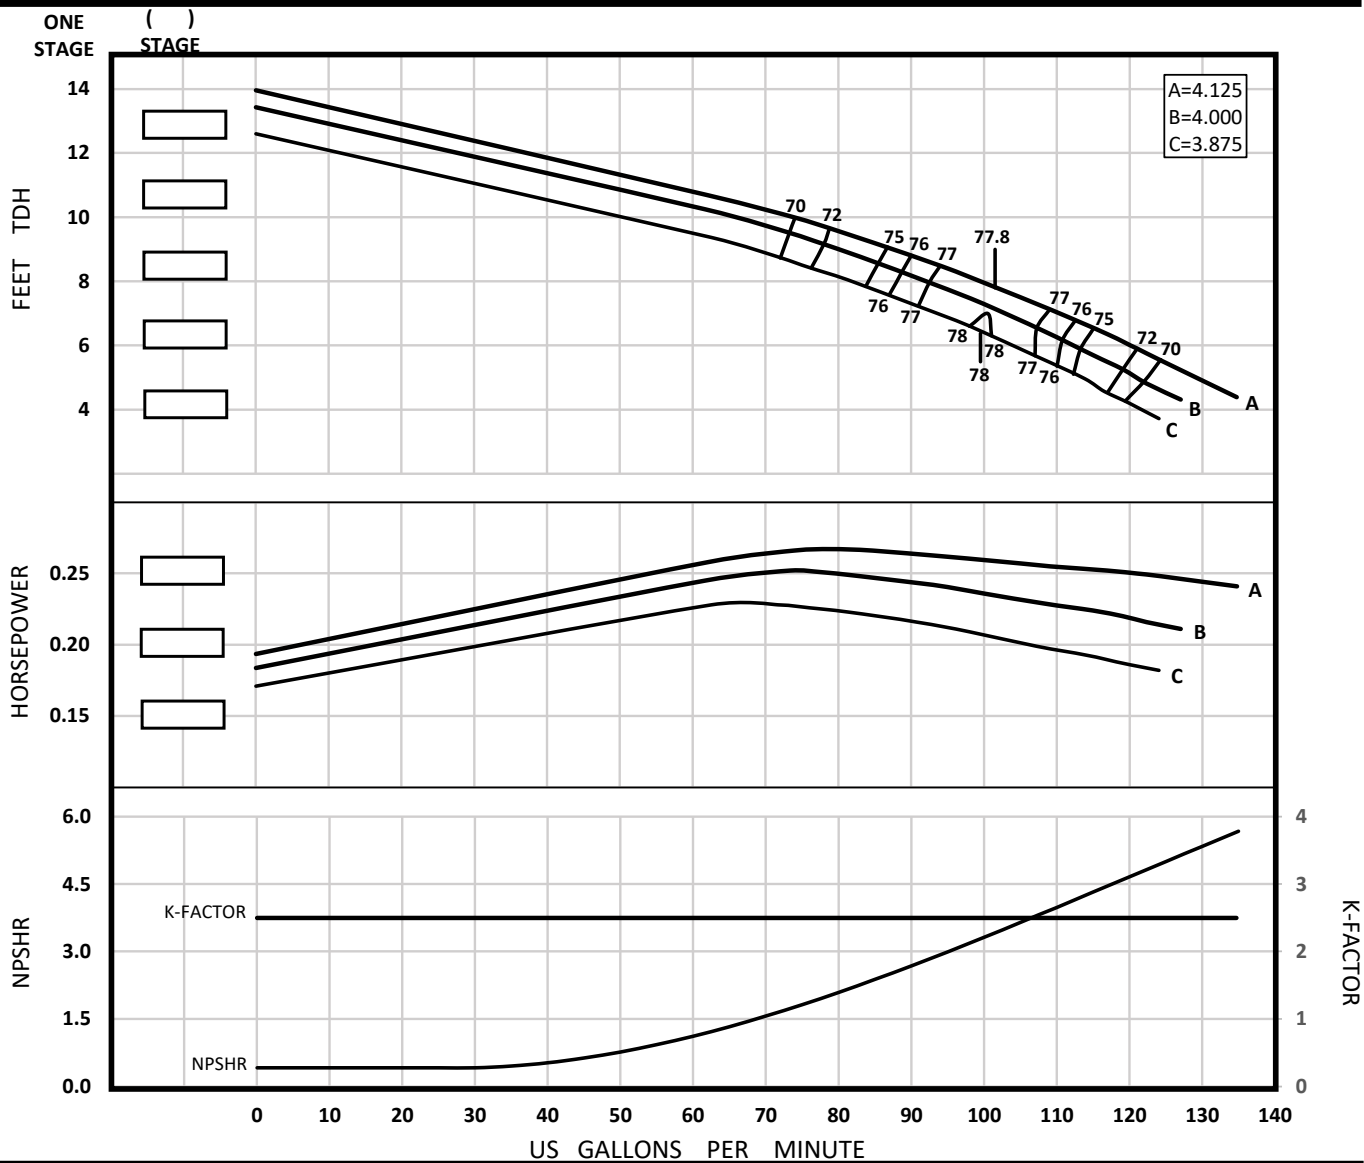

Impeller Type	Enclosed	Bowl OD (in.)	5.25	PEI cl	.858	Qty.	Eff.
Impeller Model	SM5M	Thd'd Discharge Size	3" / 4"	Ns	3810	Stages	Change
One Stage Weight (lb)	50.00	Thd'd Suction Size	4"	Nss	7089	1	-4
Add'l Stage Wt. (lb)	14.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	0.875	2	-3
Impeller Wt. (lb)	1.85	Sub. Mtr. Size	4" / 6"	Lateral (in)	.55	3	-2
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	697	Setting (in)	.125	4	-1
One Stage Length (in)	~17.00	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	2.500	5	0
Add'l Stage Length (in)	4.875	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.015		

Δ Consult factory for availability
Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.
Weights and lengths listed are approximate and subject to change. Consult factory.

SM5H 1770 RPM

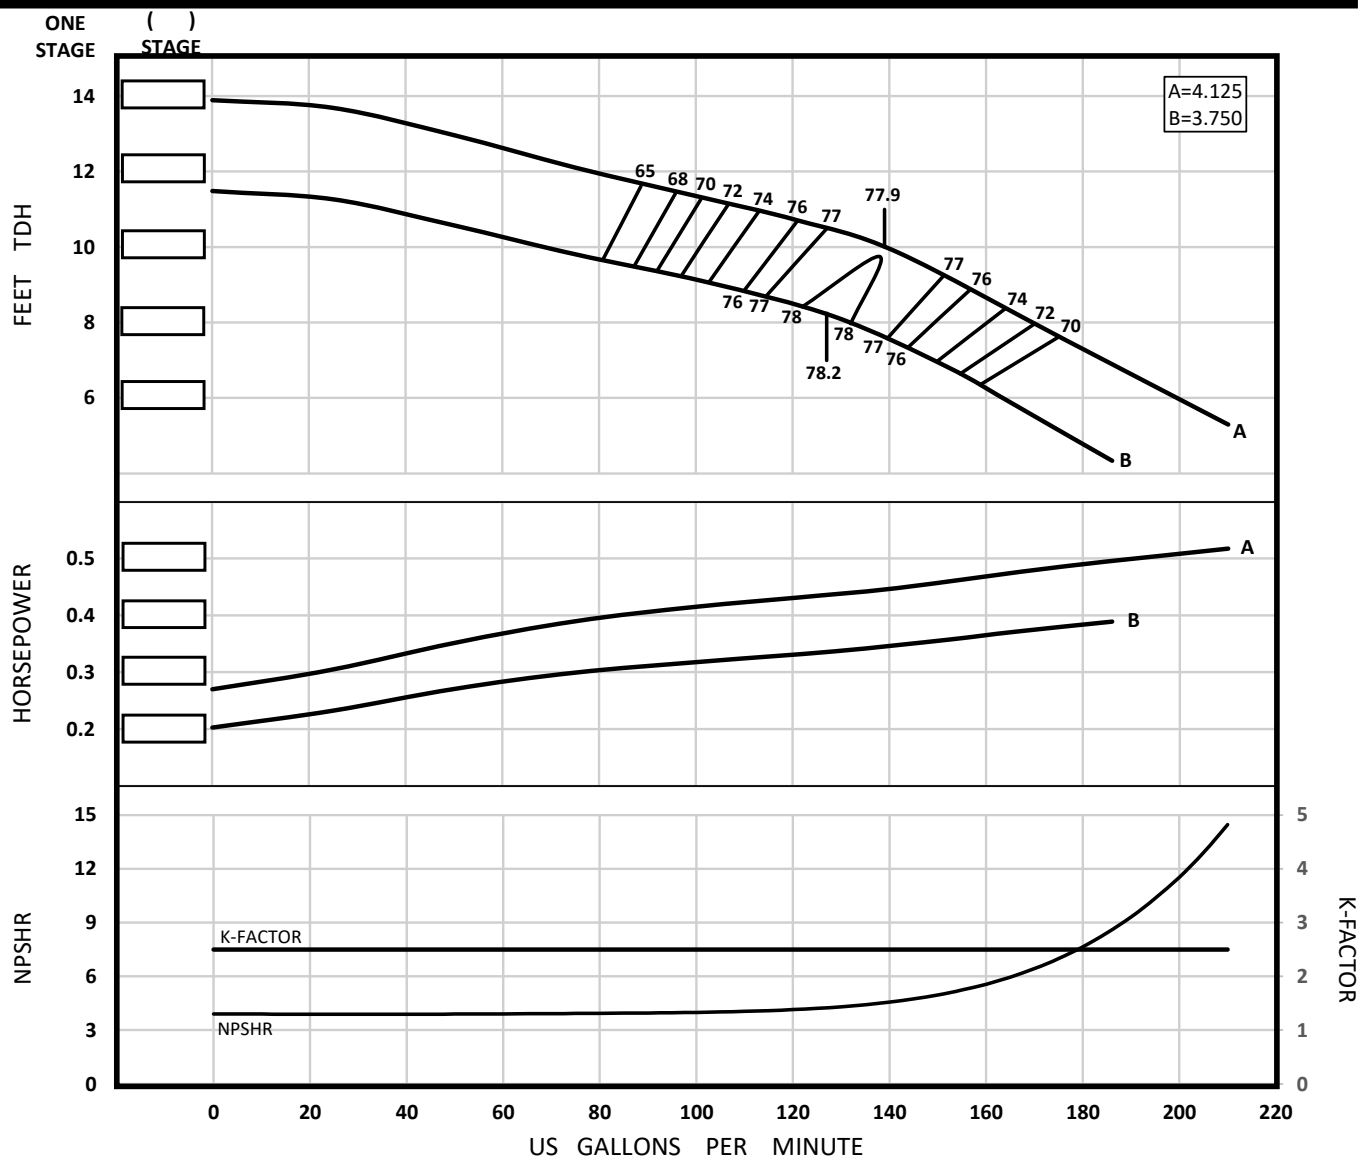

Impeller Type	Enclosed	Bowl OD (in.)	5.25	PEI cl	.797	Qty.	Eff.
Impeller Model	SM5H	Thd'd Discharge Size	3" / 4"	Ns	3725	Stages	Change
One Stage Weight (lb)	50.00	Thd'd Suction Size	4"	Nss	6656	1	-4
Add'l Stage Wt. (lb)	14.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	0.875	2	-3
Impeller Wt. (lb)	1.95	Sub. Mtr. Size	4" / 6"	Lateral (in)	.55	3	-2
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	697	Setting (in)	.125	4	-1
One Stage Length (in)	~17.00	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	2.500	5	0
Add'l Stage Length (in)	4.875	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.015		

Δ Consult factory for availability


Rev. 2020.07.06

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SP6LL 1770 RPM

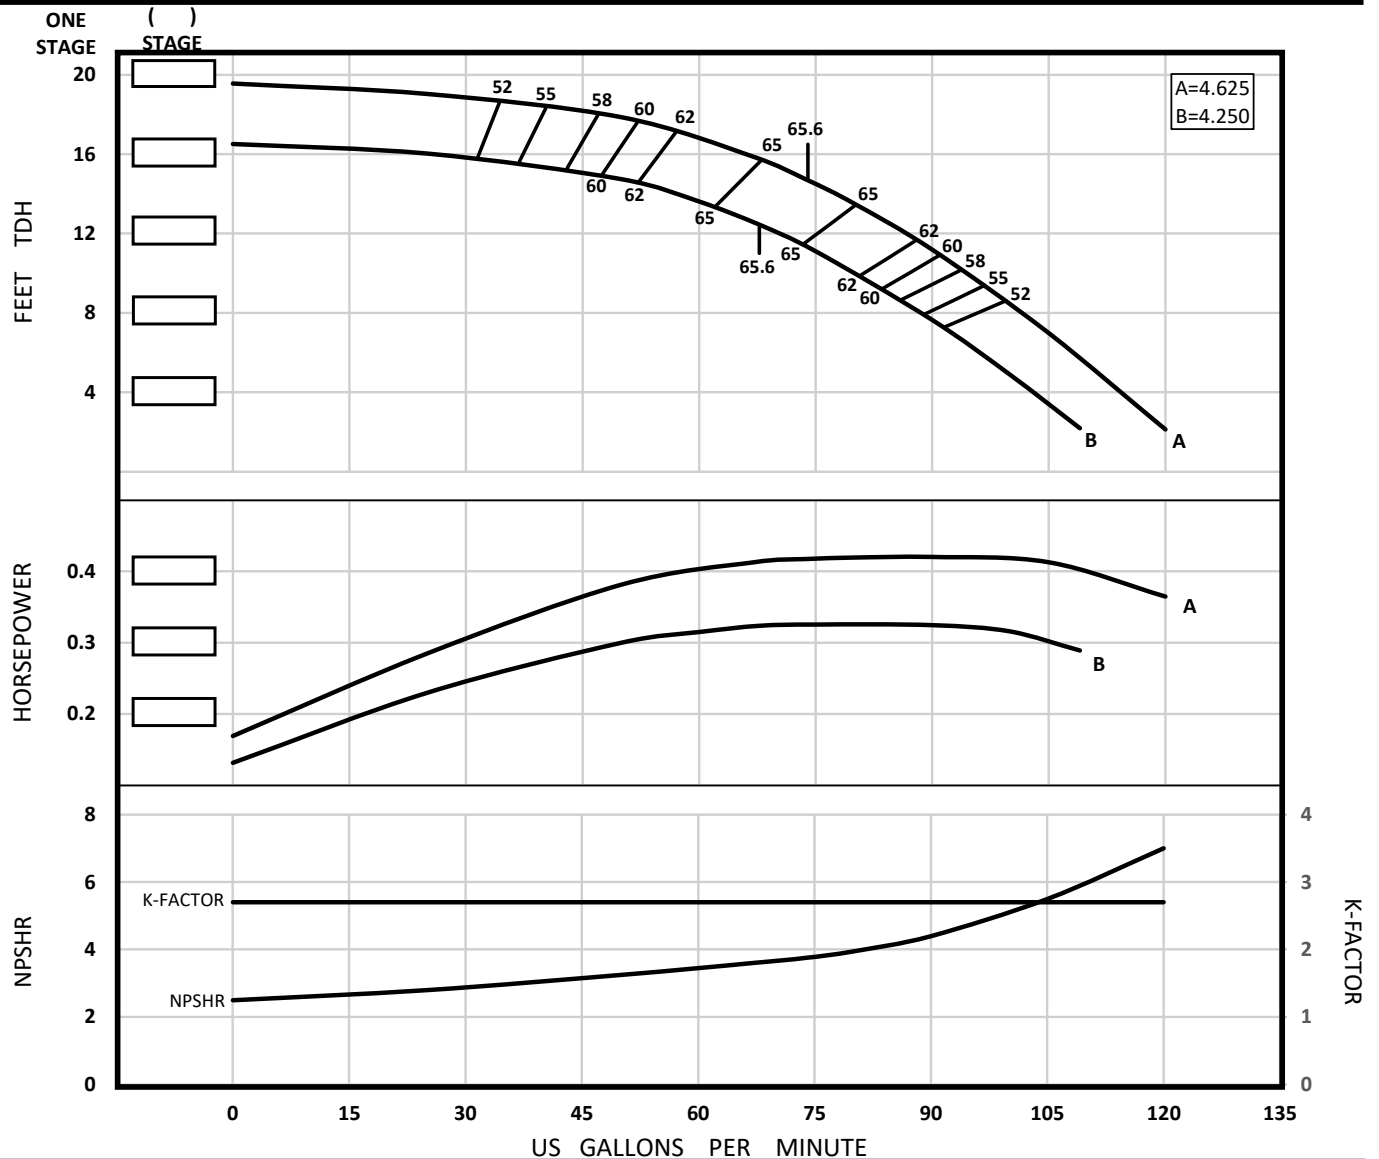

Impeller Type	Enclosed	Bowl OD (in.)	6.00	PEI cl	.889	Qty.	Eff.
Impeller Model	SP6LL	Thd'd Discharge Size	3" / 4"	Ns	2030	Stages	Change
One Stage Weight (lb)	58.00	Thd'd Suction Size	4"	Nss	5650	1	-5
Add'l Stage Wt. (lb)	18.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	1.000	2	-4
Impeller Wt. (lb)	2.55	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.66	3	-3
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	858	Setting (in)	.125	4	-1
One Stage Length (in)	~17.438	D.I. Bowl Rating (psi)	Δ1859	K-Factor (lb/ft tdh)	2.700	5	0
Add'l Stage Length (in)	4.813	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.037		


Δ Consult factory for availability

Rev. 2020.08.21

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

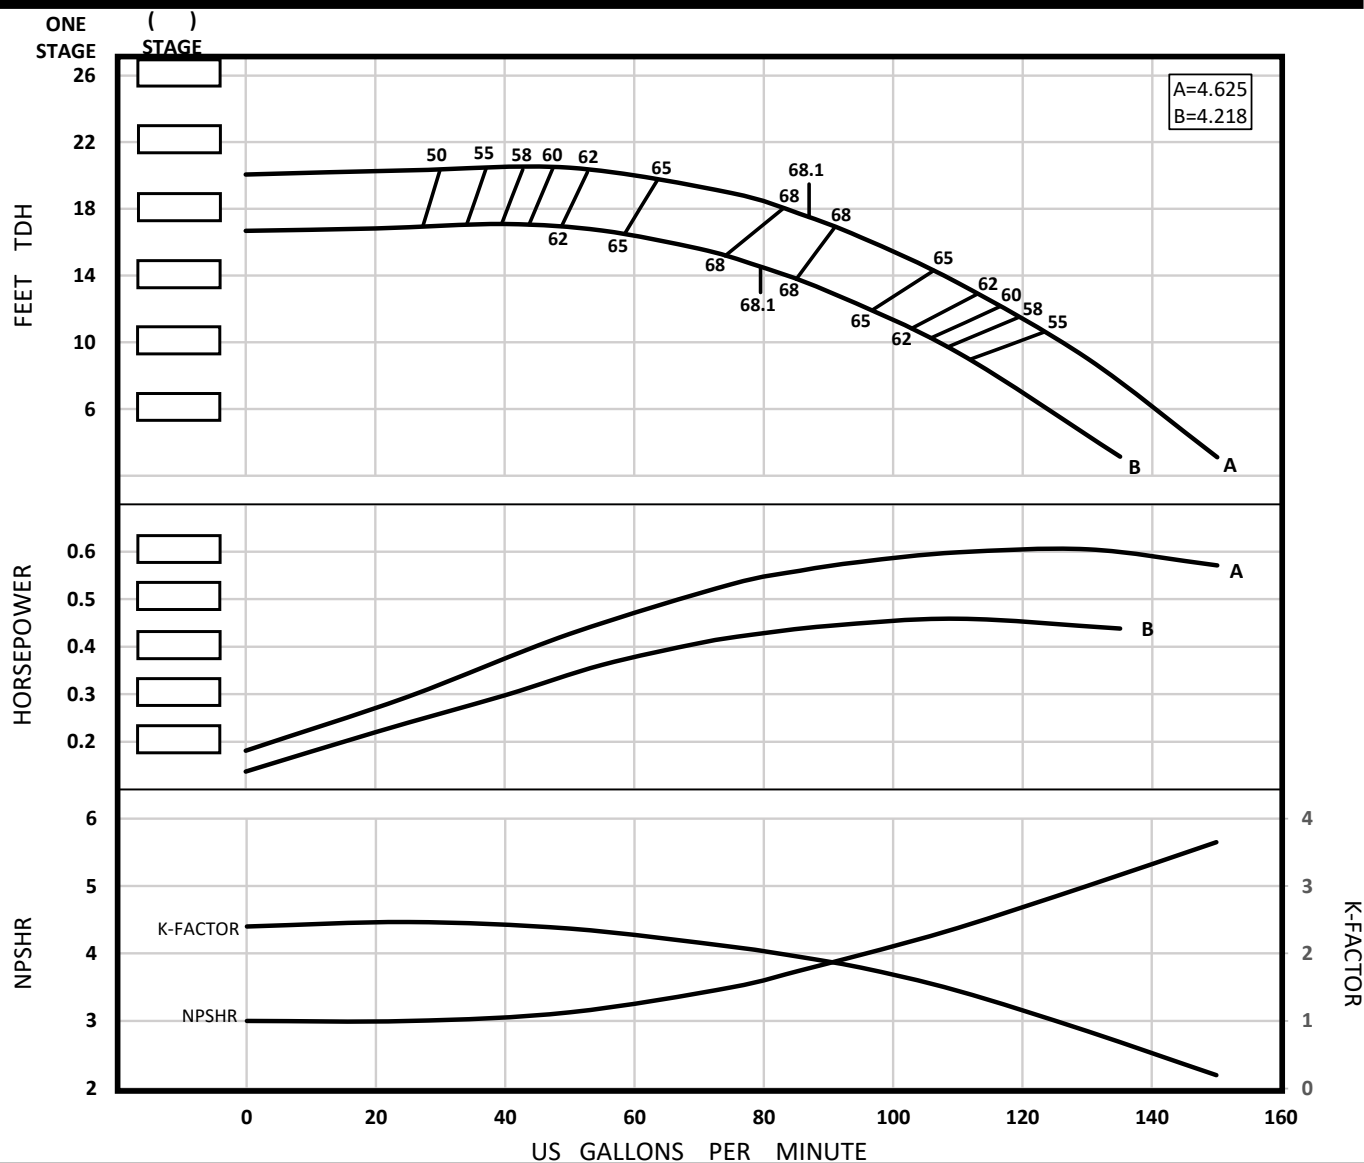

SP6M
1770 RPM

Impeller Type	Enclosed	Bowl OD (in.)	6.00	PEI cl	.879	Qty.	Eff.
Impeller Model	SP6M	Thd'd Discharge Size	3" / 4"	Ns	1929	Stages	Change
One Stage Weight (lb)	56.00	Thd'd Suction Size	4"	Nss	6126	1	-4
Add'l Stage Wt. (lb)	19.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	1.000	2	-3
Impeller Wt. (lb)	2.95	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.41	3	-2
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	858	Setting (in)	.125	4	-1
One Stage Length (in)	~17.438	D.I. Bowl Rating (psi)	Δ1859	K-Factor (lb/ft tdk)	CURVE	5	0
Add'l Stage Length (in)	4.813	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.037		

Δ Consult factory for availability


Rev. 2020.08.21

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SP6H 1770 RPM

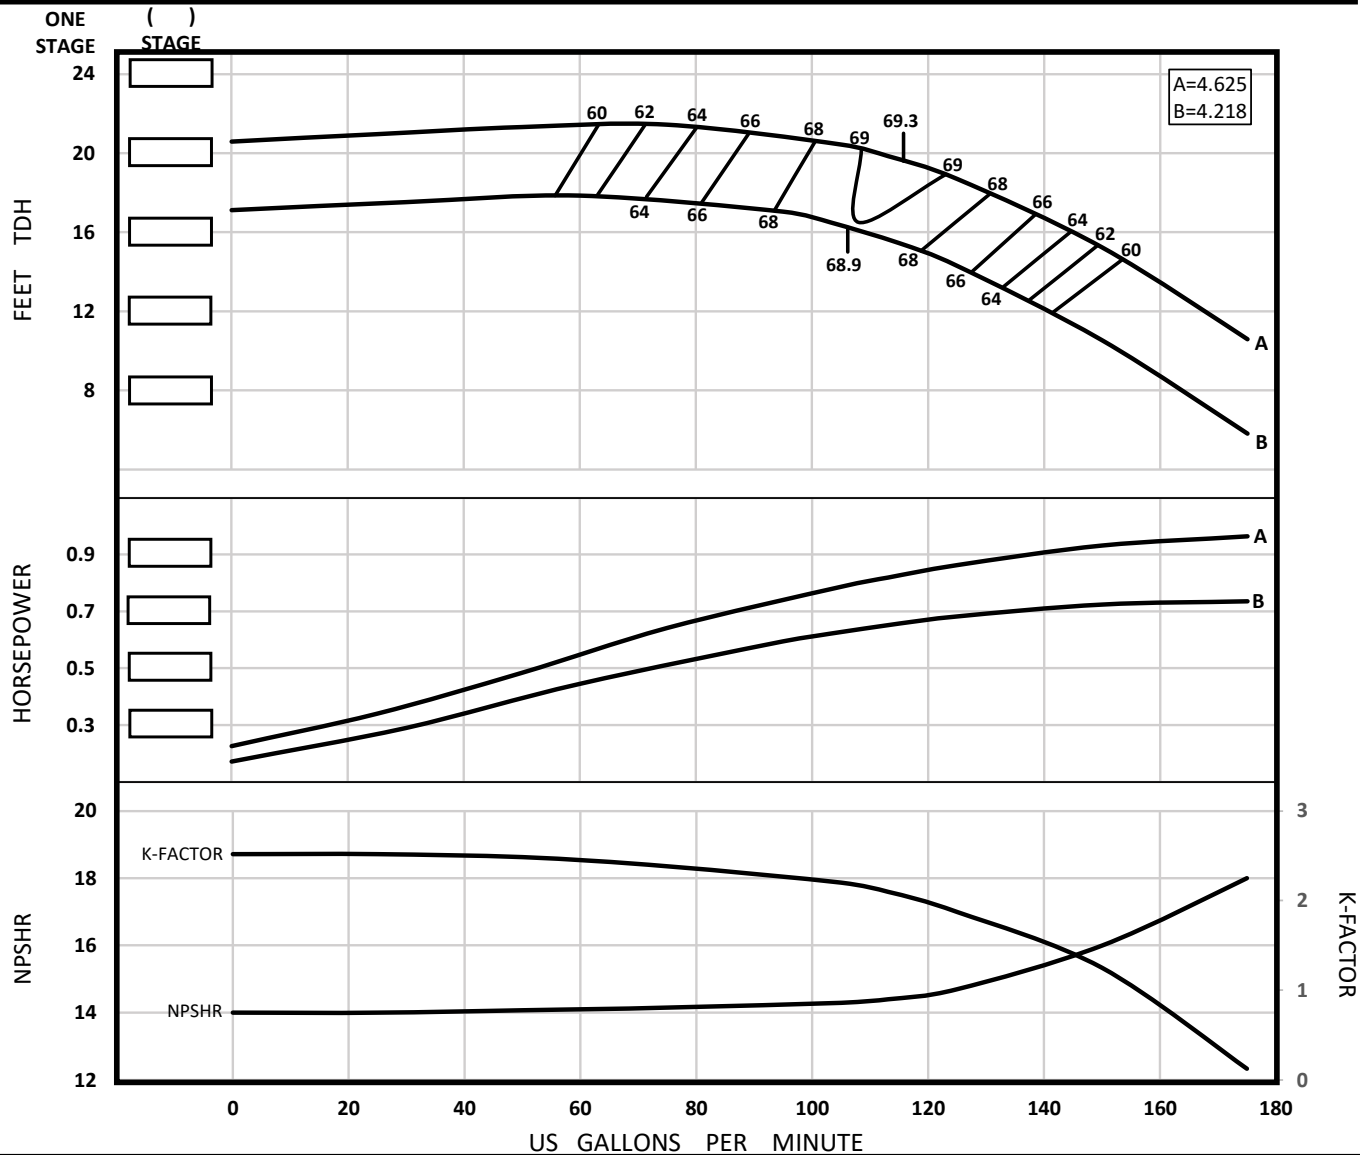

Impeller Type	Enclosed	Bowl OD (in.)	6.00	PEI cl	.897	Qty.	Eff.
Impeller Model	SP6H	Thd'd Discharge Size	3" / 4"	Ns	2042	Stages	Change
One Stage Weight (lb)	55.00	Thd'd Suction Size	4"	Nss	2576	1	-4
Add'l Stage Wt. (lb)	19.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	1.000	2	-3
Impeller Wt. (lb)	2.75	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.28	3	-2
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	858	Setting (in)	.125	4	-1
One Stage Length (in)	~17.438	D.I. Bowl Rating (psi)	Δ1859	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	4.813	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.034		


Δ Consult factory for availability

Rev. 2021.06.08

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

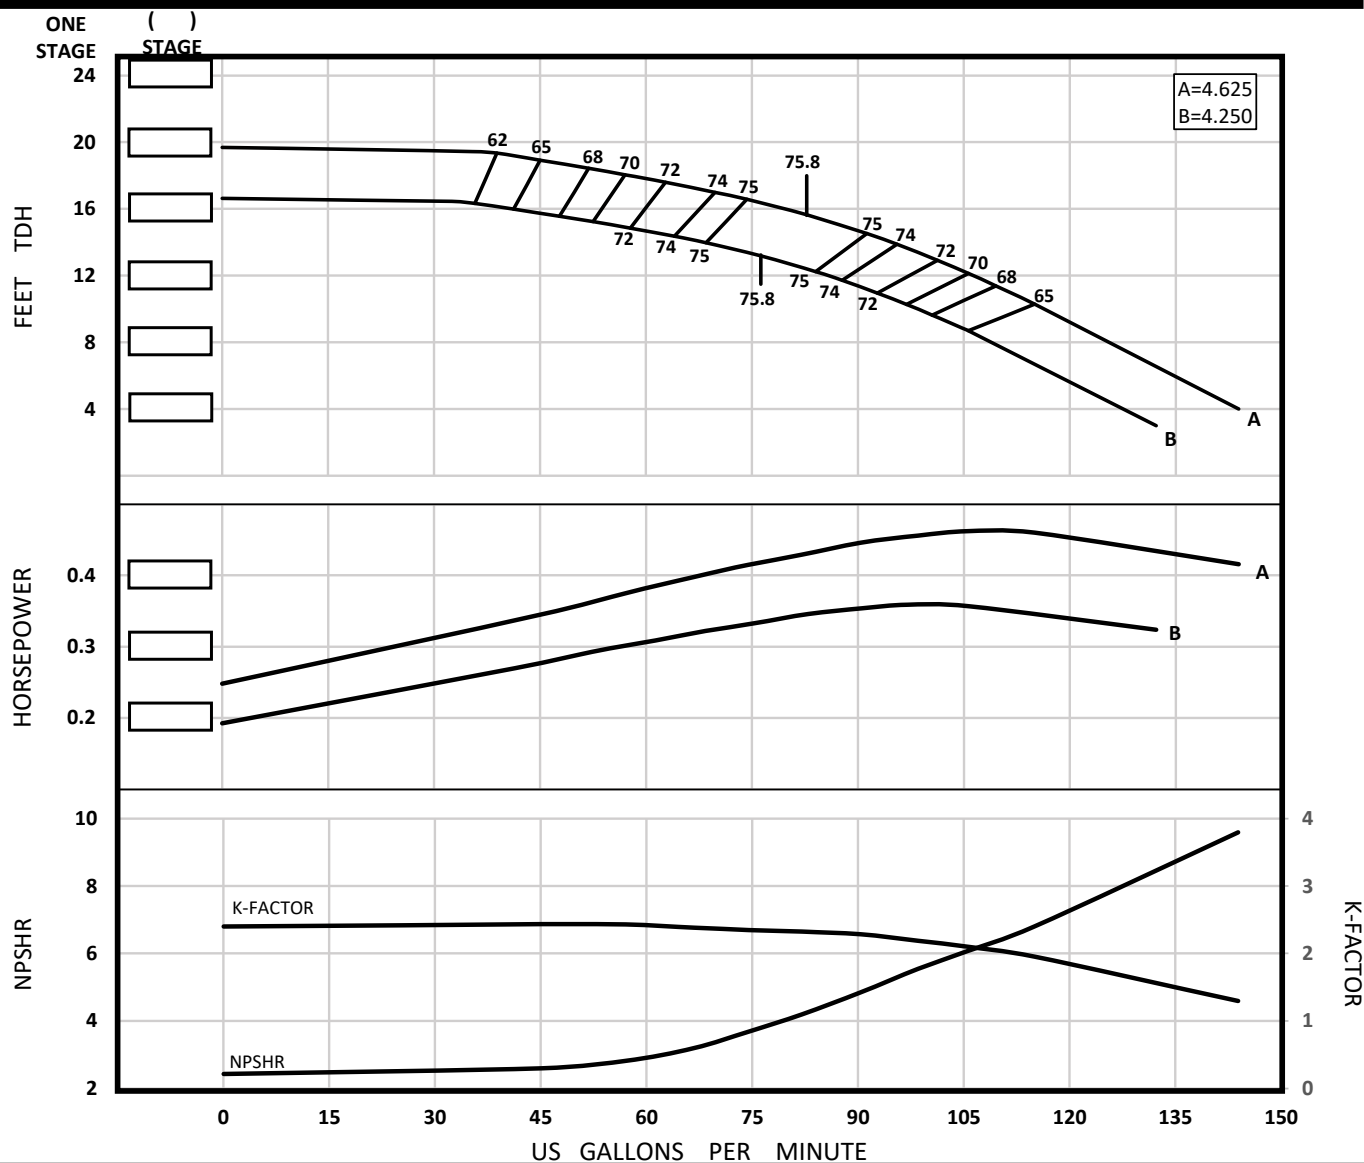

SP6LO
1770 RPM

Impeller Type	Semi-Open	Bowl OD (in.)	6.00	PEI cl	N/A	Qty.	Eff.
Impeller Model	SP6LO	Thd'd Discharge Size	3" / 4"	Ns	2047	Stages	Change
One Stage Weight (lb)	53.00	Thd'd Suction Size	4"	Nss	5488	1	-5.5
Add'l Stage Wt. (lb)	18.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	1.000	2	-4
Impeller Wt. (lb)	1.60	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.70	3	-3
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	858	Setting (in)	.03	4	-1.5
One Stage Length (in)	~17.438	D.I. Bowl Rating (psi)	Δ1859	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	4.813	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.019		

Δ Consult factory for availability


Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SP6MO 1770 RPM

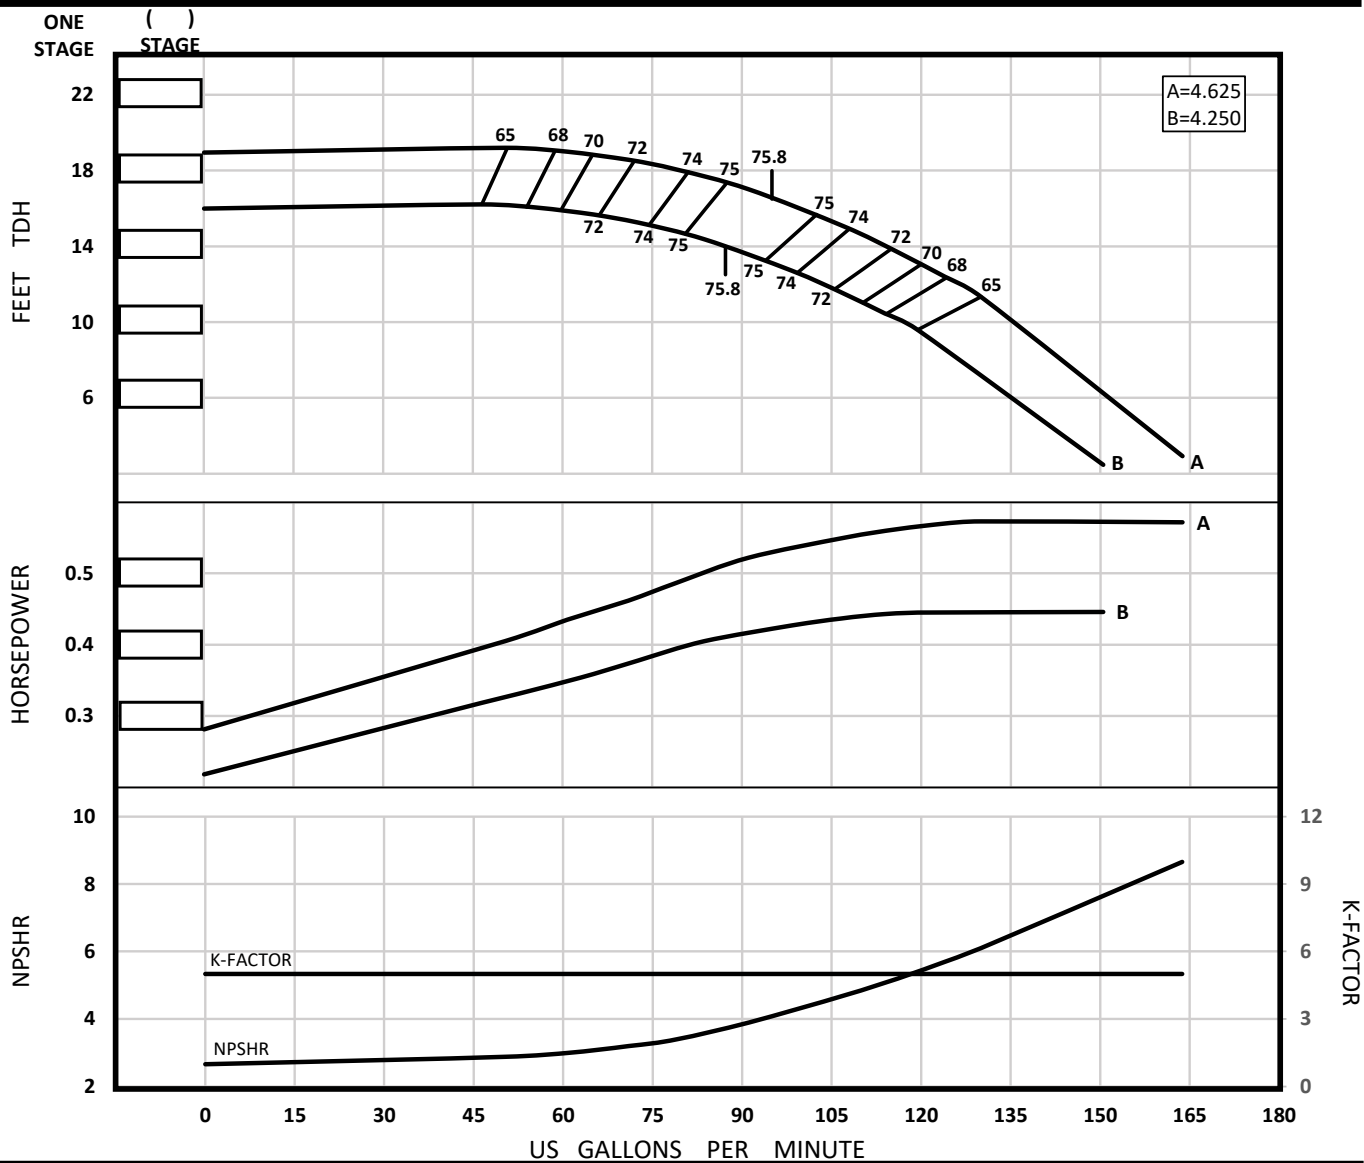

Impeller Type	Semi-Open	Bowl OD (in.)	6.00	PEI cl	N/A	Qty.	Eff.
Impeller Model	SP6MO	Thd'd Discharge Size	3" / 4"	Ns	2098	Stages	Change
One Stage Weight (lb)	53.00	Thd'd Suction Size	4"	Nss	6216	1	-5
Add'l Stage Wt. (lb)	18.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	1.000	2	-4
Impeller Wt. (lb)	1.40	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.56	3	-3
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	858	Setting (in)	.03	4	-1.5
One Stage Length (in)	~17.438	D.I. Bowl Rating (psi)	Δ1859	K-Factor (lb/ft tdh)	5.000	5	0
Add'l Stage Length (in)	4.813	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.018		

Δ Consult factory for availability


Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SK6HH 1770 RPM

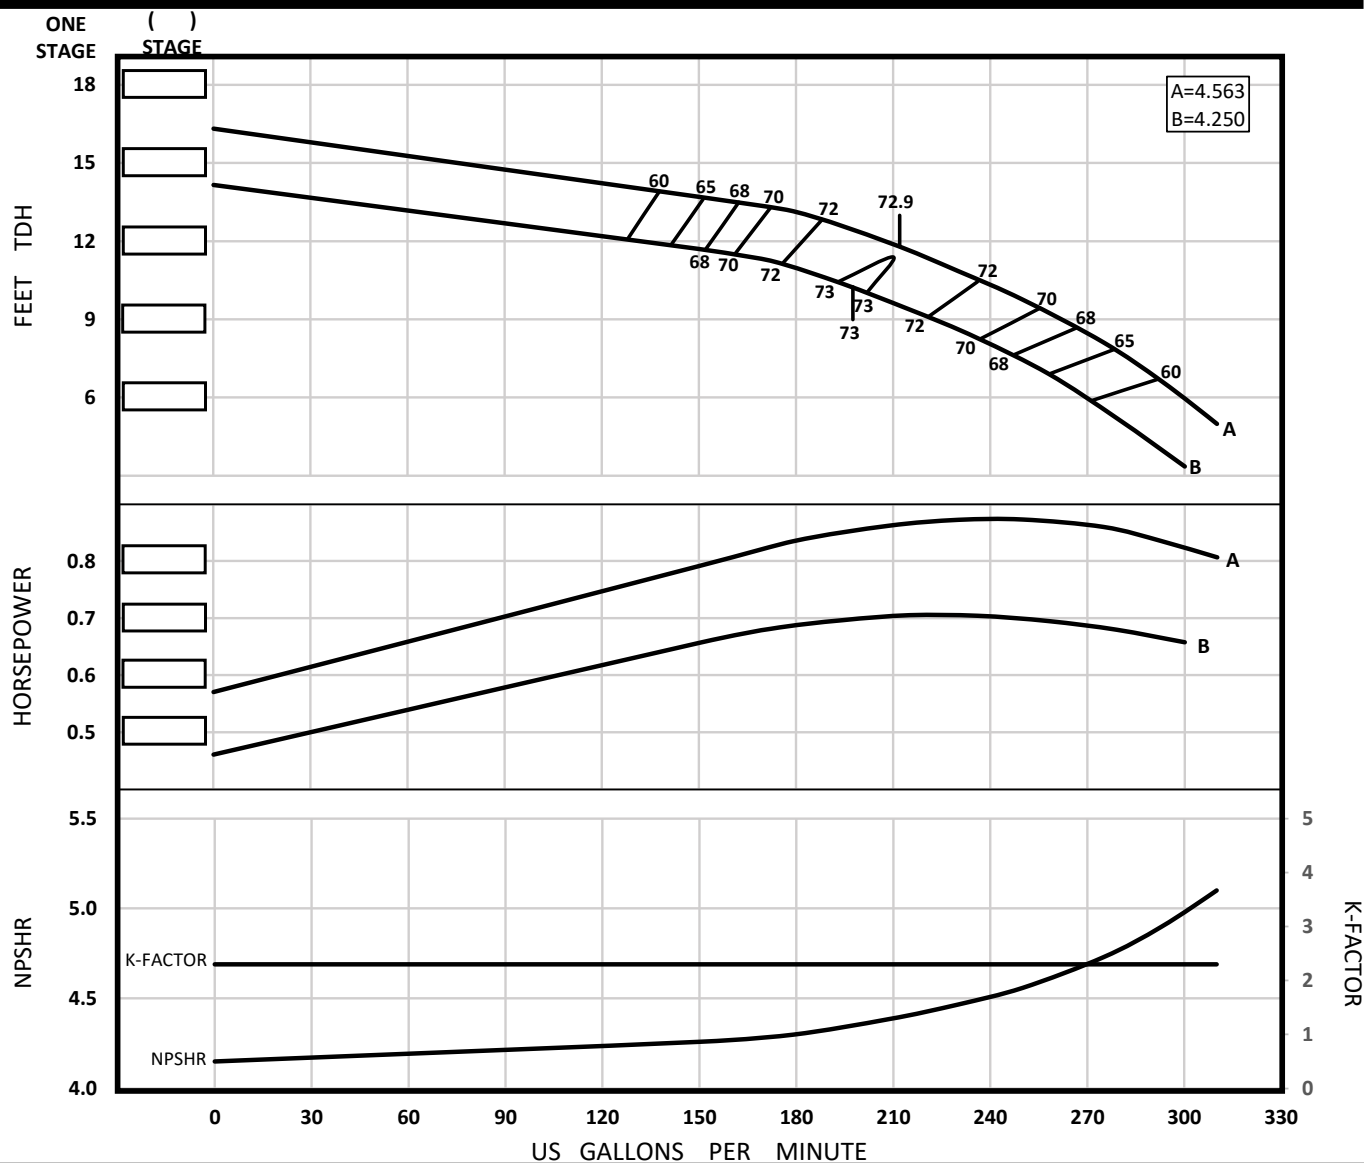

Impeller Type	Enclosed	Bowl OD (in.)	5.50	PEI cl	.869	Qty.	Eff.
Impeller Model	SK6HH	Thd'd Discharge Size	3" / 4"	Ns	4041	Stages	Change
One Stage Weight (lb)	51.00	Thd'd Suction Size	4"	Nss	8387	1	-2
Add'l Stage Wt. (lb)	16.00	Bell Suction Size	6" / 8"	Shaft Size (in.)	1.000	2	-1.5
Impeller Wt. (lb)	2.90	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.50	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	521	Setting (in)	.125	4	0
One Stage Length (in)	~18.125	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdk)	2.300	5	0
Add'l Stage Length (in)	5.500	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.031		

Δ Consult factory for availability


Rev. 2021.06.08

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.




SK7L
1770 RPM

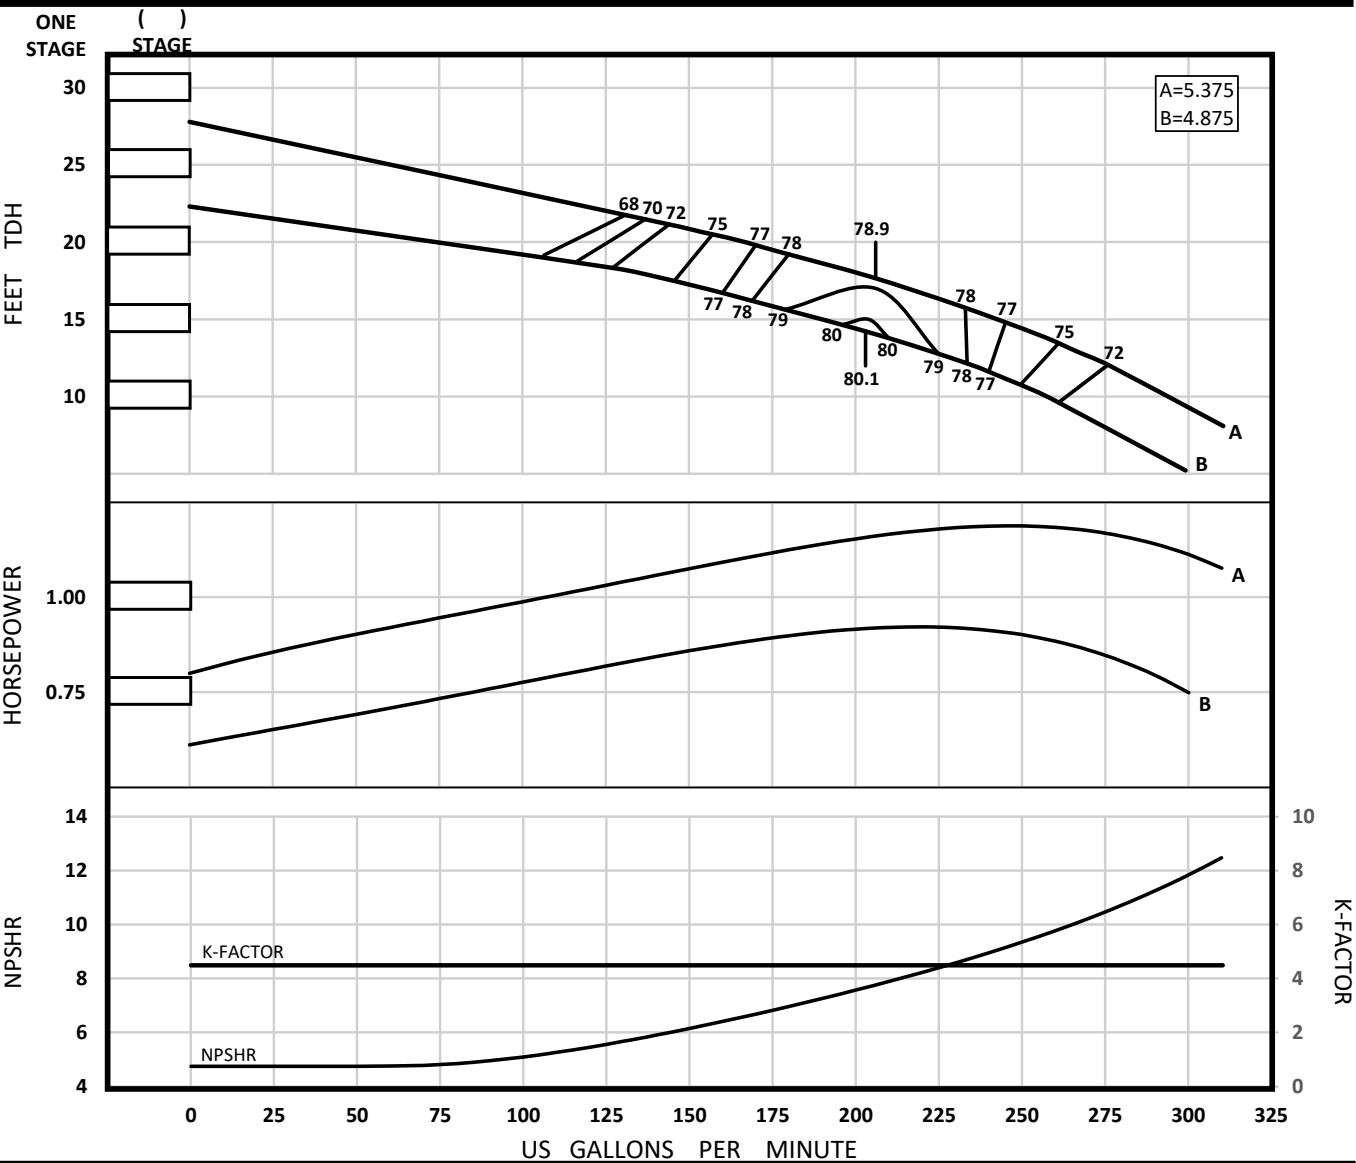

Impeller Type	Enclosed	Bowl OD (in.)	6.56	PEI cl	N/A	Qty.	Eff.
Impeller Model	SK7L	Thd'd Discharge Size	4" / 5" / 6"	Ns	2951	Stages	Change
One Stage Weight (lb)	61.00	Thd'd Suction Size	5"	Nss	5488	1	-3.5
Add'l Stage Wt. (lb)	22.00	Bell Suction Size	8" / 9.38"	Shaft Size (in.)	1.000	2	-2
Impeller Wt. (lb)	3.35	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.94	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	515	Setting (in)	.125	4	-0.5
One Stage Length (in)	~16.00	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	4.490	5	0
Add'l Stage Length (in)	6.375	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.051		

Δ Consult factory for availability
Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.
Weights and lengths listed are approximate and subject to change. Consult factory.

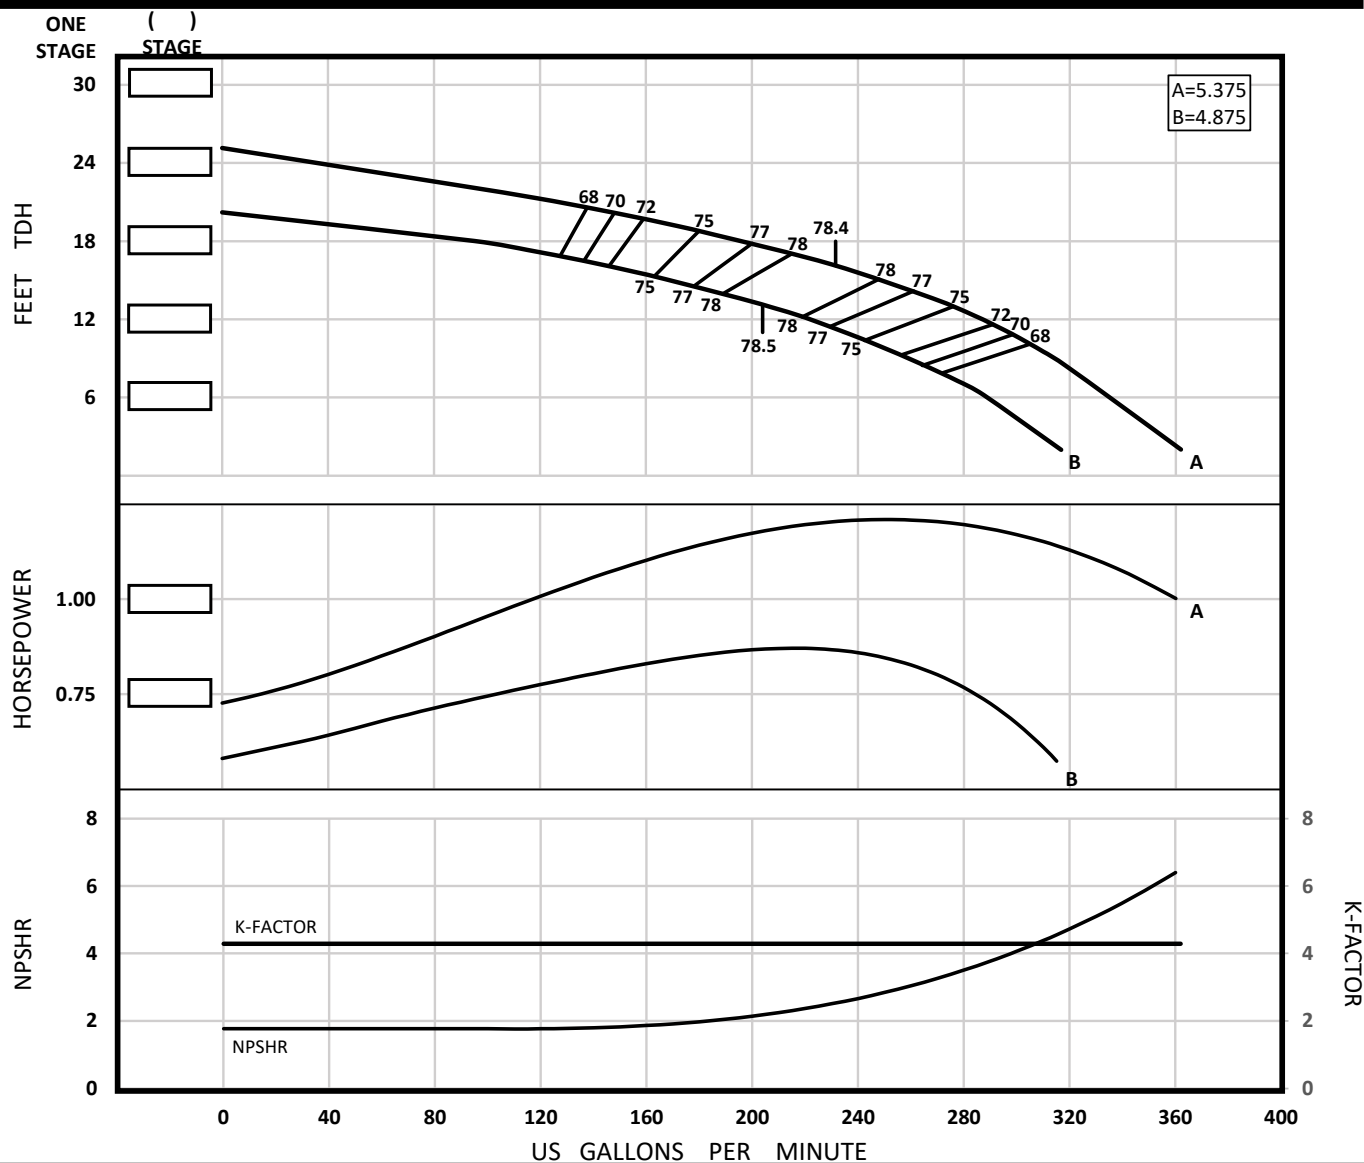SK7M
1770 RPM

Impeller Type	Enclosed	Bowl OD (in.)	6.56	PEI cl	N/A	Qty.	Eff.
Impeller Model	SK7M	Thd'd Discharge Size	4" / 5" / 6"	Ns	3347	Stages	Change
One Stage Weight (lb)	59.00	Thd'd Suction Size	5"	Nss	13714	1	-3.5
Add'l Stage Wt. (lb)	20.00	Bell Suction Size	8" / 9.38"	Shaft Size (in.)	1.000	2	-2
Impeller Wt. (lb)	2.90	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.75	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	515	Setting (in)	.125	4	-0.5
One Stage Length (in)	~16.00	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	4.290	5	0
Add'l Stage Length (in)	6.375	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.046		

Δ Consult factory for availability


Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.




SK7H
1770 RPM

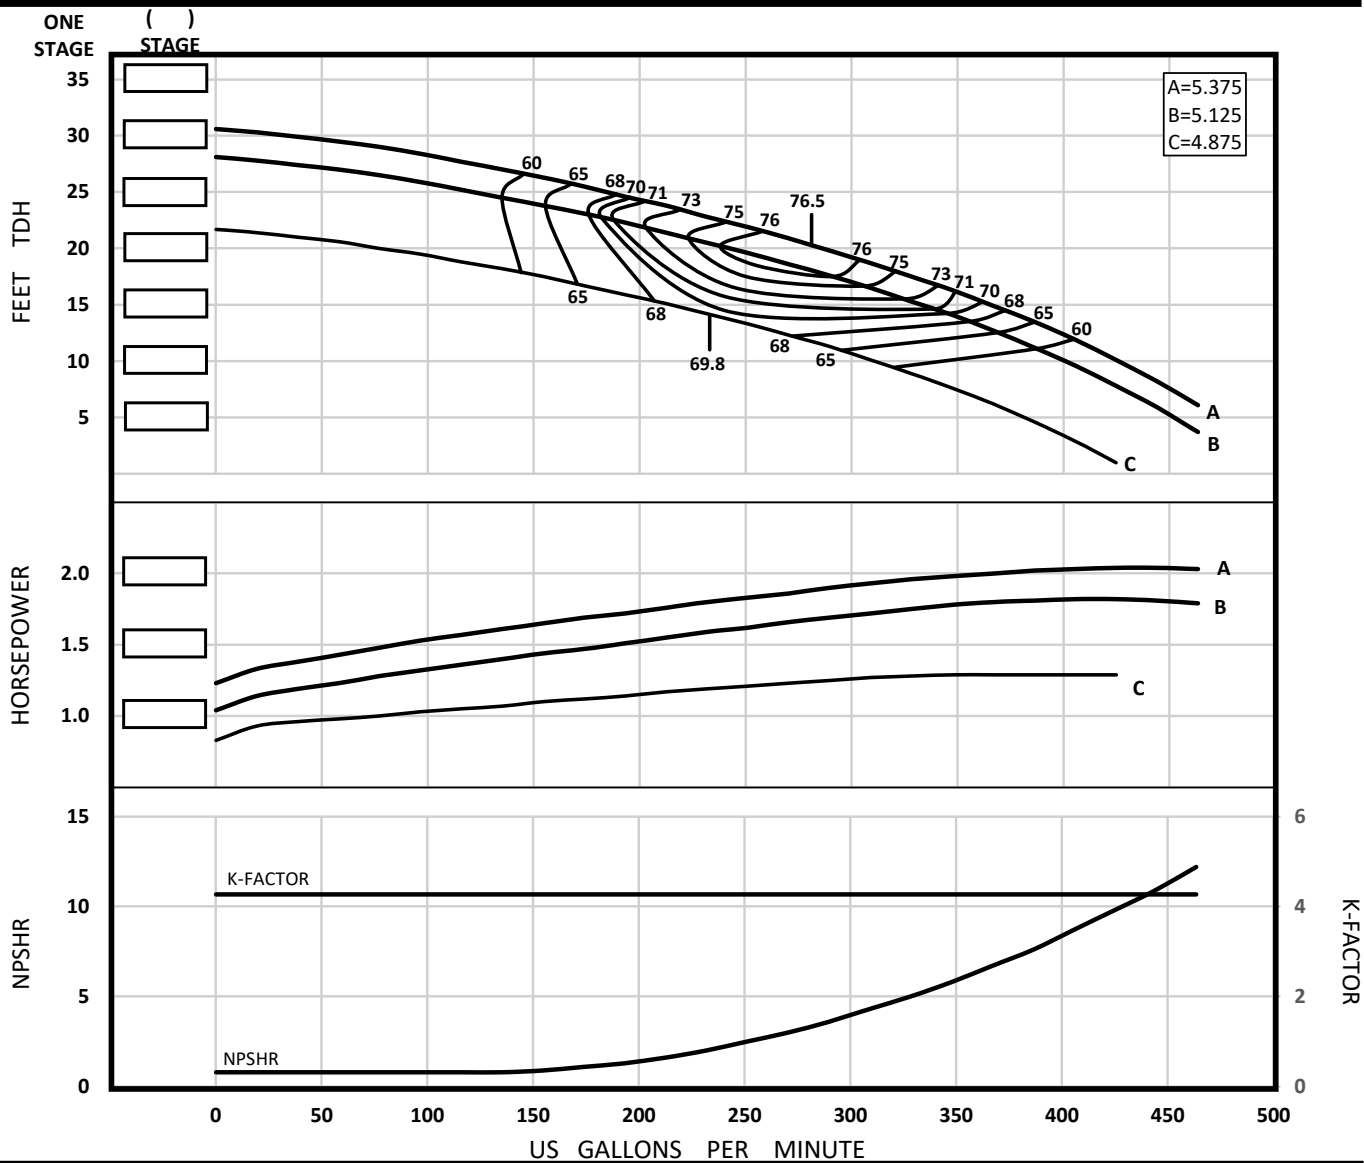

Impeller Type	Enclosed	Bowl OD (in.)	6.56	PEI cl	N/A	Qty.	Eff.
Impeller Model	SK7H	Thd'd Discharge Size	4" / 5" / 6"	Ns	3103	Stages	Change
One Stage Weight (lb)	60.00	Thd'd Suction Size	5"	Nss	13016	1	-3.5
Add'l Stage Wt. (lb)	21.00	Bell Suction Size	8" / 9.38"	Shaft Size (in.)	1.000	2	-2
Impeller Wt. (lb)	3.25	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.75	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	515	Setting (in)	.125	4	-0.5
One Stage Length (in)	~16.00	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	4.270	5	0
Add'l Stage Length (in)	6.375	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.050		

Δ Consult factory for availability
Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.
Weights and lengths listed are approximate and subject to change. Consult factory.

SP7L
1770 RPM

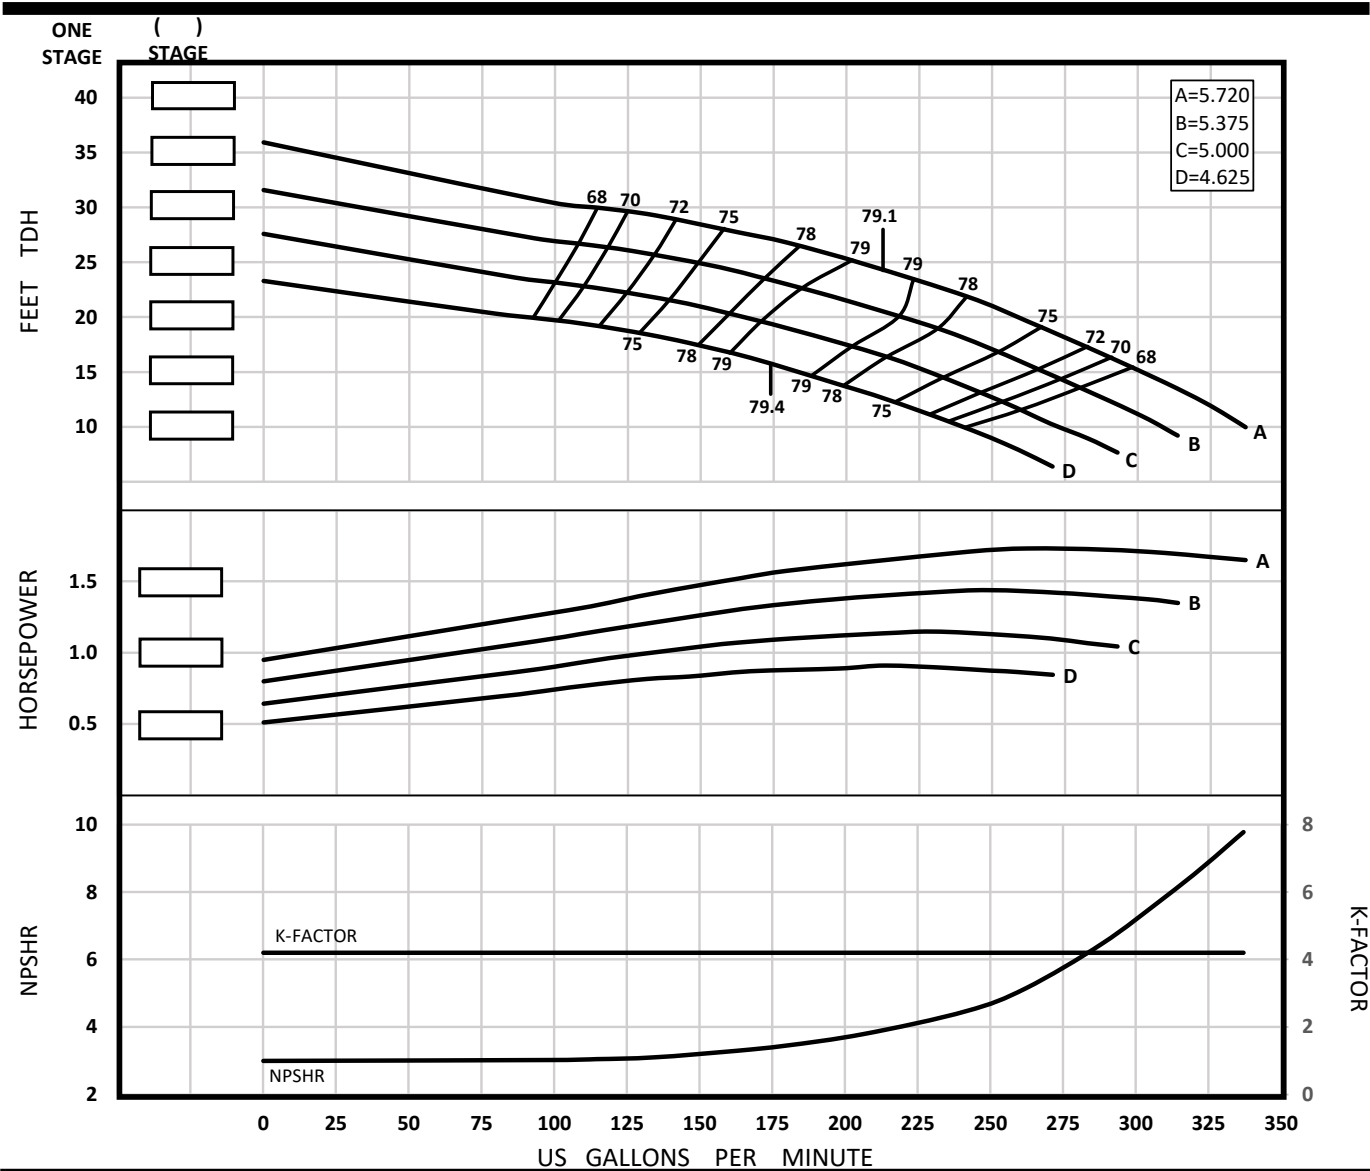

Impeller Type	Enclosed	Bowl OD (in.)	7.19	PEI cl	N/A	Qty.	Eff.
Impeller Model	SP7L	Thd'd Discharge Size	4" / 5" / 6"	Ns	2353	Stages	Change
One Stage Weight (lb)	100.00	Thd'd Suction Size	5"	Nss	9497	1	-4
Add'l Stage Wt. (lb)	34.00	Bell Suction Size	8" / 9.38"	Shaft Size (in.)	1.250	2	-2
Impeller Wt. (lb)	4.05	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.63	3	0
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	378	Setting (in)	.125	4	0
One Stage Length (in)	~19.625	D.I. Bowl Rating (psi)	Δ820	K-Factor (lb/ft tdh)	4.200	5	0
Add'l Stage Length (in)	6.375	S.S. Bowl Rating (psi)	Δ883	Imp. WR² (lb-ft²)	.073		


Δ Consult factory for availability

Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.

SP7H
1770 RPM

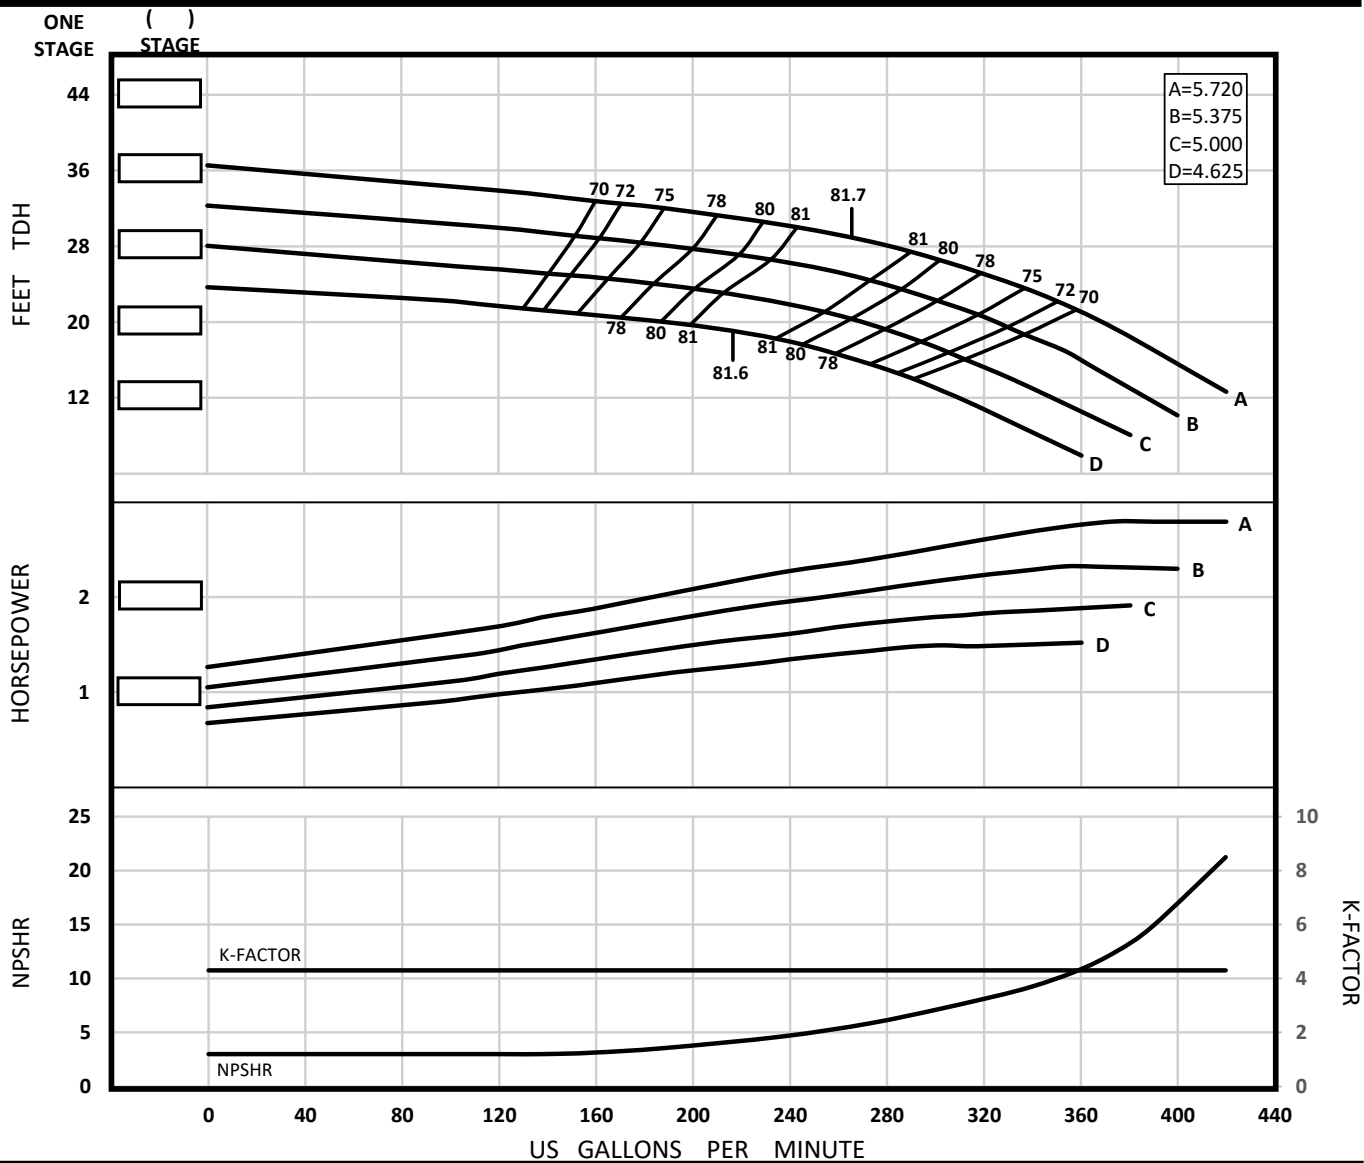

Impeller Type	Enclosed	Bowl OD (in.)	7.19	PEI cl	N/A	Qty.	Eff.
Impeller Model	SP7H	Thd'd Discharge Size	4" / 5" / 6"	Ns	2311	Stages	Change
One Stage Weight (lb)	100.00	Thd'd Suction Size	5"	Nss	7670	1	-3
Add'l Stage Wt. (lb)	34.00	Bell Suction Size	8" / 9.38"	Shaft Size (in.)	1.250	2	-1
Impeller Wt. (lb)	4.00	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.63	3	0
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	378	Setting (in)	.125	4	0
One Stage Length (in)	~19.625	D.I. Bowl Rating (psi)	Δ820	K-Factor (lb/ft tdh)	4.300	5	0
Add'l Stage Length (in)	6.375	S.S. Bowl Rating (psi)	Δ883	Imp. WR ² (lb-ft ²)	.072		

Δ Consult factory for availability
Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.
Weights and lengths listed are approximate and subject to change. Consult factory.

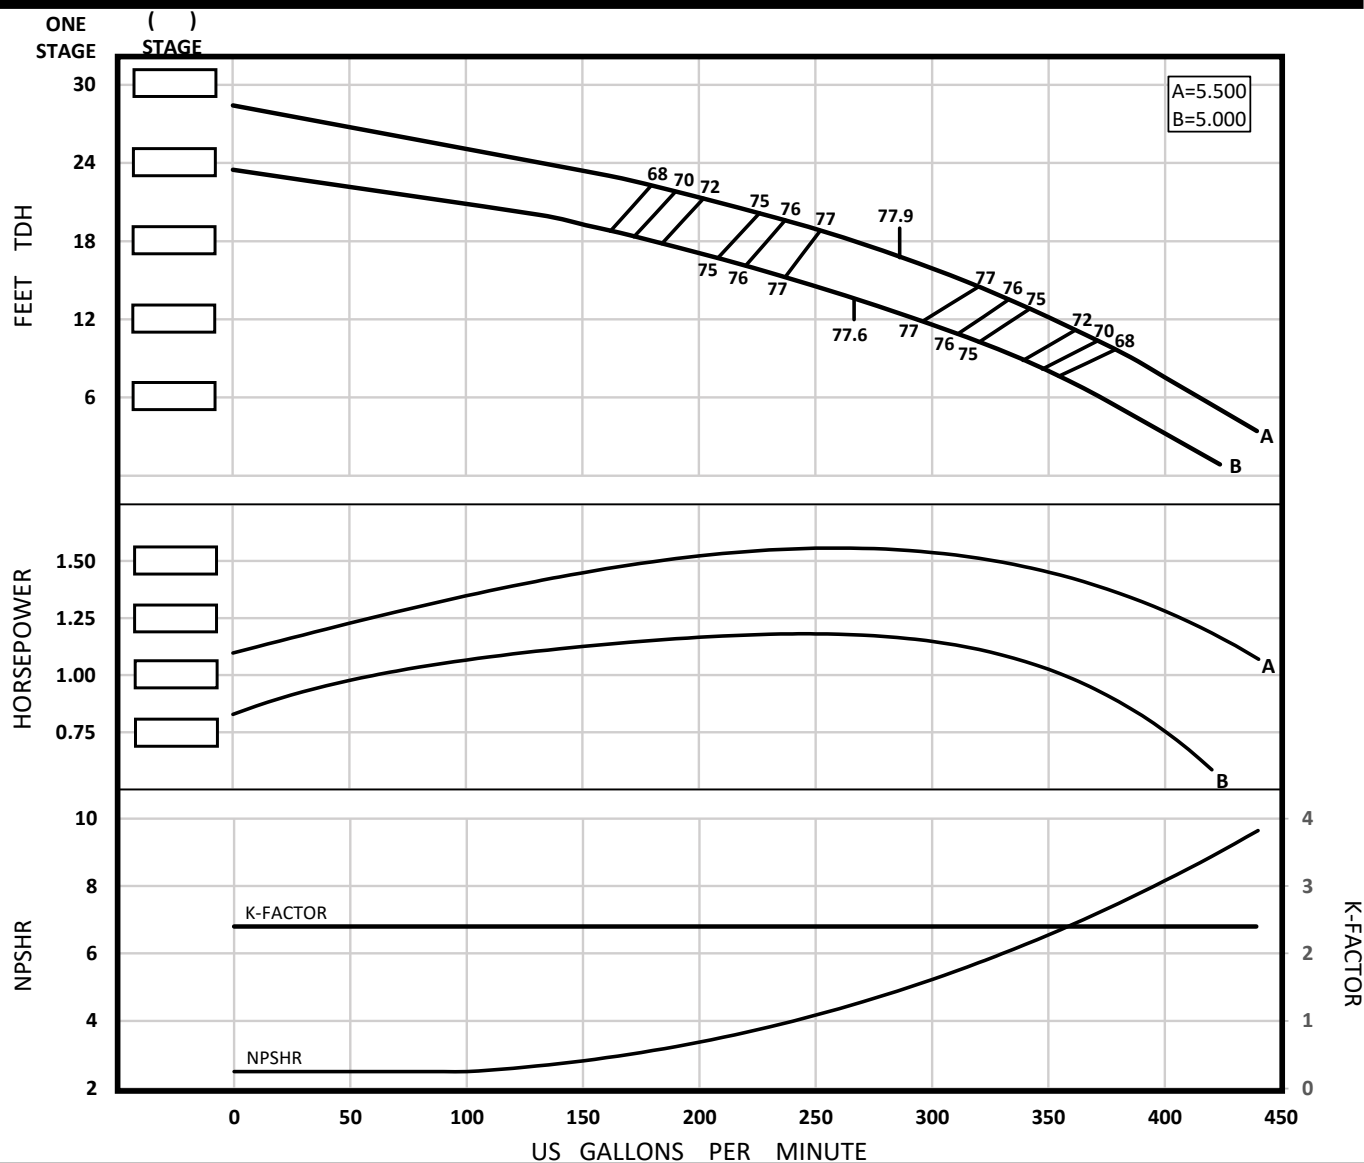SM7M
1770 RPM

Impeller Type	Enclosed	Bowl OD (in.)	7.00	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM7M	Thd'd Discharge Size	4" / 5" / 6"	Ns	3602	Stages	Change
One Stage Weight (lb)	100.00	Thd'd Suction Size	5"	Nss	9958	1	-4
Add'l Stage Wt. (lb)	40.00	Bell Suction Size	8" / 9.38"	Shaft Size (in.)	1.250	2	-3
Impeller Wt. (lb)	6.20	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.94	3	-2
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	536	Setting (in)	.125	4	-1
One Stage Length (in)	~20.25	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdk)	2.400	5	0
Add'l Stage Length (in)	7.000	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.015		

Δ Consult factory for availability


Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SP8L 1770 RPM

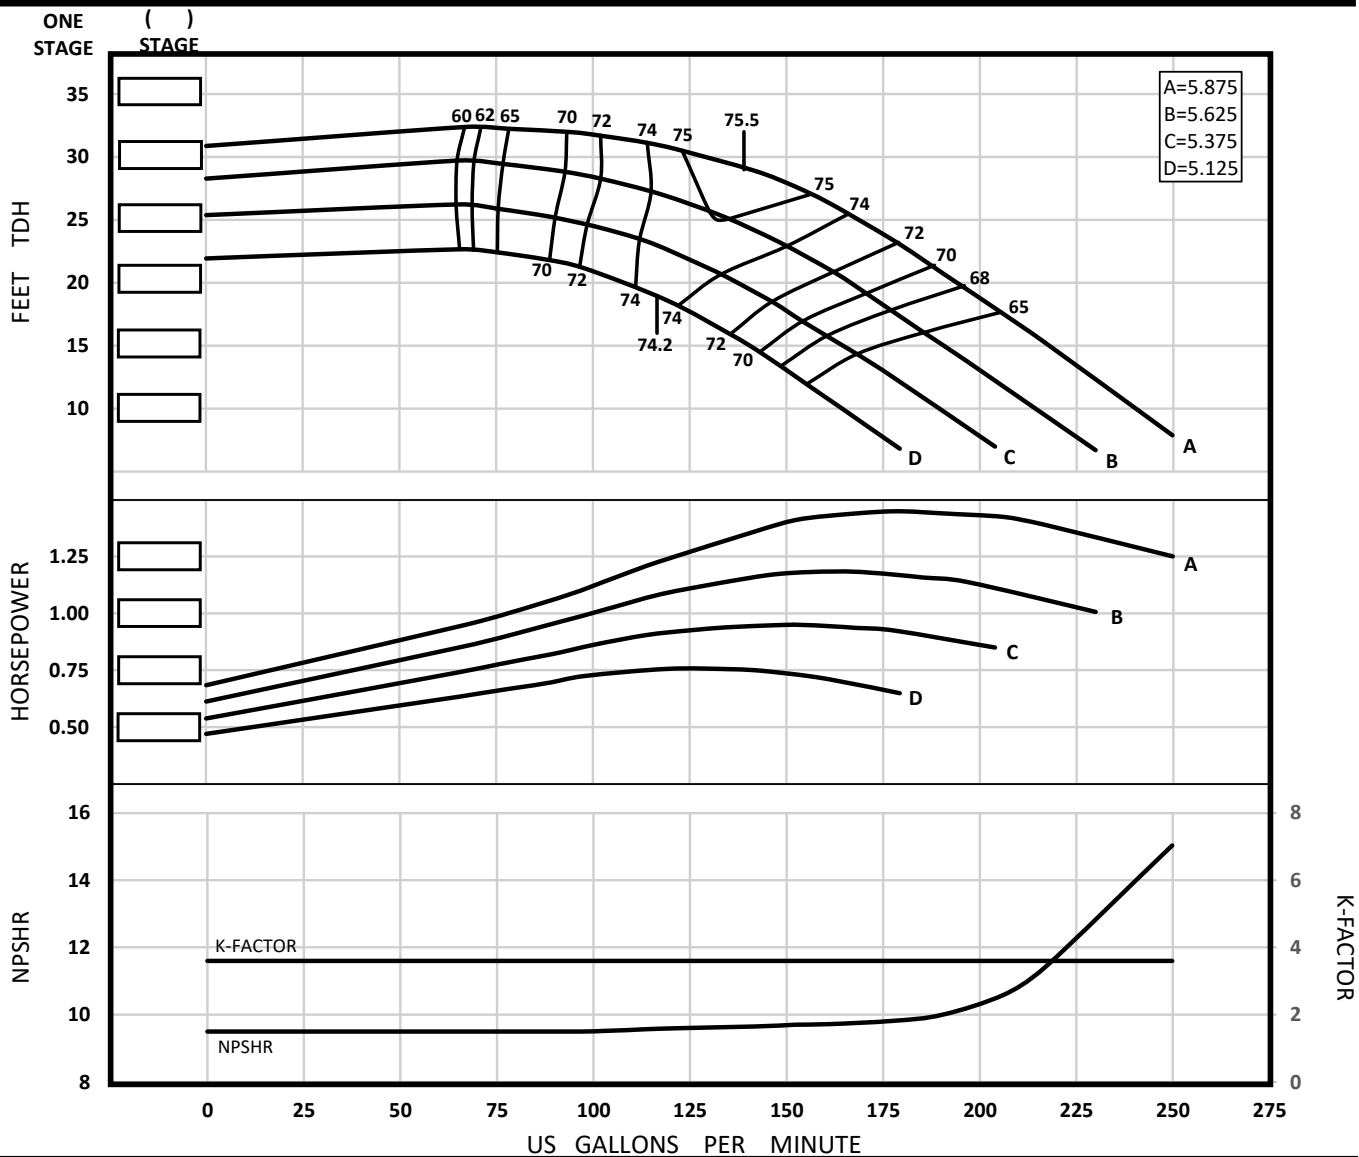


Impeller Type	Enclosed	Bowl OD (in.)	7.88	PEI cl	N/A	Qty.	Eff.
Impeller Model	SP8L	Thd'd Discharge Size	4" / 5" / 6"	Ns	1723	Stages	Change
One Stage Weight (lb)	122.00	Thd'd Suction Size	5"	Nss	7462	1	-4
Add'l Stage Wt. (lb)	40.00	Bell Suction Size	8" / 9.38"	Shaft Size (in.)	1.25	2	-3
Impeller Wt. (lb)	5.40	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.88	3	-2
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	679	Setting (in)	.125	4	-1
One Stage Length (in)	~20.188	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	3.600	5	0
Add'l Stage Length (in)	6.375	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.108		

Δ Consult factory for availability

Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

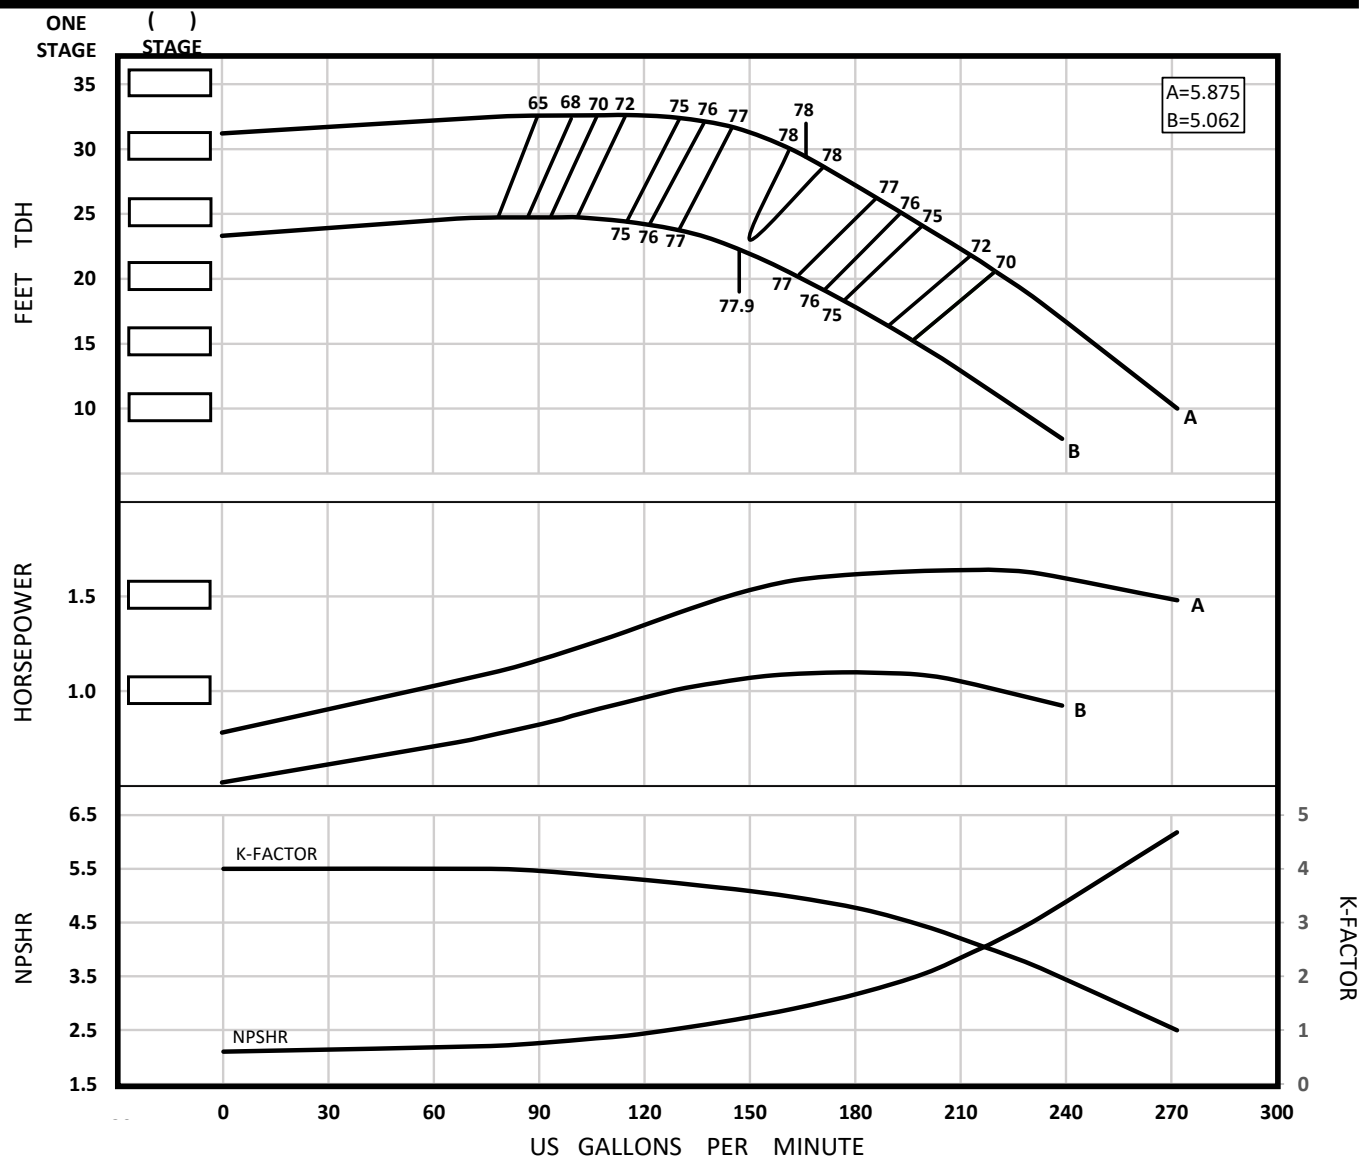SP8M
1770 RPM

Impeller Type	Enclosed	Bowl OD (in.)	7.88	PEI cl	N/A	Qty.	Eff.
Impeller Model	SP8M	Thd'd Discharge Size	4" / 5" / 6"	Ns	1812	Stages	Change
One Stage Weight (lb)	100.00	Thd'd Suction Size	5"	Nss	10262	1	-4
Add'l Stage Wt. (lb)	40.00	Bell Suction Size	8" / 9.38"	Shaft Size (in.)	1.250	2	-3
Impeller Wt. (lb)	5.15	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.75	3	-2
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	679	Setting (in)	.125	4	-1
One Stage Length (in)	~20.188	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdk)	CURVE	5	0
Add'l Stage Length (in)	6.375	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.105		

Δ Consult factory for availability


Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SP8H 1770 RPM

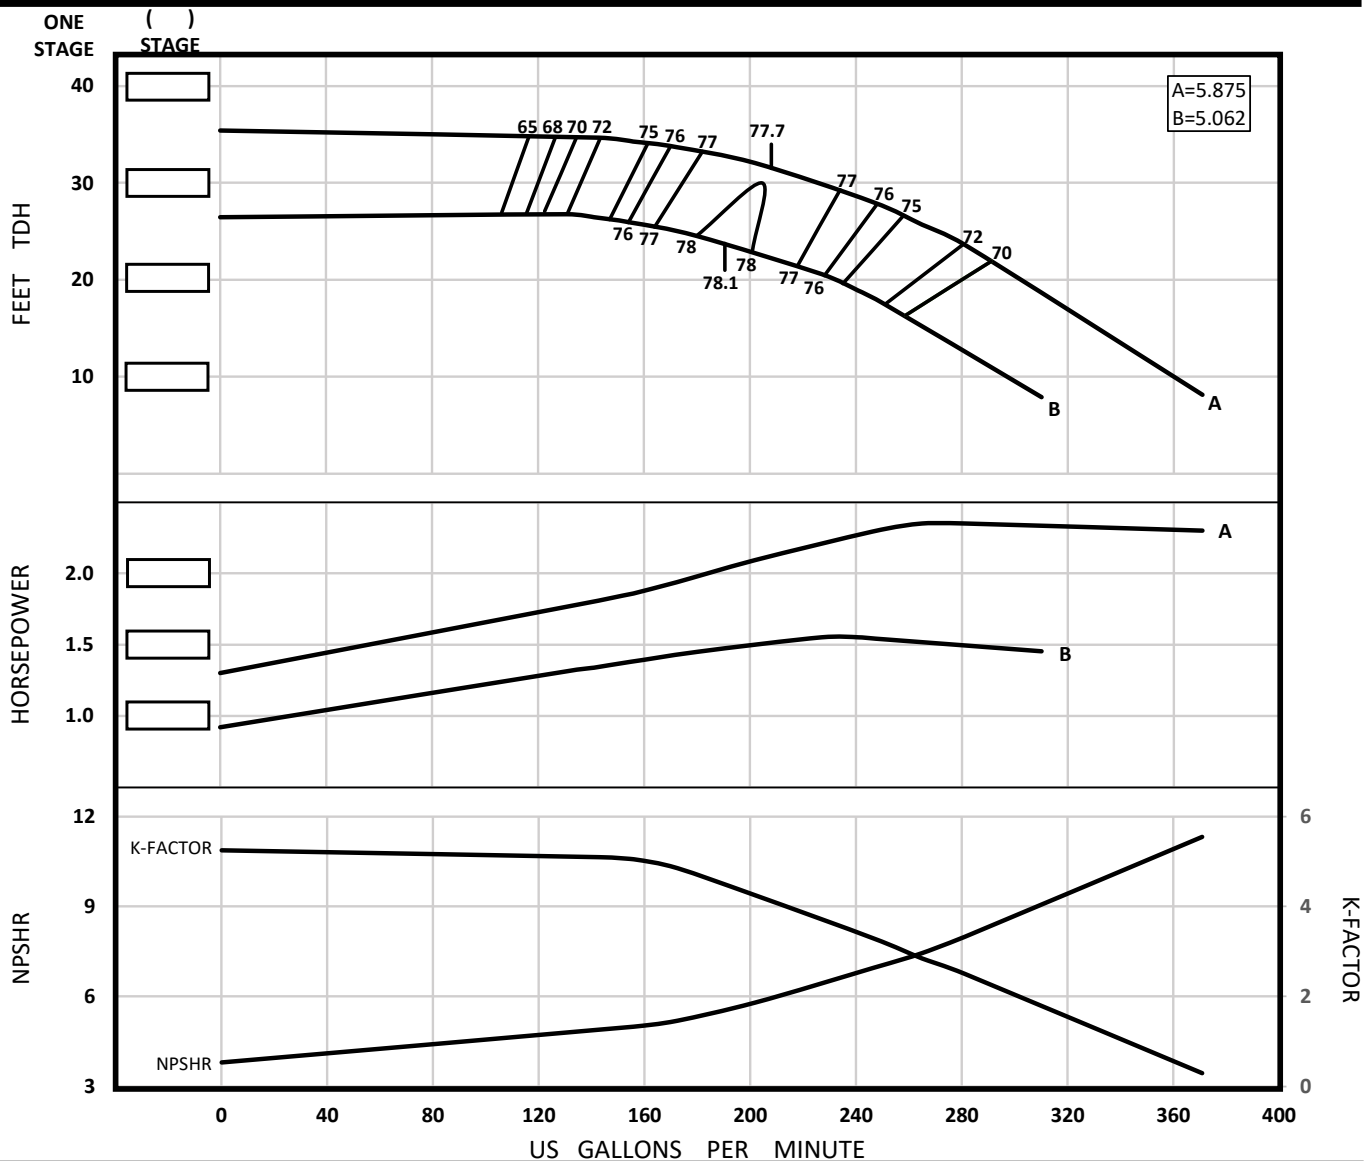


Impeller Type	Enclosed	Bowl OD (in.)	7.88	PEI cl	N/A	Qty.	Eff.
Impeller Model	SP8H	Thd'd Discharge Size	4" / 5" / 6"	Ns	1916	Stages	Change
One Stage Weight (lb)	100.00	Thd'd Suction Size	5"	Nss	5366	1	-4
Add'l Stage Wt. (lb)	40.00	Bell Suction Size	8" / 9.38"	Shaft Size (in.)	1.250	2	-3
Impeller Wt. (lb)	5.20	Sub. Mtr. Size	4" / 6" / 8"	Lateral (in)	.58	3	-2
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	679	Setting (in)	.125	4	-1
One Stage Length (in)	~20.188	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	6.375	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.105		

Δ Consult factory for availability

Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

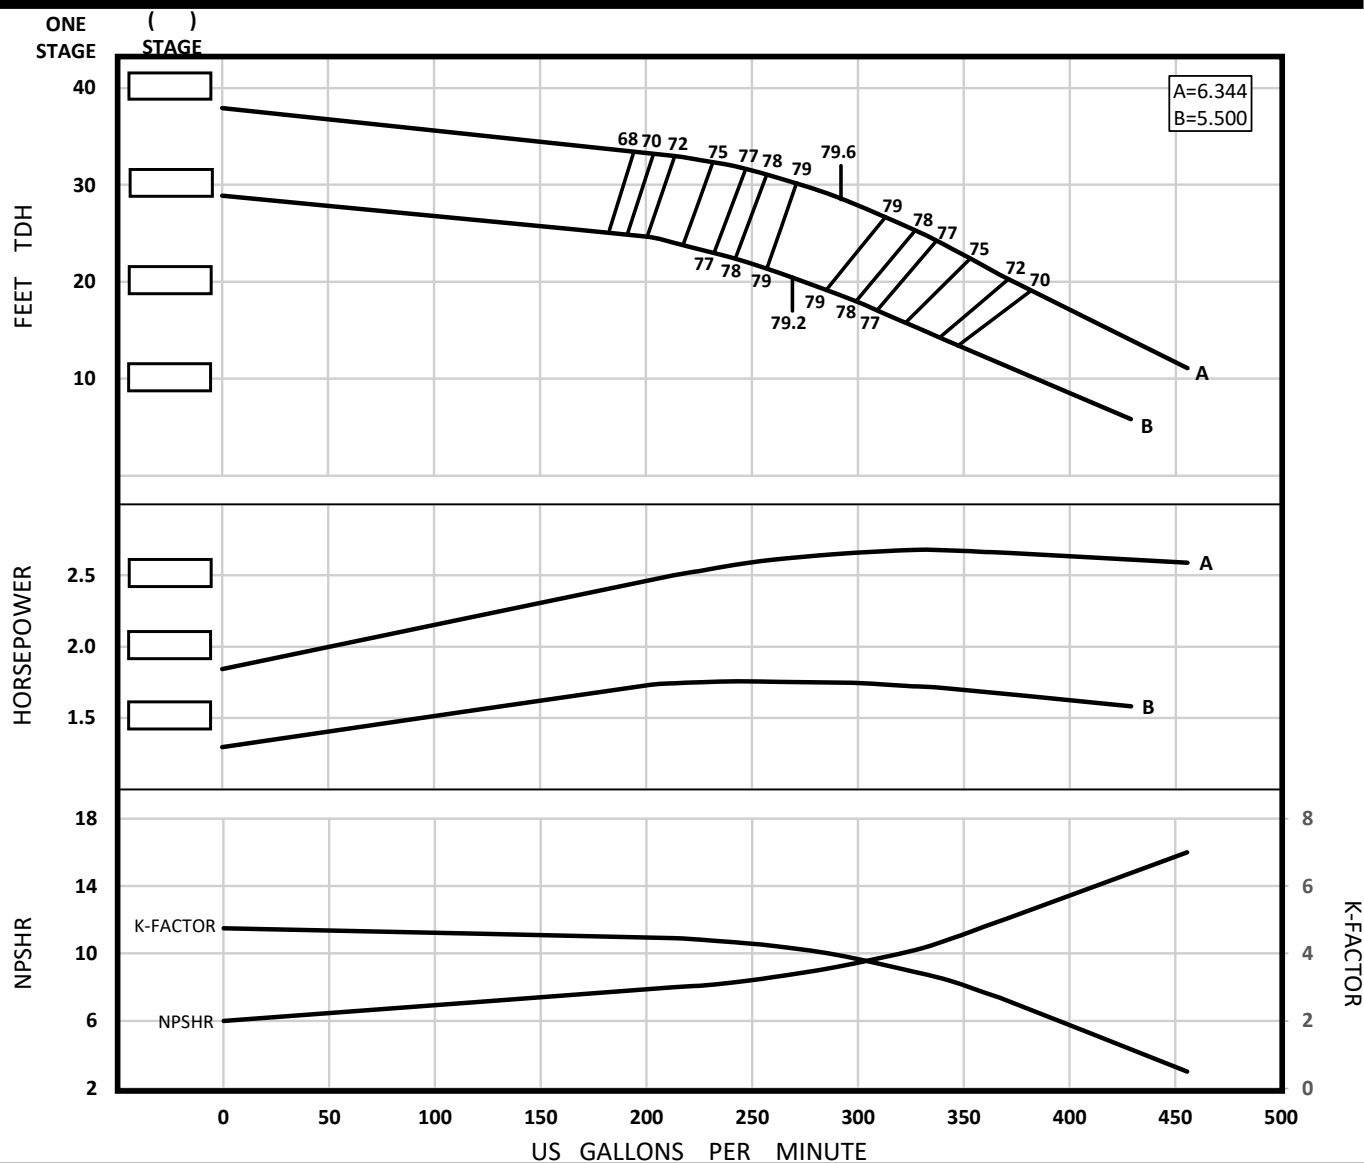SM8H
1770 RPM

Impeller Type	Enclosed	Bowl OD (in.)	7.69	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM8H	Thd'd Discharge Size	4" / 5" / 6"	Ns	2425	Stages	Change
One Stage Weight (lb)	100.00	Thd'd Suction Size	5"	Nss	8449	1	-4
Add'l Stage Wt. (lb)	40.00	Bell Suction Size	8" / 9.38"	Shaft Size (in.)	1.25	2	-3
Impeller Wt. (lb)	7.30	Sub. Mtr. Size	6" / 8"	Lateral (in)	.58	3	-2
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	376	Setting (in)	.125	4	-1
One Stage Length (in)	~19.813	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	6.000	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.158		

Δ Consult factory for availability


Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SK8H 1770 RPM

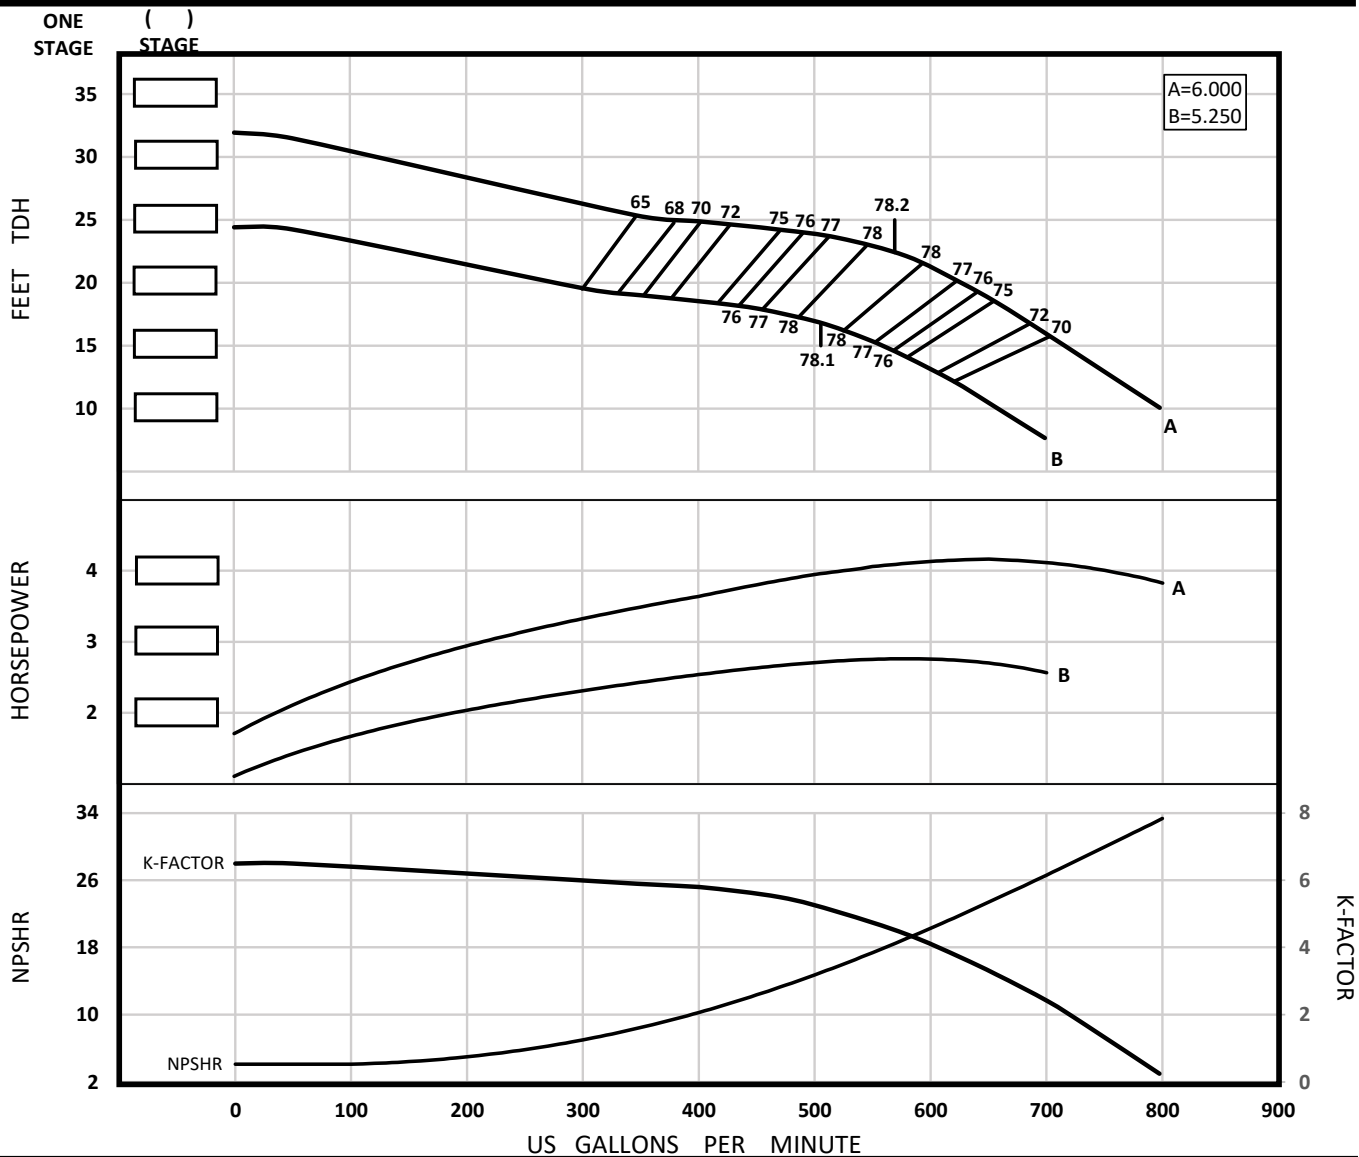

Impeller Type	Enclosed	Bowl OD (in.)	7.50	PEI cl	N/A	Qty.	Eff.
Impeller Model	SK8H	Thd'd Discharge Size	6"	Ns	4128	Stages	Change
One Stage Weight (lb)	180.00	Thd'd Suction Size	6"	Nss	4983	1	-4
Add'l Stage Wt. (lb)	60.00	Bell Suction Size	N/A	Shaft Size (in.)	1.50	2	-3
Impeller Wt. (lb)	6.60	Sub. Mtr. Size	6" / 8"	Lateral (in)	1.00	3	-2
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	652	Setting (in)	.125	4	-1
One Stage Length (in)	~25.25	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	9.000	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.133		


Δ Consult factory for availability

Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

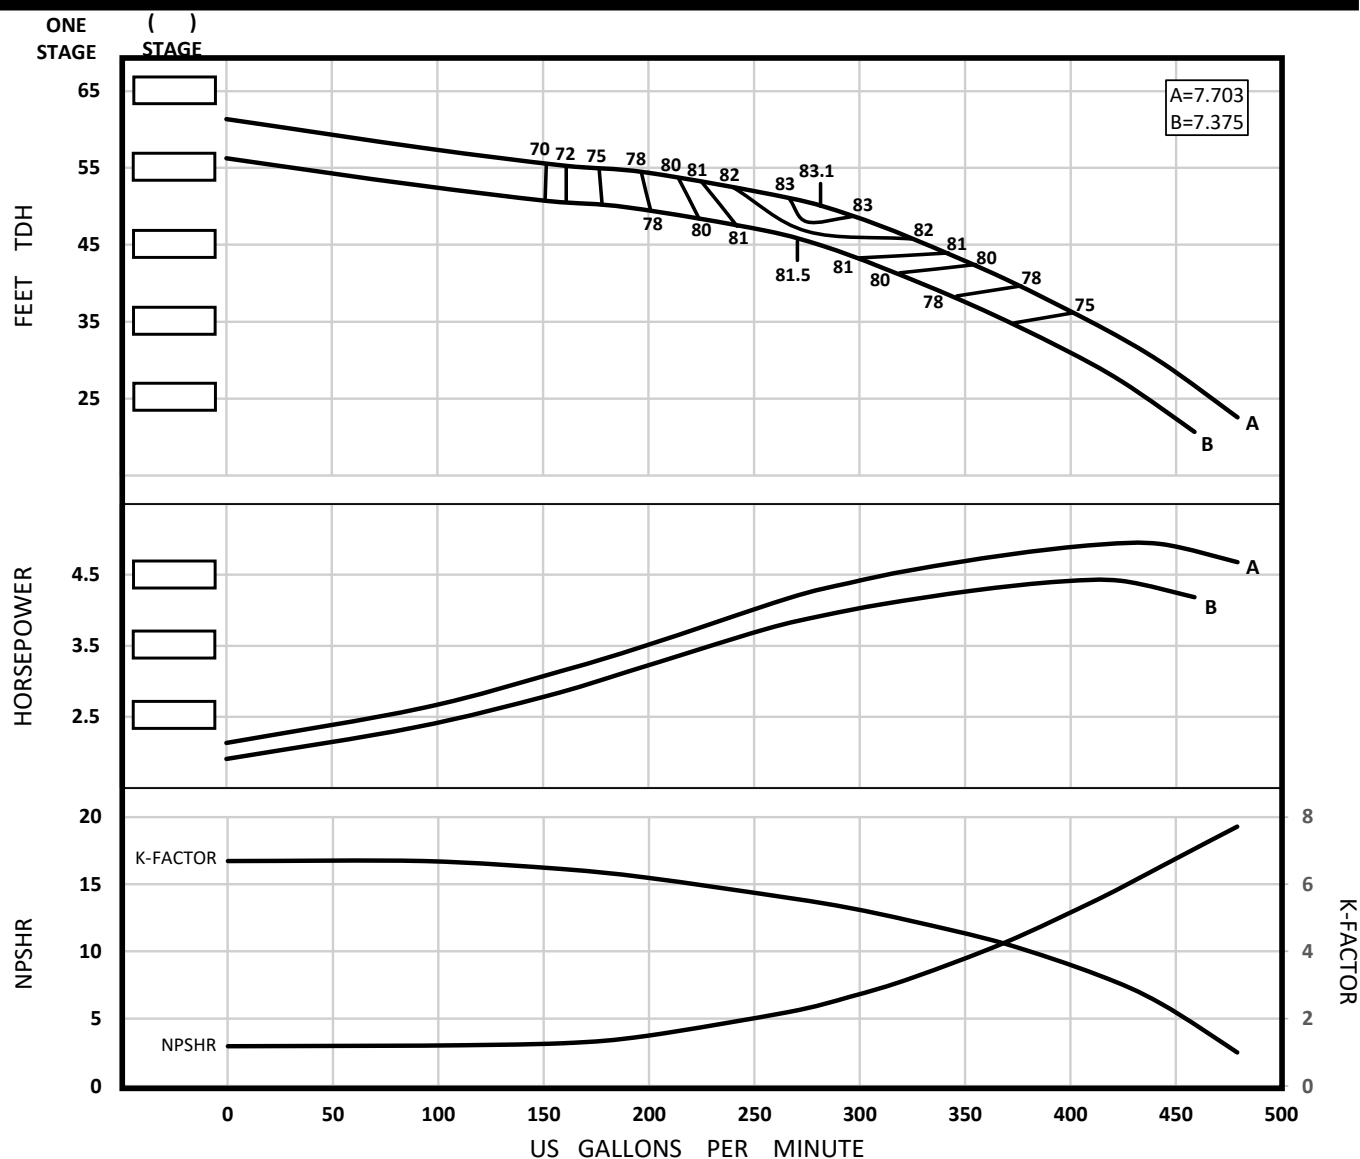

SM9L
1770 RPM

Impeller Type	Enclosed	Bowl OD (in.)	9.50	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM9L	Thd'd Discharge Size	4" / 6" / 8"	Ns	4128	Stages	Change
One Stage Weight (lb)	150.00	Thd'd Suction Size	6"	Nss	4983	1	-3
Add'l Stage Wt. (lb)	60.00	Bell Suction Size	10"	Shaft Size (in.)	1.50	2	-2
Impeller Wt. (lb)	9.00	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	.88	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	408	Setting (in)	.31	4	0
One Stage Length (in)	~23.125	D.I. Bowl Rating (psi)	Δ884	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	7.750	S.S. Bowl Rating (psi)	Δ952	Imp. WR ² (lb-ft ²)	.286		

Δ Consult factory for availability


Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SM9M 1770 RPM

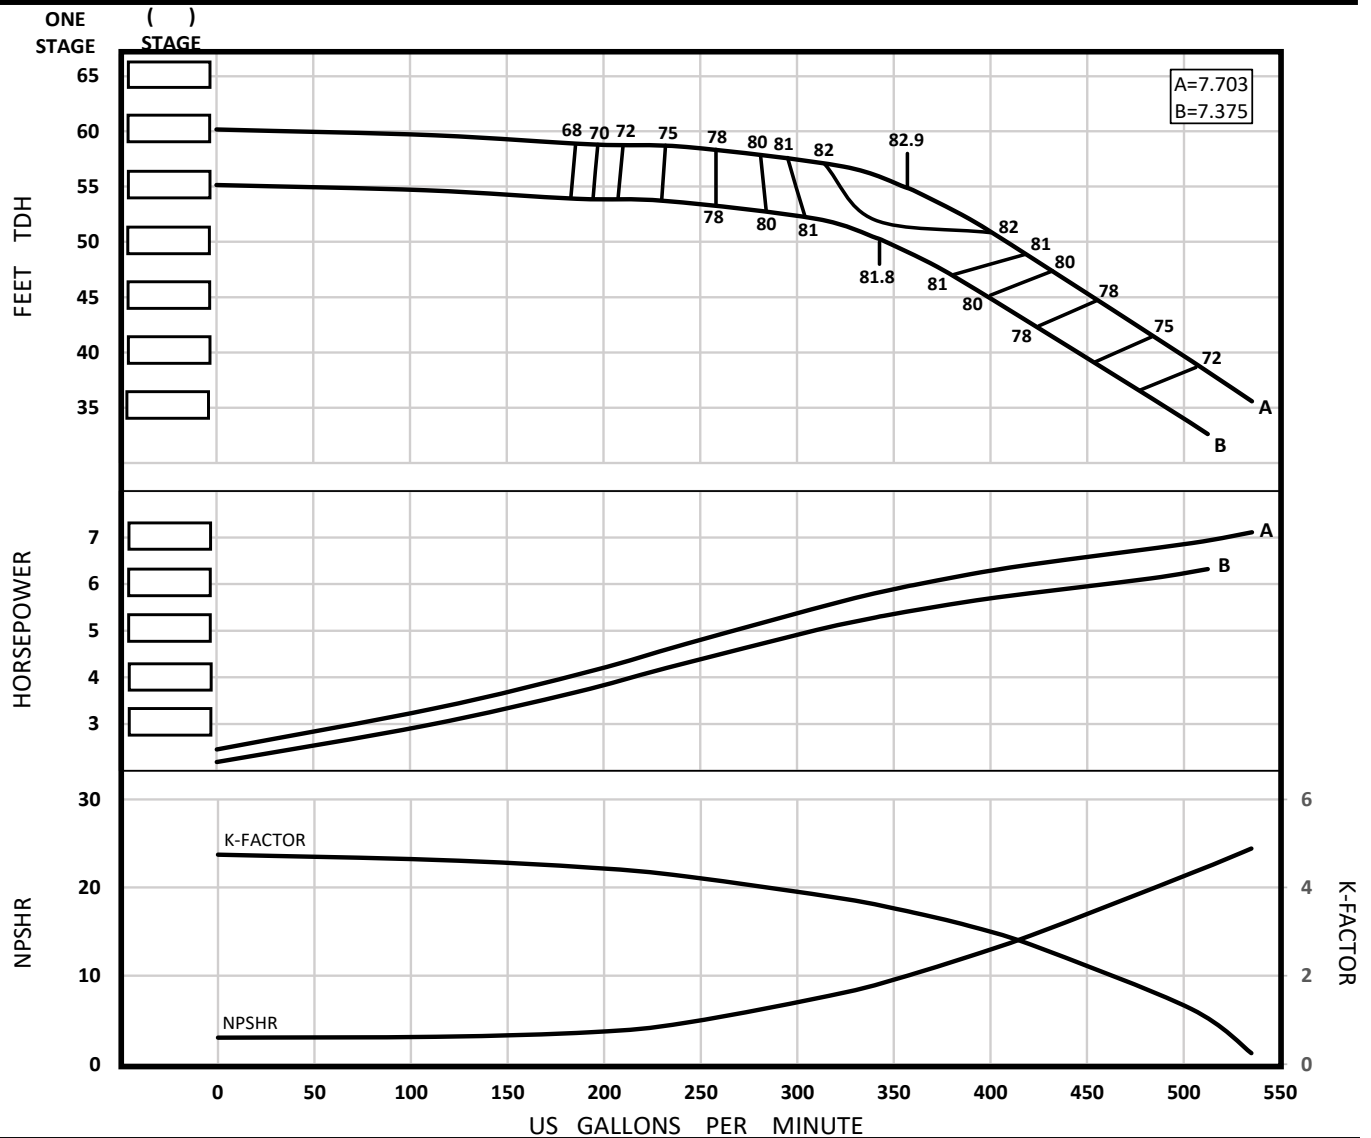

Impeller Type	Enclosed	Bowl OD (in.)	9.50	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM9M	Thd'd Discharge Size	4" / 6" / 8"	Ns	4128	Stages	Change
One Stage Weight (lb)	150.00	Thd'd Suction Size	6"	Nss	4983	1	-3
Add'l Stage Wt. (lb)	60.00	Bell Suction Size	10"	Shaft Size (in.)	1.50	2	-2
Impeller Wt. (lb)	9.50	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	.88	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	408	Setting (in)	.31	4	0
One Stage Length (in)	~23.125	D.I. Bowl Rating (psi)	Δ884	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	7.750	S.S. Bowl Rating (psi)	Δ952	Imp. WR ² (lb-ft ²)	.303		


Δ Consult factory for availability

Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

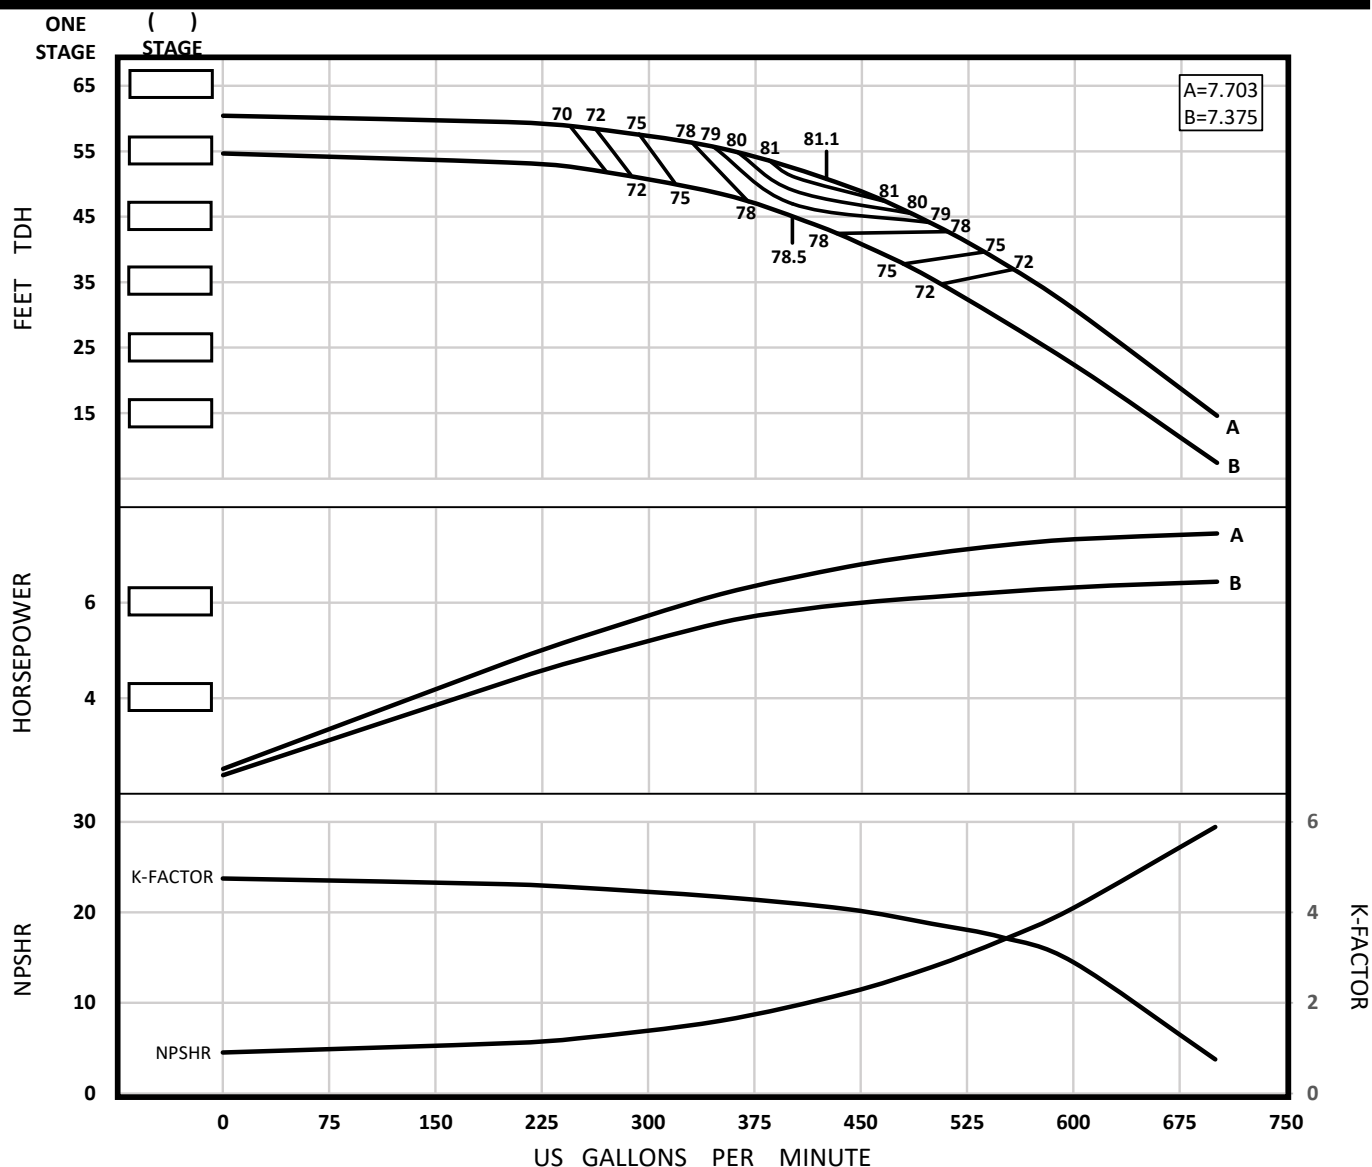

SM9H
1770 RPM

Impeller Type	Enclosed	Bowl OD (in.)	9.50	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM9H	Thd'd Discharge Size	4" / 6" / 8"	Ns	1916	Stages	Change
One Stage Weight (lb)	150.00	Thd'd Suction Size	6"	Nss	6011	1	-3
Add'l Stage Wt. (lb)	60.00	Bell Suction Size	10"	Shaft Size (in.)	1.500	2	-2
Impeller Wt. (lb)	9.50	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	.75	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	408	Setting (in)	.31		
One Stage Length (in)	~23.125	D.I. Bowl Rating (psi)	Δ884	K-Factor (lb/ft tdh)	CURVE		
Add'l Stage Length (in)	7.750	S.S. Bowl Rating (psi)	Δ952	Imp. WR ² (lb-ft ²)	.303		

Δ Consult factory for availability


Rev. 2021.06.08

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SP9L 1770 RPM

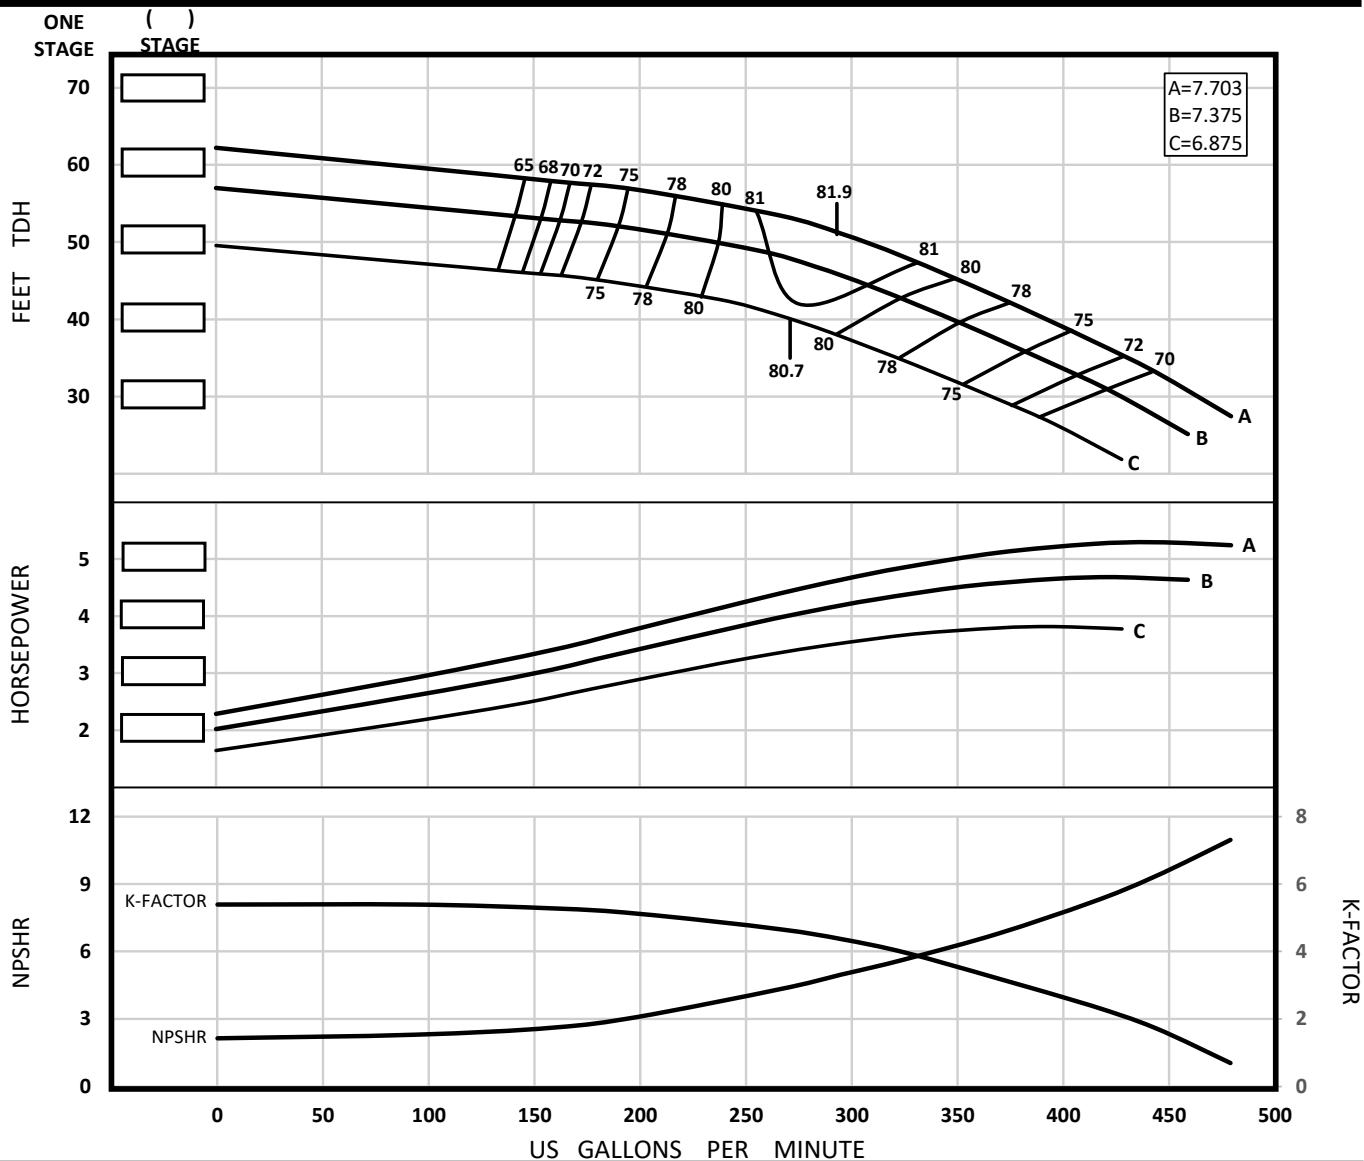

Impeller Type	Enclosed	Bowl OD (in.)	9.50	PEI cl	N/A	Qty.	Eff.
Impeller Model	SP9L	Thd'd Discharge Size	4" / 6" / 8"	Ns	1584	Stages	Change
One Stage Weight (lb)	150.00	Thd'd Suction Size	6"	Nss	9094	1	-3
Add'l Stage Wt. (lb)	60.00	Bell Suction Size	10"	Shaft Size (in.)	1.50	2	-2
Impeller Wt. (lb)	9.00	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	.94	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	409	Setting (in)	.31	4	0
One Stage Length (in)	~23.125	D.I. Bowl Rating (psi)	Δ887	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	7.750	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.286		


Δ Consult factory for availability

Rev. 2022.10.25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

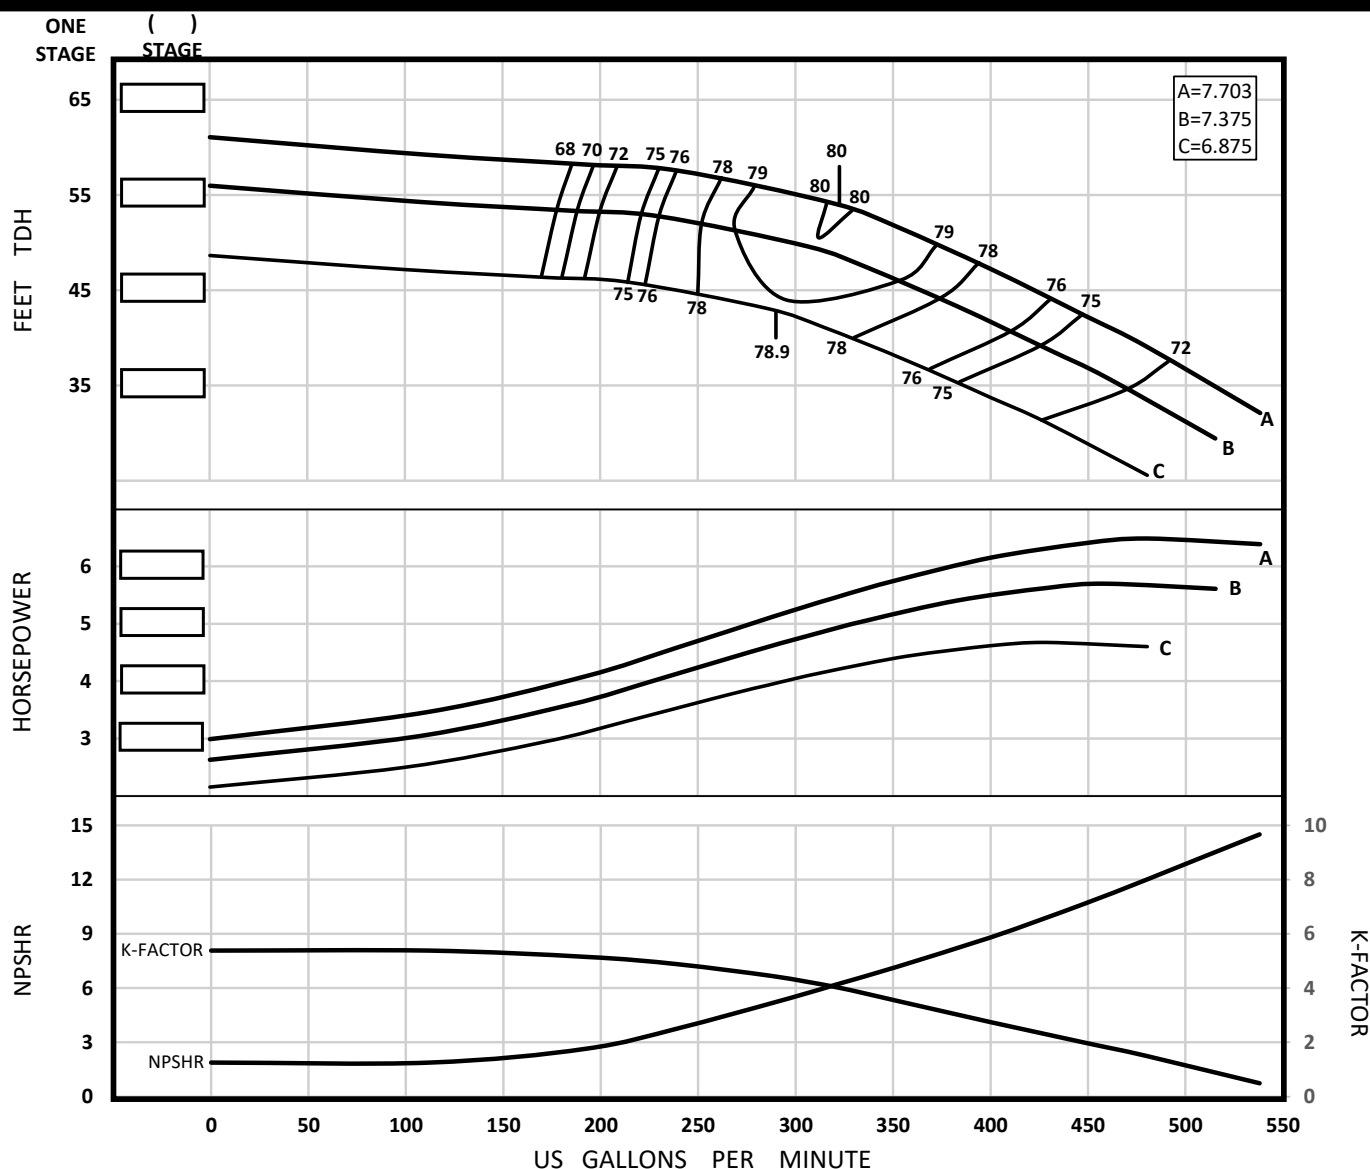

SP9M
1770 RPM

Impeller Type	Enclosed	Bowl OD (in.)	9.50	PEI cl	N/A	Qty.	Eff.
Impeller Model	SP9M	Thd'd Discharge Size	4" / 6" / 8"	Ns	1600	Stages	Change
One Stage Weight (lb)	150.00	Thd'd Suction Size	6"	Nss	8122	1	-3
Add'l Stage Wt. (lb)	60.00	Bell Suction Size	10"	Shaft Size (in.)	1.50	2	-2
Impeller Wt. (lb)	9.50	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	.94	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	409	Setting (in)	.31	4	0
One Stage Length (in)	~23.125	D.I. Bowl Rating (psi)	Δ887	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	7.750	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.303		

Δ Consult factory for availability


Rev. 2022.10.25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SL9H 1770 RPM

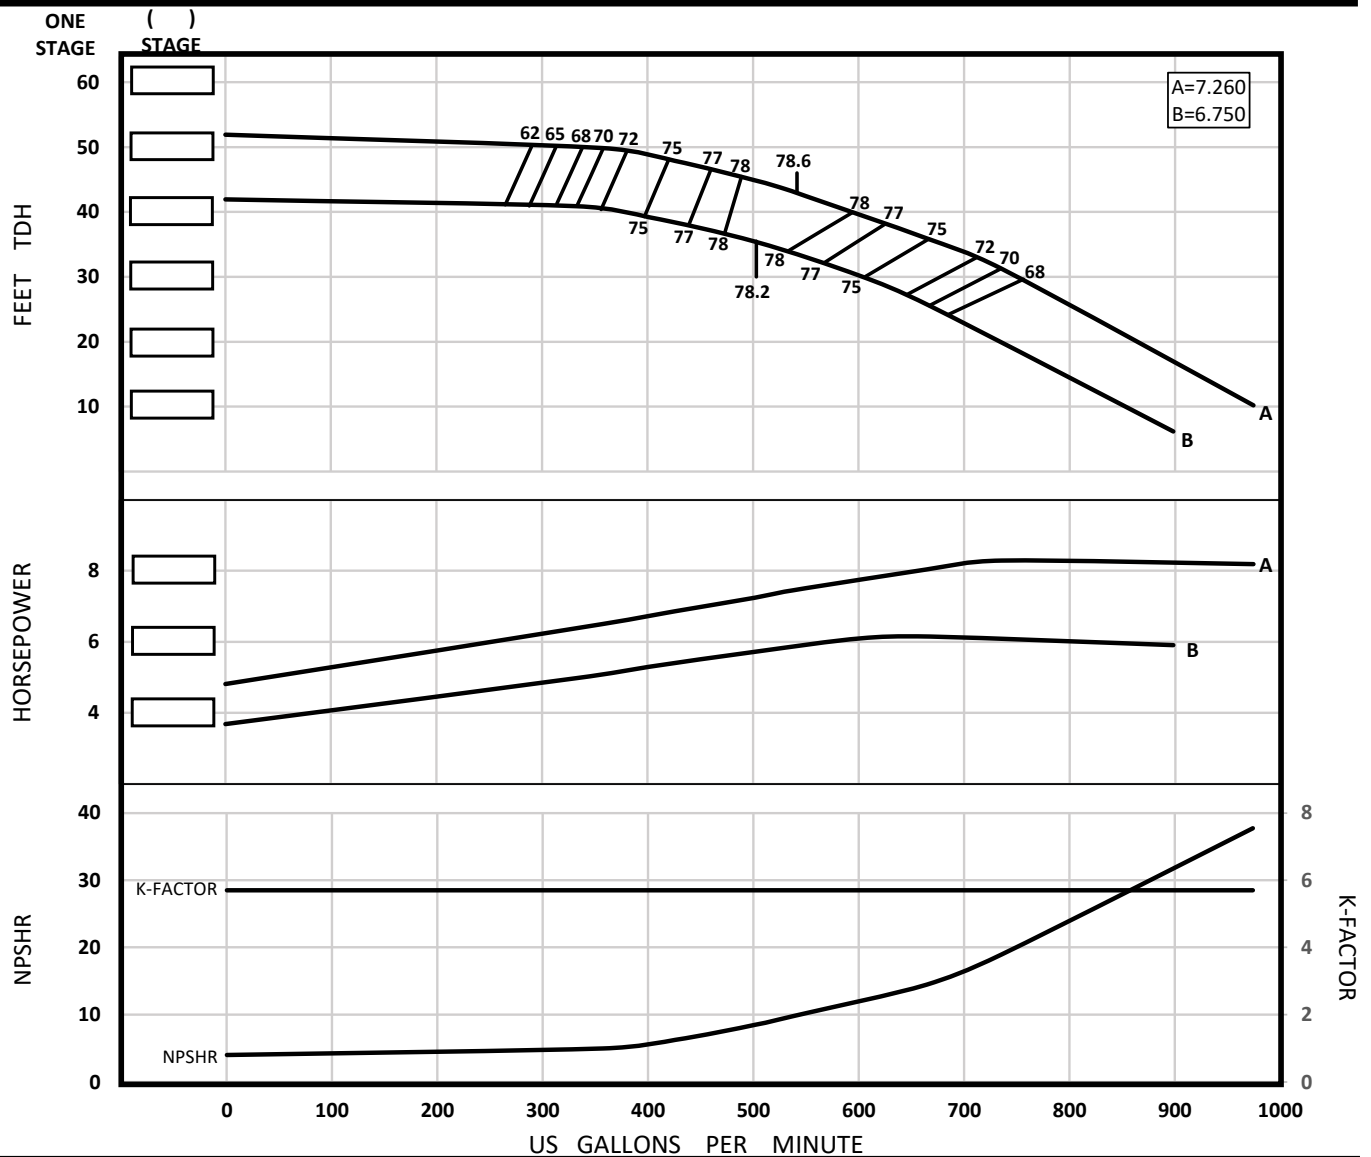


Impeller Type	Enclosed	Bowl OD (in.)	9.00	PEI cl	N/A	Qty.	Eff.
Impeller Model	SL9H	Thd'd Discharge Size	4" / 6" / 8"	Ns	4128	Stages	Change
One Stage Weight (lb)	135.00	Thd'd Suction Size	6"	Nss	4983	1	-3
Add'l Stage Wt. (lb)	53.00	Bell Suction Size	10"	Shaft Size (in.)	1.50	2	-2
Impeller Wt. (lb)	8.65	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	1.00	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	428	Setting (in)	.125	4	0
One Stage Length (in)	~24.25	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdk)	5.700	5	0
Add'l Stage Length (in)	8.500	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.248		

Δ Consult factory for availability

Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

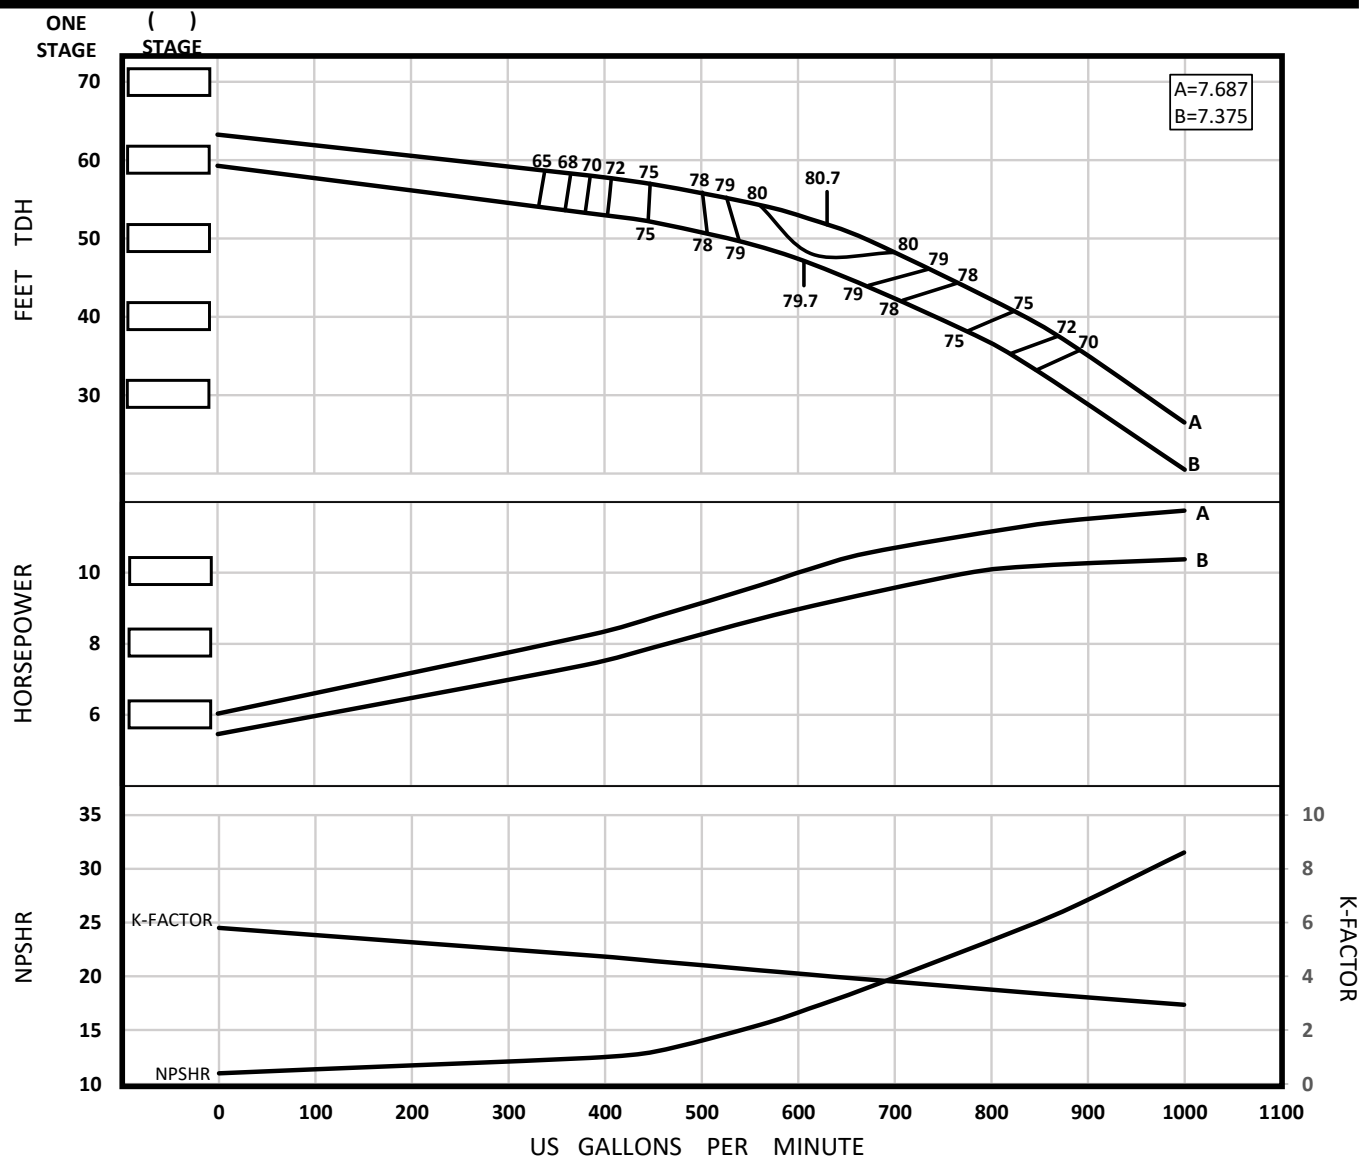SF9H
1770 RPM

Impeller Type	Enclosed	Bowl OD (in.)	9.50	PEI cl	N/A	Qty.	Eff.
Impeller Model	SF9H	Thd'd Discharge Size	4" / 6" / 8"	Ns	4128	Stages	Change
One Stage Weight (lb)	185.00	Thd'd Suction Size	6"	Nss	4983	1	-3
Add'l Stage Wt. (lb)	67.00	Bell Suction Size	10"	Shaft Size (in.)	1.50	2	-2
Impeller Wt. (lb)	9.00	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	.94	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	377	Setting (in)	.125	4	0
One Stage Length (in)	~22.875	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	7.500	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.291		

Δ Consult factory for availability


Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SK9M 1770 RPM

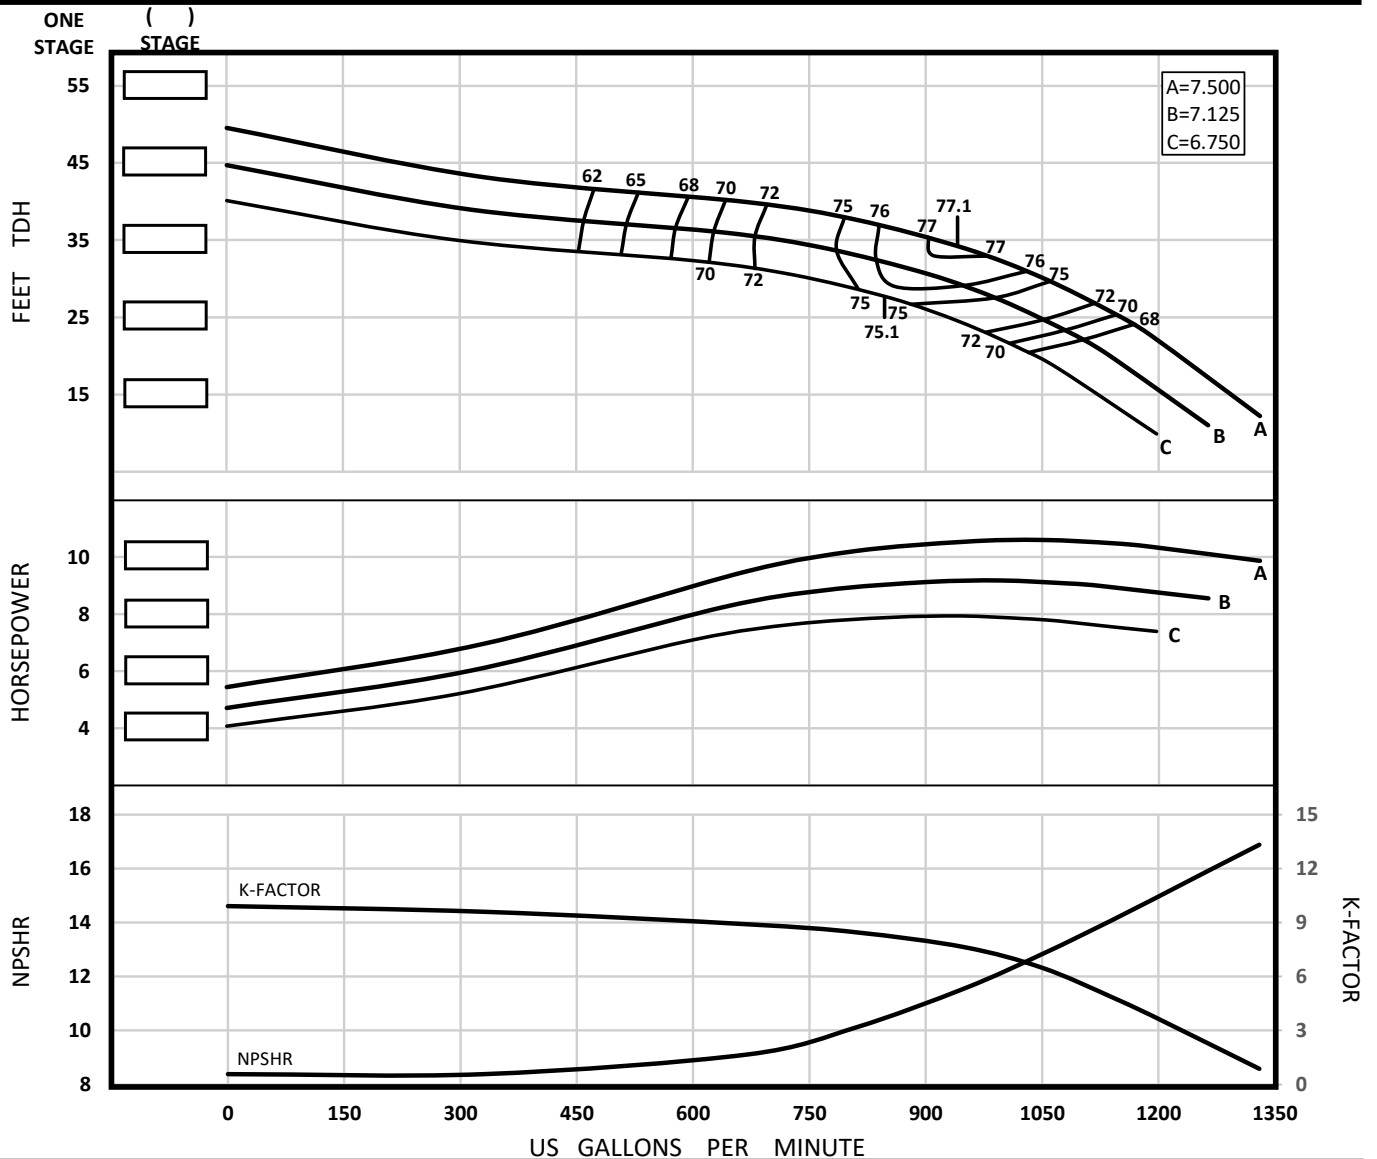


Impeller Type	Enclosed	Bowl OD (in.)	9.44	PEI cl	N/A	Qty.	Eff.
Impeller Model	SK9M	Thd'd Discharge Size	4" / 6" / 8"	Ns	3836	Stages	Change
One Stage Weight (lb)	250.00	Thd'd Suction Size	8"	Nss	8659	1	-4
Add'l Stage Wt. (lb)	85.00	Bell Suction Size	N/A	Shaft Size (in.)	1.6875	2	-3
Impeller Wt. (lb)	14.90	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	1.44	3	-2
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	526	Setting (in)	.125	4	-1
One Stage Length (in)	~27.00	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	10.625	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.462		

Δ Consult factory for availability

Rev. 2021.06.08

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

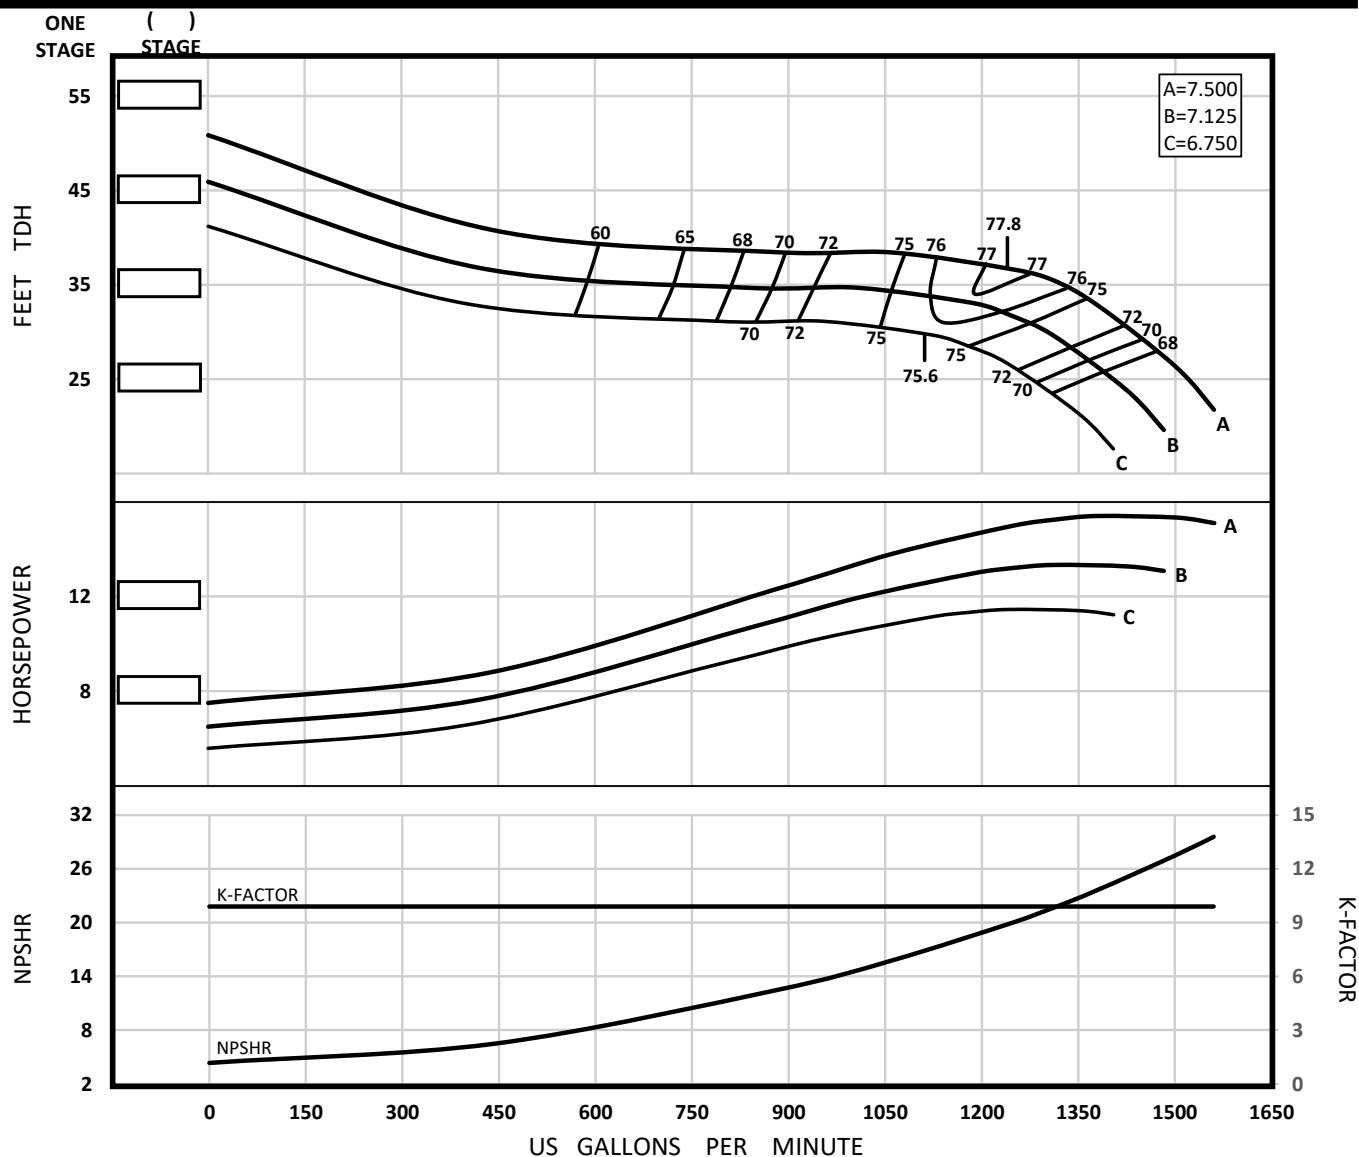SK9H
1770 RPM

Impeller Type	Enclosed	Bowl OD (in.)	9.44	PEI cl	N/A	Qty.	Eff.
Impeller Model	SK9H	Thd'd Discharge Size	4" / 6" / 8"	Ns	4171	Stages	Change
One Stage Weight (lb)	250.00	Thd'd Suction Size	8"	Nss	6576	1	-4
Add'l Stage Wt. (lb)	85.00	Bell Suction Size	N/A	Shaft Size (in.)	1.6875	2	-3
Impeller Wt. (lb)	14.90	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	1.00	3	-2
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	526	Setting (in)	.125	4	-1
One Stage Length (in)	~27.00	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdk)	9.900	5	0
Add'l Stage Length (in)	10.625	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.462		

Δ Consult factory for availability


Rev. 2021.06.08

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SP10M 1770 RPM

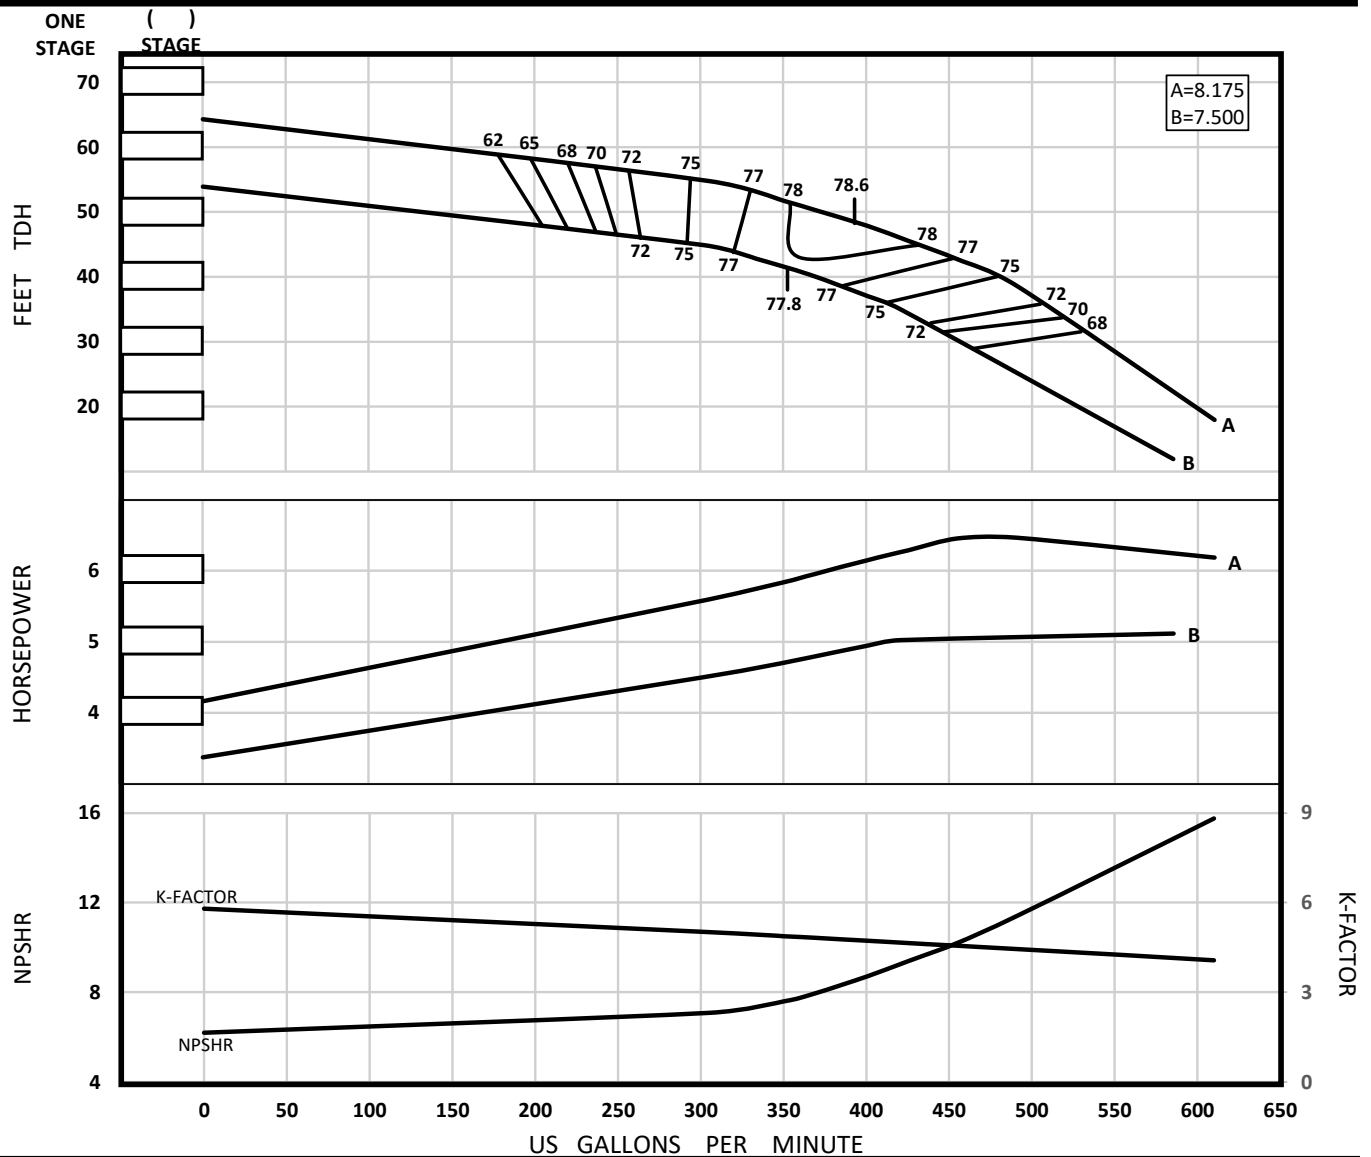

Impeller Type	Enclosed	Bowl OD (in.)	10.19	PEI cl	N/A	Qty.	Eff.
Impeller Model	SP10M	Thd'd Discharge Size	4" / 6" / 8"	Ns	1911	Stages	Change
One Stage Weight (lb)	190.00	Thd'd Suction Size	6"	Nss	6915	1	-3
Add'l Stage Wt. (lb)	75.00	Bell Suction Size	10"	Shaft Size (in.)	1.50	2	-2
Impeller Wt. (lb)	8.85	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	.94	3	-1
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	731	Setting (in)	.125	4	0
One Stage Length (in)	~23.125	D.I. Bowl Rating (psi)	Δ1583	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	7.250	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.324		


Δ Consult factory for availability

Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

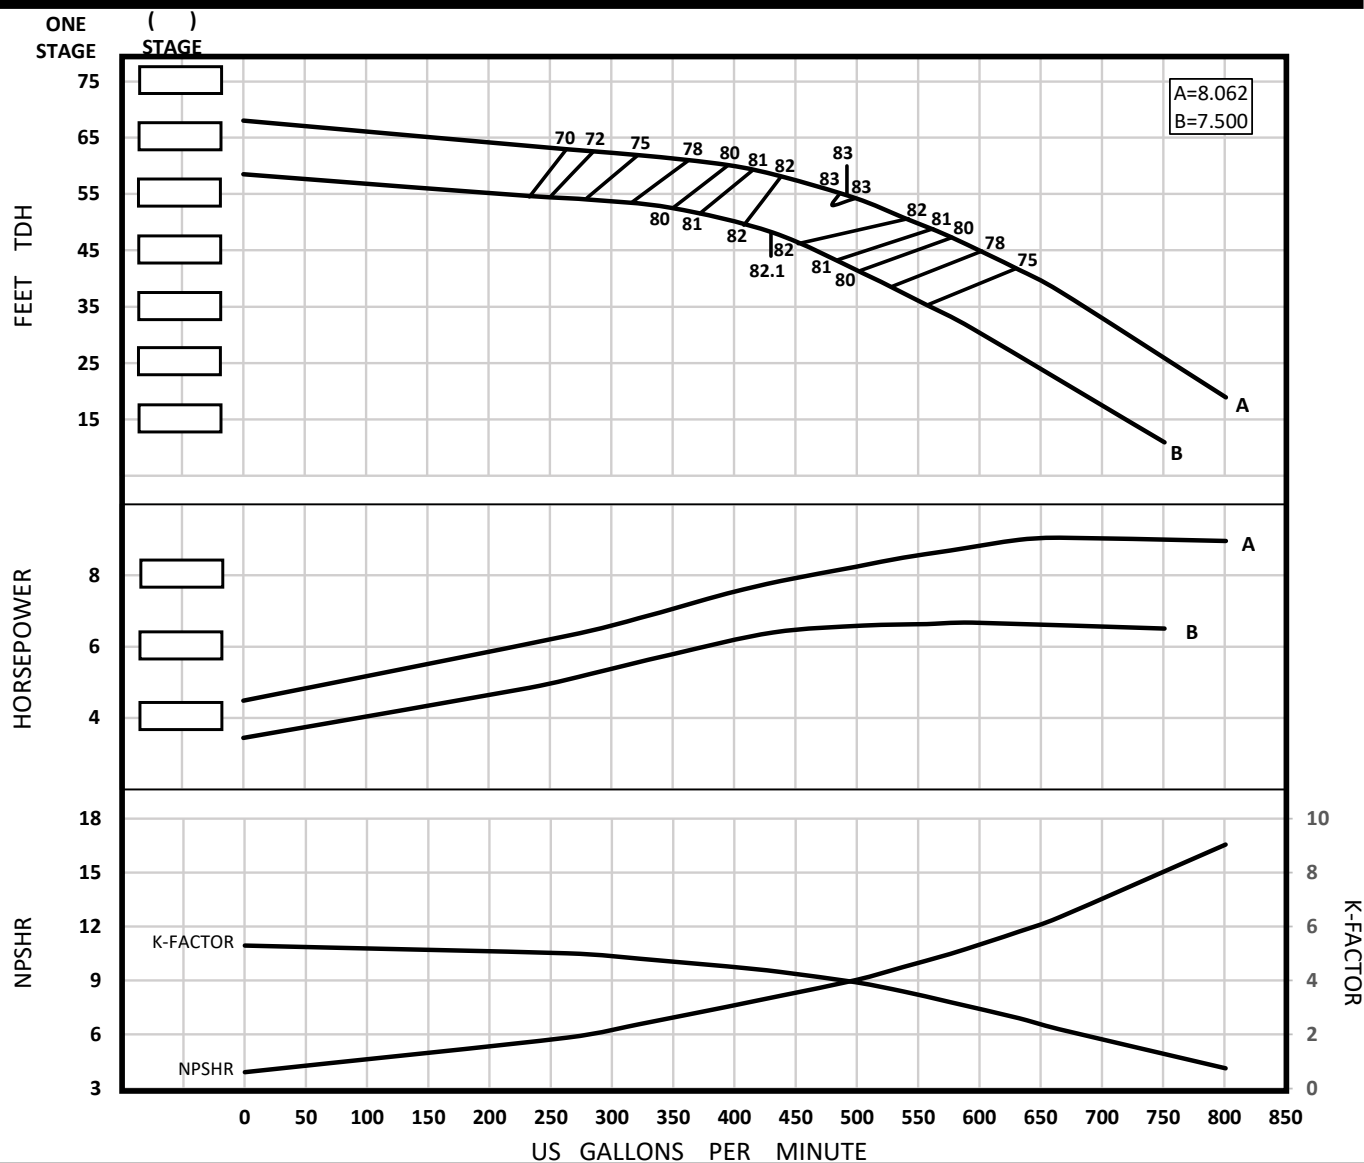

SP10H
1770 RPM

Impeller Type	Enclosed	Bowl OD (in.)	10.19	PEI cl	N/A	Qty.	Eff.
Impeller Model	SP10H	Thd'd Discharge Size	4" / 6" / 8"	Ns	1953	Stages	Change
One Stage Weight (lb)	190.00	Thd'd Suction Size	6"	Nss	7543	1	-3
Add'l Stage Wt. (lb)	75.00	Bell Suction Size	10"	Shaft Size (in.)	1.50	2	-2
Impeller Wt. (lb)	9.00	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	.63	3	-1
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	731	Setting (in)	.125	4	0
One Stage Length (in)	~22.375	D.I. Bowl Rating (psi)	Δ1583	K-Factor (lb/ft tdk)	CURVE	5	0
Add'l Stage Length (in)	7.250	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.324		

Δ Consult factory for availability


Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SM10MO 1770 RPM

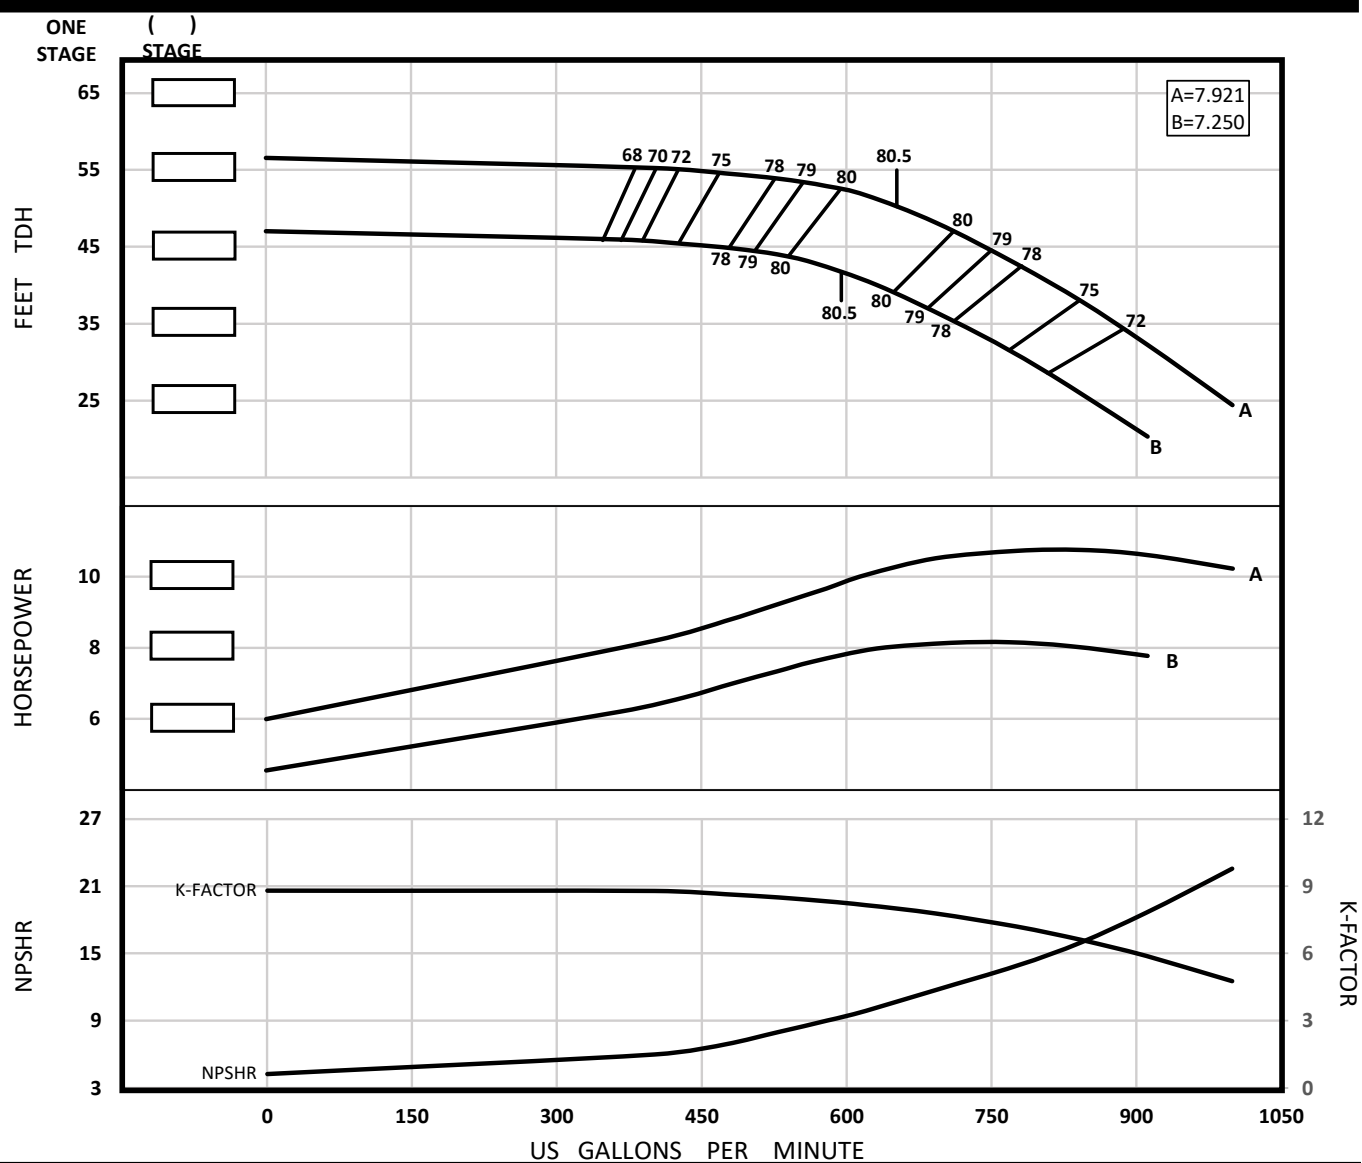

Impeller Type	Semi-Open	Bowl OD (in.)	10.19	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM10MO	Thd'd Discharge Size	4" / 6" / 8"	Ns	2398	Stages	Change
One Stage Weight (lb)	160.00	Thd'd Suction Size	6"	Nss	8098	1	-4
Add'l Stage Wt. (lb)	75.00	Bell Suction Size	10"	Shaft Size (in.)	1.50	2	-3
Impeller Wt. (lb)	6.10	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	1.56	3	-2
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	489	Setting (in)	.02	4	-1
One Stage Length (in)	~24.75	D.I. Bowl Rating (psi)	Δ1059	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	8.875	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.217		


Δ Consult factory for availability

Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

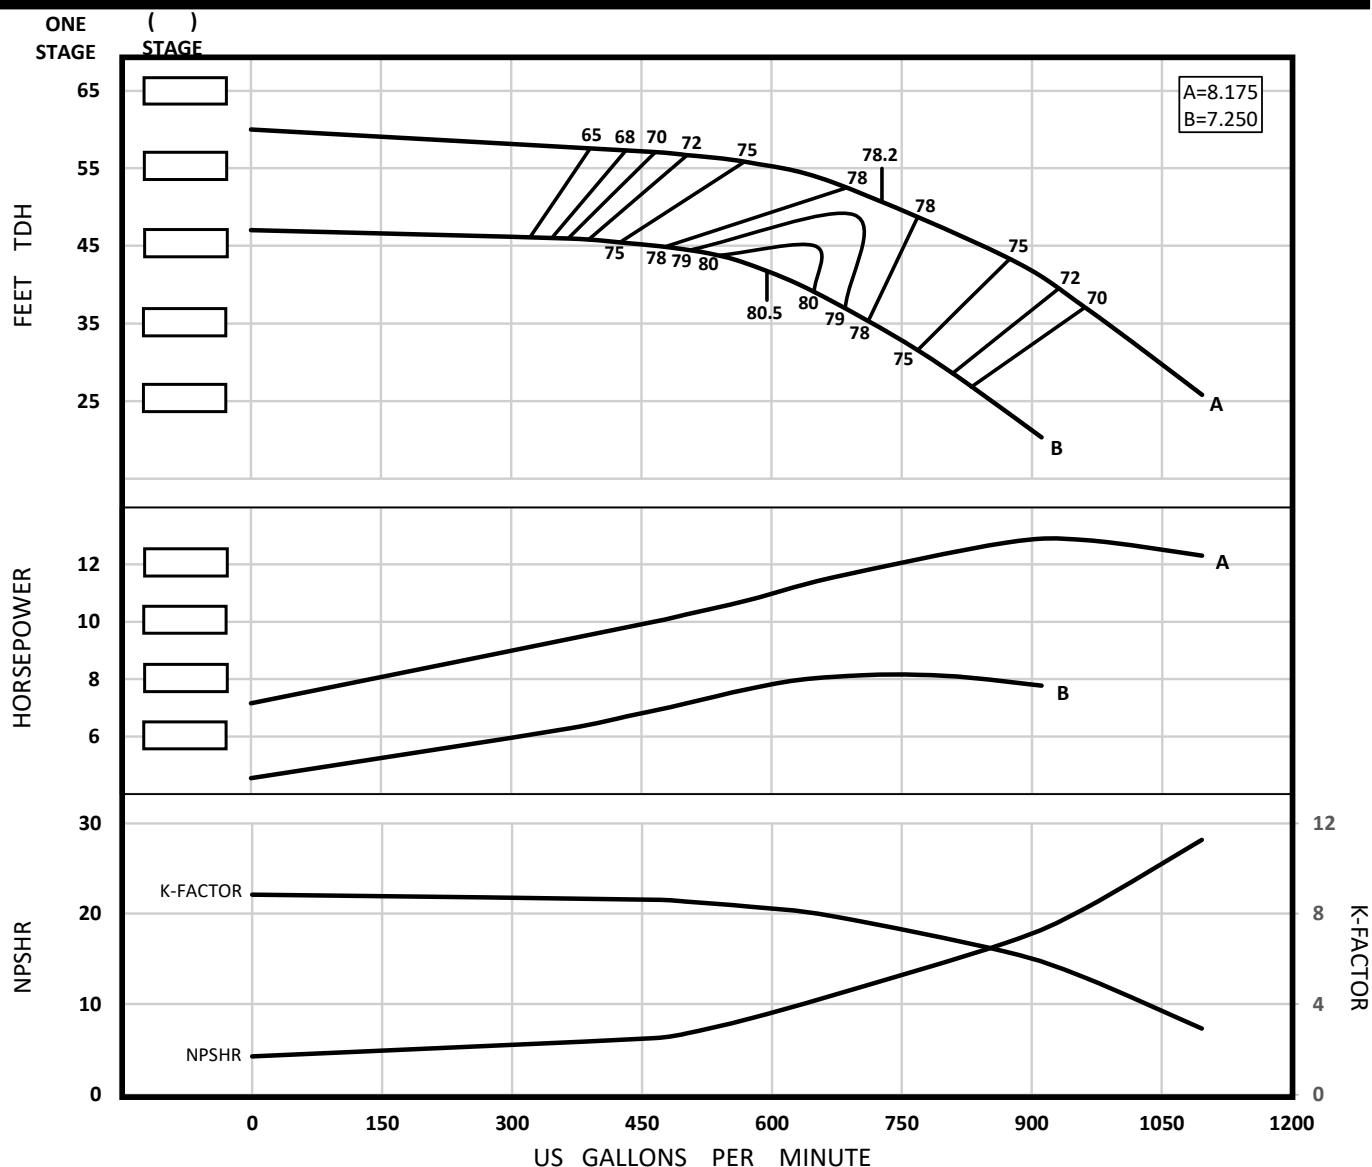

SM10HO
1770 RPM

Impeller Type	Semi-Open	Bowl OD (in.)	10.19	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM10HO	Thd'd Discharge Size	4" / 6" / 8"	Ns	2496	Stages	Change
One Stage Weight (lb)	190.00	Thd'd Suction Size	6"	Nss	7901	1	-4
Add'l Stage Wt. (lb)	75.00	Bell Suction Size	10"	Shaft Size (in.)	1.50	2	-3
Impeller Wt. (lb)	6.10	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	1.25	3	-2
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	489	Setting (in)	.02	4	-1
One Stage Length (in)	~24.75	D.I. Bowl Rating (psi)	Δ1059	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	8.875	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.217		

Δ Consult factory for availability


Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SM10M 1770 RPM

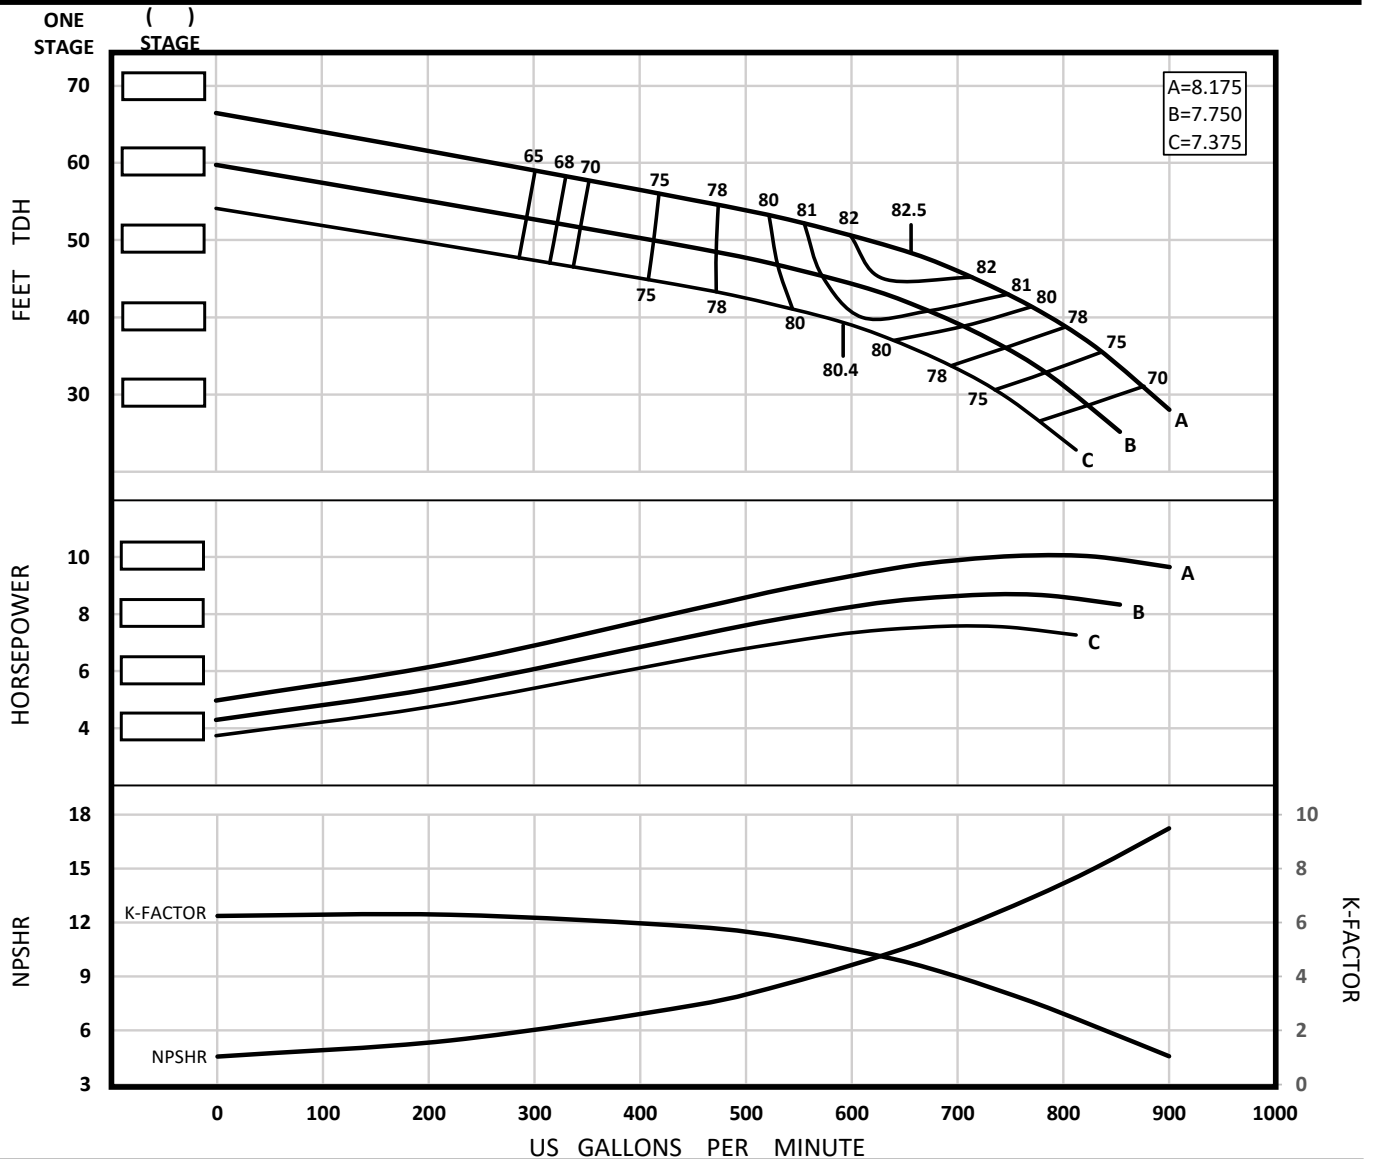

Impeller Type	Enclosed	Bowl OD (in.)	10.19	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM10M	Thd'd Discharge Size	4" / 6" / 8"	Ns	2474	Stages	Change
One Stage Weight (lb)	195.00	Thd'd Suction Size	6"	Nss	7839	1	-4
Add'l Stage Wt. (lb)	75.00	Bell Suction Size	10"	Shaft Size (in.)	1.500	2	-3
Impeller Wt. (lb)	9.70	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	1.06	3	-2
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	489	Setting (in)	.125	4	-1
One Stage Length (in)	~24.00	D.I. Bowl Rating (psi)	Δ1059	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	8.875	S.S. Bowl Rating (psi)	Δ1141	Imp. WR ² (lb-ft ²)	.386		


Δ Consult factory for availability

Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

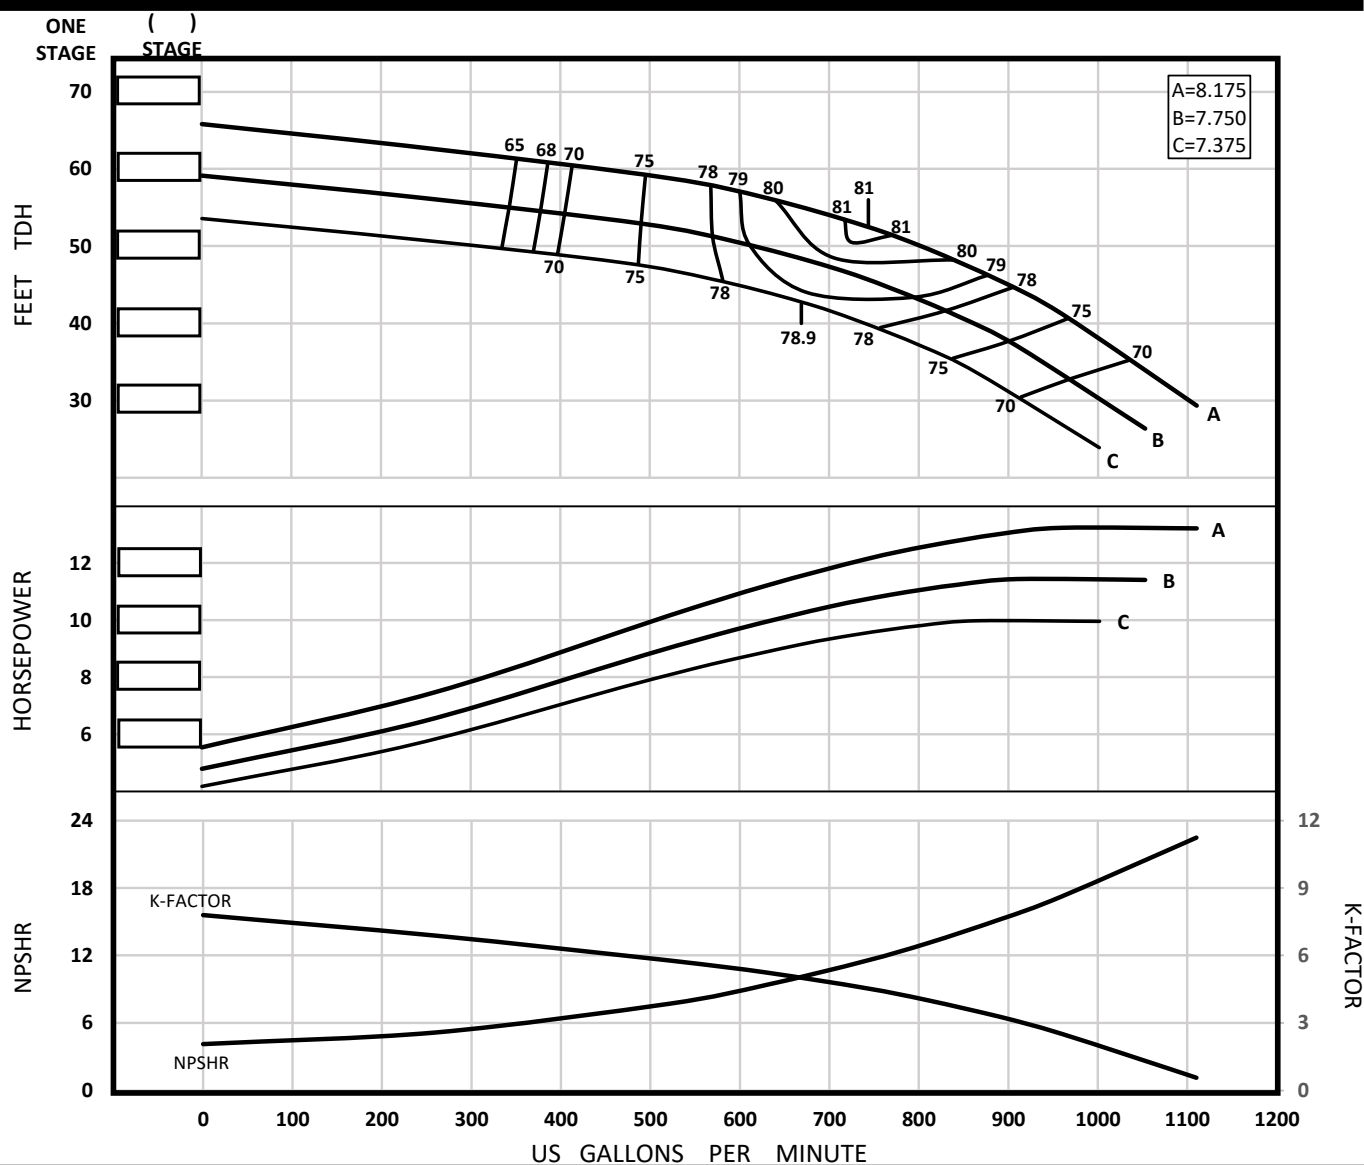

SM10H
1770 RPM

Impeller Type	Enclosed	Bowl OD (in.)	10.19	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM10H	Thd'd Discharge Size	4" / 6" / 8"	Ns	2475	Stages	Change
One Stage Weight (lb)	195.00	Thd'd Suction Size	6"	Nss	7724	1	-4
Add'l Stage Wt. (lb)	76.00	Bell Suction Size	10"	Shaft Size (in.)	1.500	2	-3
Impeller Wt. (lb)	10.80	Sub. Mtr. Size	6"/8"/10"/12"	Lateral (in)	1.06	3	-2
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	489	Setting (in)	.125	4	-1
One Stage Length (in)	~24.00	D.I. Bowl Rating (psi)	Δ1059	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	8.875	S.S. Bowl Rating (psi)	Δ1141	Imp. WR ² (lb-ft ²)	.386		

Δ Consult factory for availability


Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.




SM11M
1770 RPM

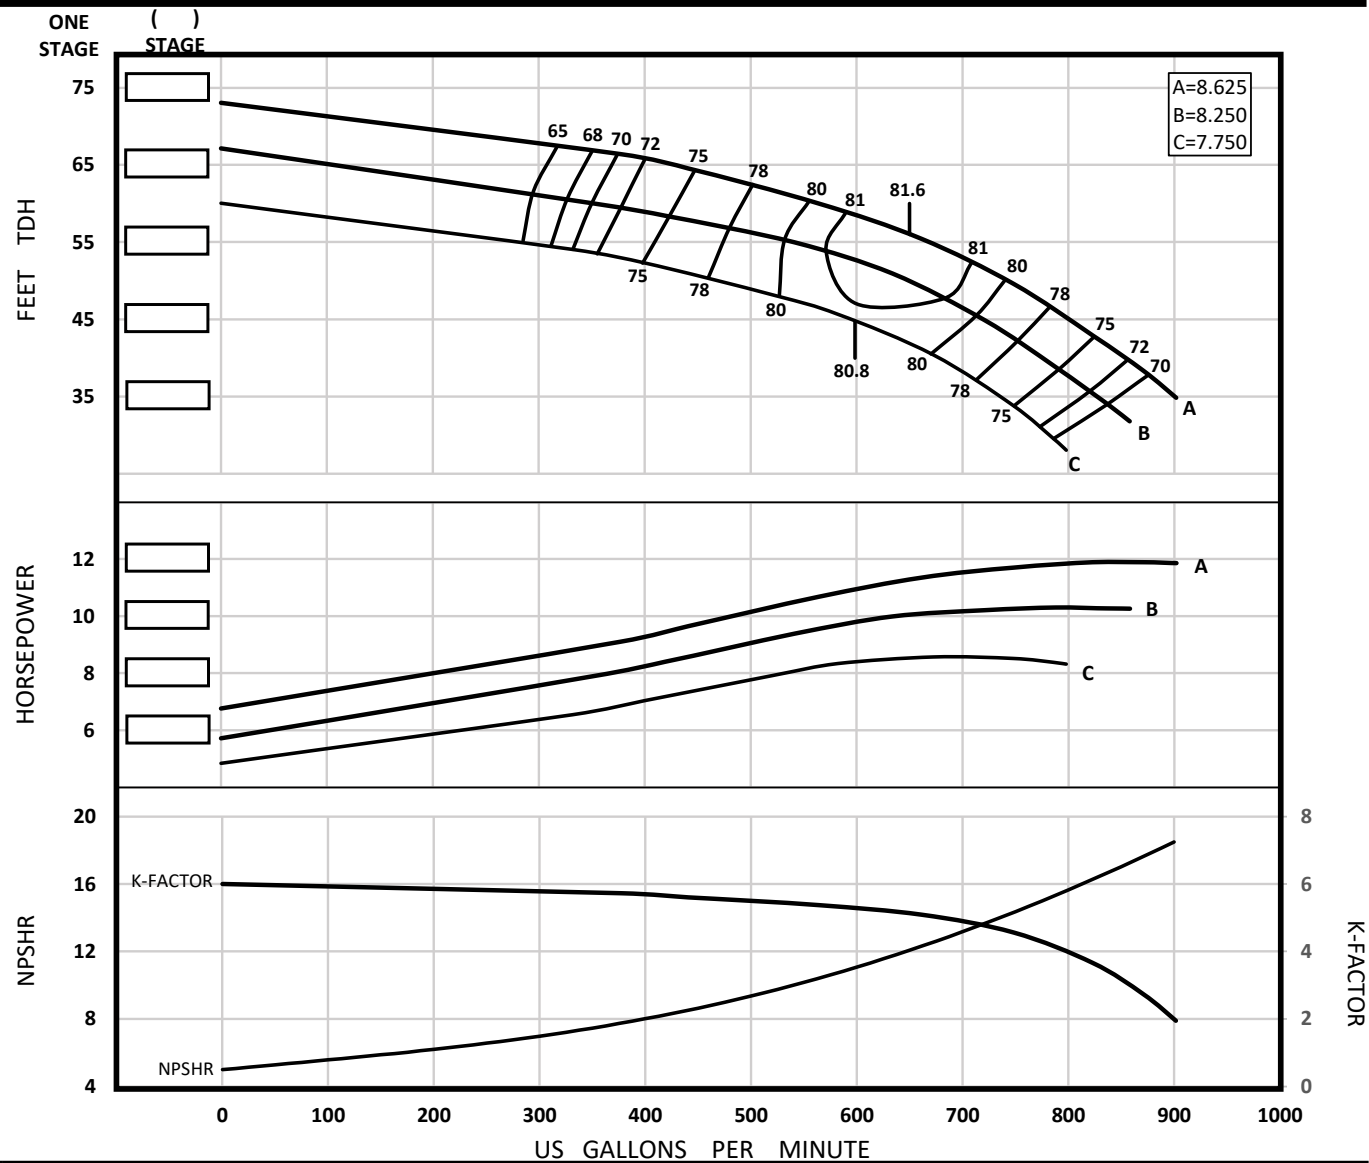

Impeller Type	Enclosed	Bowl OD (in.)	10.63	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM11M	Thd'd Discharge Size	4" / 6" / 8"	Ns	2202	Stages	Change
One Stage Weight (lb)	195.00	Thd'd Suction Size	8"	Nss	6903	1	-3
Add'l Stage Wt. (lb)	75.00	Bell Suction Size	11.38"	Shaft Size (in.)	1.500	2	-2
Impeller Wt. (lb)	9.50	Sub. Mtr. Size	8" / 10" / 12"	Lateral (in)	.88	3	-1
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	420	Setting (in)	.125	4	0
One Stage Length (in)	~25.125	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	2.500	5	0
Add'l Stage Length (in)	8.625	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.382		

Δ Consult factory for availability
Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.
Weights and lengths listed are approximate and subject to change. Consult factory.

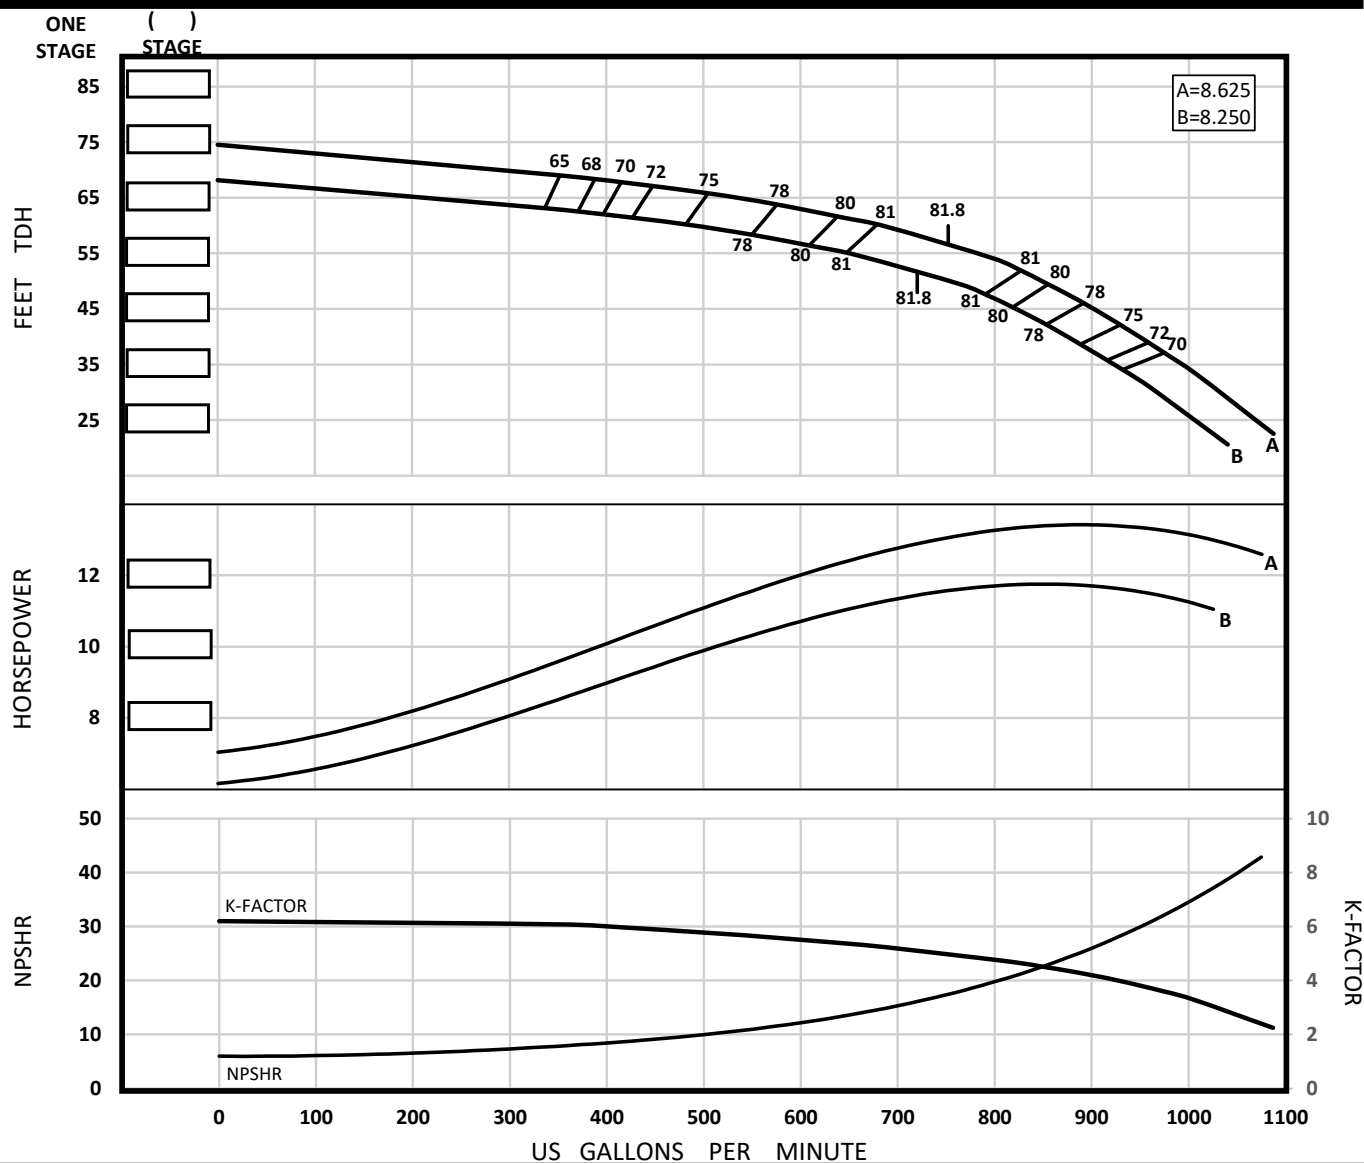SM11H
1770 RPM

Impeller Type	Enclosed	Bowl OD (in.)	10.63	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM11H	Thd'd Discharge Size	4" / 6" / 8"	Ns	2347	Stages	Change
One Stage Weight (lb)	195.00	Thd'd Suction Size	8"	Nss	5258	1	-3
Add'l Stage Wt. (lb)	75.00	Bell Suction Size	11.38"	Shaft Size (in.)	1.50	2	-2
Impeller Wt. (lb)	11.00	Sub. Mtr. Size	8" / 10" / 12"	Lateral (in)	.94	3	-1
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	420	Setting (in)	.125	4	0
One Stage Length (in)	~25.125	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	8.625	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.450		

Δ Consult factory for availability


Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SR11MO 1770 RPM

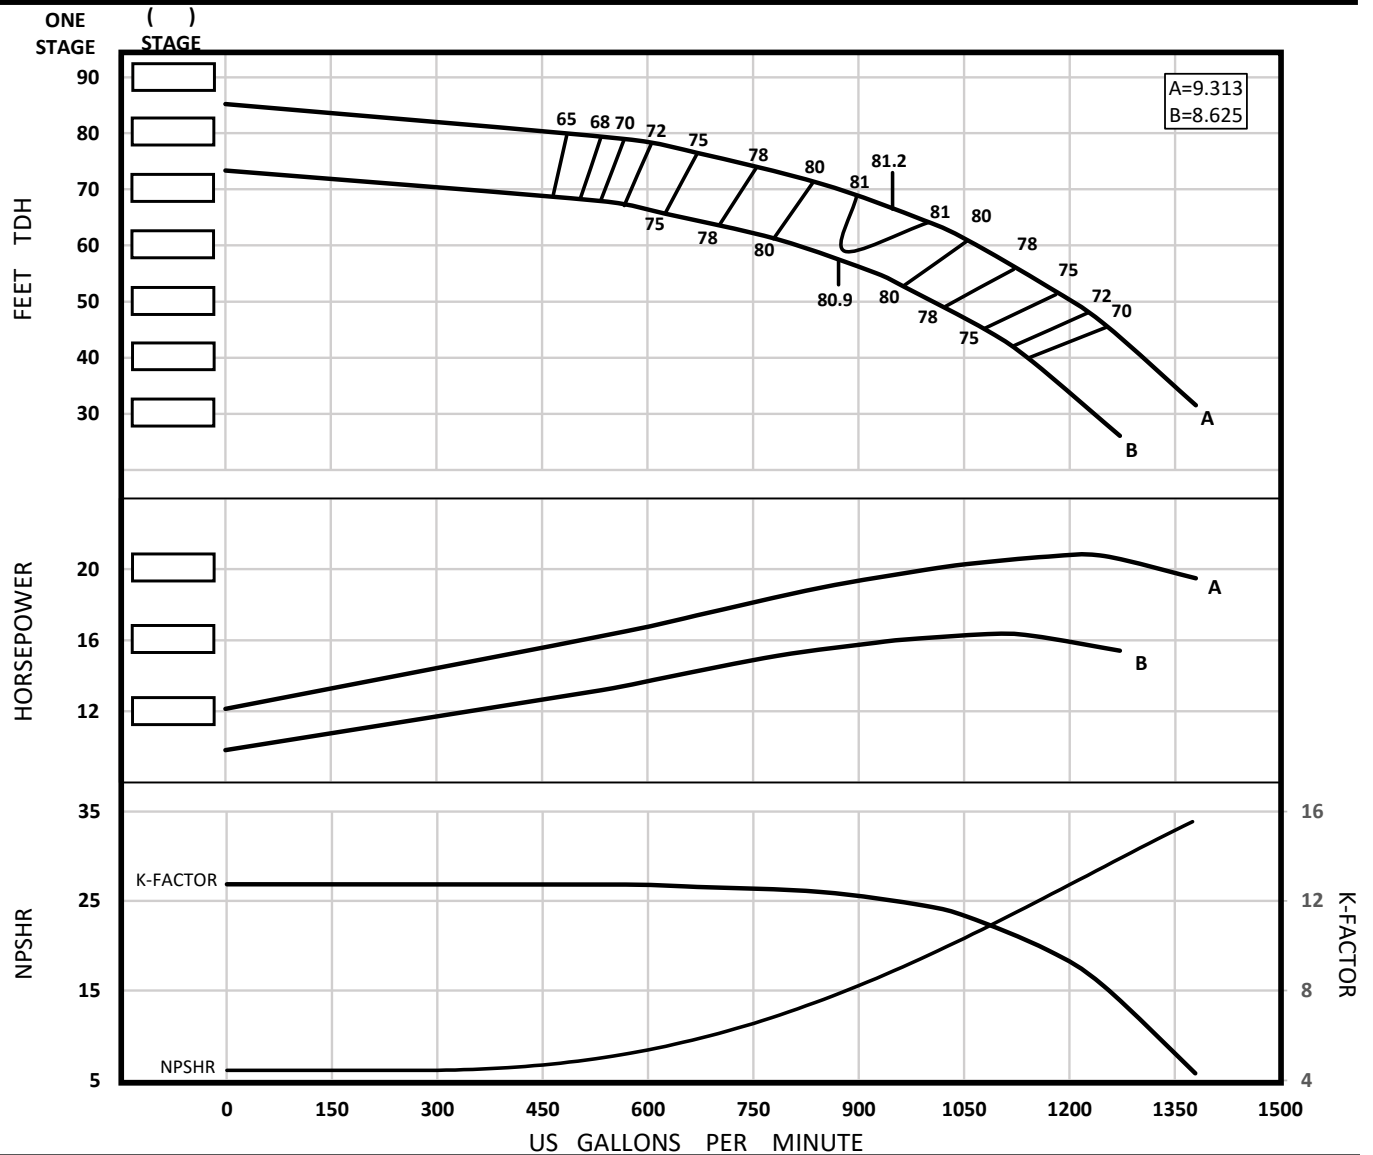

Impeller Type	Enclosed	Bowl OD (in.)	11.50	PEI cl	N/A	Qty.	Eff.
Impeller Model	SR11MO	Thd'd Discharge Size	6" / 8" / 10"	Ns	2335	Stages	Change
One Stage Weight (lb)	270.00	Thd'd Suction Size	8"	Nss	6031	1	-3
Add'l Stage Wt. (lb)	100.00	Bell Suction Size	11.38"	Shaft Size (in.)	1.6875	2	-2
Impeller Wt. (lb)	8.00	Sub. Mtr. Size	10" / 12"	Lateral (in)	1.13	3	-1
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	596	Setting (in)	.02	4	0
One Stage Length (in)	~25.813	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	9.500	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.375		

Δ Consult factory for availability


Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.




SR11HO
1770 RPM

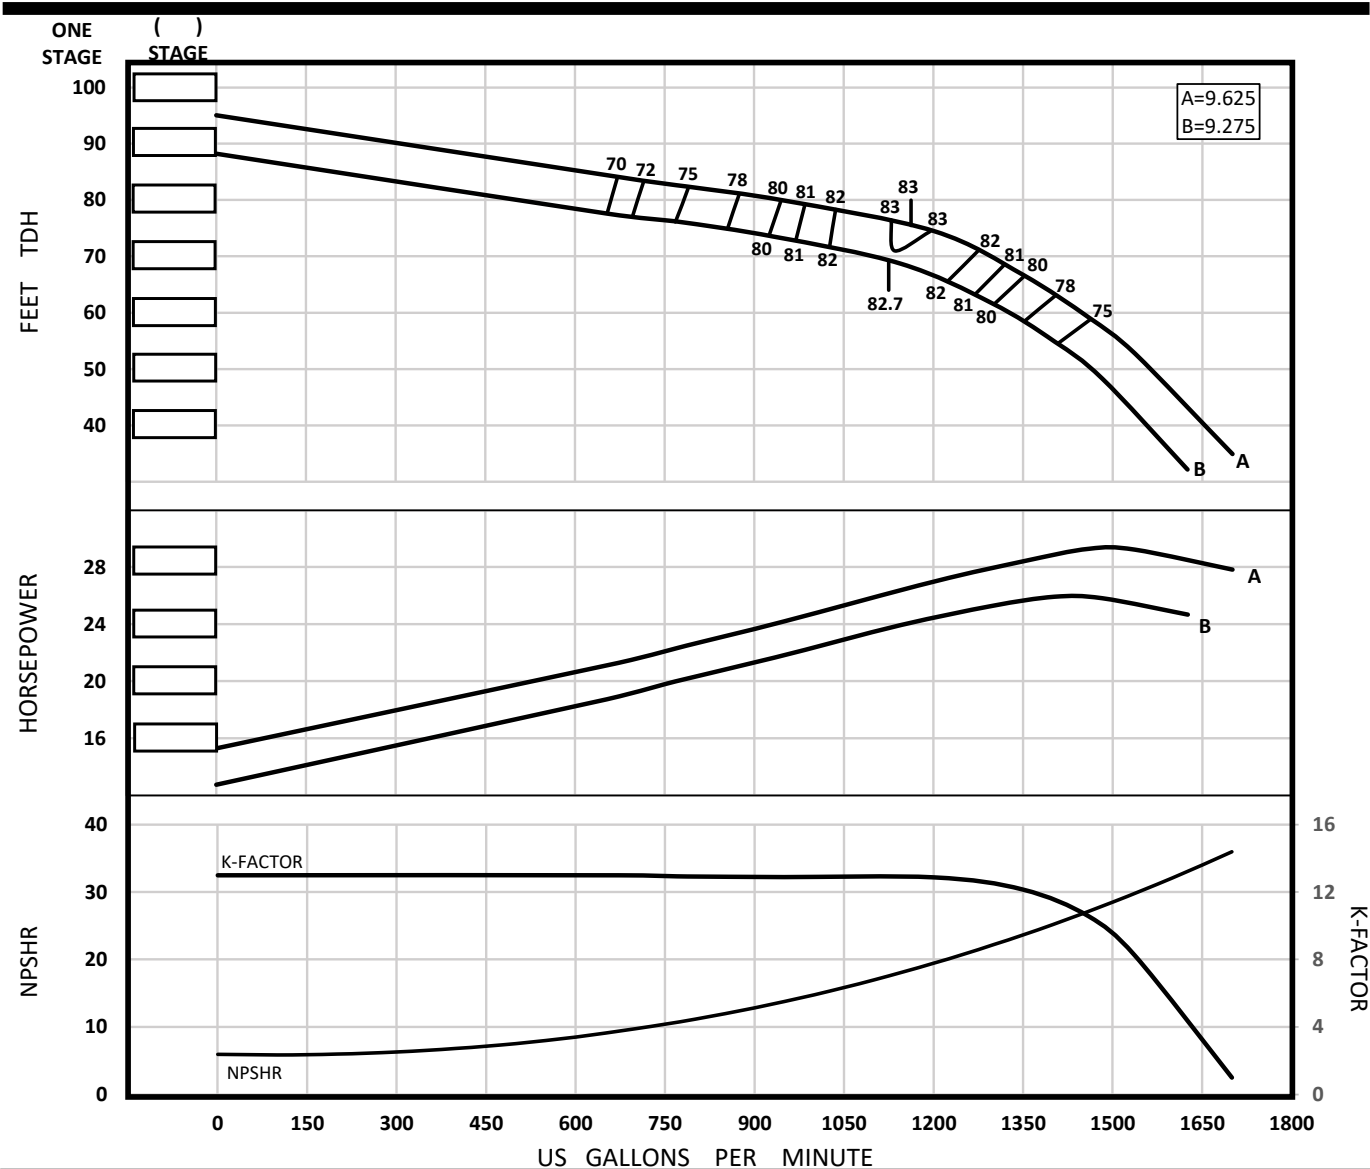

Impeller Type	Enclosed	Bowl OD (in.)	11.50	PEI cl	N/A	Qty.	Eff.
Impeller Model	SR11HO	Thd'd Discharge Size	6" / 8" / 10"	Ns	2355	Stages	Change
One Stage Weight (lb)	270.00	Thd'd Suction Size	8"	Nss	6513	1	-3
Add'l Stage Wt. (lb)	100.00	Bell Suction Size	11.38"	Shaft Size (in.)	1.6875	2	-2
Impeller Wt. (lb)	8.35	Sub. Mtr. Size	8" / 10" / 12"	Lateral (in)	.72	3	-1
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	596	Setting (in)	.02	4	0
One Stage Length (in)	~25.813	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	9.500	S.S. Bowl Rating (psi)	Δ	Imp. WR² (lb-ft²)	.411		

Δ Consult factory for availability
Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.
Weights and lengths listed are approximate and subject to change. Consult factory.

SL11H
1770 RPM

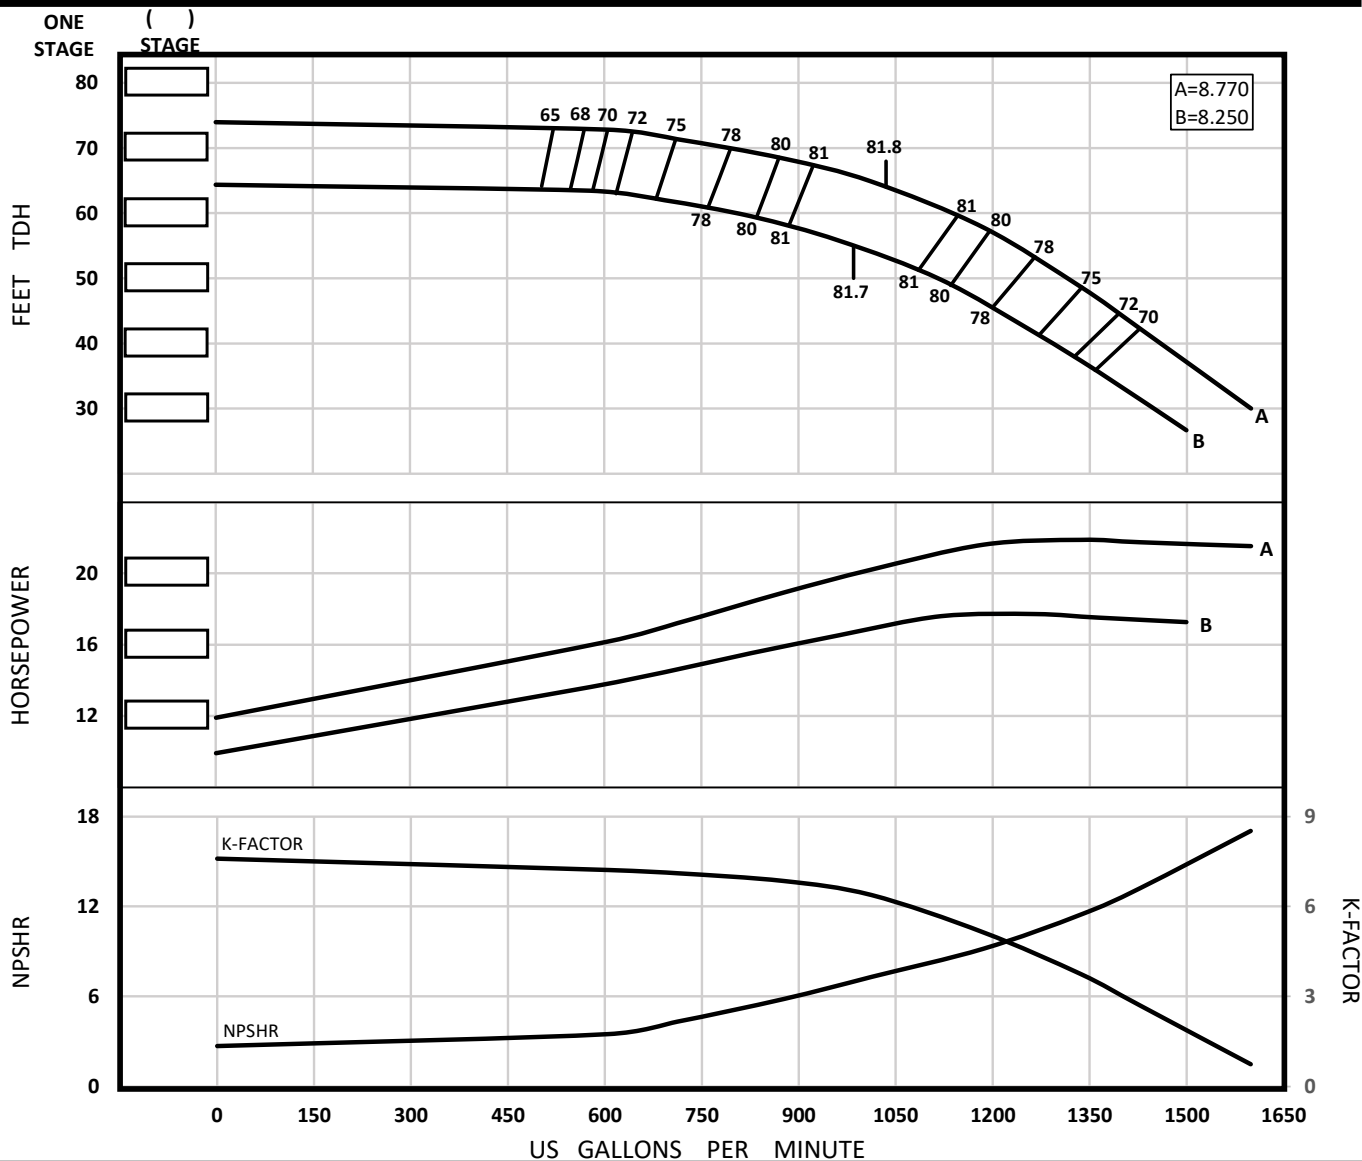

Impeller Type	Enclosed	Bowl OD (in.)	10.88	PEI cl	N/A	Qty.	Eff.
Impeller Model	SL11H	Thd'd Discharge Size	4" / 6" / 8"	Ns	2512	Stages	Change
One Stage Weight (lb)	200.00	Thd'd Suction Size	8"	Nss	12814	1	-3
Add'l Stage Wt. (lb)	81.00	Bell Suction Size	11.38"	Shaft Size (in.)	1.6875	2	-2
Impeller Wt. (lb)	13.00	Sub. Mtr. Size	8" / 10" / 12"	Lateral (in)	1.44	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	489	Setting (in)	.125	4	0
One Stage Length (in)	~25.813	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	10.000	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.532		


Δ Consult factory for availability

Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.


SP11L
1770 RPM

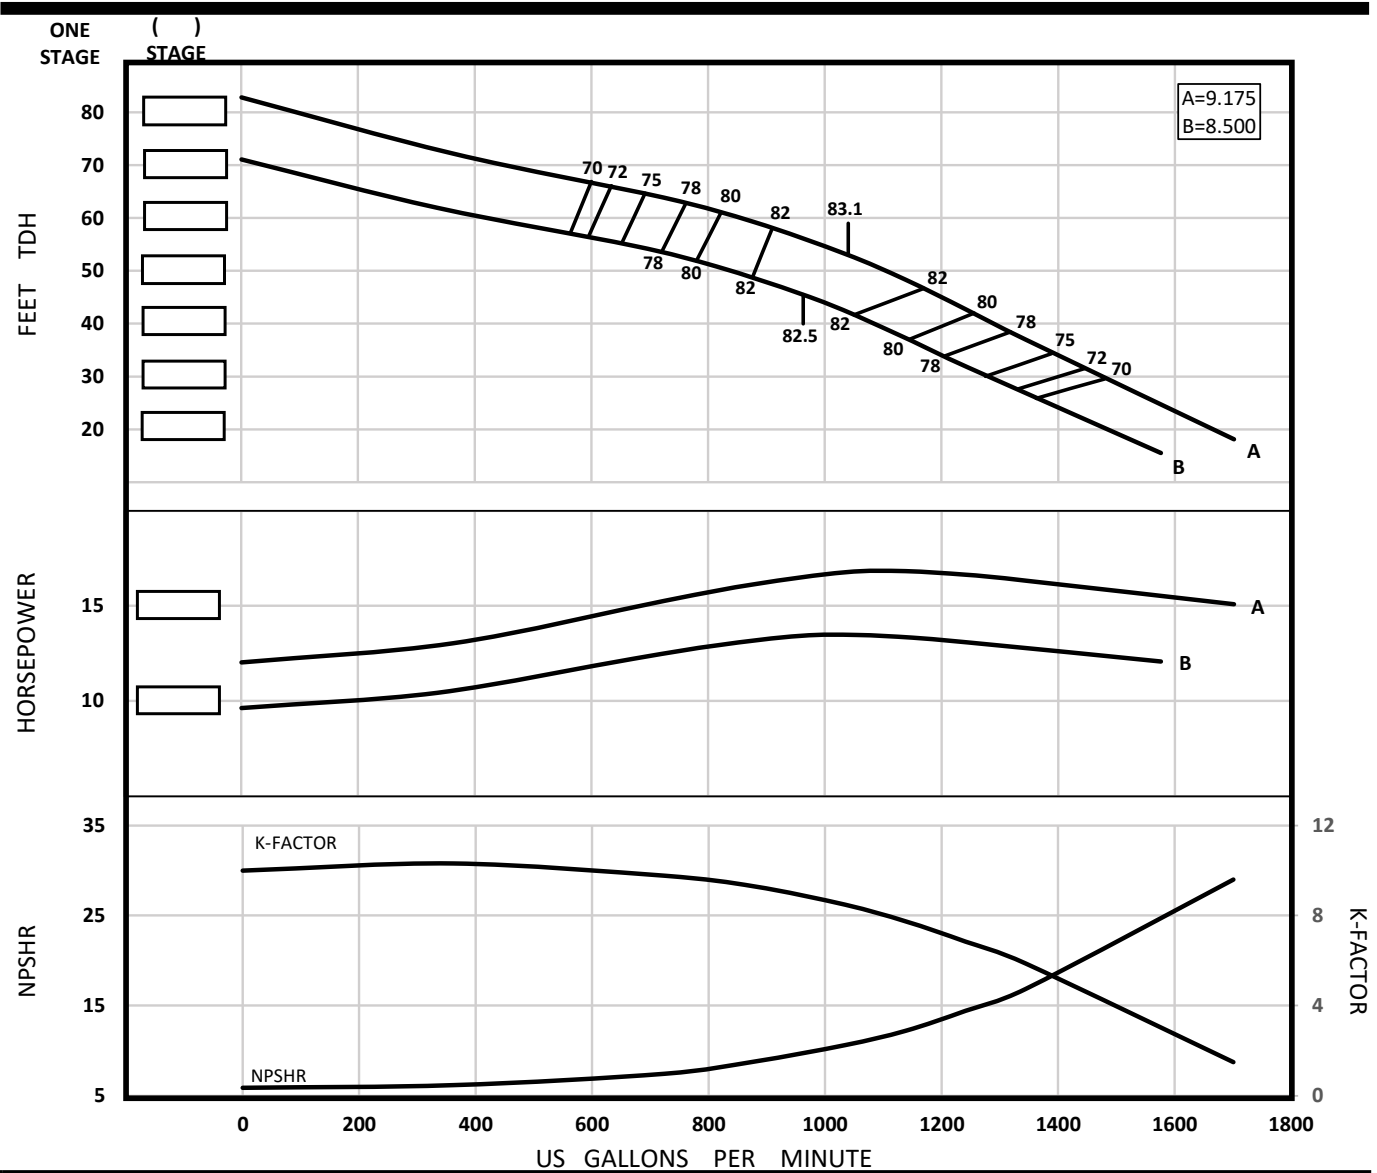

Impeller Type	Enclosed	Bowl OD (in.)	11.25	PEI cl	N/A	Qty.	Eff.
Impeller Model	SP11L	Thd'd Discharge Size	6" / 8" / 10"	Ns	2907	Stages	Change
One Stage Weight (lb)	290.00	Thd'd Suction Size	8"	Nss	9693	1	-4
Add'l Stage Wt. (lb)	105.00	Bell Suction Size	11.38"	Shaft Size (in.)	1.9375	2	-3
Impeller Wt. (lb)	16.40	Sub. Mtr. Size	8"/ 10"/ 12"	Lateral (in)	1.13	3	-2
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	427	Setting (in)	.125	4	-1
One Stage Length (in)	~27.50	D.I. Bowl Rating (psi)	Δ925	K-Factor (lb/ft tdk)	CURVE	5	0
Add'l Stage Length (in)	10.000	S.S. Bowl Rating (psi)	Δ996	Imp. WR² (lb-ft²)	.754		

Δ Consult factory for availability
Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.
Weights and lengths listed are approximate and subject to change. Consult factory.

SP11M
1770 RPM

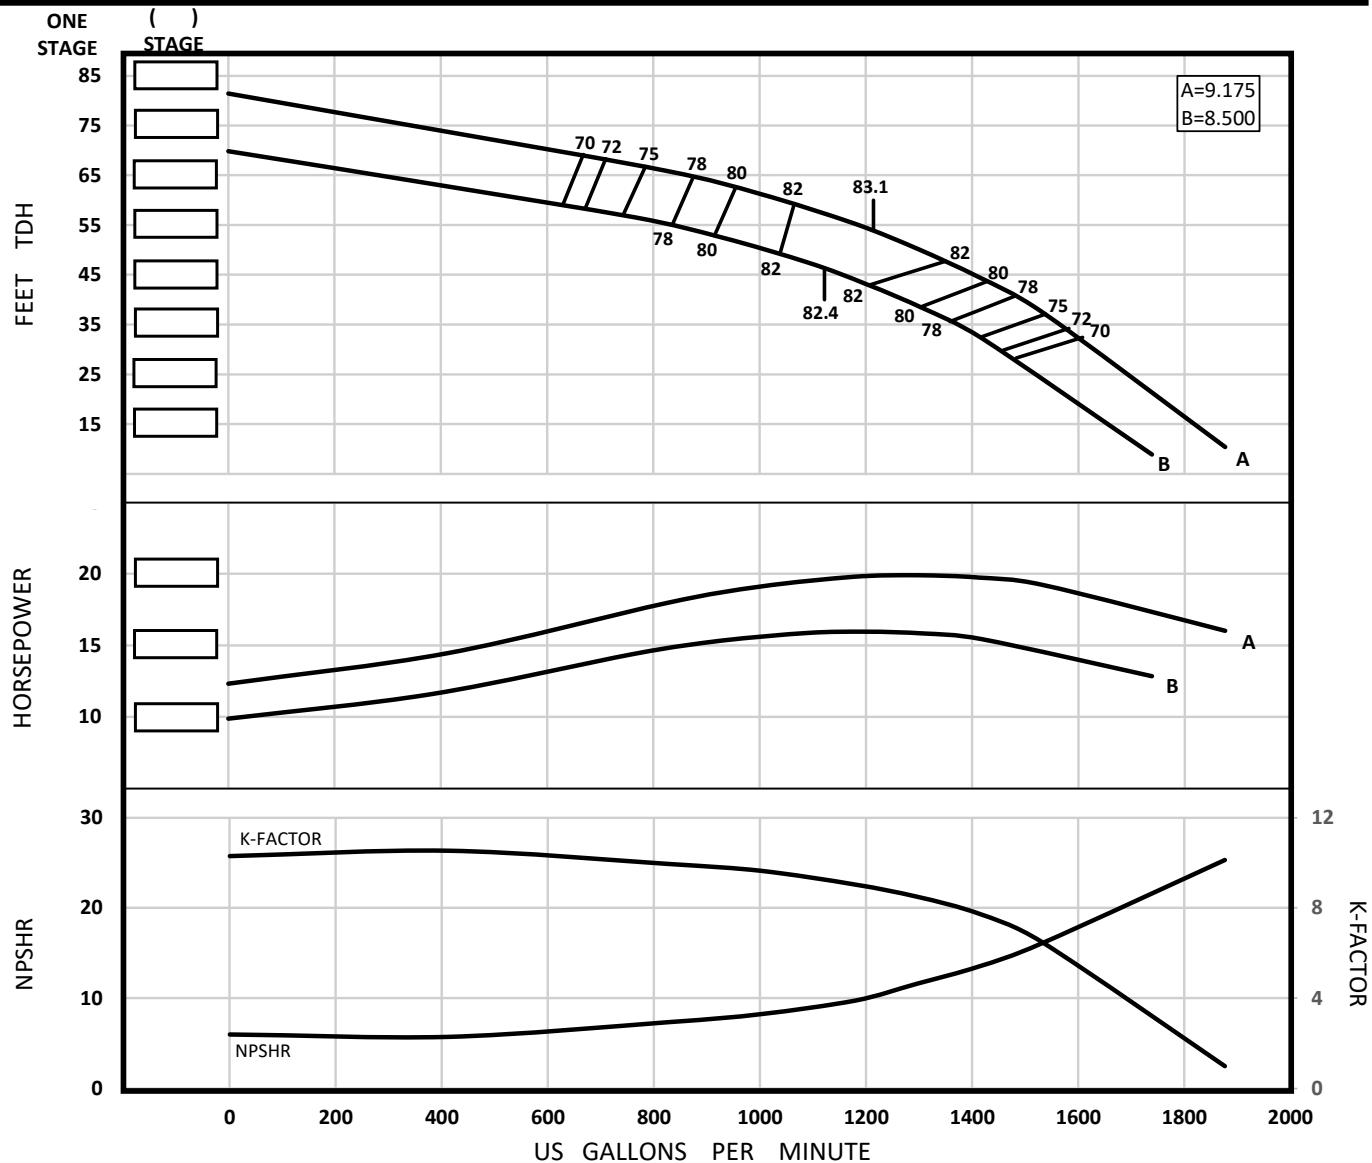


Impeller Type	Enclosed	Bowl OD (in.)	11.25	PEI cl	N/A	Qty.	Eff.
Impeller Model	SP11M	Thd'd Discharge Size	6" / 8" / 10"	Ns	3102	Stages	Change
One Stage Weight (lb)	290.00	Thd'd Suction Size	8"	Nss	11177	1	-3
Add'l Stage Wt. (lb)	105.00	Bell Suction Size	11.38"	Shaft Size (in.)	1.9375	2	-2
Impeller Wt. (lb)	14.30	Sub. Mtr. Size	8" / 10" / 12"	Lateral (in)	1.13	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	427	Setting (in)	.125	4	0
One Stage Length (in)	~27.50	D.I. Bowl Rating (psi)	Δ925	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	10.000	S.S. Bowl Rating (psi)	Δ996	Imp. WR ² (lb-ft ²)	.670		

Δ Consult factory for availability Rev. 2023.08.18

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

SP11H
1770 RPM

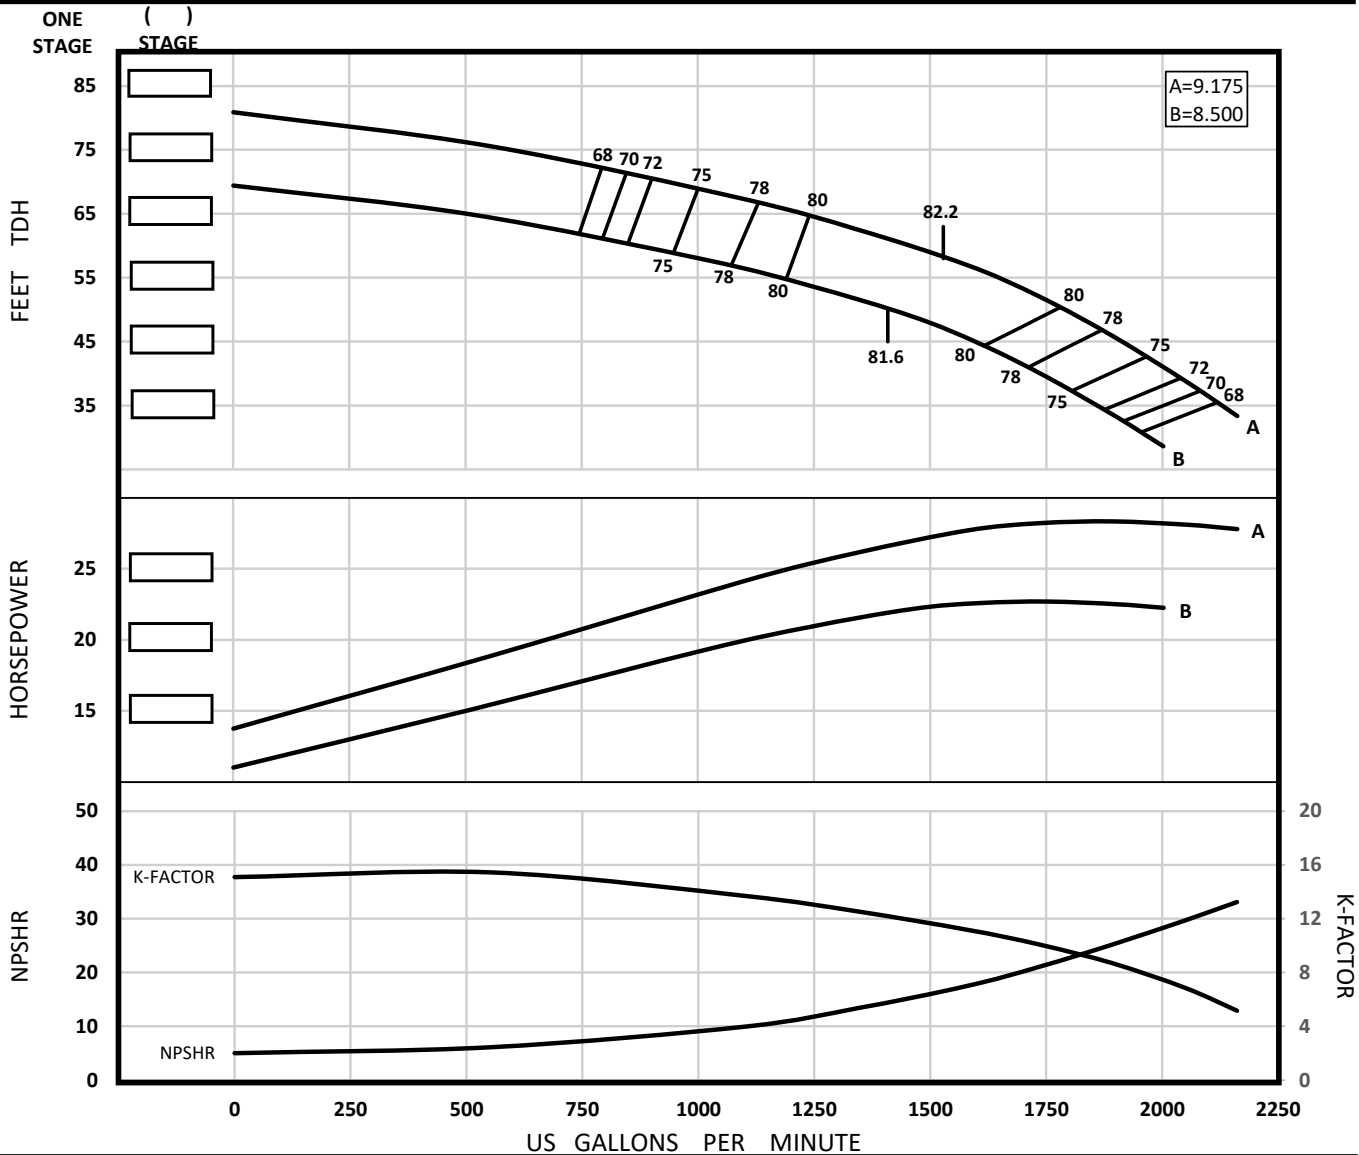

Impeller Type	Enclosed	Bowl OD (in.)	11.25	PEI cl	N/A	Qty.	Eff.
Impeller Model	SP11H	Thd'd Discharge Size	6" / 8" / 10"	Ns	3277	Stages	Change
One Stage Weight (lb)	290.00	Thd'd Suction Size	8"	Nss	8095	1	-3
Add'l Stage Wt. (lb)	105.00	Bell Suction Size	11.38"	Shaft Size (in.)	1.9375	2	-2
Impeller Wt. (lb)	14.90	Sub. Mtr. Size	8" / 10" / 12"	Lateral (in)	1.13	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	427	Setting (in)	.125	4	0
One Stage Length (in)	~27.50	D.I. Bowl Rating (psi)	Δ925	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	10.000	S.S. Bowl Rating (psi)	Δ996	Imp. WR ² (lb-ft ²)	.718		


Δ Consult factory for availability

Rev. 2023.08.18

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.

SW12L
1770 RPM

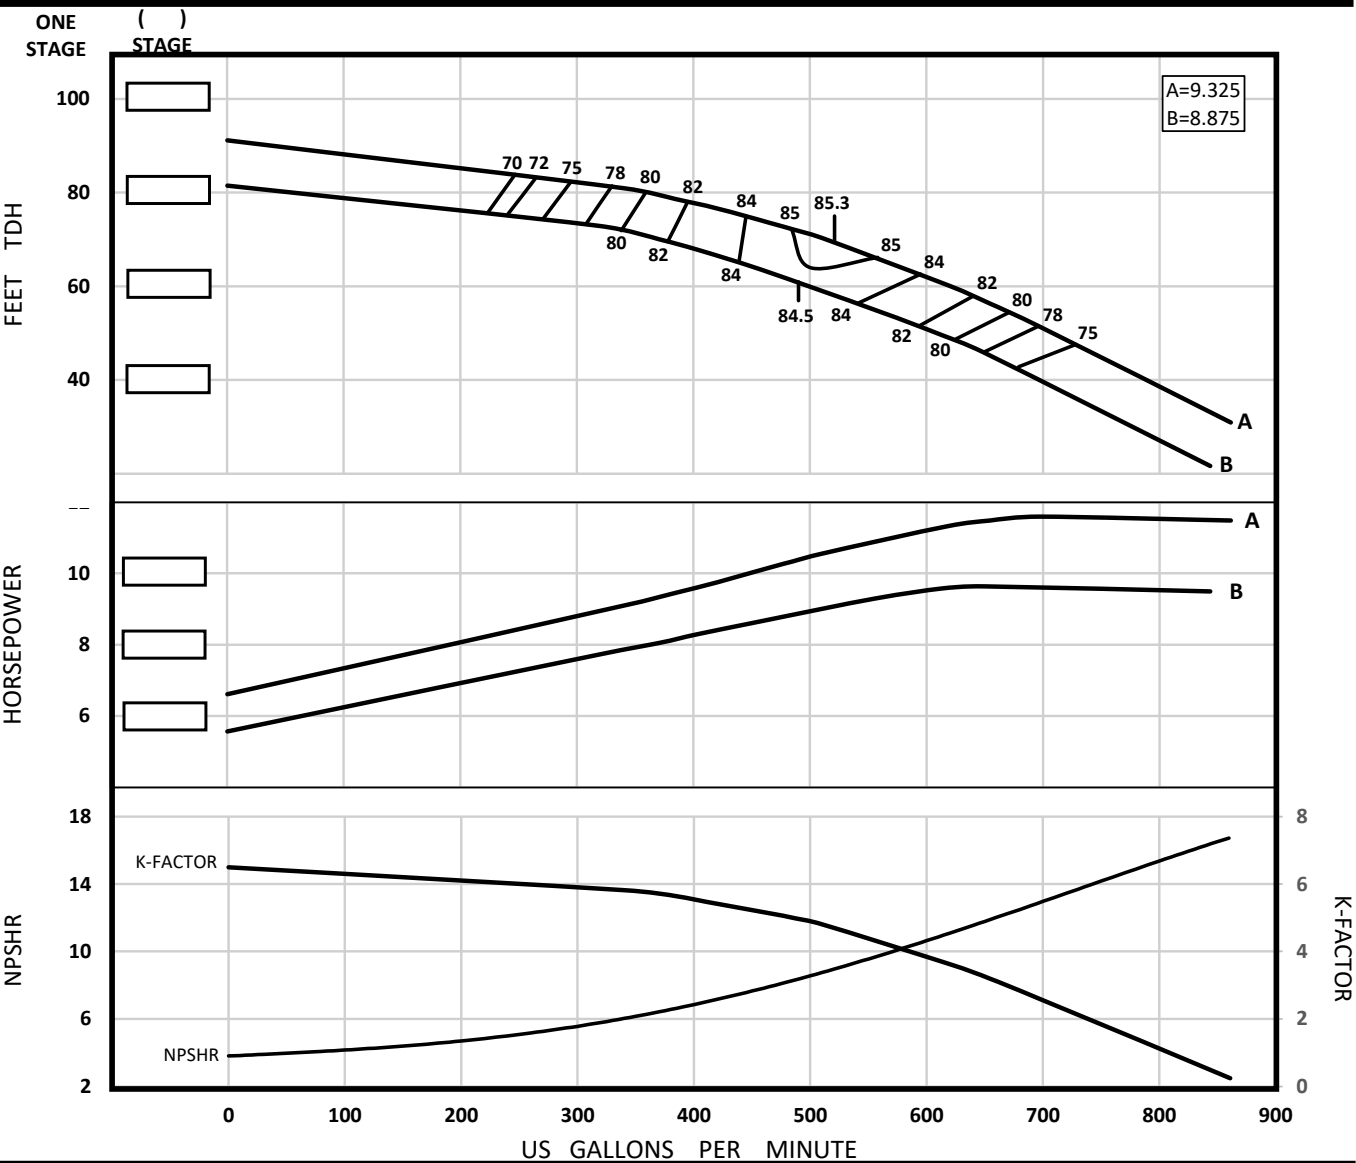

Impeller Type	Enclosed	Bowl OD (in.)	11.63	PEI cl	N/A	Qty.	Eff.
Impeller Model	SW12L	Thd'd Discharge Size	6" / 8" / 10"	Ns	1681	Stages	Change
One Stage Weight (lb)	235.00	Thd'd Suction Size	8"	Nss	7957	1	-3
Add'l Stage Wt. (lb)	105.00	Bell Suction Size	11.38"	Shaft Size (in.)	1.6875	2	-2
Impeller Wt. (lb)	13.80	Sub. Mtr. Size	8" / 10" / 12"	Lateral (in)	1.13	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	526	Setting (in)	.25	4	0
One Stage Length (in)	~26.50	D.I. Bowl Rating (psi)	Δ1140	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	9.000	S.S. Bowl Rating (psi)	Δ1227	Imp. WR ² (lb-ft ²)	.642		

Δ Consult factory for availability
Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.
Weights and lengths listed are approximate and subject to change. Consult factory.

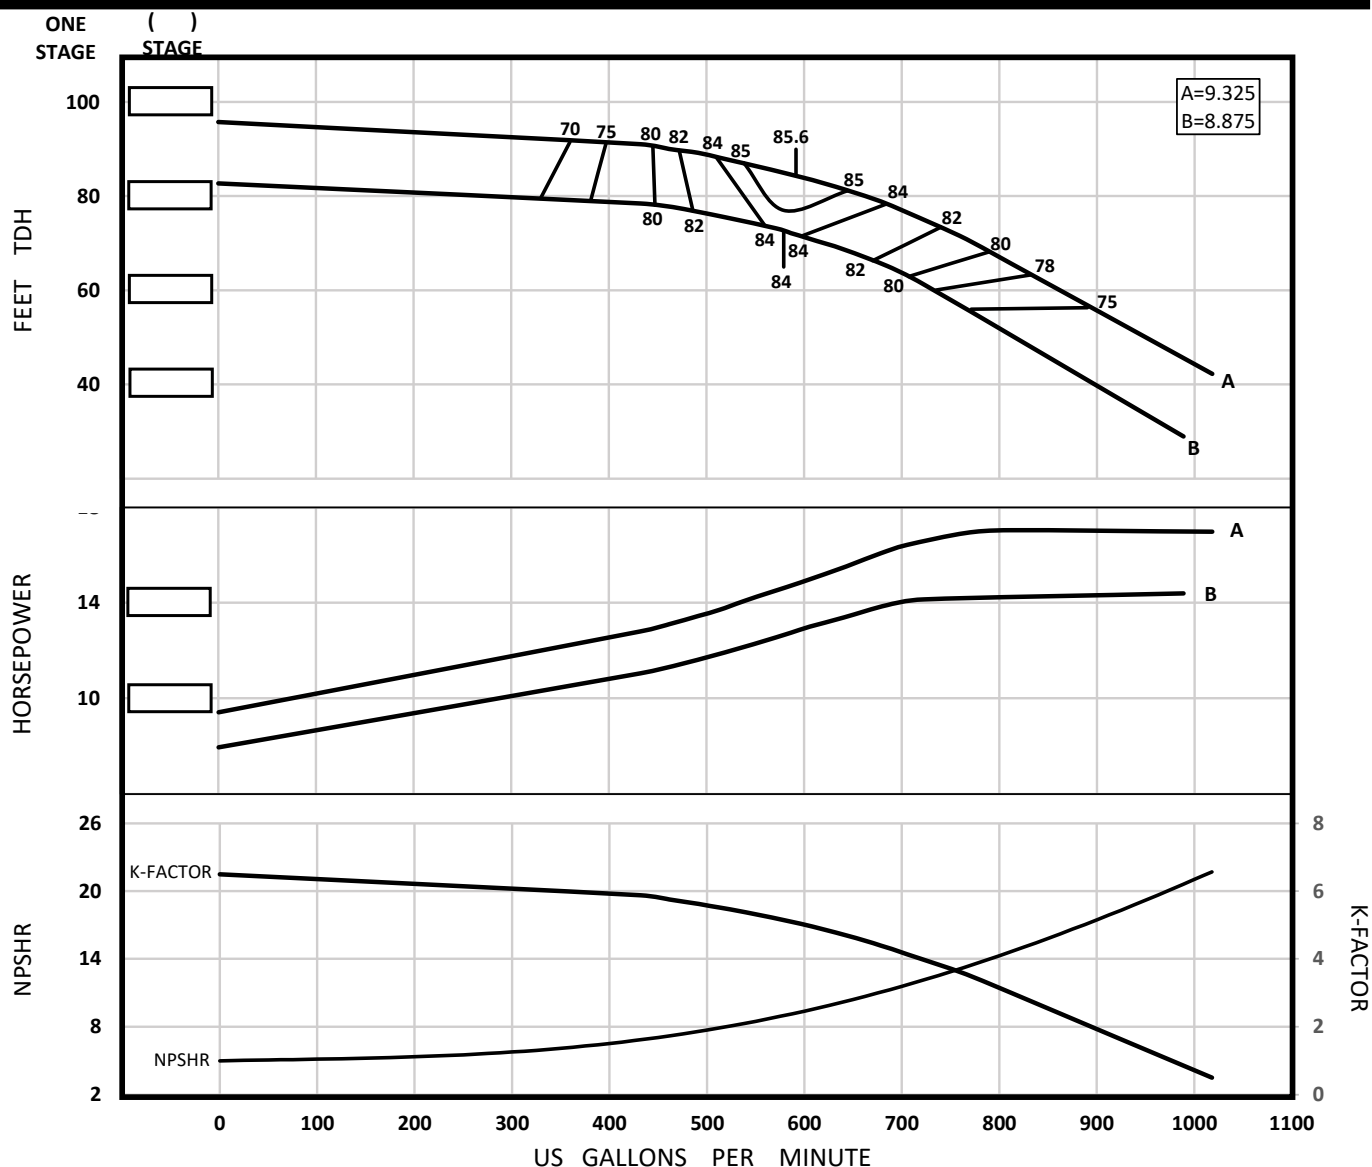SW12M
1770 RPM

Impeller Type	Enclosed	Bowl OD (in.)	11.63	PEI cl	N/A	Qty.	Eff.
Impeller Model	SW12L	Thd'd Discharge Size	6" / 8" / 10"	Ns	1555	Stages	Change
One Stage Weight (lb)	235.00	Thd'd Suction Size	8"	Nss	8034	1	-3
Add'l Stage Wt. (lb)	105.00	Bell Suction Size	11.38"	Shaft Size (in.)	1.6875	2	-2
Impeller Wt. (lb)	13.80	Sub. Mtr. Size	8" / 10" / 12"	Lateral (in)	1.13	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	526	Setting (in)	.25	4	0
One Stage Length (in)	~26.50	D.I. Bowl Rating (psi)	Δ1140	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	9.000	S.S. Bowl Rating (psi)	Δ1227	Imp. WR ² (lb-ft ²)	.642		

Δ Consult factory for availability


Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.




SL12M
1770 RPM

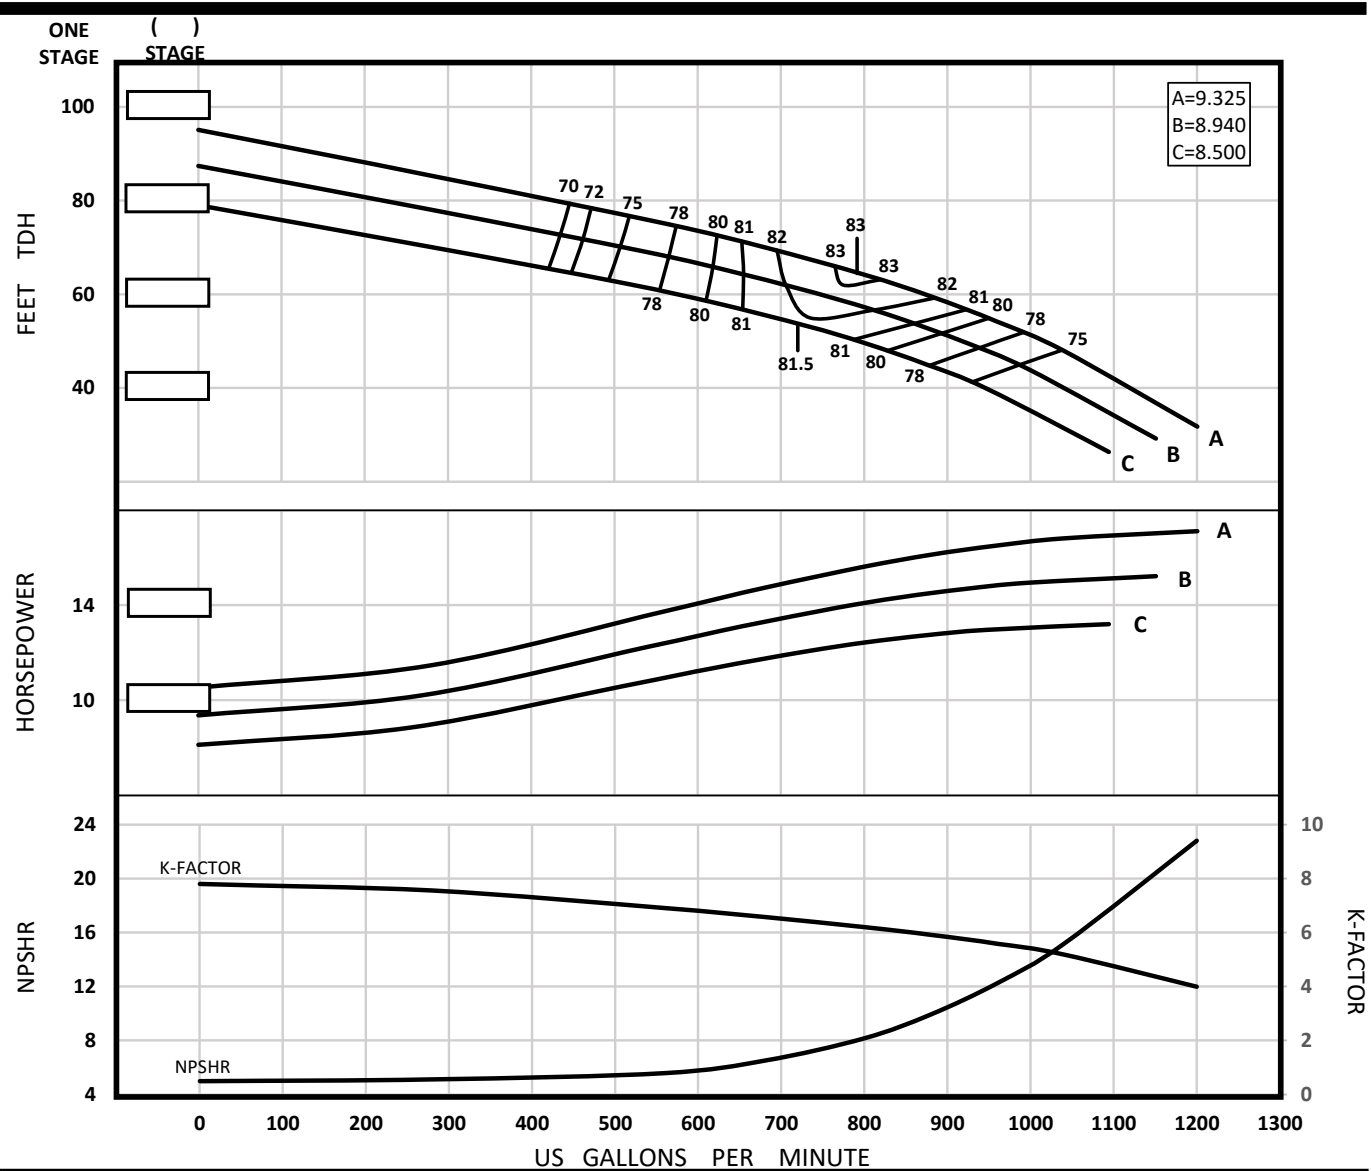

Impeller Type	Enclosed	Bowl OD (in.)	11.75	PEI cl	N/A	Qty.	Eff.
Impeller Model	SL12M	Thd'd Discharge Size	6" / 8" / 10"	Ns	2184	Stages	Change
One Stage Weight (lb)	250.00	Thd'd Suction Size	8"	Nss	10297	1	-3.5
Add'l Stage Wt. (lb)	107.00	Bell Suction Size	11.38"	Shaft Size (in.)	1.6875	2	-2
Impeller Wt. (lb)	13.20	Sub. Mtr. Size	8" / 10" / 12"	Lateral (in)	1.13	3	-1
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	549	Setting (in)	.25	4	0
One Stage Length (in)	~27.50	D.I. Bowl Rating (psi)	Δ1190	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	10.000	S.S. Bowl Rating (psi)	Δ1282	Imp. WR ² (lb-ft ²)	.670		

Δ Consult factory for availability
Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.
Weights and lengths listed are approximate and subject to change. Consult factory.

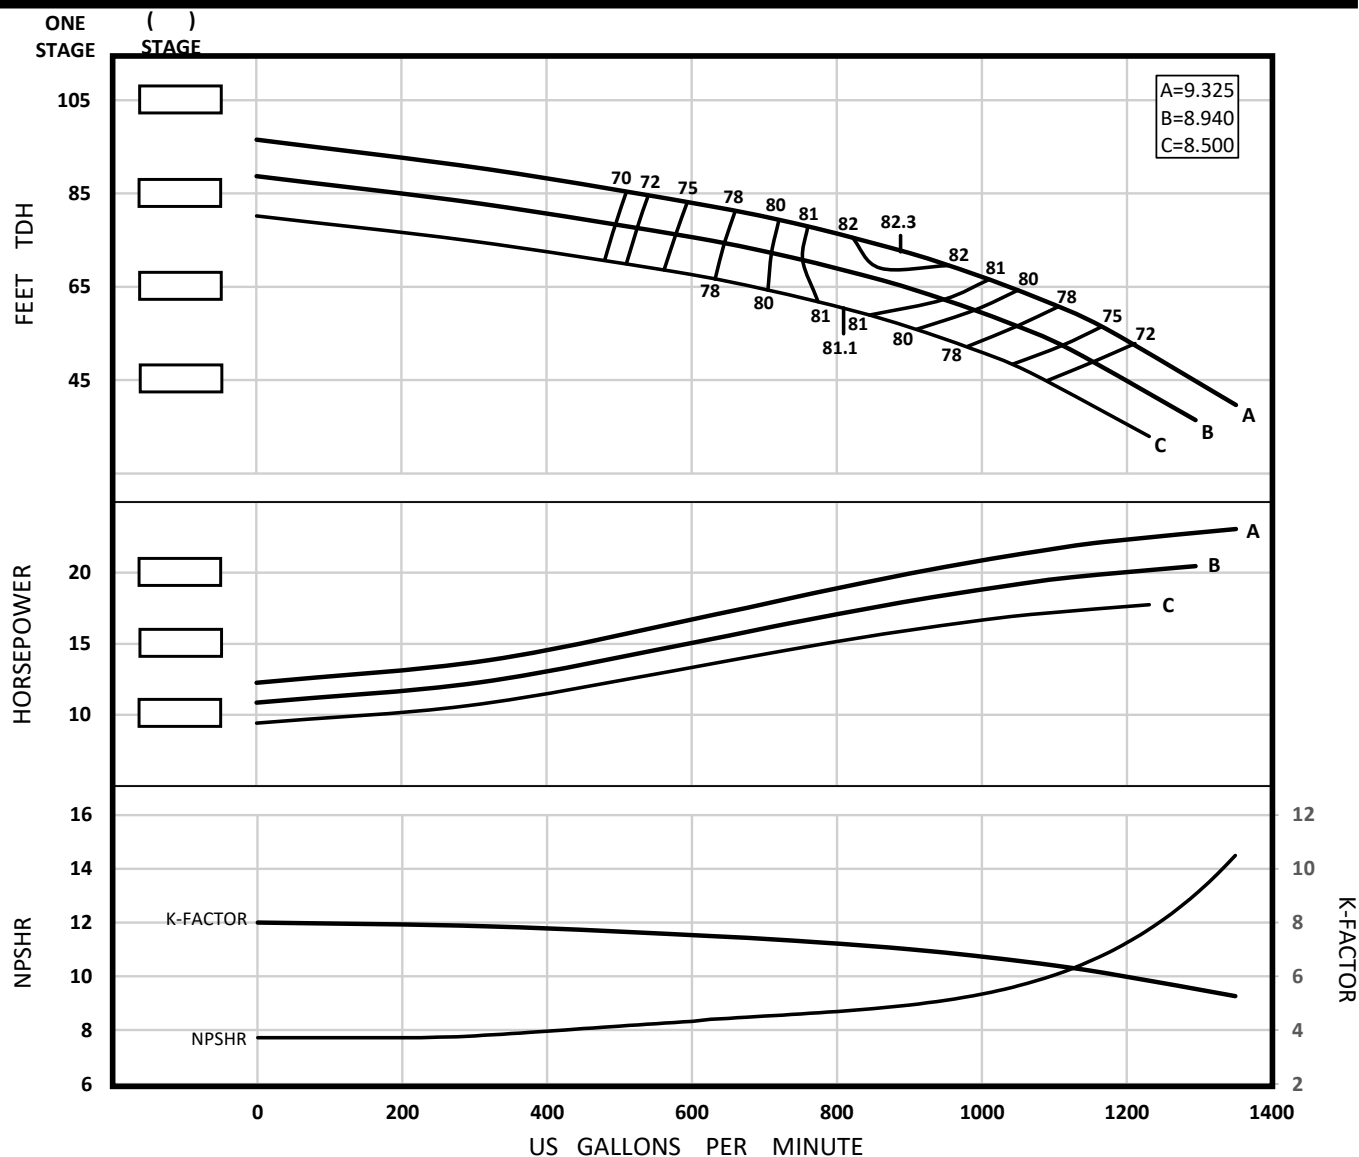SL12H
1770 RPM

Impeller Type	Enclosed	Bowl OD (in.)	11.75	PEI cl	N/A	Qty.	Eff.
Impeller Model	SL12H	Thd'd Discharge Size	6" / 8" / 10"	Ns	2128	Stages	Change
One Stage Weight (lb)	250.00	Thd'd Suction Size	8"	Nss	10207	1	-1
Add'l Stage Wt. (lb)	107.00	Bell Suction Size	11.38"	Shaft Size (in.)	1.6875	2	0
Impeller Wt. (lb)	13.50	Sub. Mtr. Size	8" / 10" / 12"	Lateral (in)	1.13	3	0
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	549	Setting (in)	.25	4	0
One Stage Length (in)	~27.50	D.I. Bowl Rating (psi)	Δ1190	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	10.000	S.S. Bowl Rating (psi)	Δ1282	Imp. WR ² (lb-ft ²)	.744		

Δ Consult factory for availability


Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SJ12M 1770 RPM

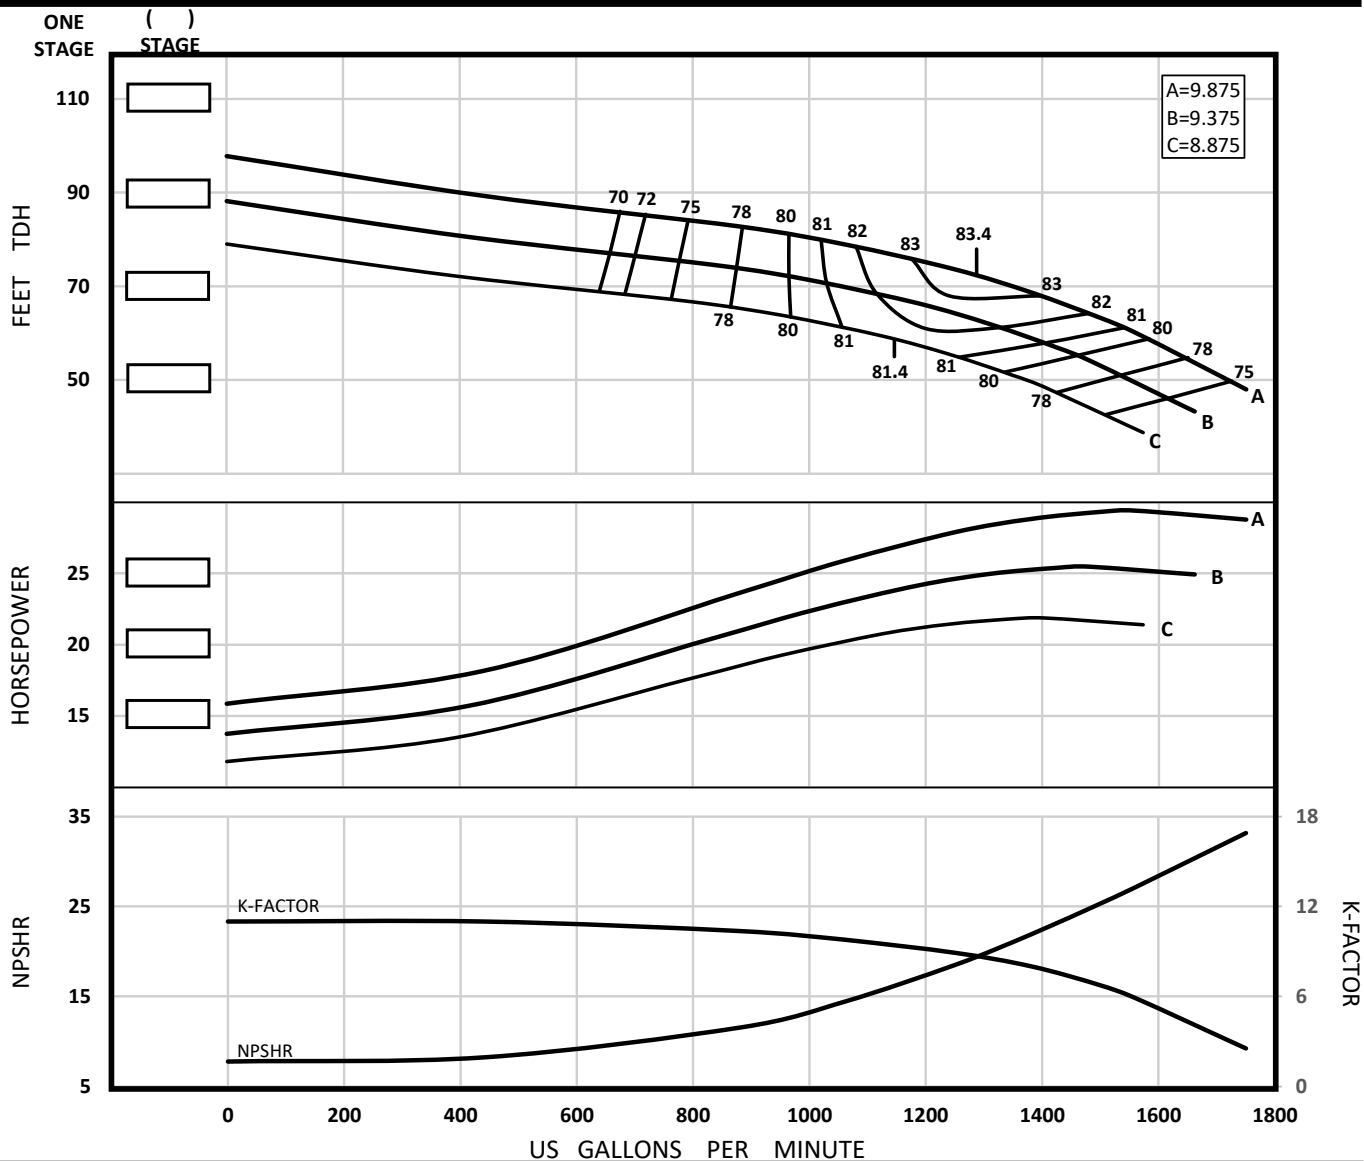

Impeller Type	Enclosed	Bowl OD (in.)	12.00	PEI cl	N/A	Qty.	Eff.
Impeller Model	SJ12M	Thd'd Discharge Size	6" / 8" / 10"	Ns	2560	Stages	Change
One Stage Weight (lb)	270.00	Thd'd Suction Size	8"	Nss	7113	1	-2
Add'l Stage Wt. (lb)	110.00	Bell Suction Size	11.38"	Shaft Size (in.)	1.6875	2	-1
Impeller Wt. (lb)	17.00	Sub. Mtr. Size	8" / 10" / 12"	Lateral (in)	1.19	3	0
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	487	Setting (in)	.19	4	0
One Stage Length (in)	~28.25	D.I. Bowl Rating (psi)	Δ1056	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	10.750	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.744		


Δ Consult factory for availability

Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

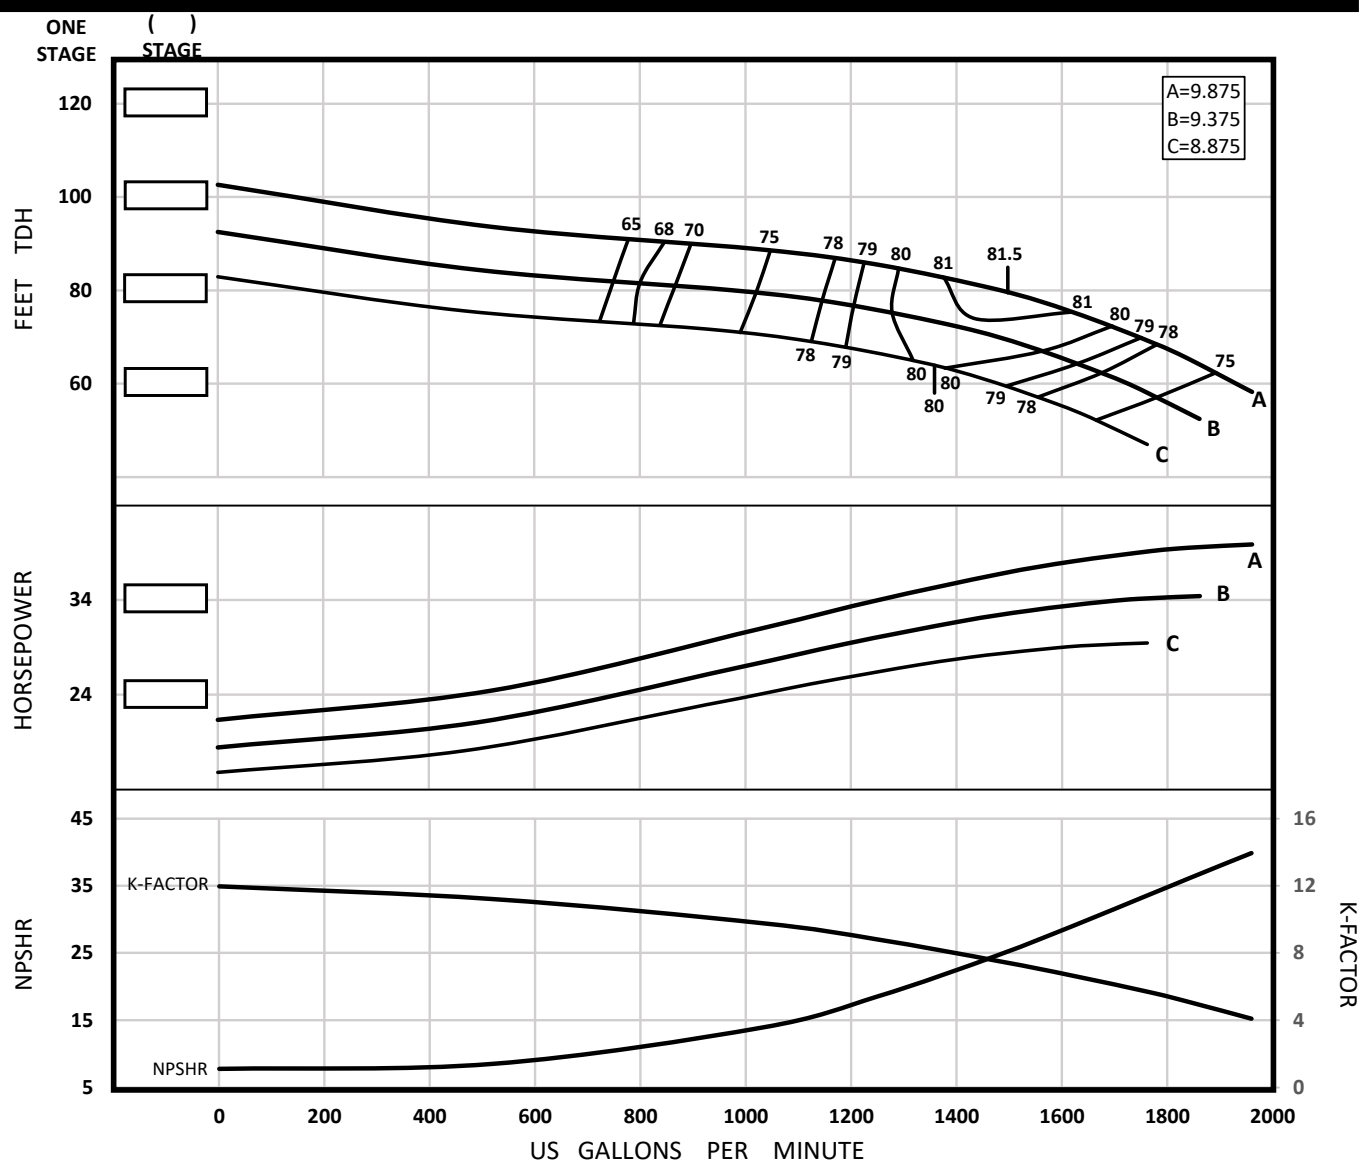

SJ12H
1770 RPM

Impeller Type	Enclosed	Bowl OD (in.)	12.00	PEI cl	N/A	Qty.	Eff.
Impeller Model	SJ12H	Thd'd Discharge Size	6" / 8" / 10"	Ns	2571	Stages	Change
One Stage Weight (lb)	270.00	Thd'd Suction Size	8"	Nss	6176	1	-1
Add'l Stage Wt. (lb)	110.00	Bell Suction Size	11.38"	Shaft Size (in.)	1.6875	2	0
Impeller Wt. (lb)	12.00	Sub. Mtr. Size	8" / 10" / 12"	Lateral (in)	1.19	3	0
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	487	Setting (in)	.19	4	0
One Stage Length (in)	~28.25	D.I. Bowl Rating (psi)	Δ1056	K-Factor (lb/ft tdk)	CURVE	5	0
Add'l Stage Length (in)	10.750	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	.744		

Δ Consult factory for availability


Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SM14LL
1770 RPM

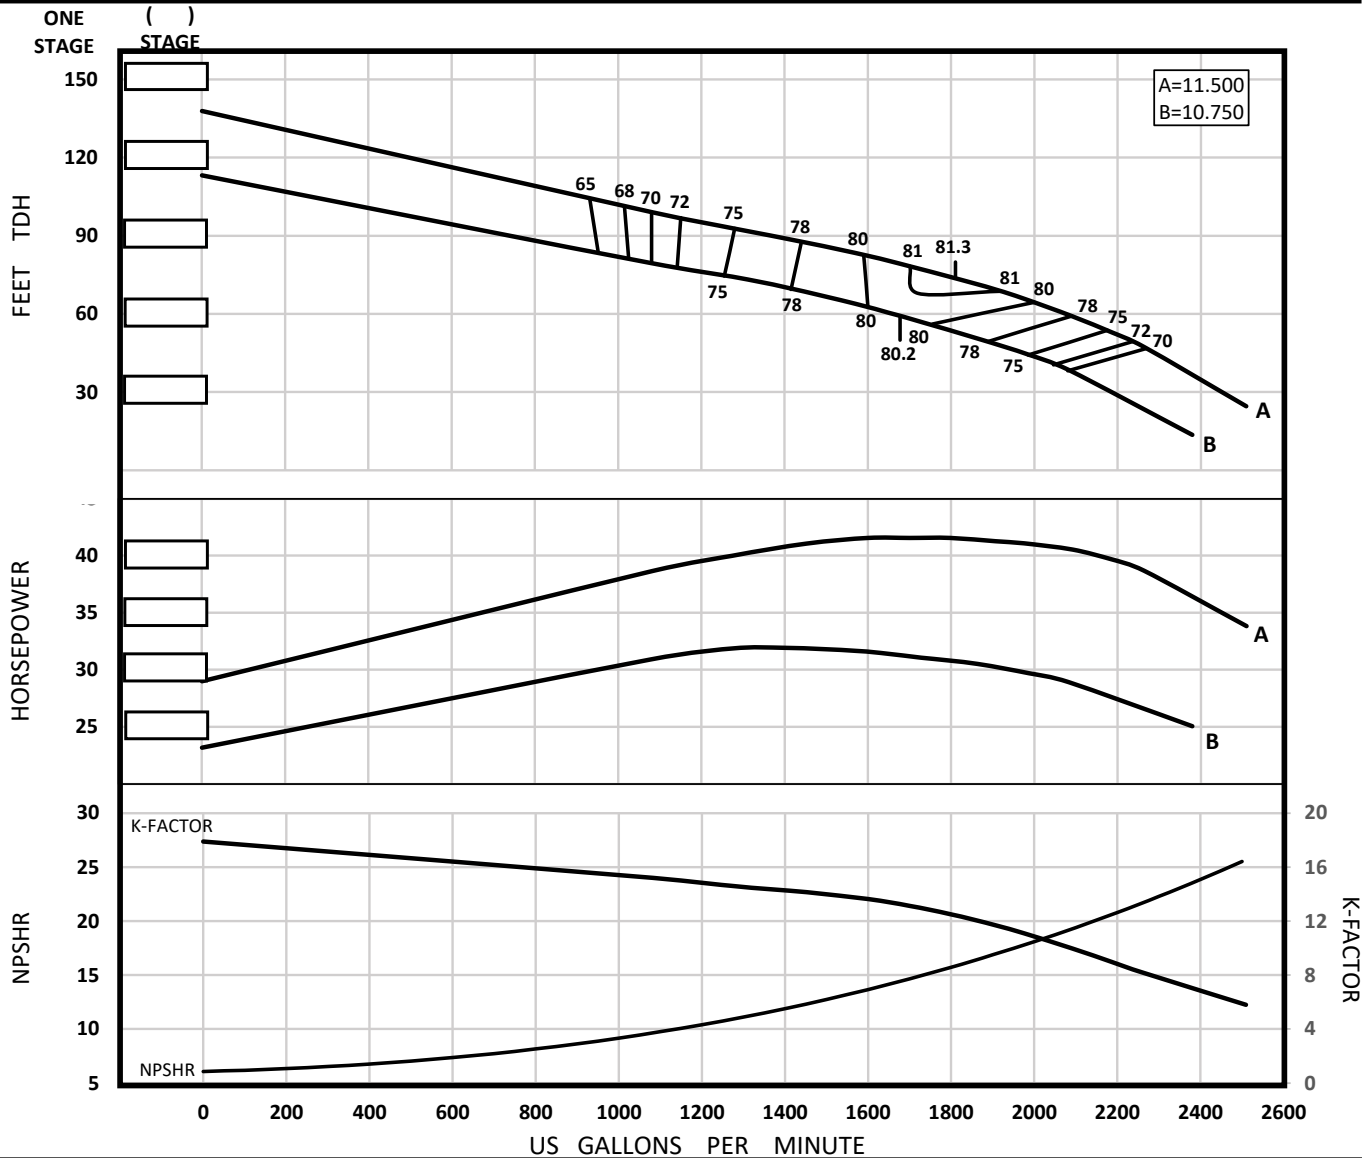

Impeller Type	Enclosed	Bowl OD (in.)	14.00	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM14LL	Thd'd Discharge Size	10" / 12"	Ns	2989	Stages	Change
One Stage Weight (lb)	550.00	Thd'd Suction Size	10"	Nss	9533	1	-3
Add'l Stage Wt. (lb)	235.00	Bell Suction Size	13.88"/18.13"	Shaft Size (in.)	2.1875	2	-2
Impeller Wt. (lb)	31.00	Sub. Mtr. Size	10"/ 12"/ 14"	Lateral (in)	1.25	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	459	Setting (in)	.25	4	0
One Stage Length (in)	~32.50	D.I. Bowl Rating (psi)	Δ869	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	13.500	S.S. Bowl Rating (psi)	Δ936	Imp. WR ² (lb-ft ²)	2.211		


Δ Consult factory for availability

Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

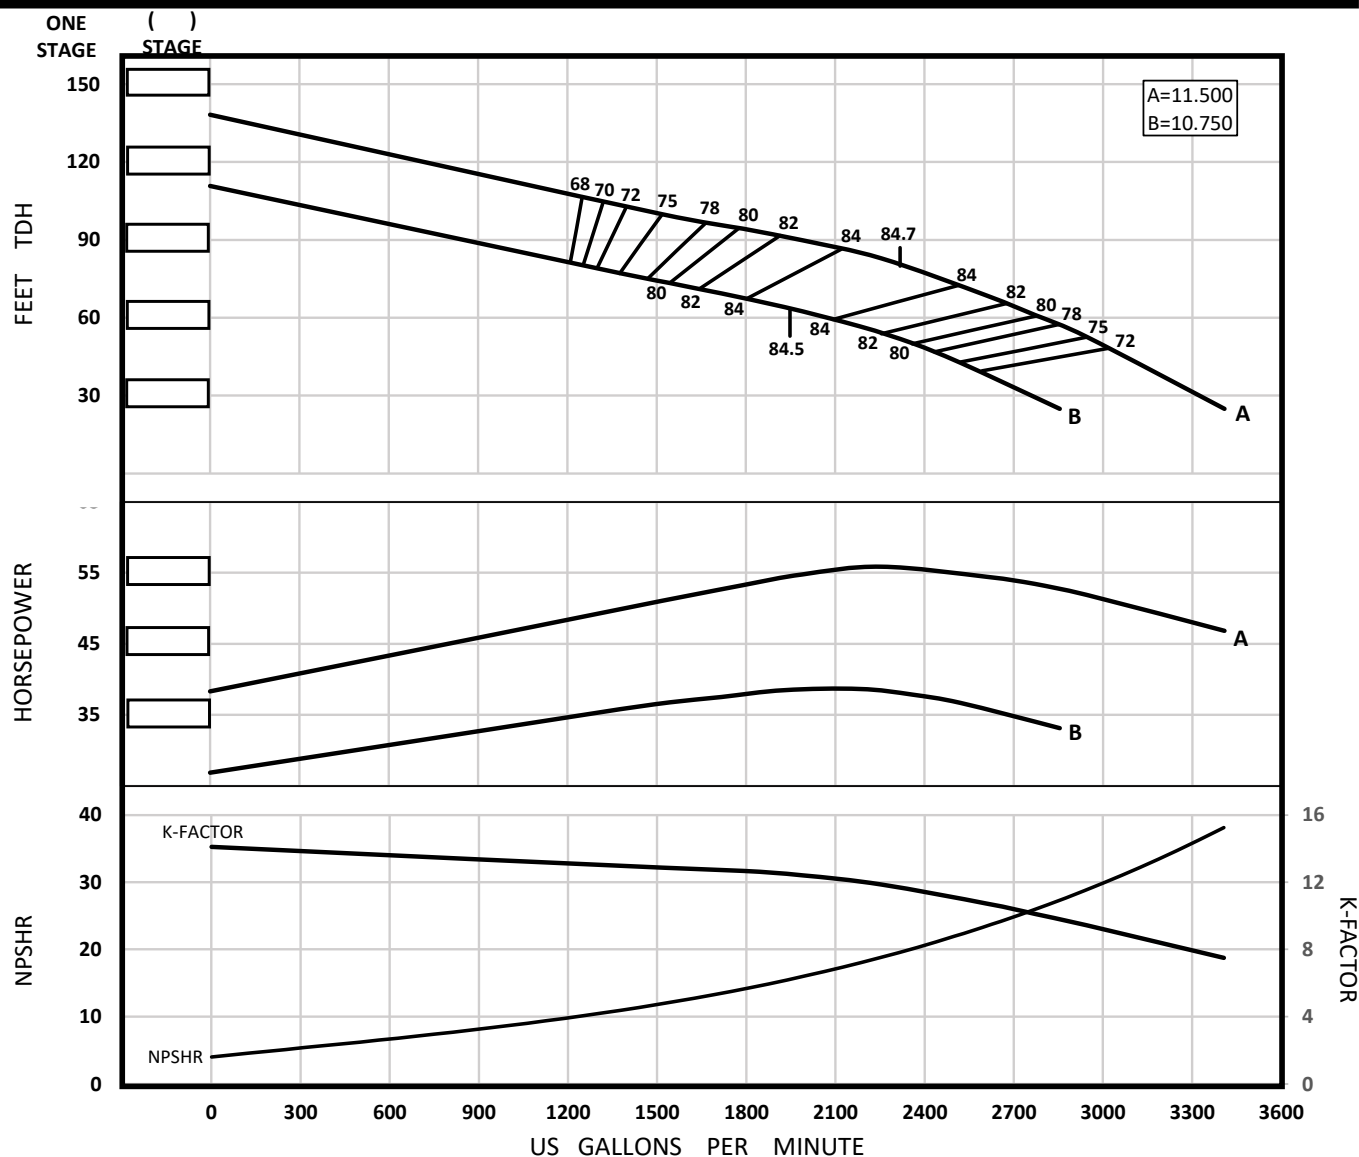

SM14M
1770 RPM

Impeller Type	Enclosed	Bowl OD (in.)	14.00	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM14M	Thd'd Discharge Size	10" / 12"	Ns	3175	Stages	Change
One Stage Weight (lb)	550.00	Thd'd Suction Size	10"	Nss	9292	1	-3
Add'l Stage Wt. (lb)	235.00	Bell Suction Size	13.88"/18.13"	Shaft Size (in.)	2.1875	2	-1
Impeller Wt. (lb)	31.70	Sub. Mtr. Size	10"/ 12"/ 14"	Lateral (in)	1.25	3	0
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	459	Setting (in)	.25	4	0
One Stage Length (in)	~32.50	D.I. Bowl Rating (psi)	Δ869	K-Factor (lb/ft tdk)	CURVE	5	0
Add'l Stage Length (in)	13.500	S.S. Bowl Rating (psi)	Δ936	Imp. WR ² (lb-ft ²)	2.182		

Δ Consult factory for availability


Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SM14H 1770 RPM

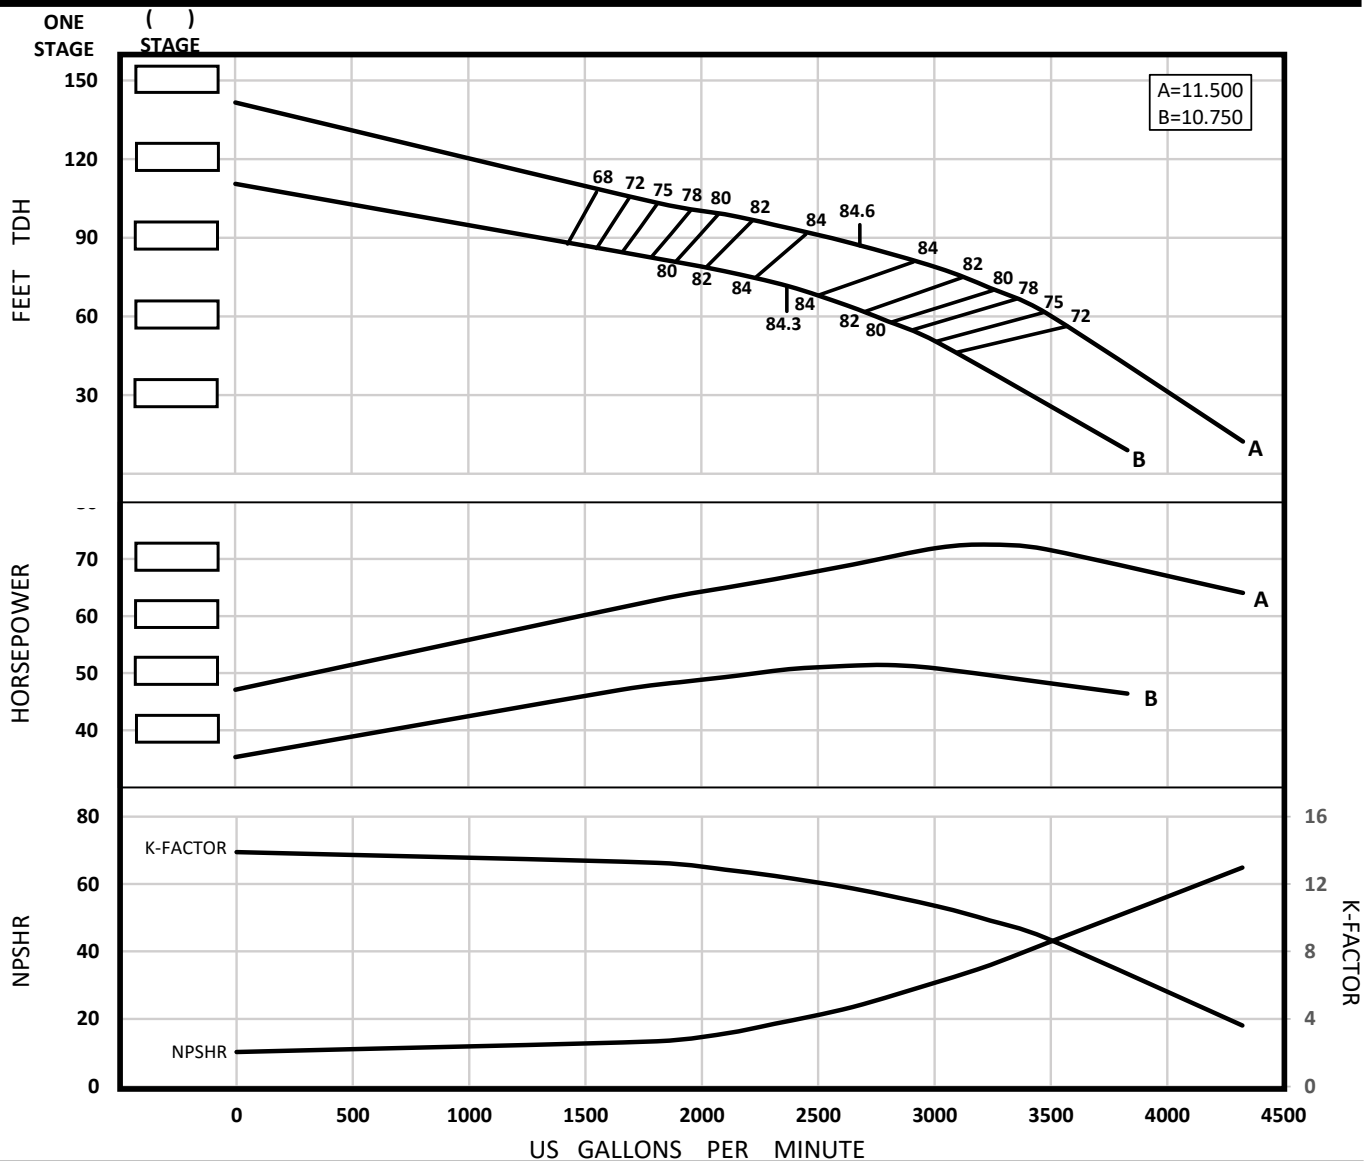

Impeller Type	Enclosed	Bowl OD (in.)	14.00	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM14H	Thd'd Discharge Size	10" / 12"	Ns	3207	Stages	Change
One Stage Weight (lb)	550.00	Thd'd Suction Size	10"	Nss	8555	1	-2
Add'l Stage Wt. (lb)	235.00	Bell Suction Size	13.88"/18.13"	Shaft Size (in.)	2.1875	2	-1
Impeller Wt. (lb)	29.00	Sub. Mtr. Size	10"/ 12"/ 14"	Lateral (in)	1.25	3	0
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	459	Setting (in)	.25	4	0
One Stage Length (in)	~32.50	D.I. Bowl Rating (psi)	Δ869	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	13.500	S.S. Bowl Rating (psi)	Δ936	Imp. WR ² (lb-ft ²)	2.023		


Δ Consult factory for availability

Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

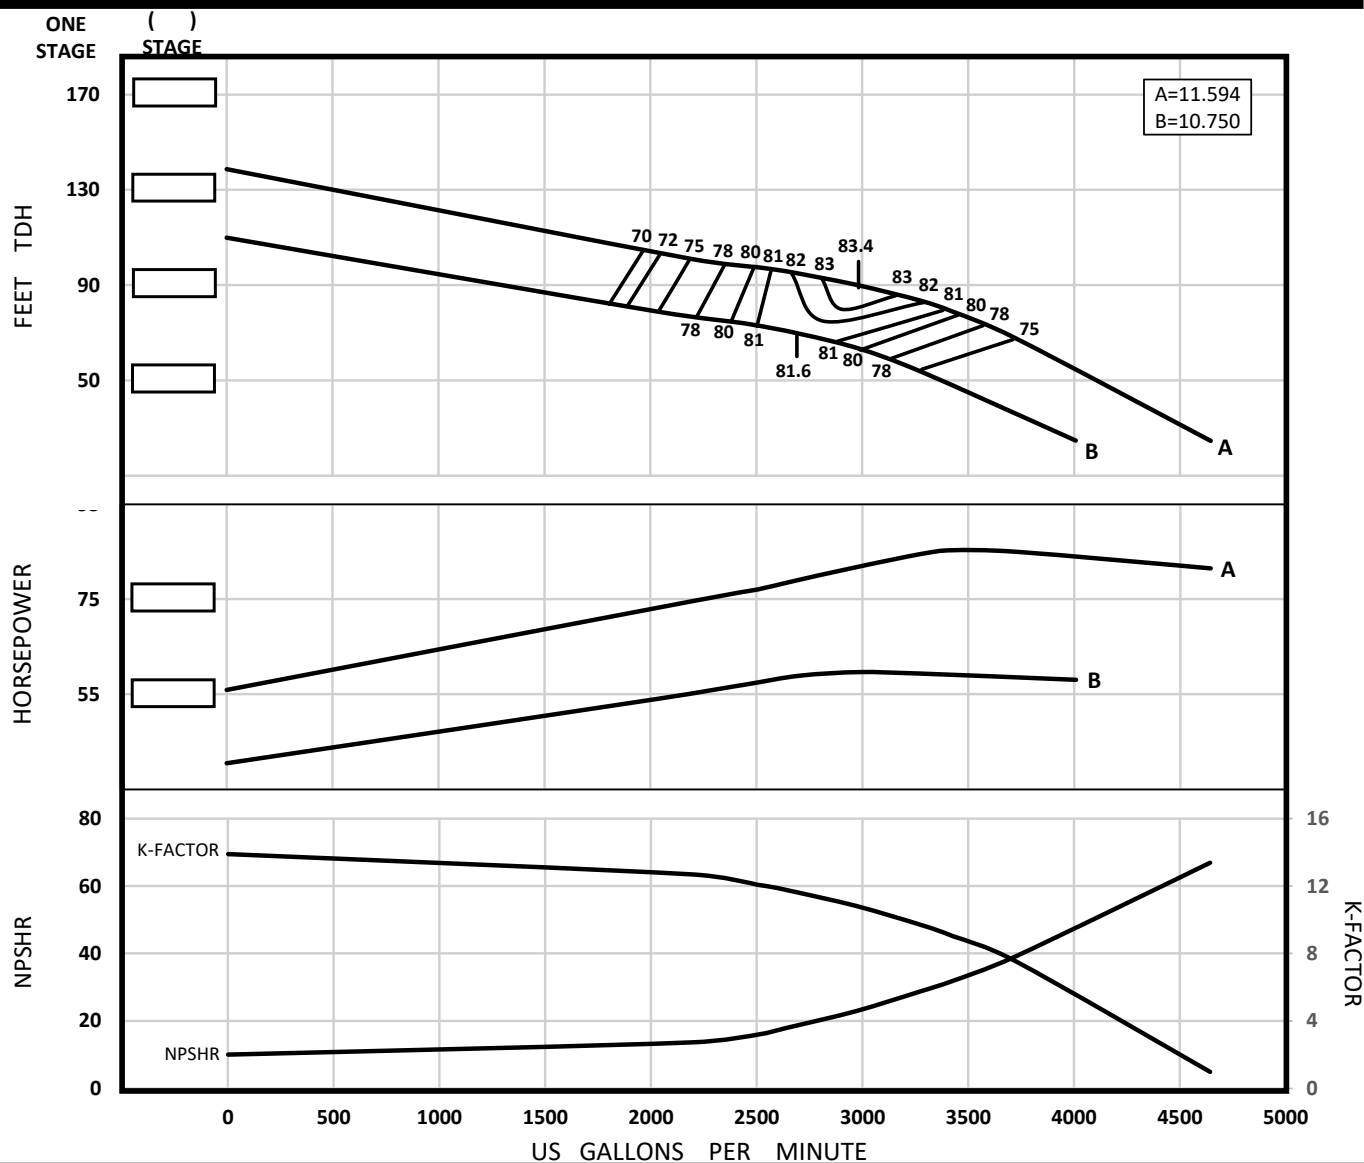

SM14HH
1770 RPM

Impeller Type	Enclosed	Bowl OD (in.)	14.00	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM14HH	Thd'd Discharge Size	10" / 12"	Ns	3324	Stages	Change
One Stage Weight (lb)	540.00	Thd'd Suction Size	10"	Nss	9203	1	-2.5
Add'l Stage Wt. (lb)	225.00	Bell Suction Size	13.88"/18.13"	Shaft Size (in.)	2.1875	2	-1.5
Impeller Wt. (lb)	28.40	Sub. Mtr. Size	10"/ 12"/ 14"	Lateral (in)	1.25	3	-0.5
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	459	Setting (in)	.25	4	0
One Stage Length (in)	~32.50	D.I. Bowl Rating (psi)	Δ869	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	13.500	S.S. Bowl Rating (psi)	Δ936	Imp. WR ² (lb-ft ²)	2.300		

Δ Consult factory for availability


Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SM16MO 1770 RPM

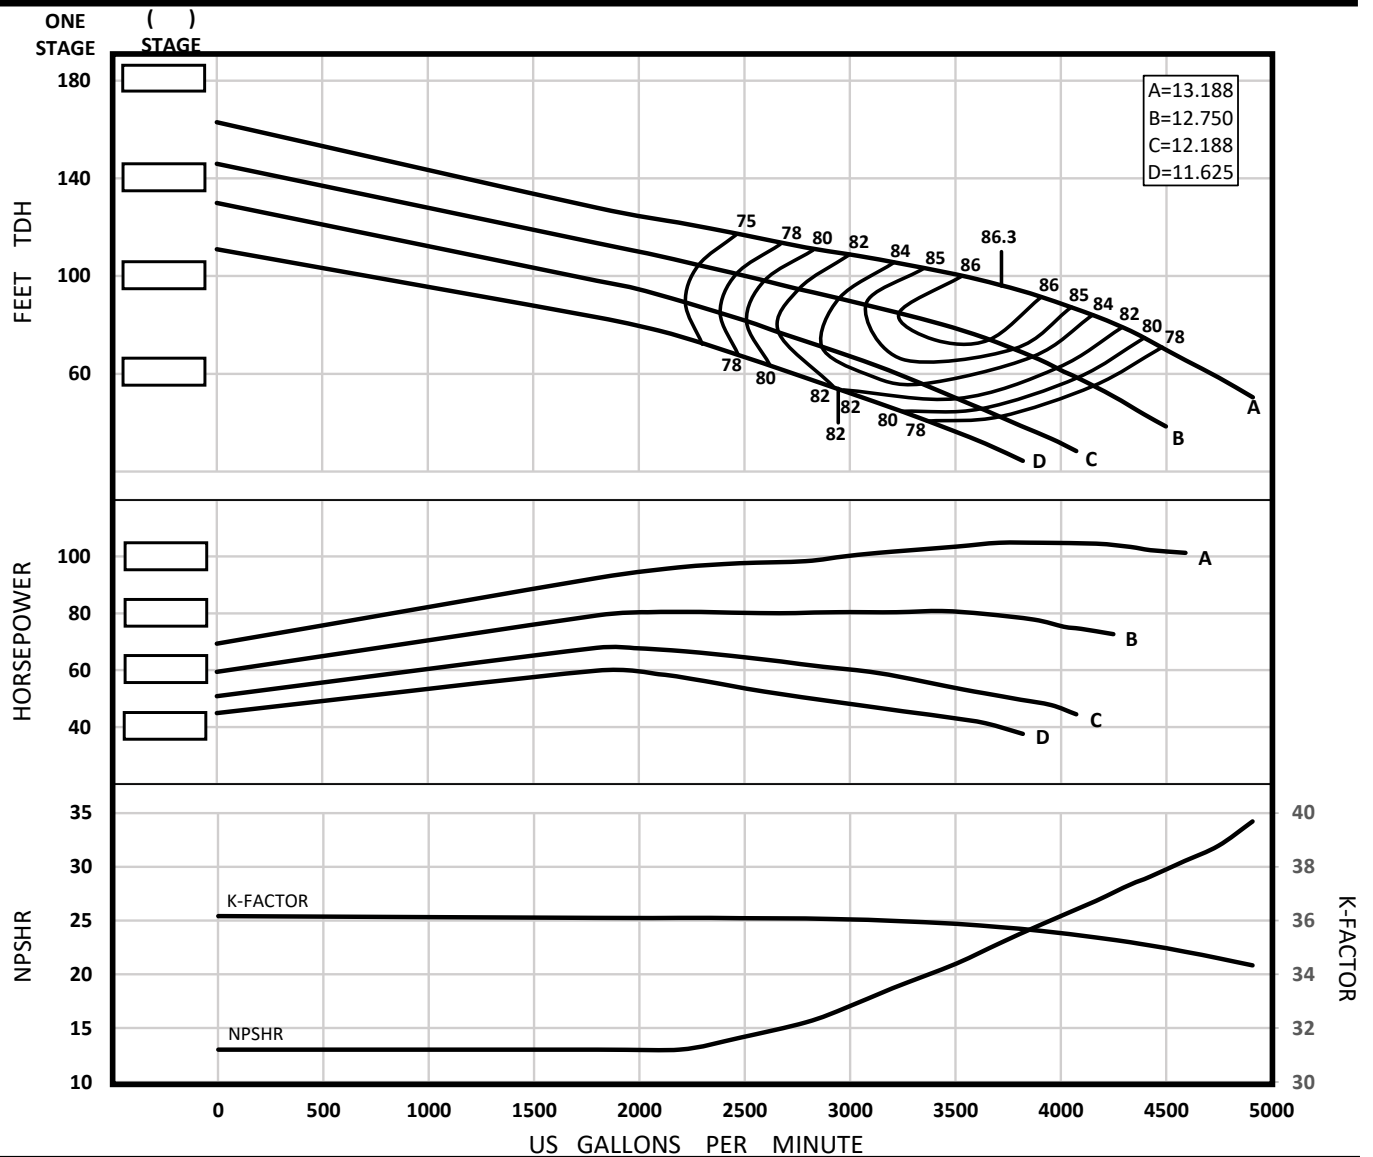

Impeller Type	Semi-Open	Bowl OD (in.)	15.25	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM16MO	Thd'd Discharge Size	12" / 14"	Ns	3517	Stages	Change
One Stage Weight (lb)	600.00	Thd'd Suction Size	12"	Nss	10313	1	-3
Add'l Stage Wt. (lb)	250.00	Bell Suction Size	15.25"/19.25"	Shaft Size (in.)	2.1875	2	-2
Impeller Wt. (lb)	21.80	Sub. Mtr. Size	10"/12"/14"	Lateral (in)	1.25	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	506	Setting (in)	.02	4	0
One Stage Length (in)	~41.75	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	15.000	S.S. Bowl Rating (psi)	Δ1033	Imp. WR ² (lb-ft ²)	2.260		

Δ Consult factory for availability


Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SM16HO 1770 RPM

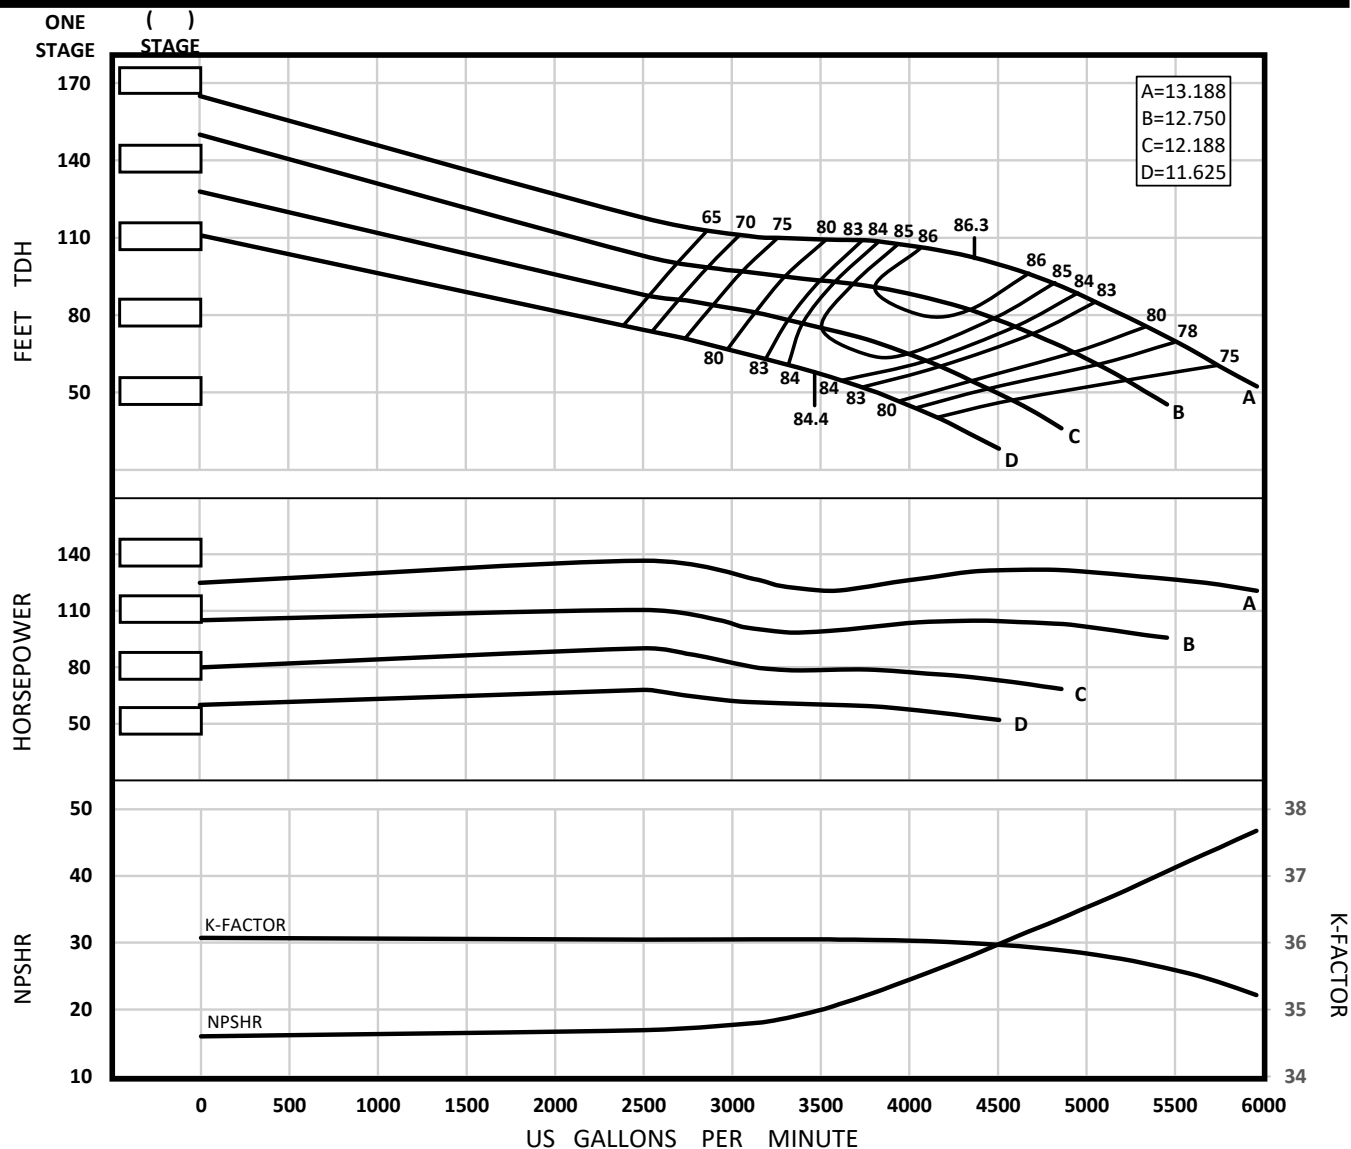

Impeller Type	Semi-Open	Bowl OD (in.)	15.25	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM16HO	Thd'd Discharge Size	12" / 14"	Ns	3641	Stages	Change
One Stage Weight (lb)	600.00	Thd'd Suction Size	12"	Nss	9584	1	-3
Add'l Stage Wt. (lb)	250.00	Bell Suction Size	15.25"/19.25"	Shaft Size (in.)	2.1875	2	-2
Impeller Wt. (lb)	21.40	Sub. Mtr. Size	10"/12"/14"	Lateral (in)	1.25	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	506	Setting (in)	.02	4	0
One Stage Length (in)	~41.75	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	15.000	S.S. Bowl Rating (psi)	Δ1033	Imp. WR ² (lb-ft ²)	2.240		

Δ Consult factory for availability


Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SM16M 1770 RPM

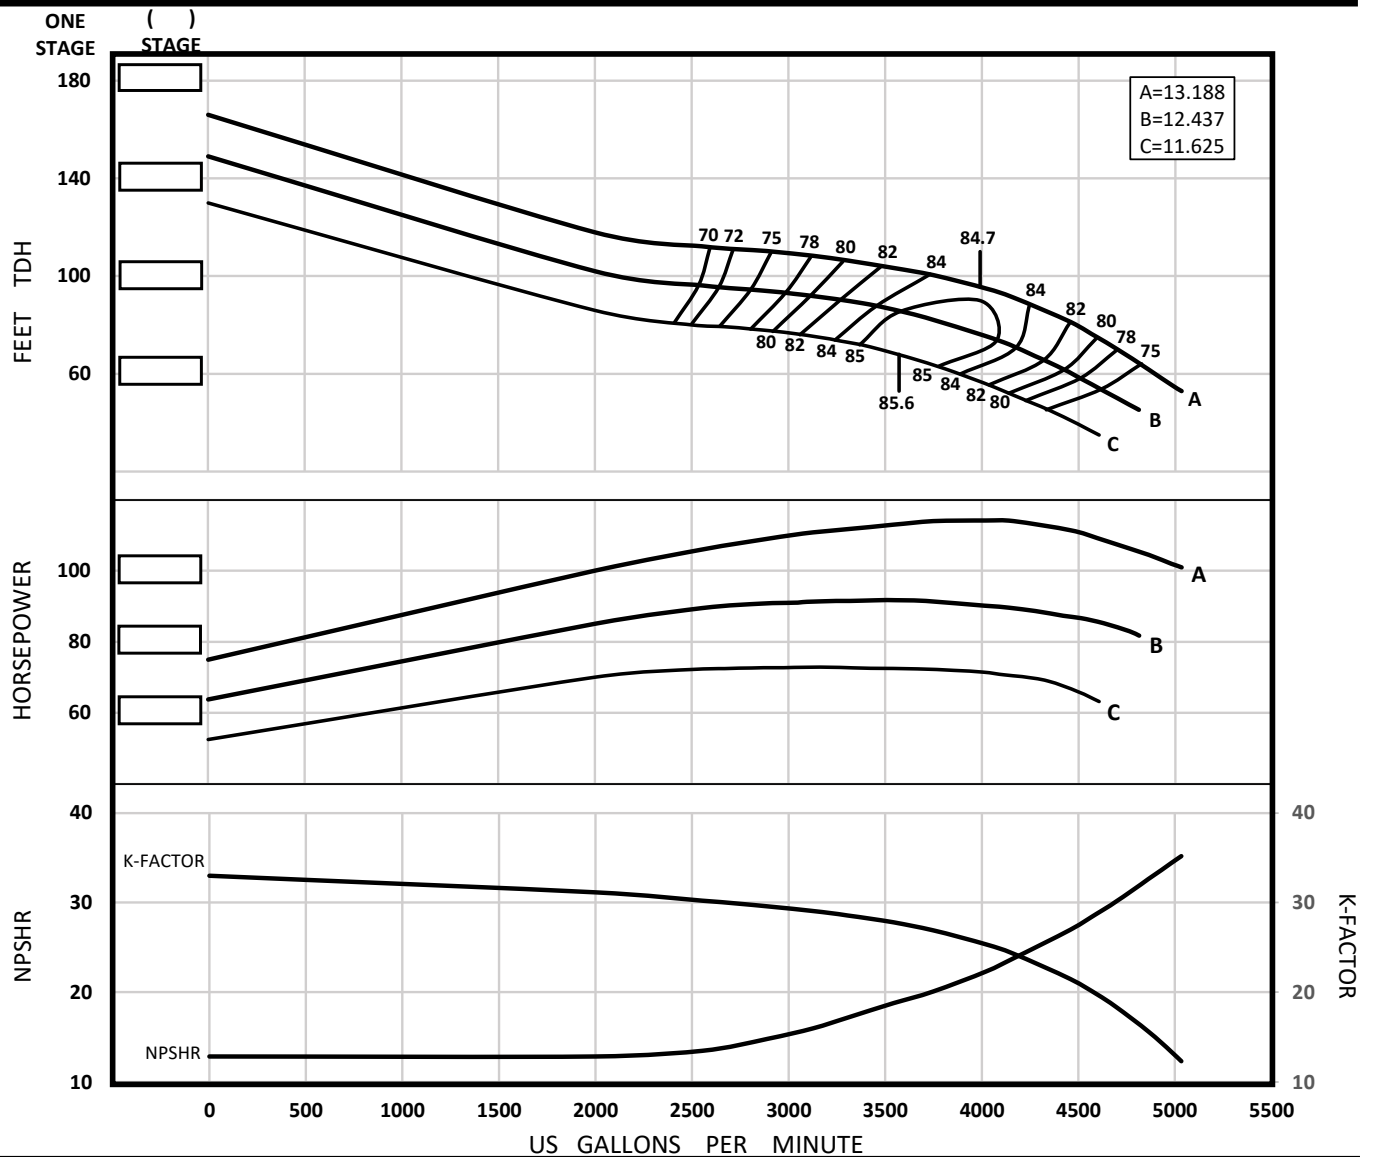

Impeller Type	Enclosed	Bowl OD (in.)	15.25	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM16M	Thd'd Discharge Size	12" / 14"	Ns	3661	Stages	Change
One Stage Weight (lb)	600.00	Thd'd Suction Size	12"	Nss	10894	1	-3
Add'l Stage Wt. (lb)	250.00	Bell Suction Size	15.25"/19.25"	Shaft Size (in.)	2.1875	2	-2
Impeller Wt. (lb)	32.40	Sub. Mtr. Size	10"/12"/14"	Lateral (in)	1.25	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	506	Setting (in)	.125	4	0
One Stage Length (in)	~41.75	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	15.000	S.S. Bowl Rating (psi)	Δ1033	Imp. WR ² (lb-ft ²)	4.966		


Δ Consult factory for availability

Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

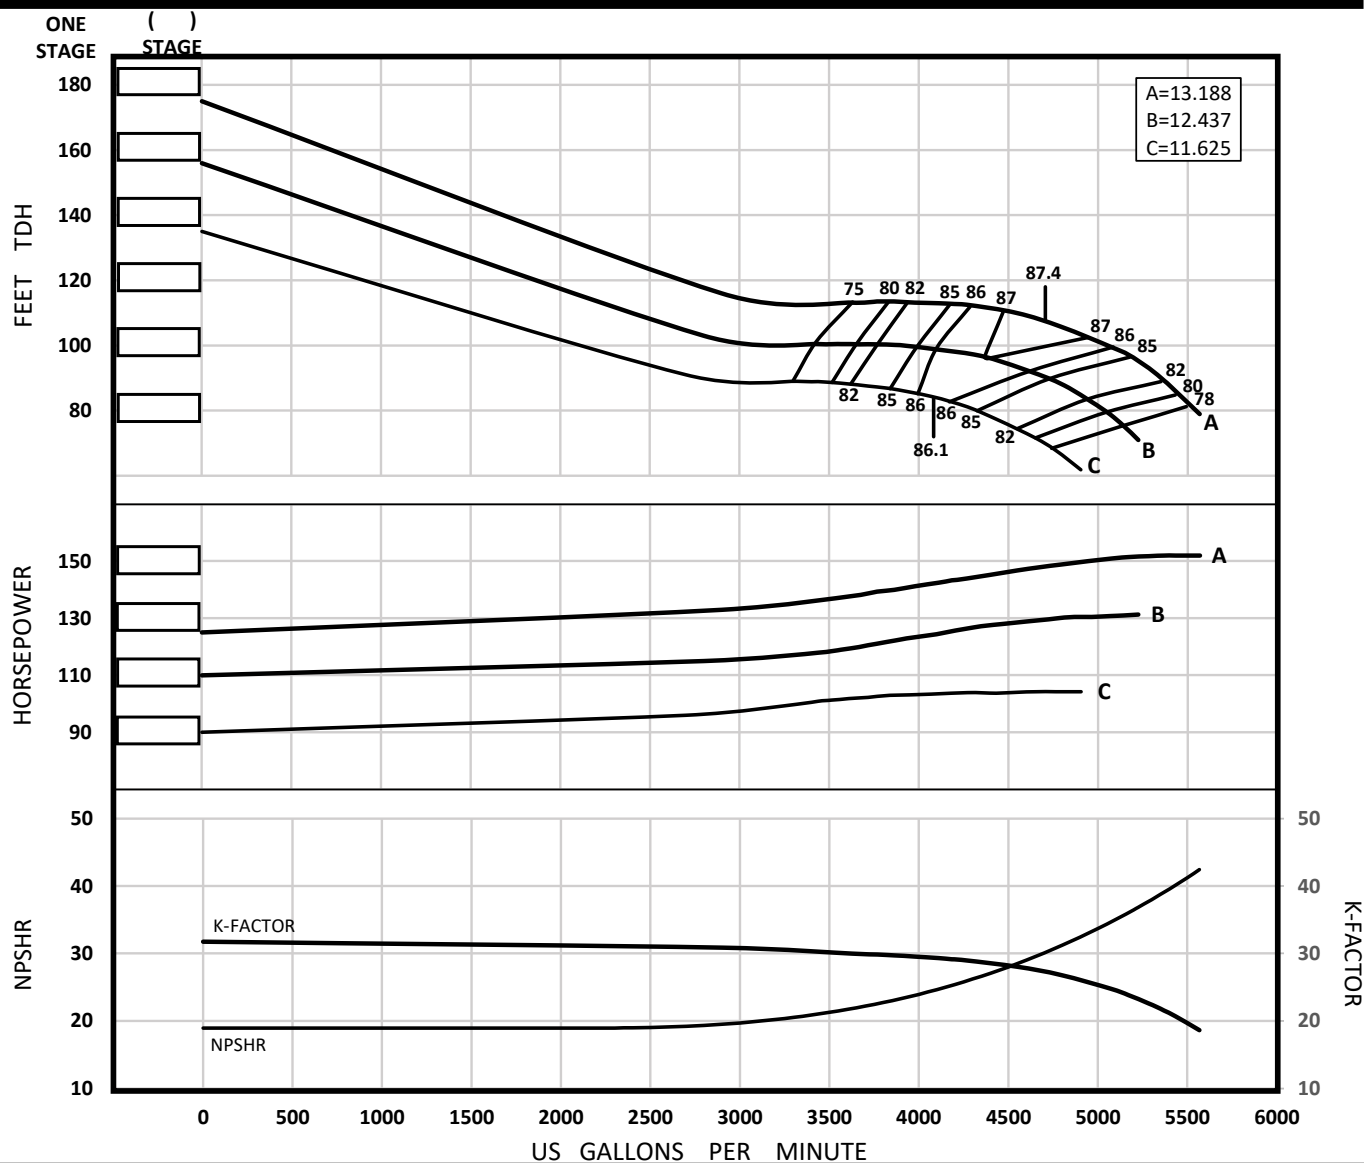

SM16H
1770 RPM

Impeller Type	Enclosed	Bowl OD (in.)	15.25	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM16H	Thd'd Discharge Size	12" / 14"	Ns	3623	Stages	Change
One Stage Weight (lb)	600.00	Thd'd Suction Size	12"	Nss	9813	1	-3
Add'l Stage Wt. (lb)	250.00	Bell Suction Size	15.25"/19.25"	Shaft Size (in.)	2.1875	2	-2
Impeller Wt. (lb)	30.40	Sub. Mtr. Size	10"/12"/14"	Lateral (in)	1.00	3	-1
Std. Impeller Mtrl.	316 SS	C.I. Bowl Rating (psi)	506	Setting (in)	.125	4	0
One Stage Length (in)	~41.75	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	15.000	S.S. Bowl Rating (psi)	Δ1033	Imp. WR ² (lb-ft ²)	4.677		

Δ Consult factory for availability


Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.




SM20M
1770 RPM

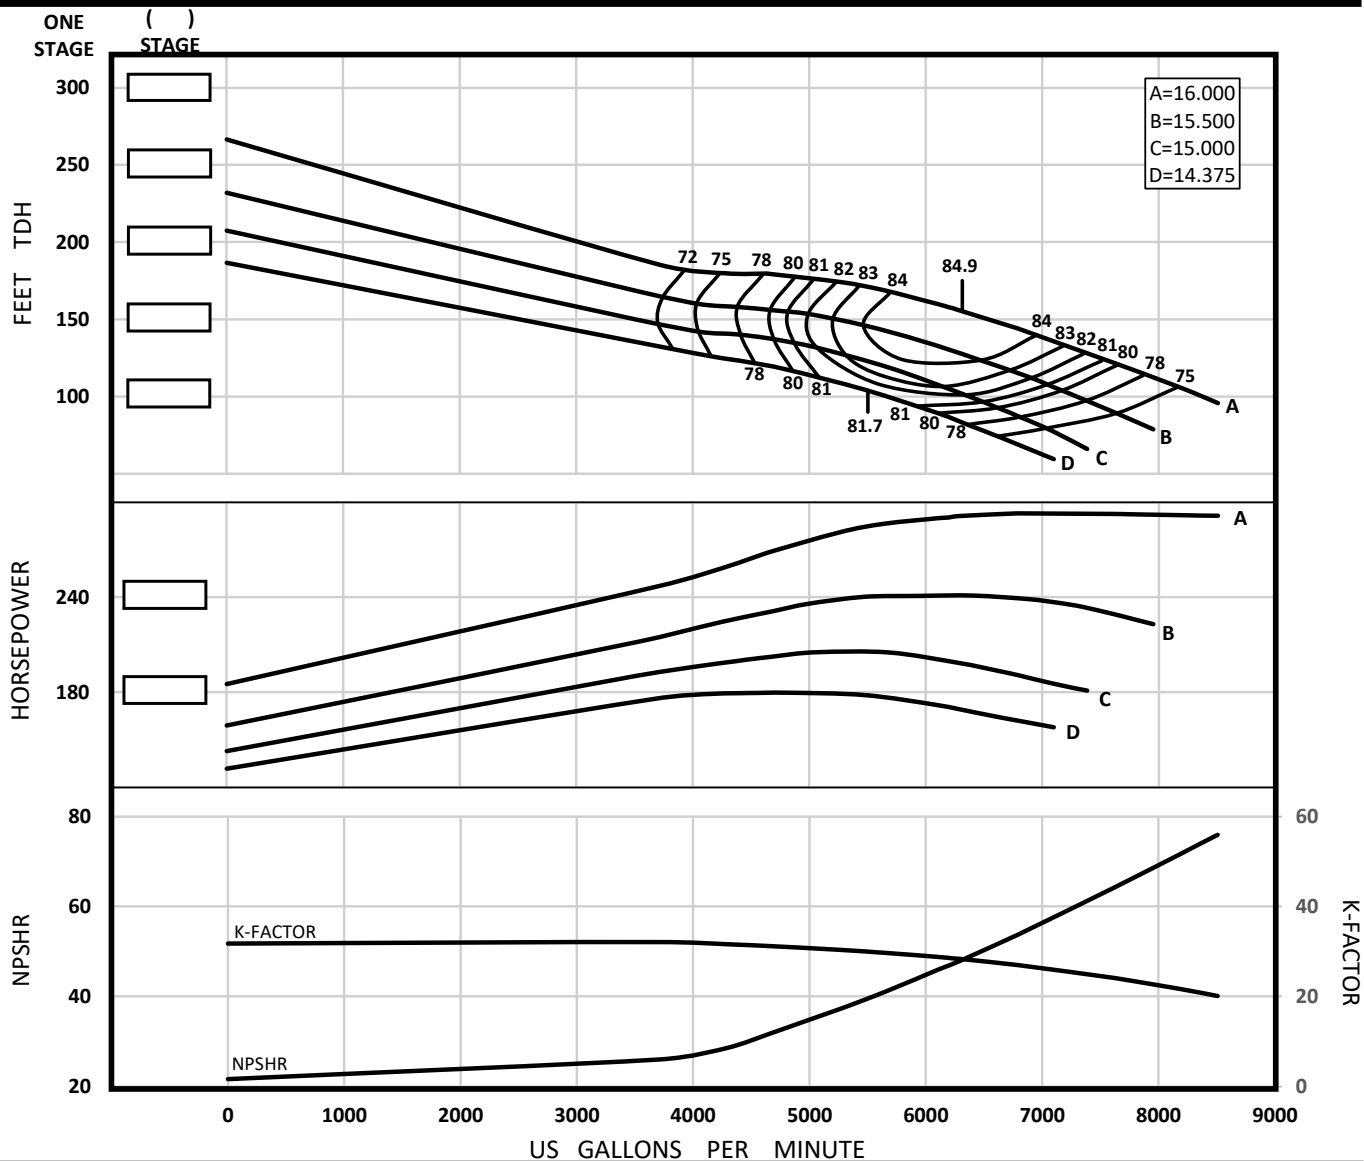

Impeller Type	Enclosed	Bowl OD (in.)	19.25	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM20M	Thd'd Discharge Size	Δ	Ns	3193	Stages	Change
One Stage Weight (lb)	1000.00	Thd'd Suction Size	N/A	Nss	7848	1	-3
Add'l Stage Wt. (lb)	450.00	Bell Suction Size	19.25"	Shaft Size (in.)	2.4375	2	-2
Impeller Wt. (lb)	101.00	Sub. Mtr. Size	10"/12"/14"	Lateral (in)	1.50	3	-1
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	509	Setting (in)	.125	4	0
One Stage Length (in)	~44.00	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	18.000	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	8.220		

Δ Consult factory for availability
Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.
Weights and lengths listed are approximate and subject to change. Consult factory.

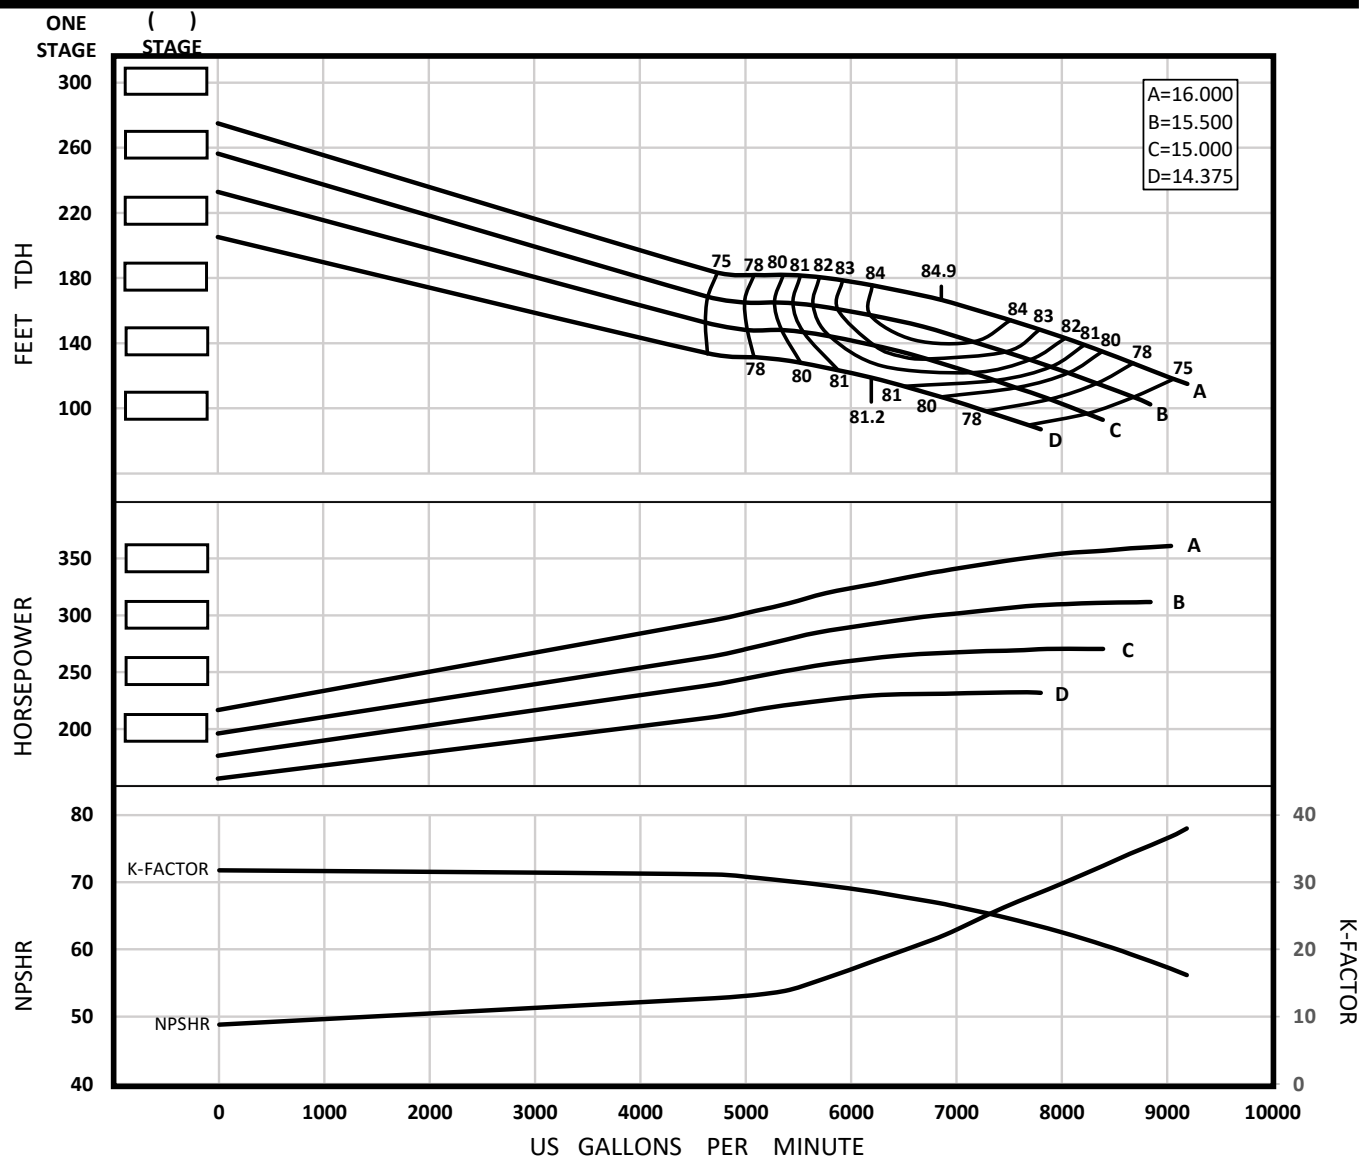SM20H
1770 RPM

Impeller Type	Enclosed	Bowl OD (in.)	19.25	PEI cl	N/A	Qty.	Eff.
Impeller Model	SM20H	Thd'd Discharge Size	Δ	Ns	3160	Stages	Change
One Stage Weight (lb)	1000.00	Thd'd Suction Size	N/A	Nss	6634	1	-3
Add'l Stage Wt. (lb)	450.00	Bell Suction Size	19.25"	Shaft Size (in.)	2.1875	2	-2
Impeller Wt. (lb)	69.00	Sub. Mtr. Size	10"/12"/14"	Lateral (in)	1.31	3	-1
Std. Impeller Mtrl.	C95500	C.I. Bowl Rating (psi)	509	Setting (in)	.125	4	0
One Stage Length (in)	~44.00	D.I. Bowl Rating (psi)	Δ	K-Factor (lb/ft tdh)	CURVE	5	0
Add'l Stage Length (in)	18.000	S.S. Bowl Rating (psi)	Δ	Imp. WR ² (lb-ft ²)	8.210		


Δ Consult factory for availability

Rev. 2022.12.28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.




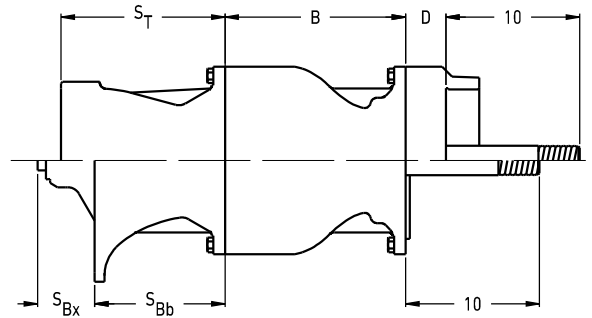

		Suction						Discharge					
Model	Bowl Dia.	Integral Bell			Threaded		Bowl	Threaded					
		Bell Dia.	S _{Bb}	S _{Bx}	Size	S _T		B	Size	D	Size	D	Size
SP5	5.25	8.00/6.00	4.75	3.13	4" NPT	6.75	4.63	3	4.00	4	5.38	---	---
SM5	5.25	8.00/6.00	4.75	3.13	4" NPT	6.75	4.88	3	4.00	4	5.38	---	---
SP5(O)	5.25	8.00/6.00	4.75	3.13	4" NPT	6.75	4.31	3	4.00	4	5.38	---	---
SP6	6.00	8.00/6.00	4.63	3.13	4" NPT	6.75	4.81	3	4.50	4	5.88	---	---
SP6(O)	6.00	8.00/6.00	4.63	3.13	4" NPT	6.75	4.81	3	4.50	4	5.88	---	---
SM6	6.00	8.00/6.00	4.69	3.13	4" NPT	6.75	5.25	3	4.25	4	5.63	---	---
SK6	5.50	8.00/6.00	4.63	3.13	4" NPT	6.75	5.50	3	4.50	4	5.88	---	---
SP7	7.19	9.38/8.00	5.75	3.88	5" NPT	6.50	6.38	4	5.38	5	6.75	6	5.00
SK7	6.56	9.38/8.00	5.63	3.88	5" NPT	6.50	6.38	5	0.94	6	2.50	4	3.13
SM7	7.00	9.38/8.00	5.75	3.88	5" NPT	6.50	7.00	4	5.38	5	6.75	6	5.00
SP8	7.88	9.38/8.00	5.75	3.88	5" NPT	6.19	6.38	4	5.63	5	7.00	6	3.00
SM8	7.69	9.38/8.00	5.75	3.88	5" NPT	6.19	6.00	4	5.63	5	7.00	6	3.00
SK8	7.50	---	---	---	6" NPT	8.63	9.00	6	3.00	---	---	---	---
SP9	9.50	10.00	5.88	3.75	6" NPT	8.63	7.75	6	3.00	8	3.00	4	3.50
SM9	9.50	10.00	5.88	3.75	6" NPT	8.63	7.75	6	3.00	8	3.00	4	3.50
SL9	9.00	10.00	5.88	3.75	6" NPT	9.00	8.50	6	3.00	8	3.00	4	3.50
SF9	9.50	10.00	5.63	3.75	6" NPT	8.63	7.50	6	3.00	8	3.00	4	3.50
SK9	9.44	---	---	---	8" NPT	9.63	10.63	6	3.00	8	3.00	4	3.50
SP10	10.19	10.00	5.88	3.75	6" NPT	8.63	7.25	6	3.00	8	3.00	4	3.50
SM10(O)	10.19	10.00	5.88	3.75	6" NPT	9.38	8.88	6	3.00	8	3.00	4	3.50
SM10	10.19	10.00	5.88	3.75	6" NPT	8.63	8.88	6	3.00	8	3.00	4	3.50
SM11	10.63	11.38	6.50	4.50	8" NPT	10.00	8.63	6	3.00	8	3.00	4	3.50
SL11	10.88	11.38	6.50	4.50	8" NPT	9.31	10.00	6	3.00	8	3.00	4	3.50
SR11(O)	11.50	11.38	6.50	4.50	8" NPT	9.13	9.50	8	3.00	10	3.00	6	3.00
SP11	11.25	11.38	6.50	4.50	8" NPT	10.00	10.00	8	3.00	10	3.00	6	3.00
SW12	11.63	11.38	6.50	4.50	8" NPT	10.00	9.00	8	3.00	10	3.00	6	3.00
SL12	11.75	11.38	6.50	4.50	8" NPT	10.00	10.00	8	3.00	10	3.00	6	3.00
SJ12	12.00	11.38	6.50	4.50	8" NPT	10.00	10.75	8	3.00	10	3.00	6	3.00
SM14	14.00	18.13/13.88	9.75	4.25	10" NPT	12.25	13.50	10	1.88	12	1.88	---	---
SM16(O)	15.25	19.25/15.25	10.44	2.19	12" NPT	13.81	15.00	12	3.31	---	---	---	---
SM16	15.25	19.25/15.25	10.44	2.19	12" NPT	13.81	15.00	12	3.31	---	---	---	---
SM20	19.25	19.25	12.00	5.88	---	---	18.00	---	---	---	---	---	---
SM24	24.00	26.00	15.38	7.00	---	---	21.00	---	---	---	---	---	---
SM28	28.00	26.00	17.00	9.88	---	---	24.00	---	---	---	---	---	---

v23.1

Dimensions are in inches and are subject to change without notice.

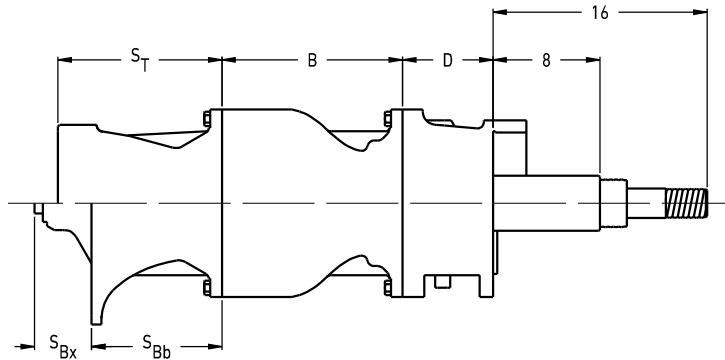


		Suction						Discharge			
Model	Bowl Dia.	Integral Bell			Threaded		Bowl	Threaded / Flanged			
		Bell Dia.	S _{Bb}	S _{Bx}	Size	S _T		Size	D	Size	D
SP6	6.00	8.00/6.00	4.625	3.125	4" NPT	6.75	4.813	4	5.5	---	---
SP6(O)	6.00	8.00/6.00	4.625	3.125	4" NPT	6.75	4.813	4	5.5	---	---
SM6	6.00	8.00/6.00	4.69	3.13	4" NPT	6.75	5.25	4	5.25	---	---
SK6	5.50	8.00/6.00	4.63	3.13	4" NPT	6.75	5.50	4	5.50	---	---
SP7	7.19	9.38/8.00	5.75	3.88	5" NPT	6.50	6.38	5	5.25	6	6.75
SK7	6.56	9.38/8.00	5.63	3.88	5" NPT	6.50	6.38	---	---	---	---
SM7	7.00	9.38/8.00	5.75	3.88	5" NPT	6.50	7.00	5	5.25	6	6.75
SP8	7.88	9.38/8.00	5.75	3.88	5" NPT	6.19	6.38	5	6.13	6	7.63
SM8	7.69	9.38/8.00	5.75	3.88	5" NPT	6.19	6.00	5	6.13	6	7.63
SK8	7.50	---	---	---	6" NPT	8.63	9.00	6	7.63	---	---
SP9	9.50	10.00	5.88	3.75	6" NPT	8.63	7.75	6	6.75	8	6.75
SM9	9.50	10.00	5.88	3.75	6" NPT	8.63	7.75	6	6.75	8	6.75
SL9	9.00	10.00	5.88	3.75	6" NPT	9.00	8.50	6	6.38	8	6.75
SF9	9.50	10.00	5.63	3.75	6" NPT	8.63	7.50	6	6.75	8	6.75
SK9	9.44	---	---	---	8" NPT	9.63	10.63	8	6.75	---	---
SP10	10.19	10.00	5.88	3.75	6" NPT	8.63	7.25	6	6.50	8	6.50
SM10(O)	10.19	10.00	5.88	3.75	6" NPT	9.38	8.88	6	6.50	8	6.50
SM10	10.19	10.00	5.88	3.75	6" NPT	8.63	8.88	6	6.50	8	6.50
SM11	10.63	11.38	6.50	4.50	8" NPT	10.00	8.63	6	6.50	8	6.50
SL11	10.88	11.38	6.50	4.50	8" NPT	9.31	10.00	6	6.50	8	6.50
SR11(O)	11.50	11.38	6.50	4.50	8" NPT	9.13	9.50	8	7.50	10	7.50
SP11	11.25	11.38	6.50	4.50	8" NPT	10.00	10.00	8	7.50	10	7.50
SW12	11.63	11.38	6.50	4.50	8" NPT	10.00	9.00	8	7.50	10	7.50
SL12	11.75	11.38	6.50	4.50	8" NPT	10.00	10.00	8	7.50	10	7.50
SJ12	12.00	11.38	6.50	4.50	8" NPT	10.00	10.75	8	7.50	10	7.50
SM14	14.00	18.13/13.88	9.75	4.25	10" NPT	12.25	13.50	10	6.75	12	6.75
SM16(O)	15.25	19.25/15.25	10.44	2.19	12" NPT	13.81	15.00	12	10.44	14	12.94
SM16	15.25	19.25/15.25	10.44	2.19	12" NPT	13.81	15.00	12	10.44	14	12.94
SM20	19.25	19.25	12.00	5.88	---	---	18.00	16*	14.00	---	---
SM24	24.00	26.00	15.38	7.00	---	---	21.00	18*	13.00	---	---
SM28	28.00	26.00	17.00	9.88	---	---	24.00	20*	14.00	---	---

* Flanged Discharge Only / Threaded available with Adapter. Consult Factory

v23.1

Dimensions are in inches and are subject to change without notice.



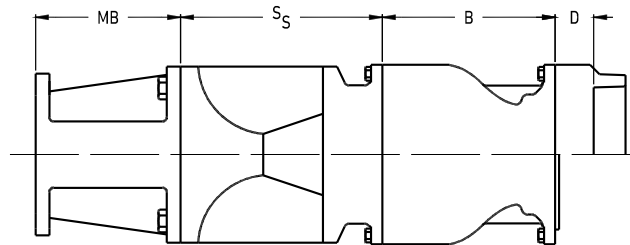

Model	Bowl Dia.	Motor Bracket								Suction		Discharge					
		Mtr.	MB	Mtr.	MB	Mtr.	MB	Mtr.	MB	Sub.	Bowl	Threaded					
												Size	D	Size	D	Size	D
SP5	5.25	4	8.06	6	5.88	---	---	---	---	5.44	4.63	3	4.00	4	5.38	---	---
SM5	5.25	4	8.06	6	5.88	---	---	---	---	5.44	4.88	3	4.00	4	5.38	---	---
SP5(O)	5.25	4	8.06	6	5.88	---	---	---	---	5.44	4.31	3	4.00	4	5.38	---	---
SP6	6.00	4	8.06	6	5.88	8	8.75	---	---	5.44	4.81	3	4.50	4	5.88	---	---
SP6(O)	6.00	4	8.06	6	5.88	8	8.75	---	---	5.44	4.81	3	4.50	4	5.88	---	---
SM6	6.00	4	8.06	6	5.88	8	8.75	---	---	5.44	5.25	3	4.25	4	5.63	---	---
SK6	5.50	4	8.06	6	5.88	8	8.75	---	---	5.44	5.50	3	4.50	4	5.88	---	---
SP7	7.19	4	7.81	6	5.63	8	8.50	---	---	7.38	6.38	4	5.38	5	6.75	6	5.00
SK7	6.56	4	7.81	6	5.63	8	8.50	---	---	7.38	6.38	5	0.94	6	2.50	4	3.13
SM7	7.00	4	7.81	6	5.63	8	8.50	---	---	7.38	7.00	4	5.38	5	6.75	6	5.00
SP8	7.88	4	7.81	6	5.63	8	8.50	---	---	6.25	6.38	4	5.63	5	7.00	6	3.00
SM8	7.69	6	5.63	8	8.50	---	---	---	---	6.25	6.00	4	5.63	5	7.00	6	3.00
SK8	7.50	6	5.63	8	8.50	---	---	---	---	7.63	9.00	6	3.00	---	---	---	---
SP9	9.50	6	6.00	8	8.00	10A	8.00	10B	9.00	9.19	7.75	6	3.00	8	3.00	4	3.50
SM9	9.50	6	6.00	8	8.00	10A	8.00	10B	9.00	9.19	7.75	6	3.00	8	3.00	4	3.50
SL9	9.00	6	6.00	8	8.00	10A	8.00	10B	9.00	9.19	8.50	6	3.00	8	3.00	4	3.50
SF9	9.50	6	6.00	8	8.00	10A	8.00	10B	9.00	8.94	7.50	6	3.00	8	3.00	4	3.50
SK9	9.44	6	6.00	8	8.00	10A	8.00	10B	9.00	9.19	10.63	6	3.00	8	3.00	4	3.50
SP10	10.19	6	6.00	8	8.00	10A	8.00	10B	9.00	9.19	7.25	6	3.00	8	3.00	4	3.50
SM10(O)	10.19	6	6.00	8	8.00	10A	8.00	10B	9.00	9.19	8.88	6	3.00	8	3.00	4	3.50
SM10	10.19	6	6.00	8	8.00	10A	8.00	10B	9.00	9.19	8.88	6	3.00	8	3.00	4	3.50
SM11	10.63	8	8.00	10A	8.00	10B	9.00	14H	9.00	11.38	8.63	6	3.00	8	3.00	4	3.50
SL11	10.88	8	8.00	10A	8.00	10B	9.00	14H	9.00	11.38	10.00	6	3.00	8	3.00	4	3.50
SR11(O)	11.50	8	8.00	10A	8.00	10B	9.00	14H	9.00	11.38	9.50	8	3.00	10	3.00	6	3.00
SP11	11.25	8	8.00	10A	8.00	10B	9.00	14H	9.00	11.38	10.00	8	3.00	10	3.00	6	3.00
SW12	11.63	8	8.00	10A	8.00	10B	9.00	14H	9.00	11.38	9.00	8	3.00	10	3.00	6	3.00
SL12	11.75	8	8.00	10A	8.00	10B	9.00	14H	9.00	11.38	10.00	8	3.00	10	3.00	6	3.00
SJ12	12.00	8	8.00	10A	8.00	10B	9.00	14H	9.00	11.38	10.75	8	3.00	10	3.00	6	3.00
SM14	14.00	10B	9.00	14H	9.00	---	---	---	---	15.75	13.50	10	1.88	12	1.88	---	---
SM16(O)	15.25	10B	9.00	14H	9.00	---	---	---	---	17.13	15.00	12	3.31	---	---	---	---
SM16	15.25	10B	9.00	14H	9.00	---	---	---	---	17.13	15.00	12	3.31	---	---	---	---
SM20	19.25	10B	9.00	14H	9.00	---	---	---	---	17.13	18.00	---	---	---	---	---	---

v23.1

Dimensions are in inches and are subject to change without notice.

**SIMFLO, LLC. Terms
and Conditions**

SIMFLO, LLC. is herein referred to as the **"Seller"** and the customer purchasing goods (**"Goods"**) from the Seller is referred to as the **"Buyer."** The Terms and Conditions as set forth herein, and the Seller's quotation, estimate or bid to Buyer, shall collectively and exclusively govern all of the rights, duties and obligations of Seller and Buyer related to Buyer's purchase order for the Goods Seller is agreeing to sell to Buyer. Any terms and conditions set forth in Buyer's purchase order which are different or inconsistent with Seller's Terms and Conditions and/or Seller's quotation, estimate or bid, shall be null and void. Buyer's receipt of the Goods, and/or payment, or partial payment, to Seller for the Goods being sold to Buyer, shall evidence Buyer's acceptance of the terms and conditions of the sale as set forth herein. Seller reserves the right, in its sole discretion, to refuse any purchase order.

1. PRICES: Prices for Goods shall apply to the specific quantities stated in Seller's quotation, estimate or bid. Prices shall include standard packing according to Seller's specification for packing and delivery. All costs and taxes for special packing requests by Buyer, including packing for exports, shall be paid by Buyer as an additional charge. Prices for Goods are subject to change without notice based on any subsequent changes in the cost to Seller for sub-supplier materials, supplies or other related increases, and the adjusted price will be based on the cost to Seller in effect at the time of the requested shipment date, and each shipment will be invoiced at such increased price. All prices for Goods are exclusive of, and do not include, any applicable sales, use, excise, GST, VAT or similar taxes, duties or levies, or transportation or insurance costs, and all such costs are the sole responsibility of, and shall be paid by, Buyer.

2. TAXES: Any current or future tax or government charge, or increase in same, affecting Seller's costs of production, sales, delivery or shipment, or which Seller is otherwise required to pay or collect in connection with the sale, purchase, delivery, storage, processing, use of consumption of Goods, shall be paid by Buyer and shall either be added to the purchase price of the Goods or added to Buyer separately, at Seller's election.

3. ARBITRATION: Seller and Buyer agree that any controversy or claim, excluding collections and past due accounts, arising out of or relating to the agreed terms as provided herein to sell Goods, or the breach thereof, shall be submitted to mandatory arbitration in accordance with the Texas Arbitration Act, and the arbitration award or dispositive order, shall be final and binding and may be entered in any court of competent jurisdiction in the State of Texas. The exclusive place of arbitration shall be within Lubbock County, Texas, and the parties hereby submit to such jurisdiction and venue. Collections and past due accounts may be filed in the appropriate court located in Lubbock County, Texas, and Buyer hereby submits to the exclusive jurisdiction and venue in Lubbock County, Texas.

4. TERMS OF PAYMENT: Seller reserves the right to require payment in advance or C.O.D., and otherwise modify credit terms should Buyer's credit standing not meet Seller's credit requirements. Unless otherwise specified in writing by Seller, the terms of payment are net thirty (30) days from the date of Seller's invoice to be paid in U.S. currency. All credit sales are subject to prior approval by Seller. Seller may, at its option, require copies of pertinent contracts, financial statements and other documents relative to any given sale of Goods in order to evaluate and determine, in its sole discretion, Buyer's credit status or the credit status of any third party with whom Buyer has a contractual relationship concerning the Goods to be furnished to Buyer. Failure or delay in delivery of this information will postpone production and delivery of Goods, and may result in a price increase. In the event payment is not made when due, Buyer agrees to pay Seller a service or finance charge of the lesser of: (i) one and one-half percent (1.5%) per month (18% per annum); or (ii) the highest rate permitted by applicable law, on the unpaid balance of the invoice from and after the invoice due date. Buyer shall be responsible for all costs and expenses associated with any checks returned due to insufficient funds. If, during the performance hereunder with Buyer, the financial responsibility or condition of Buyer is such that Seller in good faith deems itself insecure, or if Buyer becomes insolvent, or if a material change in the ownership of Buyer occurs, or if Buyer fails to make any payments in accordance with the terms as provided herein, then, in any such event, Seller is not obligated to continue performance under the agreed terms as provided herein, and may stop Goods in transit and defer or decline to make delivery of Goods, except upon receipt of satisfactory security or cash payments in advance, or Seller may terminate Buyer's purchase order upon written notice to Buyer without further obligation to Buyer whatsoever. Payment by Buyer to Seller shall not be conditioned upon Buyer receiving payment from any third party.

5. Quotation, (Estimate or Bid), Withdrawal, Expiration: Quotations, estimates or bids are valid for thirty (30) calendar days from the date of issuance, unless otherwise provided therein. Seller reserves the right to cancel or withdraw any quotation, estimate or bid at any time, with or without notice or cause, prior to acceptance by Buyer. There is no agreement if any conditions specified within the quotation, estimate or bid are not completed by Buyer to Seller's satisfaction within thirty (30) calendar days of Seller's written acknowledgement of a purchase order by Buyer. Seller, nevertheless, reserves its right to accept any contractual documents received from Buyer after this 30-day period.

6. SELLER'S RIGHTS IN DEFAULT: In the event Buyer fails to make any payment when due, Seller shall have the right, among other remedies, either to terminate its agreement with Buyer, or suspend further performance under the agreed terms as provided herein and/or any other agreements with Buyer. Buyer shall be liable for all expenses, including attorneys' fees, relating to the collection of past due amounts. Additionally, upon any payment default by Buyer, Buyer shall immediately pay to Seller the entire unpaid amounts for any and all shipments made to Buyer irrespective of the terms of said shipment and whether said shipments are made pursuant to the agreed terms as provided herein, or any other agreement between Seller and Buyer, and Seller may also withhold all subsequent shipments until the full amount due is paid by Buyer. Acceptance by Seller of less than full payment shall not be a waiver of any of its rights hereunder. Buyer shall not assign or transfer its rights, duties or obligations, or any interest in it, or monies payable under it, without the written consent of Seller, and any assignment made without such written consent shall be null and void.

7. SHIPMENT AND DELIVERY: While Seller will use all responsible commercial efforts to maintain the delivery date(s) acknowledged or quoted by Seller, all shipping dates are proximate and not guaranteed. Shipment dates are best, estimates only at the time of the proposal, and are subject to change based on manufacturing load and sub-supplier schedules at Seller's date of order and/or full release to manufacture. Seller reserves the right to make partial shipments. Seller, at its option, shall not be bound to tender delivery of any Goods postponed or delayed by Buyer for any reason. Buyer agrees to reimburse Seller for any and all storage costs and other additional expenses resulting therefrom. Risk of loss and legal title to the Goods shall transfer to Buyer for sales in which the end destination of the Goods is outside the United States immediately after the Goods have passed beyond the territorial limits of the United States. For all other shipments, risk of loss for damage and responsibility shall pass from Seller to Buyer upon delivery to and receipt by a carrier at Seller's shipping point. All shipments are F.O.B. Seller's shipping point. Any claims for shortages or damages suffered in transit are the responsibility of the Buyer and shall be submitted by Buyer directly to the carrier. Shortages or damages must be identified and signed for at the time of delivery. Seller is not responsible for any such shortages or loss. Seller shall not be responsible to Buyer for any loss, whether direct, indirect, incidental or consequential in nature, including without limitation loss of profits or liquidated damages, arising out of or relating to any failure of the Goods to be delivered by the specified delivery date. In the absence of specific instructions, Seller will select the carrier. Buyer shall reimburse Seller for the additional cost of its performance resulting from inaccurate or lack of delivery instructions, or by any act or omission on Buyer's part. Any such additional cost may include, but is not limited to, storage, insurance, protection, re-inspection, and delivery expenses. Buyer further agrees that any payment due on delivery shall also be made if the Goods are delivered into storage as though the Goods had been delivered in accordance with the purchase order. Buyer grants to Seller a continuing security interest in and a lien upon the Goods and the proceeds thereof (including insurance proceeds), as security for the payment of all such amounts and the performance by Buyer of all of its obligations to Seller pursuant to this agreed terms as provided herein and all such other sales, and Buyer shall have no right to sell, encumber or dispose of the Goods. Buyer shall execute any and all financing statements and other documents and instruments and do and perform any and all other acts and things which Seller may consider necessary, desirable or appropriate to establish, perfect or protect Seller's title, security interest and lien. In addition, Buyer authorizes Seller and its agents and employees to execute any and all such documents and instruments, and do and perform any and all such acts and things, at Buyer's expense, in Buyer's name and on its behalf related to its security interest in the Goods. Such documents and instruments may also be filed without the signature of Buyer to the extent permitted by law.

8. LIMITED WARRANTY: Subject to the limitations of Section 9, below, Seller warrants that the Goods manufactured by Seller will be free from defects in material and workmanship at the time of shipment

under normal use and regular service and maintenance, for a period of eighteen (18) months from the date of shipment of the Goods by Seller, or one year from start-up, whichever occurs first, unless otherwise specified by Seller in writing. Products and Special Coating Applications purchased by the Seller from a third party for resale to Buyer (**Resale Products**) shall carry only the warranty extended by the original manufacturer or supplier. ANY ITEM OF THE PRODUCT(S) WHICH IS NOT MANUFACTURED OR APPLIED BY SELLER IS NOT WARRANTED BY SELLER and shall be covered only by the express warranty, if any, of the manufacturer or applicator thereof. **THE WARRANTY SET FORTH IN THIS SECTION 8 AND THE WARRANTY SET FORTH IN SECTION 9, BELOW, ARE THE SOLE AND EXCLUSIVE WARRANTIES GIVEN BY SELLER WITH RESPECT TO THE GOODS, AND ARE IN LIEU OF AND EXCLUDE ALL OTHER WARRANTIES, EXPRESS OR IMPLIED, ARISING BY OPERATION OF LAW OR OTHERWISE, INCLUDING WITHOUT LIMITATION, MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE, WHETHER OR NOT THE PURPOSE OR USE HAD BEEN DISCLOSED TO SELLER IN SPECIFICATIONS, DRAWINGS OR OTHERWISE, AND WHETHER OR NOT SELLER'S GOODS ARE SPECIFICALLY DESIGNED AND/OR MANUFACTURED BY SELLER FOR BUYER'S USE OR PURPOSE.** This warranty does not extend to any losses or damages due to misuse, accident, abuse, neglect, normal wear and tear, negligence (other than Seller's), unauthorized modification or alteration, use beyond rated capacity, unsuitable power sources or environmental conditions, improper installation, repair, handling, maintenance or application or any other cause not the fault of the Seller. To the extent that Buyer, or its agents, has supplied specifications, information, representation of operating conditions or other conditions or other data to Seller in the selection or design of the Goods and the preparation of Seller's quotation, estimate or bid, or in the event that actual operating conditions or other conditions differ from those represented by Buyer, any warranties or other provisions contained herein which are affected by such conditions shall be null and void. Equipment performance is not warranted unless separately agreed to in writing by the Seller. Seller manufactures engineered-to-order Goods based on the design point specified by the Buyer. Warranty on performance results will be based on laboratory tests performed at Seller's location. Due to the inaccuracies of field testing, if there are any conflicts between the results of field testing conducted and laboratory testing conducted, the laboratory tests results will control. Seller will not provide or furnish any equipment for field testing. (See Section 16) If within thirty (30) days after Buyer's discovery of any claimed warranty defects within the warranty period, and Buyer notifies Seller thereof in writing, Seller shall, at its option and as Buyer's exclusive remedy, repair, correct, replace or refund the purchase price for that portion of the Goods found by Seller to be defective. Failure by Buyer to give such written notice within the applicable time period shall be deemed absolute and unconditional waiver of Buyer's claims for such defects. Seller shall have the right to require the Buyer to deliver the Goods to Seller's designated repair center or manufacturing facility. All responsibility and expenses associated with removal, dismantling, reinstallation and transportation to and from Seller's designated repair center or manufacturing facility, and the time and expense of Seller's personnel and representatives for site travel and diagnosis under this warranty, shall be paid by Buyer. Goods repaired or replaced during the warranty period shall be covered by the foregoing warranty for the remainder of the original warranty period, or ninety (90) days from the shipment date that the Goods are returned to Buyer, whichever is longer. Buyer assumes all other responsibility for any loss, damage, or injury to persons or property arising out of, connected with, or resulting from the use of the Goods, whether alone or in combination with other products/components.

Buyer agrees to provide any subsequent transferee of the Goods conspicuous written notice of Section 8 and 9 herein. Sections 8 and 9 shall apply to any entity or person who may buy, acquire or use the Goods, including any entity or person who obtains Goods from Buyer, and such entity or person shall be bound by the limitations as provided herein.

9. LIMITATION OF REMEDY AND LIABILITY: BUYER'S SOLE AND EXCLUSIVE REMEDY FOR BREACH OF ANY WARRANTY HEREUNDER SHALL BE LIMITED TO REPAIR, CORRECTION, REPLACEMENT OR REFUND OF THE PURCHASE PRICE UNDER SECTION 8. SELLER SHALL NOT BE LIABLE FOR DAMAGES CAUSED BY DELAY IN PERFORMANCE, AND THE REMEDIES OF BUYER UNDER THE AGREED TERMS AS PROVIDED HEREIN ARE EXCLUSIVE. IN NO EVENT, REGARDLESS OF THE FORM OF THE CLAIM OR CAUSE OF ACTION (WHETHER BASED IN CONTRACT, INFRINGEMENT, NEGLIGENCE, STRICT LIABILITY, ANY OTHER TORT OR OTHERWISE), SHALL SELLER'S LIABILITY TO BUYER AND/OR ITS CUSTOMERS EXCEED THE PRICE PAID BY BUYER FOR THE SPECIFIC GOODS PROVIDED BY SELLER GIVING RISE TO THE CLAIM OR CAUSE OF ACTION. BUYER AGREES THAT IN NO EVENT SHALL SELLER'S LIABILITY TO BUYER AND/OR ITS CUSTOMERS EXTEND TO INCLUDE: LIQUIDATED, INCIDENTAL, CONSEQUENTIAL, PUNITIVE, EXEMPLARY OR SPECIAL DAMAGES, INCLUDING BUT NOT LIMITED TO, LOSS OF PROFITS OR ANTICIPATED PROFITS, LOSS OF ANTICIPATED SAVINGS OR REVENUE, LOSS OF INCOME, LOSS OF BUSINESS AND BUSINESS INTERRUPTION, LOSS OF USE, LOSS OF PRODUCTION, LOSS OF OPPORTUNITY, LOSS OF REPUTATION, AND/OR LOSS OR DAMAGE TO PROPERTY OR EQUIPMENT. THE FOREGOING LIMITATIONS OF LIABILITY SHALL BE EFFECTIVE WITHOUT REGARD TO SELLER'S ACTS OR OMISSIONS OR NEGLIGENCE OR STRICT LIABILITY IN THE PERFORMANCE OR NON-PERFORMANCE HEREUNDER. It is expressly understood that any technical advice furnished by Seller with respect to the use of the Goods is given without charge, and Seller assumes no obligation or liability for the advice given, or result obtained, and all such advice being given is accepted at Buyer's risk.

10. Buyer Warranty: Buyer warrants the accuracy of any and all information relating to the details of its operating conditions, including temperatures, pressures, and where applicable, the nature of all hazardous materials. Seller can justifiably rely upon the accuracy of Buyer's information in its performance. Should Buyer's information prove inaccurate, Buyer agrees to reimburse Seller for any losses, liabilities, damages and expenses that Seller may have incurred as a result of any inaccurate information provided by Buyer to Seller.

11. EXCUSE OF PERFORMANCE/FORCE MAJEURE: Seller shall not be liable for delays in performance or for non-performance due to acts of God; acts of Buyer; war; fire; flood; weather; natural disasters; terrorism; sabotage; strikes; labor disputes; civil disturbances or riots; currency restrictions; pandemics; disease; governmental requests, restrictions, allocations, laws, regulations, orders or actions; unavailability of or delays in transportation or in obtaining materials, fuel, power and energy; default of suppliers; or unforeseen circumstances or any events or causes beyond Seller's reasonable control. Deliveries or other performances may be suspended for an appropriate period of time or canceled by Seller upon notice to Buyer in the event of any occurrence of the foregoing, but the balance of the agreement shall otherwise remain unaffected as a result of the foregoing. If Seller determines that its ability to supply the total demand for the Goods, or to obtain material used directly or indirectly in the manufacture of the Goods, is hindered, limited or made impracticable due to causes set forth hereinabove, Seller may allocate its available supply of the Goods or such material (without obligation to acquire other supplies of any such Goods or material) among itself and its buyers on such a basis as Seller determines to be equitable, in its sole discretion, without liability for any failure of performance which may result therefrom.

12. CANCELLATION: Except as otherwise provided herein, no order may be cancelled on special or made-to-order Goods unless requested in writing by either party and accepted in writing by the other party. In the event of a cancellation by Buyer, Buyer shall, within thirty (30) days of such cancellation, pay Seller a cancellation fee, which shall include all costs and expenses incurred by Seller prior to the receipt of the request for cancellation, including but not limited to, all commitments to its suppliers, subcontractors and others, all fully burdened labor and overhead expended by Seller, plus a reasonable profit charge. Return of Goods shall be in accordance with Seller's most current return policy and subject to a minimum thirty percent (30%) restocking fee, unless otherwise agreed to by the parties in writing. Notwithstanding anything to the contrary herein, in the event that: (i) there is a commencement by or against Buyer of any voluntary or involuntary proceedings in bankruptcy or insolvency; (ii) it is determined Buyer is insolvent; (iii) Buyer makes a general assignment for the benefit of its creditors; (iv) a receiver is appointed on account of Buyer's insolvency; (v) Buyer fails to make payment when due under the agreed terms as provided herein; or (vi) Buyer does not correct or, if immediate correction is not possible, commence and diligently continue action to correct any default of Buyer to comply with any of the provisions or requirements of the agreed terms as provided herein within ten (10) calendar



days after being notified in writing of such default by Seller, Seller may, by written notice to Buyer, without prejudice to any other rights or remedies which Seller may have, terminate its further performance hereunder. In the event of such termination, Seller shall be entitled to receive payment as if Buyer has cancelled its purchase order pursuant to this paragraph. Seller may nevertheless elect to complete its performance of under the agreed terms provided herein by any means it chooses. Buyer agrees to be responsible for any additional costs incurred by Seller in so doing. Upon termination of the agreed terms as provided herein, the rights, obligations and liabilities of the parties, which shall have arisen or been incurred hereunder prior to its termination, shall survive such termination.

13. CHANGES: Buyer may request changes or additions to the Goods consistent with the Seller's specifications and criteria. In the event Seller accepts such changes or additions, Seller may revise the price and dates of delivery. Seller reserves the right to change the design and specifications for the Goods without prior notice to the Buyer, except with respect to Goods being made-to-order for Buyer. Seller shall have no obligation to install or make such change in any Goods manufactured prior to the date of notification of such change.

14. NUCLEAR/FIRE/MEDICAL: GOODS SOLD HEREUNDER ARE NOT FOR USE IN CONNECTION WITH ANY NUCLEAR, FIRE SYSTEMS, MEDICAL, LIFE-SUPPORT AND RELATED APPLICATIONS. Buyer accepts Goods with the foregoing understanding, and agrees to communicate same in writing to any subsequent purchasers or users, and to defend, indemnify and hold harmless Seller for any claims, losses, suits, judgments and damages, including incidental and consequential damages, arising from such use, whether the cause be based in tort, contract or otherwise, including allegations that the Seller's liability is based on negligence or strict liability.

15. ASSIGNMENT: Buyer shall not assign its rights or delegate its duties hereunder, or any interest herein, without the prior written consent of Seller, and any such assignment, without such consent, shall be null and void.

16. INSPECTION/TESTING: Buyer shall have the right to inspect the Goods upon their receipt. When delivery is to Buyer's site or to a project site ("Site"), Buyer shall notify Seller in writing of any nonconformity of the Goods with the quotation, estimate or bid, or the agreed terms as provided herein, within three (3) days from receipt of the Goods by Buyer, unless a shorter period is required in Seller's quotation, estimate or bid. For all other deliveries, Buyer shall notify Seller in writing of any nonconformity of the Goods with the quotation, estimate or bid, or the agreed terms as provided herein, within fourteen (14) days from receipt of the Goods by Buyer. Failure to give such applicable notice shall constitute a waiver of Buyer's right to inspect and/or reject the Goods for nonconformity, and shall be equivalent to an irrevocable acceptance of the Goods by Buyer. Claims for loss of or damage to Goods in transit must be made to the carrier, and not to Seller. Buyer, at its option and sole expense, may inspect and observe the testing by Seller of the Goods for compliance with Seller's standard test procedures prior to shipment, which inspection and testing shall be conducted at Seller's plant at such reasonable time as is determined by Seller. Any rejection of the Goods must be made promptly by Buyer before shipment. Tests shall be deemed to be satisfactorily completed, and the test fully met, when the Goods meet Seller's criteria for such procedures. Acceptance by Buyer, or Buyer's representative, of any witnessed testing or coatings will preclude any future rejection.

17. STANDARD TOLERANCE: Except for made-to-order Goods specified by the Buyer in writing and expressly agreed to in writing by Seller, all Goods furnished hereunder are produced in accordance with the standard manufacturing practices in the country of origin of the Goods. All materials incorporated into the Goods are subject to mill tolerances and variations consistent with normal manufacturing practices for dimension, weight, straightness, section, composition and mechanical properties, normal surface and internal conditions, and deviations in quality resulting from practical testing. Seller is not responsible for any deterioration in quality as a result of the foregoing tolerances and variations.

18. DRAWINGS: Seller's prints and drawings (including without limitation, the underlying technology) furnished by Seller to Buyer in connection with Seller's quotation, estimate or bid are the property of Seller, and Seller retains all rights, including without limitation, exclusive rights of use and license. Buyer shall return all copies (in whatever medium) of such prints or drawings to Seller immediately upon request by Seller. Seller does not supply detailed or shop working drawings of the Goods; however, Seller will supply necessary installation drawings. The drawings and bulletin illustrations submitted with Seller's quotation, estimate or bid, show general type, arrangement and approximate dimensions of the Goods to be furnished for Buyer's information only, and Seller makes no representation or warranty regarding their accuracy. Unless expressly stated to the contrary within the quotation, estimate or bid, all drawings, illustrations, specifications or diagrams form no part of the agreed terms as provided herein. Seller reserves the right to alter such details in design or arrangement of its Goods which, in its sole discretion, constitute an improvement in construction, application or operation of the Goods. All engineering information necessary for installation of the Goods shall be forwarded by Seller to Buyer at the time the Goods are shipped. After Buyer's acceptance of Seller's quotation, estimate or bid, any changes requested by Buyer in the type of Goods, the arrangement of the Goods, or the application of the Goods will be made at Buyer's expense. Instructions necessary for installation, operating and maintenance will be supplied when the Goods are shipped.

19. EXPORT/IMPORT: Buyer agrees that all applicable import and export control laws, regulations, orders and requirements, including without limitation those of the United States and the European Union, and the jurisdictions in which the Seller and Buyer are established, or from which the Goods may be supplied, will apply to the Goods receipt and use. In no event shall Buyer use, transfer, release, import or export any Goods in violation of such applicable laws, regulations, orders or requirements. The Buyer shall not, and shall not permit any third parties to, directly or indirectly, export, re-export or release any Goods to any jurisdiction or country to which, or any party to whom, the export, re-export or release of any Goods is prohibited by applicable law, regulation or rule. The Buyer shall be solely responsible for any breach of this Section 19.

20. Proprietary Information, Injunction: Seller's designs, illustrations, drawings, specifications, technical data, catalogues, "know-how", economic or other business or manufacturing information (collectively "Proprietary Information") disclosed to Buyer shall be deemed proprietary and confidential to Seller. Buyer agrees not to disclose, use or reproduce any Proprietary Information without first having obtained Seller's express written consent. Buyer's agreement to refrain from disclosing, using or reproducing Proprietary Information shall survive completion of the work and delivery of the Goods under the agreed terms as provided herein. Buyer acknowledges that its improper disclosure of Proprietary Information to any third party will result in Seller's suffering irreparable harm. Seller may seek injunctive or equitable relief to prevent Buyer's unauthorized disclosure of Proprietary Information.

21. Installation and Start-up: Unless otherwise agreed to in writing by Seller, installation of the Goods shall be the sole responsibility of Buyer. In the event Buyer has engaged Seller to provide an engineer for start-up supervision, such engineer will function in a supervisory capacity only, and Seller shall have no responsibility for the quality of workmanship of the installation. Buyer understands and agrees that it shall furnish, at Buyer's sole expense, all necessary foundations, supplies, labor and facilities that might be required to install and operate the Goods.

22. INSURANCE: Buyer agrees to do all acts necessary to protect Seller's interest by adequately insuring the Goods against loss or damage from any external cause, with Seller named as insured, additional insured or co-insured. Seller and Buyer agree to maintain liability insurance in commercially reasonable amounts covering claims of any kind or nature for damage to property or personal injury, including death, made by anyone that may arise from activities performed or facilitated related to the Goods, whether these activities are performed by that company, its employees, agents, or anyone directly engaged or employed by that party or its agents.

23. GENERAL PROVISIONS: These terms and conditions herein supersede all other communications, negotiations, and prior oral or written statements regarding the subject matter of the agreed terms as provided herein. No change, modification, rescission, discharge, abandonment, or waiver of these terms and conditions shall be binding upon the Seller, unless made in writing and signed on its behalf by a duly authorized officer of Seller. No conditions, usage of trade, course of dealing or performance, understanding or agreement purporting to modify, vary, explain, or supplement these terms and conditions shall be binding unless hereafter made in writing and signed by the party to be bound, and no modification or additional terms shall be applicable to the agreed terms as provided herein by Seller's receipt, acknowledgement, or acceptance of purchase orders, shipping instruction forms, or other documentation containing terms at variance with or in addition to those set forth herein. Any such modifications or additional terms are specifically rejected and deemed a material alteration hereof. If this document shall be deemed an acceptance of a prior offer by Buyer, such acceptance is expressly conditional upon Buyer's assent to any additional or different term set forth herein. There is no waiver by either party with respect to any other breach or default of any other right or remedy, unless such waiver be expressed in writing and signed by the party to be bound. All typographical or clerical errors made by Seller in any quotation, estimate or bid, acknowledgement or publication are subject to correction. No action, regardless of form, arising out of transactions relating to this contract, may be brought by either party more than two years after the cause of action has accrued.

24. GOVERNING LAW: THE AGREED TERMS AS PROVIDED HEREIN, AND THE VALIDITY, PERFORMANCE, AND ALL OTHER MATTERS RELATING TO THE INTERPRETATION AND EFFECT OF AND ALL RIGHTS AND OBLIGATIONS HEREUNDER, SHALL BE GOVERNED BY THE LAWS OF THE STATE OF TEXAS, WITHOUT REFERENCE TO PRINCIPLES OF CONFLICTS OF LAW. SUBJECT TO THE ARBITRATION PROVISION AS PROVIDED HEREINABOVE, THE JURISDICTION OF ANY PROCEEDING RELATED TO THE GOODS SHALL BE IN THE STATE OF TEXAS AND VENUE SHALL BE LUBBOCK COUNTY, TEXAS. THE RIGHTS AND OBLIGATIONS OF THE PARTIES HEREUNDER SHALL NOT BE GOVERNED BY THE 1980 U.N. CONVENTION ON CONTRACTS FOR THE INTERNATIONAL SALE OF GOODS.

25. Titles: The section titles herein are for reference only, and shall not limit or restrict the interpretation or construction of this Agreement.

26. Waiver: Seller's failure to insist, in any one or more instances, upon Buyer's performance of this Agreement, or to exercise any rights conferred, shall not constitute a waiver or relinquishment of any such right or right to insist upon Buyer's performance in any other regard.

27. Severability: The partial or complete invalidity of any one or more provisions of this Agreement shall not affect the validity or continuing force and effect of any other provision.





**CONTACT US
FOR THE TOOLS AND
SERVICE YOU NEED
TO MAKE THE MOST
OF YOUR WATER.**

SIMFLO®



SIMFLO.COM