

SIMFLO®

50 Hz

**LINESHAFT & SUBMERSIBLE
TURBINE PUMP CURVES**

2875 & 1450 RPM

26.1

For more information,
or the location of your nearest SIMFLO distributor,
Please visit www.simflo.com



Texas:
2605 Interstate 27
Lubbock, TX 79404
806.747.3411

Mississippi:
8500 Aaron Lane
Southaven, MS 38671
662.793.8090

Terms & Conditions **i-ii**

Turbine Performance..... **Section 150**

 2875 RPM.....Section 151, 1-44

 1450 RPM.....Section 152, 45-119

Bowl Assembly Dimensions **Section 250**

 Open Lineshaft Bowl Assembly Dimensions 120

 Enclosed Lineshaft Bowl Assembly Dimensions 121

 Submersible Bowl Assembly Dimensions..... 122

**SIMFLO, LLC. Terms
and Conditions**

SIMFLO, LLC. is herein referred to as the "Seller" and the customer purchasing goods ("Goods") from the Seller is referred to as the "Buyer." The Terms and Conditions as set forth herein, and the Seller's quotation, estimate or bid to Buyer, shall collectively and exclusively govern all of the rights, duties and obligations of Seller and Buyer related to Buyer's purchase order for the Goods Seller is agreeing to sell to Buyer. Any terms and conditions set forth in Buyer's purchase order which are different or inconsistent with Seller's Terms and Conditions and/or Seller's quotation, estimate or bid, shall be null and void. Buyer's receipt of the Goods, and/or payment, or partial payment, to Seller for the Goods being sold to Buyer, shall evidence Buyer's acceptance of the terms and conditions of the sale as set forth herein. Seller reserves the right, in its sole discretion, to refuse any purchase order.

1. PRICES: Prices for Goods shall apply to the specific quantities stated in Seller's quotation, estimate or bid. Prices shall include standard packing according to Seller's specification for packing and delivery. All costs and taxes for special packing requests by Buyer, including packing for exports, shall be paid by Buyer as an additional charge. Prices for Goods are subject to change without notice based on any subsequent changes in the cost to Seller for sub-supplier materials, supplies or other related increases, and the adjusted price will be based on the cost to Seller in effect at the time of the requested shipment date, and each shipment will be invoiced at such increased price. All prices for Goods are exclusive of, and do not include, any applicable sales, use, excise, GST, VAT or similar taxes, duties or levies, or transportation or insurance costs, and all such costs are the sole responsibility of, and shall be paid by, Buyer.

2. TAXES: Any current or future tax or government charge, or increase in same, affecting Seller's costs of production, sales, delivery or shipment, or which Seller is otherwise required to pay or collect in connection with the sale, purchase, delivery, storage, processing, use of consumption of Goods, shall be paid by Buyer and shall either be added to the purchase price of the Goods or billed to Buyer separately, at Seller's election.

3. ARBITRATION: Seller and Buyer agree that any controversy or claim, excluding collections and past due accounts, arising out of or relating to the agreed terms as provided herein to sell Goods, or the breach thereof, shall be submitted to mandatory arbitration in accordance with the Texas Arbitration Act, and the arbitration award or dispositive order, shall be final and binding and may be entered in any court of competent jurisdiction in the State of Texas. The exclusive place of arbitration shall be within Lubbock County, Texas, and the parties hereby submit to such jurisdiction and venue. Collections and past due accounts may be filed in the appropriate court located in Lubbock County, Texas, and Buyer hereby submits to the exclusive jurisdiction and venue in Lubbock County, Texas.

4. TERMS OF PAYMENT: Seller reserves the right to require payment in advance or C.O.D., and otherwise modify credit terms should Buyer's credit standing not meet Seller's credit requirements. Unless otherwise specified in writing by Seller, the terms of payment are net thirty (30) days from the date of Seller's invoice to be paid in U.S. currency. All credit sales are subject to prior approval by Seller. Seller may, at its option, require copies of pertinent contracts, financial statements and other documents relative to any given sale of Goods in order to evaluate and determine, in its sole discretion, Buyer's credit status or the credit status of any third party with whom Buyer has a contractual relationship concerning the Goods to be furnished to Buyer. Failure or delay in delivery of this information will postpone production and delivery of Goods, and may result in a price increase. In the event payment is not made when due, Buyer agrees to pay Seller a service or finance charge of the lesser of: (i) one and one-half percent (1.5%) per month (18% per annum); or (ii) the highest rate permitted by applicable law, on the unpaid balance of the invoice from and after the invoice due date. Buyer shall be responsible for all costs and expenses associated with any checks returned due to insufficient funds. If, during the performance hereunder with Buyer, the financial responsibility or condition of Buyer is such that Seller in good faith deems itself insecure, or if Buyer becomes insolvent, or if a material change in the ownership of Buyer occurs, or if Buyer fails to make any payments in accordance with the terms as provided herein, then, in any such event, Seller is not obligated to continue performance under the agreed terms as provided herein, and may stop Goods in transit and defer or decline to make delivery of Goods, except upon receipt of satisfactory security or cash payments in advance, or Seller may terminate Buyer's purchase order upon written notice to Buyer without further obligation to Buyer whatsoever. Payment by Buyer to Seller shall not be conditioned upon Buyer receiving payment from any third party.

5. Quotation, (Estimate or Bid), Withdrawal, Expiration. Quotations, estimates or bids are valid for thirty (30) calendar days from the date of issuance, unless otherwise provided therein. Seller reserves the right to cancel or withdraw any quotation, estimate or bid at any time, with or without notice or cause, prior to acceptance by Buyer. There is no agreement if any conditions specified within the quotation, estimate or bid are not completed by Buyer to Seller's satisfaction within thirty (30) calendar days of Seller's written acknowledgement of a purchase order by Buyer. Seller, nevertheless, reserves its right to accept any contractual documents received from Buyer after this 30-day period.

6. SELLER'S RIGHTS IN DEFAULT: In the event Buyer fails to make any payment when due, Seller shall have the right, among other remedies, either to terminate its agreement with Buyer, or suspend further performances under the agreed terms as provided herein and/or any other agreements with Buyer. Buyer shall be liable for all expenses, including attorneys' fees, relating to the collection of past due amounts. Additionally, upon any payment default by Buyer, Buyer shall immediately pay to Seller the entire unpaid amounts for any and all shipments made to Buyer irrespective of the terms of said shipment and whether said shipments are made pursuant to the agreed terms as provided herein, or any other agreement between Seller and Buyer, and Seller may also withhold all subsequent shipments until the full amount due is paid by Buyer. Acceptance by Seller of less than full payment shall not be a waiver of any of its rights hereunder. Buyer shall not assign or transfer its rights, duties or obligations, or any interest in it, or monies payable under it, without the written consent of Seller, and any assignment made without such written consent shall be null and void.

7. SHIPMENT AND DELIVERY: While Seller will use all responsible commercial efforts to maintain the delivery date(s) acknowledged or quoted by Seller, all shipping dates are proximate and not guaranteed. Shipment dates are best, estimates only at the time of the proposal, and are subject to change based on manufacturing load and sub-supplier schedules at Seller's date of order and/or full release to manufacture. Seller reserves the right to make partial shipments. Seller, at its option, shall not be bound to tender delivery of any Goods postponed or delayed by Buyer for any reason. Buyer agrees to reimburse Seller for any and all storage costs and other additional expenses resulting therefrom. Risk of loss and legal title to the Goods shall transfer to Buyer for sales in which the end destination of the Goods is outside the United States immediately after the Goods have passed beyond the territorial limits of the United States. For all other shipments, risk of loss for damage and responsibility shall pass from Seller to Buyer upon delivery to and receipt by a carrier at Seller's shipping point. All shipments are F.O.B. Seller's shipping point. Any claims for shortages or damages suffered in transit are the responsibility of the Buyer and shall be submitted by Buyer directly to the carrier. Shortages or damages must be identified and signed for at the time of delivery. Seller is not responsible for any such shortages or loss. Seller shall not be responsible to Buyer for any loss, whether direct, indirect, incidental or consequential in nature, including without limitation loss of profits or liquidated damages, arising out of or relating to any failure of the Goods to be delivered by the specified delivery date. In the absence of specific instructions, Seller will select the carrier. Buyer shall reimburse Seller for the additional cost of its performance resulting from inaccurate or lack of delivery instructions, or by any act or omission on Buyer's part. Any such additional cost may include, but is not limited to, storage, insurance, protection, re-inspection and delivery expenses. Buyer further agrees that any payment due on delivery shall also be made if the Goods are delivered into storage as though the Goods had been delivered in accordance with the purchase order. Buyer grants to Seller a continuing security interest in and a lien upon the Goods and the proceeds thereof (including insurance proceeds), as security for the payment of all such amounts and the performance by Buyer of all its obligations to Seller pursuant to this the agreed terms as provided herein and all such other sales, and Buyer shall have no right to sell, encumber or dispose of the Goods. Buyer shall execute any and all financing statements and other documents and instruments and do and perform any and all other acts and things which Seller may consider necessary, desirable or appropriate to establish, perfect or protect Seller's title, security interest and lien. In addition, Buyer authorizes Seller and its agents and employees to execute any and all such documents and instruments, and do and perform any and all such acts and things, at Buyer's expense, in Buyer's name and on its behalf related to its security interest in the Goods. Such documents and instruments may also be filed without the signature of Buyer to the extent permitted by law.

8. LIMITED WARRANTY: Subject to the limitations of Section 9, below, Seller warrants that the Goods manufactured by Seller will be free from defects in material and workmanship at the time of shipment

under normal use and regular service and maintenance, for a period of eighteen (18) months from the date of shipment of the Goods by Seller, or one year from start-up, whichever occurs first, unless otherwise specified by Seller in writing. Products and Special Coating Applications purchased by the Seller from a third party for resale to Buyer ("Resale Products") shall carry only the warranty extended by the original manufacturer or supplier. ANY ITEM OF THE PRODUCT(S) WHICH IS NOT MANUFACTURED OR APPLIED BY SELLER IS NOT WARRANTED BY SELLER and shall be covered only by the express warranty, if any, of the manufacturer or applicator thereof. **THE WARRANTY SET FORTH IN THIS SECTION 8 AND THE WARRANTY SET FORTH IN SECTION 9, BELOW, ARE THE SOLE AND EXCLUSIVE WARRANTIES GIVEN BY SELLER WITH RESPECT TO THE GOODS, AND ARE IN LIEU OF AND EXCLUDE ALL OTHER WARRANTIES, EXPRESS OR IMPLIED, ARISING BY OPERATION OF LAW OR OTHERWISE, INCLUDING WITHOUT LIMITATION, MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE, WHETHER OR NOT THE PURPOSE OR USE HAD BEEN DISCLOSED TO SELLER IN SPECIFICATIONS, DRAWINGS OR OTHERWISE, AND WHETHER OR NOT SELLER'S GOODS ARE SPECIFICALLY DESIGNED AND/OR MANUFACTURED BY SELLER FOR BUYER'S USE OR PURPOSE.** This warranty does not extend to any losses or damages due to misuse, accident, abuse, neglect, normal wear and tear, negligence (other than Seller's), unauthorized modification or alteration, use beyond rated capacity, unsuitable power sources or environmental conditions, improper installation, repair, handling, maintenance or application or any other cause not the fault of the Seller. To the extent that Buyer, or its agents, has supplied specifications, information, representation of operating conditions or other conditions or other data to Seller in the selection or design of the Goods and the preparation of Seller's quotation, estimate or bid, or in the event that actual operating conditions or other conditions differ from those represented by Buyer, any warranties or other provisions contained herein which are affected by such conditions shall be null and void. Equipment performance is not warranted unless separately agreed to in writing by the Seller. Seller manufactures engineered-to-order Goods based on the design point specified by the Buyer. Warranty on performance results will be based on laboratory tests performed at Sellers location. Due to the inaccuracies of field testing, if there are any conflicts between the results of field testing conducted and laboratory testing conducted, the laboratory tests results will control. Seller will not provide or furnish any equipment for field testing. (See Section 16) If within thirty (30) days after Buyer's discovery of any claimed warranty defects within the warranty period, and Buyer notifies Seller thereof in writing; Seller shall, at its option and as Buyer's exclusive remedy, repair, correct, replace or refund the purchase price for that portion of the Goods found by Seller to be defective. Failure by Buyer to give such written notice within the applicable time period shall be deemed absolute and unconditional waiver of Buyer's claims for such defects. Seller shall have the right to require the Buyer to deliver the Goods to Seller's designated repair center or manufacturing facility. All responsibility and expenses associated with removal, dismantling, reinstallation and transportation to and from Seller's designated repair center or manufacturing facility, and the time and expense of Seller's personnel and representatives for site travel and diagnosis under this warranty, shall be paid by Buyer. Goods repaired or replaced during the warranty period shall be covered by the foregoing warranty for the remainder of the original warranty period, or ninety (90) days from the shipment date that the Goods are returned to Buyer, whichever is longer. Buyer assumes all other responsibility for any loss, damage, or injury to persons or property arising out of, connected with, or resulting from the use of the Goods, whether alone or in combination with other products/components.

Buyer agrees to provide any subsequent transferee of the Goods conspicuous, written notice of Section 8 and 9 herein. Sections 8 and 9 shall apply to any entity or person who may buy, acquire or use the Goods, including any entity or person who obtains Goods from Buyer, and such entity or person shall be bound by the limitations as provided herein.

9. LIMITATION OF REMEDY AND LIABILITY: BUYER'S SOLE AND EXCLUSIVE REMEDY FOR BREACH OF ANY WARRANTY HEREUNDER SHALL BE LIMITED TO REPAIR, CORRECTION, REPLACEMENT OR REFUND OF THE PURCHASE PRICE UNDER SECTION 8. SELLER SHALL NOT BE LIABLE FOR DAMAGES CAUSED BY DELAY IN PERFORMANCE, AND THE REMEDIES OF BUYER UNDER THE AGREED TERMS AS PROVIDED HEREIN ARE EXCLUSIVE. IN NO EVENT, REGARDLESS OF THE FORM OF THE CLAIM OR CAUSE OF ACTION (WHETHER BASED IN CONTRACT, INFRINGEMENT, NEGLIGENCE, STRICT LIABILITY, ANY OTHER TORT OR OTHERWISE), SHALL SELLER'S LIABILITY TO BUYER AND/OR ITS CUSTOMERS EXCEED THE PRICE PAID BY BUYER FOR THE SPECIFIC GOODS PROVIDED BY SELLER GIVING RISE TO THE CLAIM OR CAUSE OF ACTION. BUYER AGREES THAT IN NO EVENT SHALL SELLER'S LIABILITY TO BUYER AND/OR ITS CUSTOMERS EXTEND TO INCLUDE LIQUIDATED, INCIDENTAL, CONSEQUENTIAL, PUNITIVE, EXEMPLARY OR SPECIAL DAMAGES, INCLUDING BUT NOT LIMITED TO, LOSS OF PROFITS OR ANTICIPATED PROFITS, LOSS OF ANTICIPATED SAVINGS OR REVENUE, LOSS OF INCOME, LOSS OF BUSINESS AND BUSINESS INTERRUPTION, LOSS OF USE, LOSS OF PRODUCTION, LOSS OF OPPORTUNITY, LOSS OF REPUTATION, AND/OR LOSS OR DAMAGE TO PROPERTY OR EQUIPMENT. THE FOREGOING LIMITATIONS OF LIABILITY SHALL BE EFFECTIVE WITHOUT REGARD TO SELLER'S ACTS OR OMISSIONS OR NEGLIGENCE OR STRICT LIABILITY IN THE PERFORMANCE OR NON-PERFORMANCE HEREUNDER. It is expressly understood that any technical advice furnished by Seller with respect to the use of the Goods is given without charge, and Seller assumes no obligation or liability for the advice given, or result obtained, and all such advice being given is accepted at Buyer's risk.

10. Buyer Warranty: Buyer warrants the accuracy of any and all information relating to the details of its operating conditions, including temperatures, pressures, and where applicable, the nature of all hazardous materials. Seller can justifiably rely upon the accuracy of Buyer's information in its performance. Should Buyer's information prove inaccurate, Buyer agrees to reimburse Seller for any losses, liabilities, damages and expenses that Seller may have incurred as a result of any inaccurate information provided by Buyer to Seller.

11. EXCUSE OF PERFORMANCE/FORCE MAJEURE: Seller shall not be liable for delays in performance or for non-performance due to acts of God; acts of Buyer; war; fire; flood; weather; natural disasters; terrorism; sabotage; strikes; labor disputes; civil disturbances or riots; currency restrictions; pandemics; disease; governmental requests, restrictions, allocations, laws, regulations, orders or actions; unavailability of or delays in transportation or in obtaining materials, fuel, power and energy; default of suppliers; or unforeseen circumstances or any events or causes beyond Seller's reasonable control. Deliveries or other performances may be suspended for an appropriate period of time or canceled by Seller upon notice to Buyer in the event of any occurrence of the foregoing, but the balance of the agreement shall otherwise remain unaffected as a result of the foregoing. If Seller determines that its ability to supply the total demand for the Goods, or to obtain material used directly or indirectly in the manufacture of the Goods, is hindered, limited or made impracticable due to causes set forth hereinabove, Seller may allocate its available supply of the Goods or such material (without obligation to acquire other supplies of any such Goods or material) among itself and its buyers on such a basis as Seller determines to be equitable, in its sole discretion, without liability for any failure of performance which may result therefrom.

12. CANCELLATION: Except as otherwise provided herein, no order may be cancelled on special or made-to-order Goods unless requested in writing by either party and accepted in writing by the other party. In the event of a cancellation by Buyer, Buyer shall, within thirty (30) days of such cancellation, pay Seller a cancellation fee, which shall include all costs and expenses incurred by Seller prior to the receipt of the request for cancellation, including but not limited to, all commitments to its suppliers, subcontractors and others, all fully burdened labor and overhead expended by Seller, plus a reasonable profit charge. Return of Goods shall be in accordance with Seller's most current return policy and subject to a minimum thirty percent (30%) restocking fee, unless otherwise agreed to by the parties in writing. Notwithstanding anything to the contrary herein, in the event that: (i) there is a commencement by or against Buyer of any voluntary or involuntary proceedings in bankruptcy or insolvency; (ii) it is determined Buyer is insolvent; (iii) Buyer makes a general assignment for the benefit of its creditors; (iv) a receiver is appointed on account of Buyer's insolvency; (v) Buyer fails to make payment when due under the agreed terms as provided herein; or (vi) Buyer does not correct or, if immediate correction is not possible, commence and diligently continue action to correct any default of Buyer to comply with any of the provisions or requirements of the agreed terms as provided herein within ten (10) calendar



days after being notified in writing of such default by Seller, Seller may, by written notice to Buyer, without prejudice to any other rights or remedies which Seller may have, terminate its further performance hereunder. In the event of such termination, Seller shall be entitled to receive payment as if Buyer has cancelled its purchase order pursuant to this paragraph. Seller may nevertheless elect to complete its performance of under the agreed terms provided herein by any means it chooses. Buyer agrees to be responsible for any additional costs incurred by Seller in so doing. Upon termination of the agreed terms as provided herein, the rights, obligations and liabilities of the parties, which shall have arisen or been incurred hereunder prior to its termination, shall survive such termination.

13. CHANGES: Buyer may request changes or additions to the Goods consistent with the Seller's specifications and criteria. In the event Seller accepts such changes or additions, Seller may revise the price and dates of delivery. Seller reserves the right to change the design and specifications for the Goods without prior notice to the Buyer, except with respect to Goods being made-to-order for Buyer. Seller shall have no obligation to install or make such change in any Goods manufactured prior to the date of notification of such change.

14. NUCLEAR/FIRE/MEDICAL: GOODS SOLD HEREUNDER ARE NOT FOR USE IN CONNECTION WITH ANY NUCLEAR, FIRE SYSTEMS, MEDICAL, LIFE-SUPPORT AND RELATED APPLICATIONS. Buyer accepts Goods with the foregoing understanding, and agrees to communicate same in writing to any subsequent purchasers or users, and to defend, indemnify and hold harmless Seller for any claims, losses, suits, judgments and damages, including incidental and consequential damages, arising from such use, whether the cause be based in tort, contract or otherwise, including allegations that the Seller's liability is based on negligence or strict liability.

15. ASSIGNMENT: Buyer shall not assign its rights or delegate its duties hereunder, or any interest herein, without the prior written consent of Seller, and any such assignment, without such consent, shall be null and void.

16. INSPECTION/TESTING: Buyer shall have the right to inspect the Goods upon their receipt. When delivery is to Buyer's site or to a project site ("Site"), Buyer shall notify Seller in writing of any nonconformity of the Goods with the quotation, estimate or bid, or the agreed terms as provided herein, within three (3) days from receipt of the Goods by Buyer, unless a shorter period is required in Seller's quotation, estimate or bid. For all other deliveries, Buyer shall notify Seller in writing of any nonconformity of the Goods with the quotation, estimate or bid, or the agreed terms as provided herein, within fourteen (14) days from receipt of the Goods by Buyer. Failure to give such applicable notice shall constitute a waiver of Buyer's right to inspect and/or reject the Goods for nonconformity, and shall be equivalent to an irrevocable acceptance of the Goods by Buyer. Claims for loss of or damage to Goods in transit must be made to the carrier, and not to Seller. Buyer, at its option and sole expense, may inspect and observe the testing by Seller of the Goods for compliance with Seller's standard test procedures prior to shipment, which inspection and testing shall be conducted at Seller's plant at such reasonable time as is determined by Seller. Any rejection of the Goods must be made promptly by Buyer before shipment. Tests shall be deemed to be satisfactorily completed, and the test fully met, when the Goods meet Seller's criteria for such procedures. Acceptance by Buyer, or Buyer's representative, of any witnessed testing or coatings will preclude any future rejection.

17. STANDARD TOLERANCE: Except for made-to-order Goods specified by the Buyer in writing and expressly agreed to in writing by Seller, all Goods furnished hereunder are produced in accordance with the standard manufacturing practices in the country of origin of the Goods. All materials incorporated into the Goods are subject to mill tolerances and variations consistent with normal manufacturing practices for dimension, weight, straightness, section, composition and mechanical properties, normal surface and internal conditions, and deviations in quality resulting from practical testing. Seller is not responsible for any deterioration in quality as a result of the foregoing tolerances and variations.

18. DRAWINGS: Seller's prints and drawings (including without limitation, the underlying technology) furnished by Seller to Buyer in connection with Seller's quotation, estimate or bid are the property of Seller, and Seller retains all rights, including without limitation, exclusive rights of use and license. Buyer shall return all copies (in whatever medium) of such prints or drawings to Seller immediately upon request by Seller. Seller does not supply detailed or shop working drawings of the Goods; however, Seller will supply necessary installation drawings. The drawings and bulletin illustrations submitted with Seller's quotation, estimate or bid, show general type, arrangement and approximate dimensions of the Goods to be furnished for Buyer's information only, and Seller makes no representation or warranty regarding their accuracy. Unless expressly stated to the contrary within the quotation, estimate or bid, all drawings, illustrations, specifications or diagrams form no part of the agreed terms as provided herein. Seller reserves the right to alter such details in design or arrangement of its Goods which, in its sole discretion, constitute an improvement in construction, application or operation of the Goods. All engineering information necessary for installation of the Goods shall be forwarded by Seller to Buyer at the time the Goods are shipped. After Buyer's acceptance of Seller's quotation, estimate or bid, any changes requested by Buyer in the type of Goods, the arrangement of the Goods, or the application of the Goods will be made at Buyer's expense. Instructions necessary for installation, operating and maintenance will be supplied when the Goods are shipped.

19. EXPORT/IMPORT: Buyer agrees that all applicable import and export control laws, regulations, orders and requirements, including without limitation those of the United States and the European Union, and the jurisdictions in which the Seller and Buyer are established, or from which the Goods may be supplied, will apply to the Goods receipt and use. In no event shall Buyer use, transfer, release, import or export any Goods in violation of such applicable laws, regulations, orders or requirements. The Buyer shall not, and shall not permit any third parties to, directly or indirectly, export, re-export or release any Goods to any jurisdiction or country to which, or any party to whom, the export, re-export or release of any Goods is prohibited by applicable law, regulation or rule. The Buyer shall be solely responsible for any breach of this Section 19.

20. Proprietary Information, Injunction: Seller's designs, illustrations, drawings, specifications, technical data, catalogues, "know-how", economic or other business or manufacturing information (collectively "**Proprietary Information**") disclosed to Buyer shall be deemed proprietary and confidential to Seller. Buyer agrees not to disclose, use or reproduce any Proprietary Information without first having obtained Seller's express written consent. Buyer's agreement to refrain from disclosing, using or reproducing Proprietary Information shall survive completion of the work and delivery of the Goods under the agreed terms as provided herein. Buyer acknowledges that its improper disclosure of Proprietary Information to any third party will result in Seller's suffering irreparable harm. Seller may seek injunctive or equitable relief to prevent Buyer's unauthorized disclosure of Proprietary Information.

21. Installation and Start-up: Unless otherwise agreed to in writing by Seller, installation of the Goods shall be the sole responsibility of Buyer. In the event Buyer has engaged Seller to provide an engineer for start-up supervision, such engineer will function in a supervisory capacity only, and Seller shall have no responsibility for the quality of workmanship of the installation. Buyer understands and agrees that it shall furnish, at Buyer's sole expense, all necessary foundations, supplies, labor and facilities that might be required to install and operate the Goods.

22. INSURANCE: Buyer agrees to do all acts necessary to protect Seller's interest by adequately insuring the Goods against loss or damage from any external cause, with Seller named as insured, additional insured or co-insured. Seller and Buyer agree to maintain liability insurance in commercially reasonable amounts covering claims of any kind or nature for damage to property or personal injury, including death, made by anyone that may arise from activities performed or facilitated related to the Goods, whether these activities are performed by that company, its employees, agents, or anyone directly engaged or employed by that party or its agents.

23. GENERAL PROVISIONS: These terms and conditions herein supersede all other communications, negotiations, and prior oral or written statements regarding the subject matter of the agreed terms as provided herein. No change, modification, rescission, discharge, abandonment, or waiver of these terms and conditions shall be binding upon the Seller, unless made in writing and signed on its behalf by a duly authorized officer of Seller. No conditions, usage of trade, course of dealing or performance, understanding or agreement purporting to modify, vary, explain, or supplement these terms and conditions shall be binding unless hereafter made in writing and signed by the party to be bound, and no modification or additional terms shall be applicable to the agreed terms as provided herein by Seller's receipt, acknowledgement, or acceptance of purchase orders, shipping instruction forms, or other documentation containing terms at variance with or in addition to those set forth herein. Any such modifications or additional terms are specifically rejected and deemed a material alteration hereof. If this document

shall be deemed an acceptance of a prior offer by Buyer, such acceptance is expressly conditional upon Buyer's assent to any additional or different term set forth herein. There is no waiver by either party with respect to any other breach or default of any other right or remedy, unless such waiver be expressed in writing and signed by the party to be bound. All typographical or clerical errors made by Seller in any quotation, estimate or bid, acknowledgement or publication are subject to correction. No action, regardless of form, arising out of transactions relating to this contract, may be brought by either party more than two years after the cause of action has accrued.

24. GOVERNING LAW: THE AGREED TERMS AS PROVIDED HEREIN, AND THE VALIDITY, PERFORMANCE, AND ALL OTHER MATTERS RELATING TO THE INTERPRETATION AND EFFECT OF AND ALL RIGHTS AND OBLIGATIONS HEREUNDER, SHALL BE GOVERNED BY THE LAWS OF THE STATE OF TEXAS, WITHOUT REFERENCE TO PRINCIPLES OF CONFLICTS OF LAW. SUBJECT TO THE ARBITRATION PROVISION AS PROVIDED HEREINABOVE, THE JURISDICTION OF ANY PROCEEDING RELATED TO THE GOODS SHALL BE IN THE STATE OF TEXAS AND VENUE SHALL BE LUBBOCK COUNTY, TEXAS. THE RIGHTS AND OBLIGATIONS OF THE PARTIES HEREUNDER SHALL NOT BE GOVERNED BY THE 1980 U.N. CONVENTION ON CONTRACTS FOR THE INTERNATIONAL SALE OF GOODS.

25. Titles: The section titles herein are for reference only, and shall not limit or restrict the interpretation or construction of this Agreement.

26. Waiver: Seller's failure to insist, in any one or more instances, upon Buyer's performance of this Agreement, or to exercise any rights conferred, shall not constitute a waiver or relinquishment of any such right or right to insist upon Buyer's performance in any other regard.

27. Severability: The partial or complete invalidity of any one or more provisions of this Agreement shall not affect the validity or continuing force and effect of any other provision

**2875 RPM
Selection Chart**

Model	Bowl Dia. (cm.)	Peak Eff. (Max Dia.)	BEP Flow (m ³ /h)	BEP Head (m. / Stage)	BEP NPSHr (m. H ₂ O)	POR (m ³ /h)	ns (SI)	S (SI)
SP5XXL	13.3	73.2	18.3	10.0	1.3	13-22	37	169
SP5XL	13.3	75.2	19.9	10.9	1.7	14-24	36	146
SP5L	13.3	76.7	23.0	12.9	2.2	16-28	34	129
SP5LO	13.3	75.1	19.0	9.8	2.0	13-23	38	127
SM5M	13.3	69.0	37.1	6.7	2.2	26-45	70	162
SM5H	13.3	72.2	48.6	7.9	4.4	34-58	71	111
SP6LL	15.2	71.8	22.9	12.3	2.3	16-27	35	125
SP6M	15.2	73.3	28.2	14.3	2.3	20-34	35	138
SP6H	15.2	76.6	42.5	16.6	3.2	30-51	38	130
SP6LO	15.2	75.5	30.6	12.6	3.5	21-37	40	104
SP6MO	15.2	75.2	34.5	13.4	3.2	24-41	40	117
SM6M	15.2	76.9	34.1	12.2	2.5	24-41	43	139
SM6H	15.2	79.1	42.0	14.6	2.9	29-50	42	140
SK6HH	14.0	78.9	82.5	8.8	5.4	58-99	85	123
SP7L	18.3	81.7	70.9	20.7	2.9	50-85	42	181
SP7H	18.3	81.1	91.2	23.3	4.0	64-109	43	161
SK7L	16.7	78.4	74.4	12.8	4.4	52-89	61	137
SK7M	16.7	78.1	84.6	13.0	1.4	59-102	64	338
SK7H	16.7	77.0	107	14.5	2.2	75-129	67	273
SM7M	17.8	76.5	100.5	14.7	4.6	70-121	64	152
SM7H	17.8	77.9	143.7	14.6	7.4	101-172	77	128
SP8L	20.0	76.4	53.0	22.9	3.3	37-64	33	144
SP8M	20.0	77.1	59.1	22.7	2.7	41-71	35	175
SP8H	20.0	78.1	69.1	26.3	3.6	48-83	34	152
SM8H	19.5	78.2	107	22.9	4.2	75-128	47	169
SK8H	19.1	77.9	210	18.0	13.2	147-251	80	100
SM9L	24.1	81.1	106	39.6	5.0	74-127	31	147
SM9M	24.1	82.0	132	43.6	7.9	92-158	32	117
SP9L	24.1	81.1	108	40.9	3.9	75-129	31	179
SP9M	24.1	79.1	120	42.8	5.0	84-144	31	156
SL9H	22.9	79.6	190	35.6	7.4	133-228	45	147
SF9H	24.1	80.6	227	42.3	14.1	159-272	44	99
SK9M	24.0	77.1	348	27.5	9.2	244-418	74	170
SP10M	25.9	80.1	162	40.0	8.1	113-194	38	127
SP10H	25.9	80.4	168	45.5	6.6	118-202	36	151
SM10M	25.9	79.5	243	38.7	8.6	170-291	48	148
SM10H	25.9	79.5	274	42.1	9.3	192-329	48	149
SM10MO	25.9	79.7	241	40.8	8.6	169-290	46	149
SM10HO	25.9	77.9	243	43.0	8.7	170-291	45	148
SM11M	27.0	78.5	247	42.6	14.4	173-297	45	102
SL11L	27.9	84.2	277	51.7	7.7	194-333	41	173
SL11M	27.9	85.3	306	54.9	7.8	214-367	42	180
SL11H	27.9	81.7	372	52.1	5.2	261-447	48	270


v26.1



SP5XXL

2875 RPM

ONE ()
STAGE STAGE

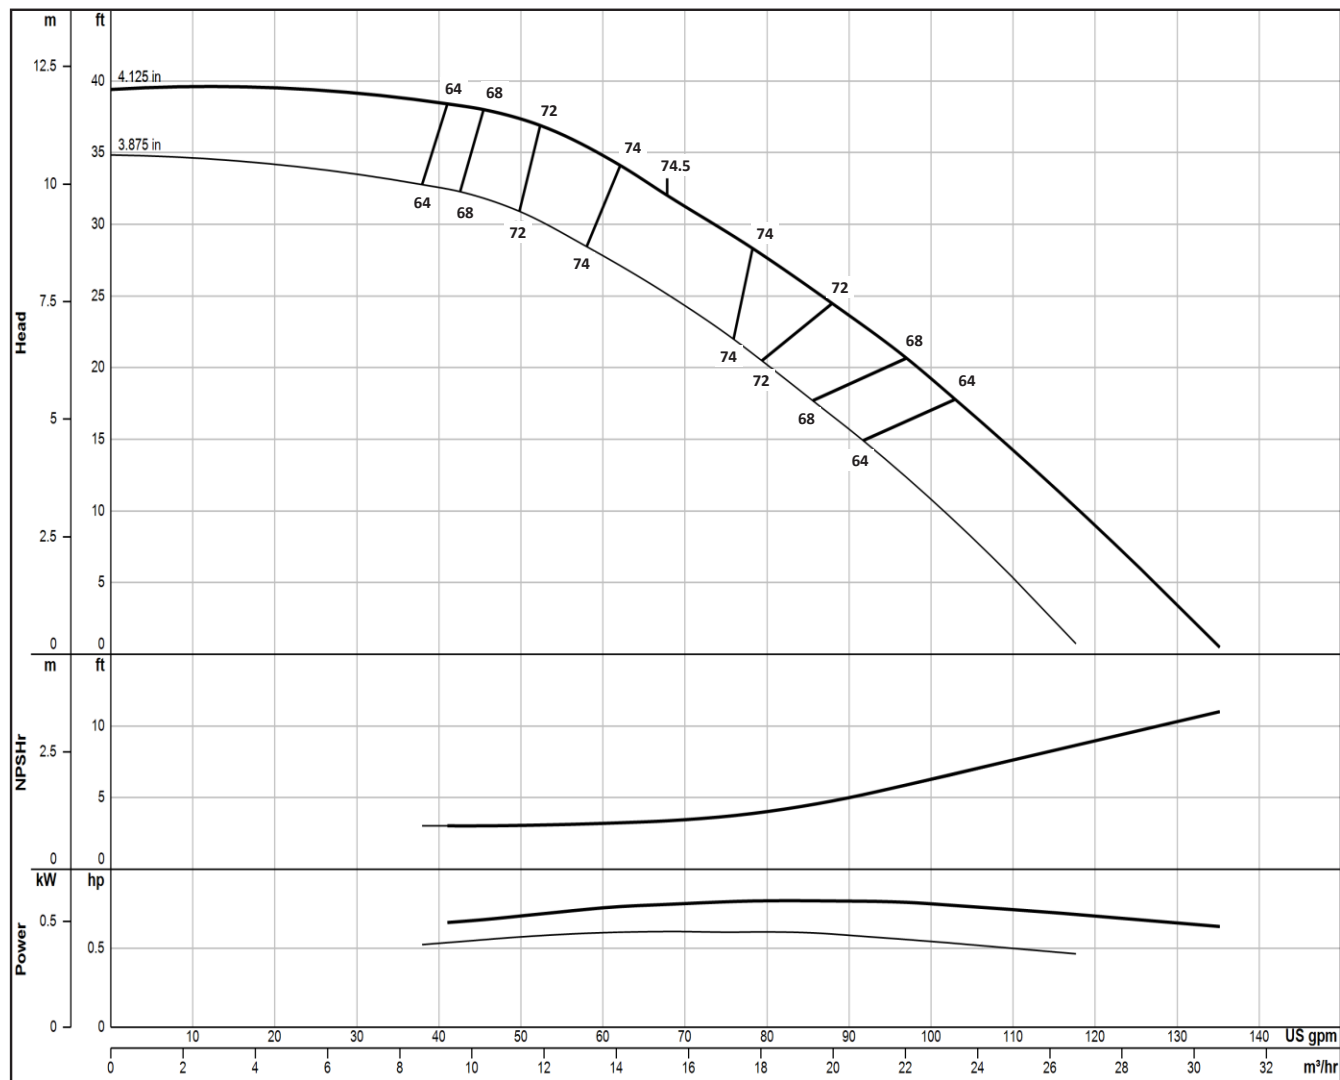

Impeller Type	Enclosed	Bowl Ø (cm)	13.3	ns (SI)	37	Qty.	Eff.
Impeller Model	SP5XXL	Thd'd Discharge (cm)	8, 10	S (SI)	169	Stages	Change
One Stage Weight (kg)	22.7	Thd'd Suction (cm)	10	PEIcl	0.89	1	-4
Add'l Stage Wt. (kg)	6.4	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.22	2	-3
Impeller Wt. (kg)	0.8	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	0.75	3	-2
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	3647	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	45.4	D.I. Bowl Rating (kPa)	7902	K-Factor (kg/m-tdh)	2.6	5	0
Add'l Stage Length (cm)	11.8	316 Bowl Rating (kPa)	8510	Imp. WR² (kg-m²)	0.001		

Δ Consult factory for availability

2022-10-20

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP5XL

2875 RPM

ONE ()
STAGE STAGE

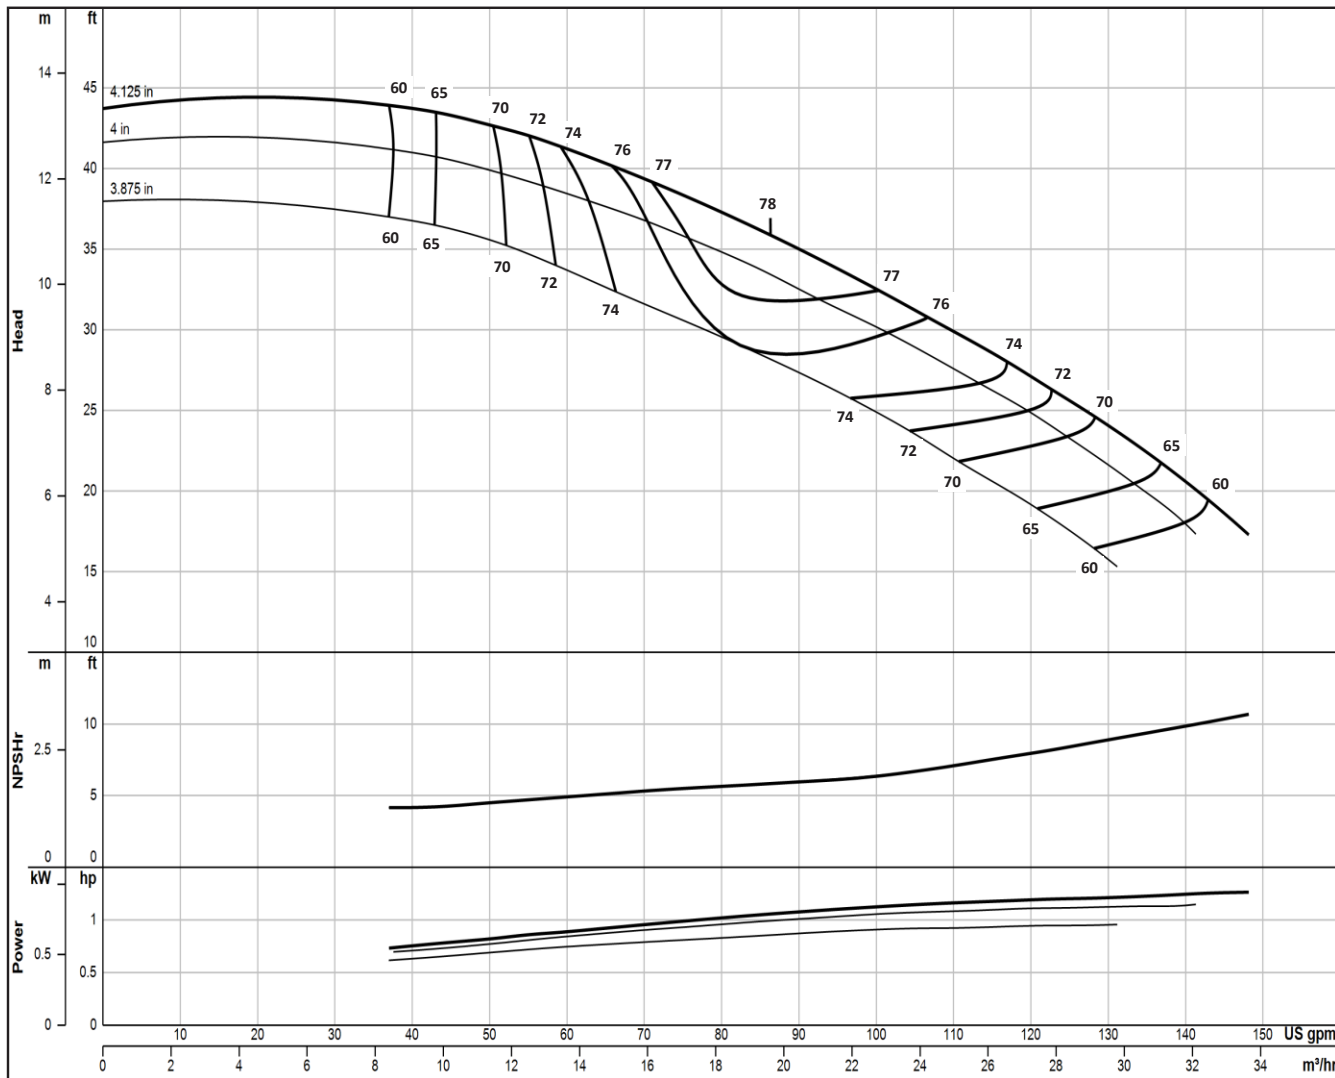

Impeller Type	Enclosed	Bowl Ø (cm)	13.3	ns (SI)	36	Qty.	Eff.
Impeller Model	SP5XL	Thd'd Discharge (cm)	8, 10	S (SI)	146	Stages	Change
One Stage Weight (kg)	22.7	Thd'd Suction (cm)	10	PEIcl	0.85	1	-4
Add'l Stage Wt. (kg)	6.4	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.22	2	-3
Impeller Wt. (kg)	0.8	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	0.75	3	-2
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	3647	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	45.4	D.I. Bowl Rating (kPa)	7902	K-Factor (kg/m-tdh)	3.4	5	0
Add'l Stage Length (cm)	11.8	316 Bowl Rating (kPa)	8510	Imp. WR ² (kg-m²)	0.001		

Δ Consult factory for availability

2022-10-20

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP5L

2875 RPM

ONE ()
STAGE STAGE

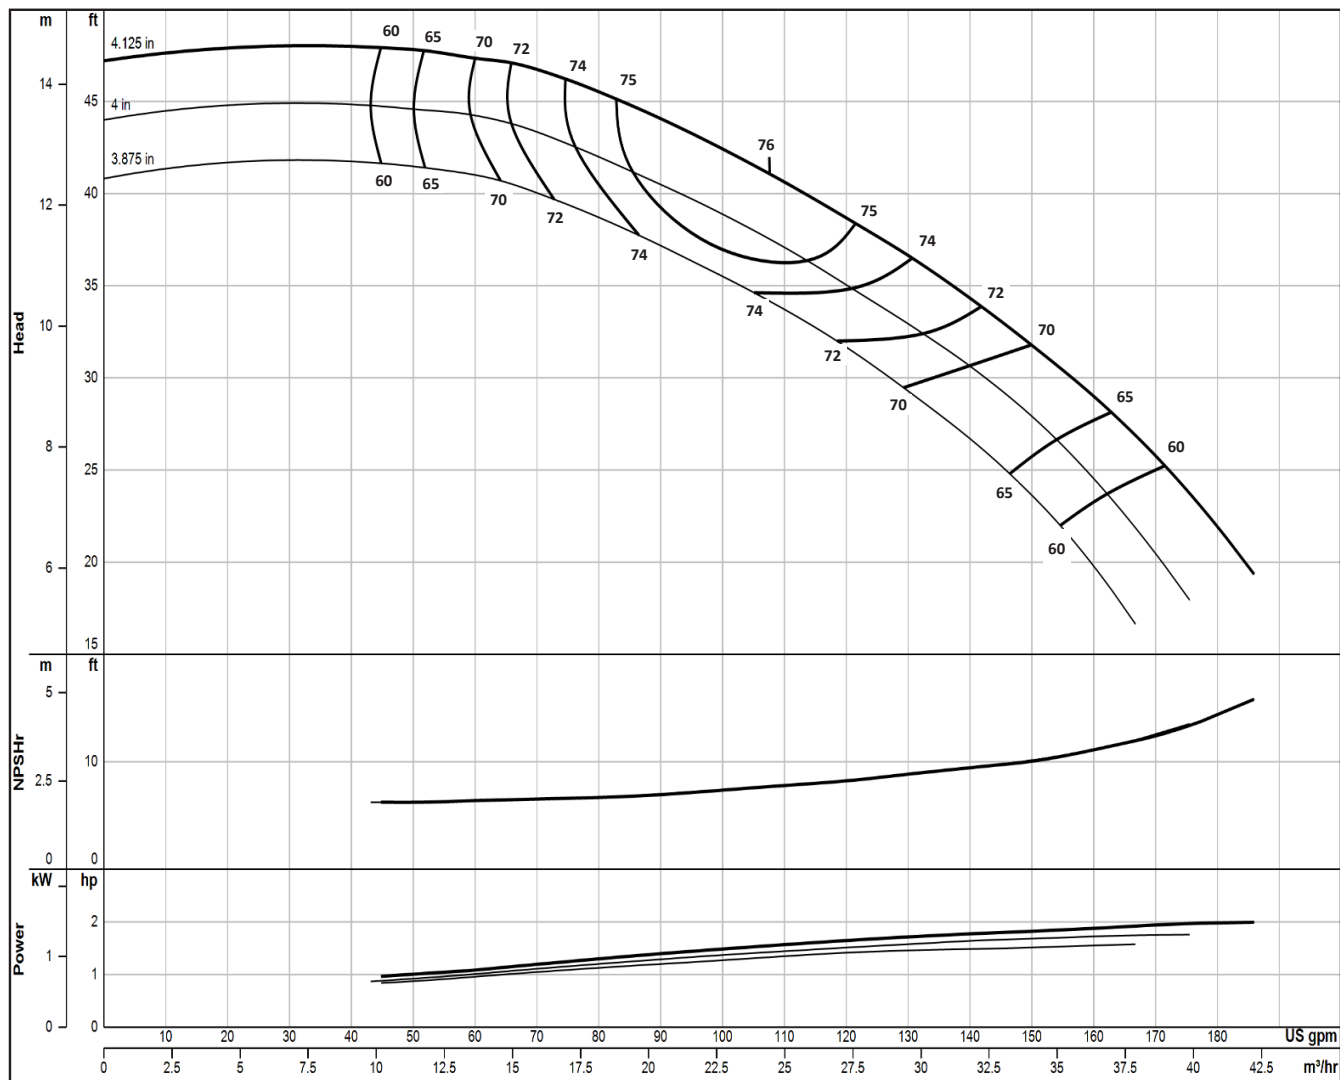

Impeller Type	Enclosed	Bowl Ø (cm)	13.3	ns (SI)	34	Qty.	Eff.
Impeller Model	SP5L	Thd'd Discharge (cm)	8, 10	S (SI)	129	Stages	Change
One Stage Weight (kg)	22.7	Thd'd Suction (cm)	10	PEIcl	0.88	1	-4
Add'l Stage Wt. (kg)	6.4	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.22	2	-3
Impeller Wt. (kg)	0.8	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	0.75	3	-2
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	3647	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	45.4	D.I. Bowl Rating (kPa)	7902	K-Factor (kg/m-tdh)	3.6	5	0
Add'l Stage Length (cm)	11.8	316 Bowl Rating (kPa)	8510	Imp. WR ² (kg-m²)	0.001		

Δ Consult factory for availability

2022-10-20

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM5M

2875 RPM

ONE ()
STAGE STAGE

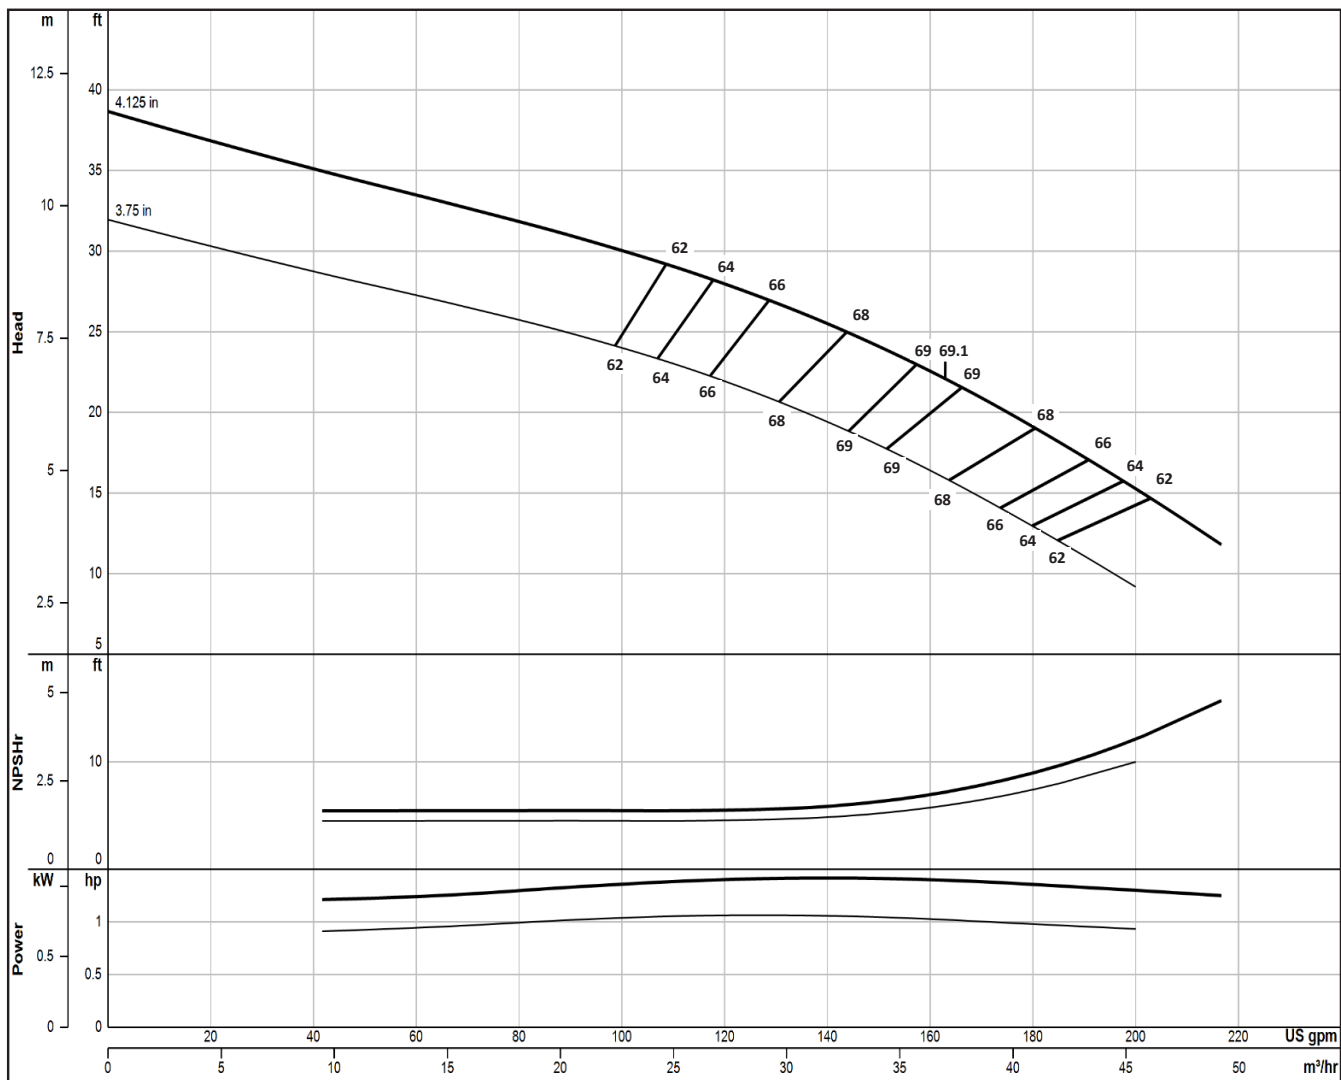

Impeller Type	Enclosed	Bowl Ø (cm)	13.3	ns (SI)	70	Qty.	Eff.
Impeller Model	SM5M	Thd'd Discharge (cm)	8, 10	S (SI)	162	Stages	Change
One Stage Weight (kg)	22.7	Thd'd Suction (cm)	10	PEIcI	0.97	1	-4
Add'l Stage Wt. (kg)	6.4	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.22	2	-3
Impeller Wt. (kg)	0.8	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.39	3	-2
Impeller Mtrl.	NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	46.1	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	3.7	5	0
Add'l Stage Length (cm)	12.4	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.001		

Δ Consult factory for availability

2021-06-08

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM5H

2875 RPM

ONE ()
STAGE STAGE

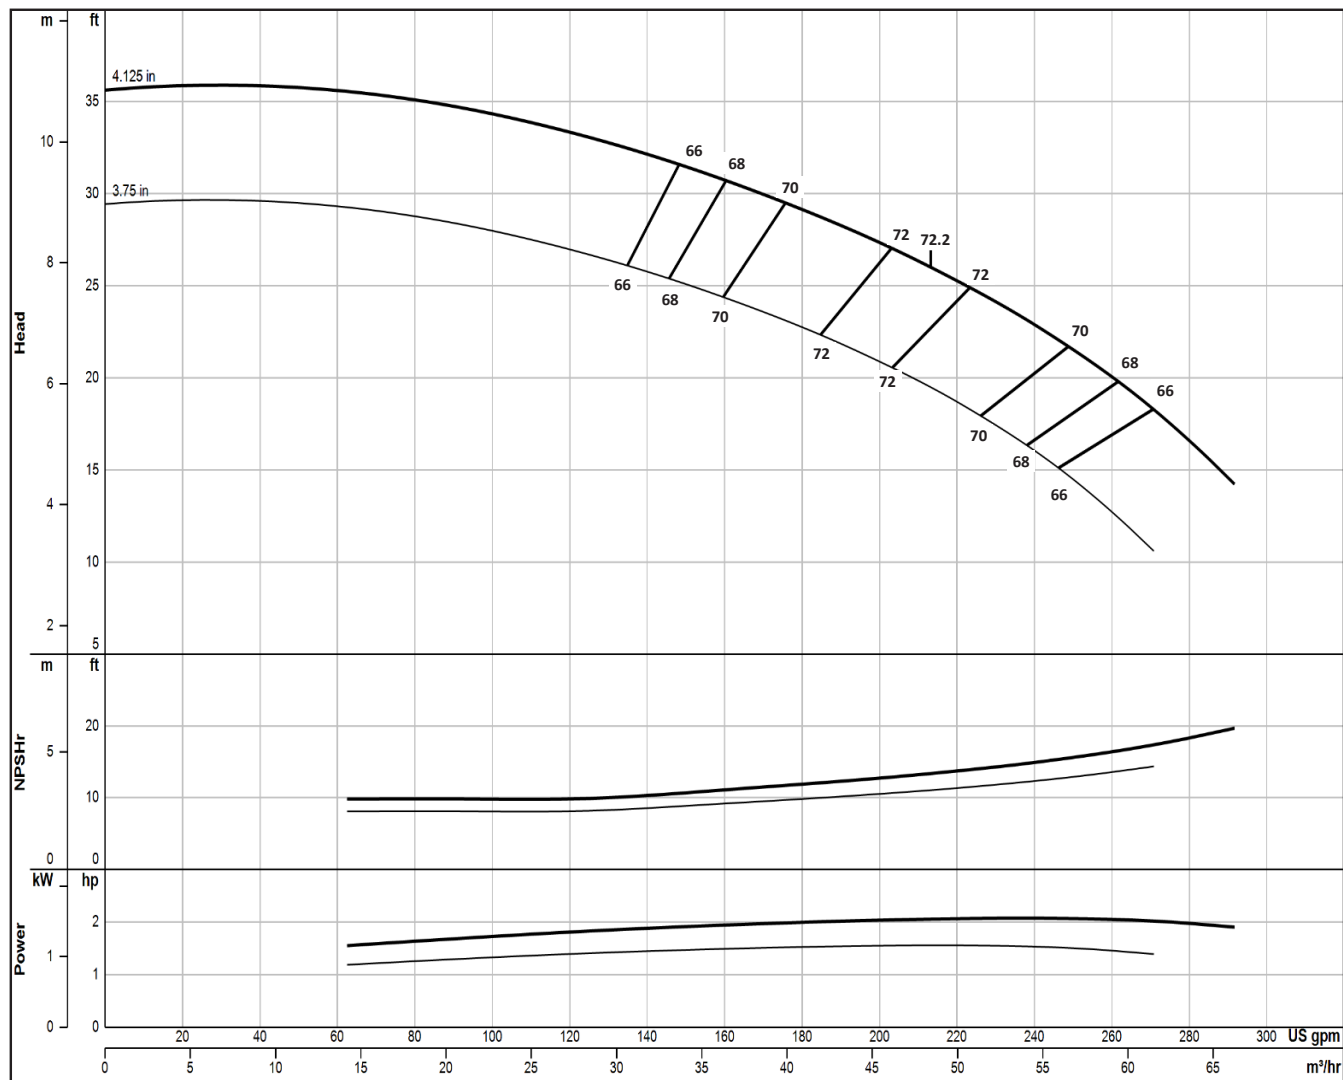

Impeller Type	Enclosed	Bowl Ø (cm)	13.3	ns (SI)	71	Qty.	Eff. Change
Impeller Model	SM5H	Thd'd Discharge (cm)	8, 10	S (SI)	111	Stages	
One Stage Weight (kg)	22.7	Thd'd Suction (cm)	10	PEIcl	0.90	1	-4
Add'l Stage Wt. (kg)	6.4	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.22	2	-3
Impeller Wt. (kg)	0.9	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.39	3	-2
Impeller Mtrl.	NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	46.1	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	3.7	5	0
Add'l Stage Length (cm)	12.4	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.001		

Δ Consult factory for availability

2020-07-07

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP5LO

2875 RPM

ONE ()
STAGE STAGE

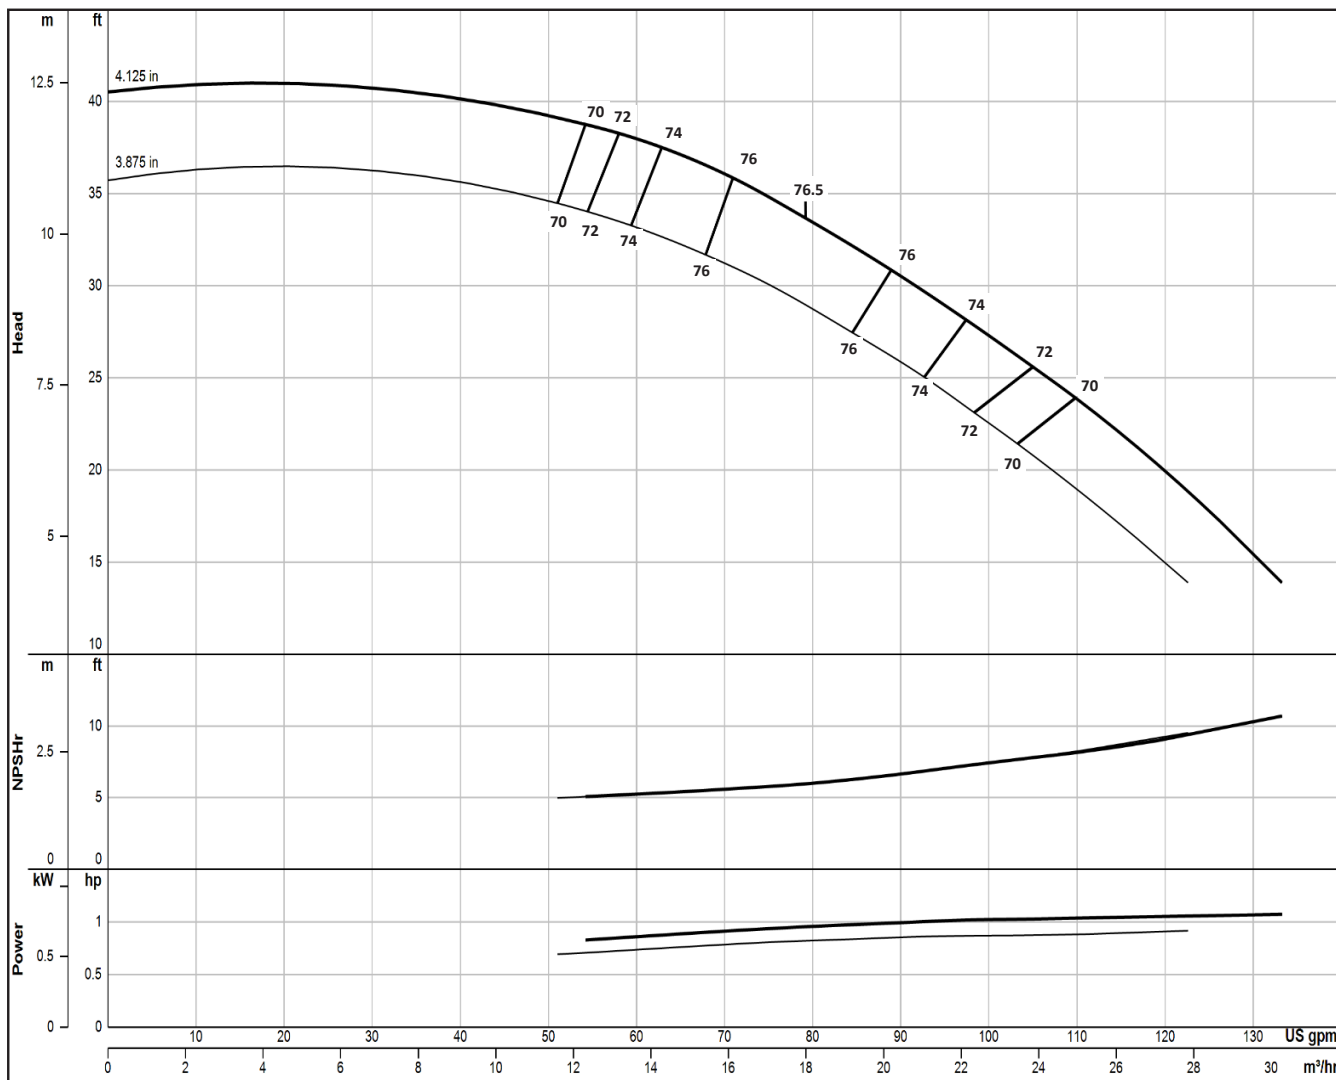

Impeller Type	Semi-Open	Bowl Ø (cm)	13.3	ns (SI)	38	Qty.	Eff.
Impeller Model	SP5LO	Thd'd Discharge (cm)	8, 10	S (SI)	127	Stages	Change
One Stage Weight (kg)	22.7	Thd'd Suction (cm)	10	PEIcl	0.88	1	-6
Add'l Stage Wt. (kg)	6.4	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.22	2	-4
Impeller Wt. (kg)	0.6	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	0.40	3	-3
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	3647	Imp. Setting (cm)	0.08	4	-1.5
One Stage Length (cm)	44.6	D.I. Bowl Rating (kPa)	7902	K-Factor (kg/m-tdh)	7.0	5	0
Add'l Stage Length (cm)	10.9	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.001		

Δ Consult factory for availability

2022-10-20

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP6LL

2875 RPM

ONE ()
STAGE STAGE

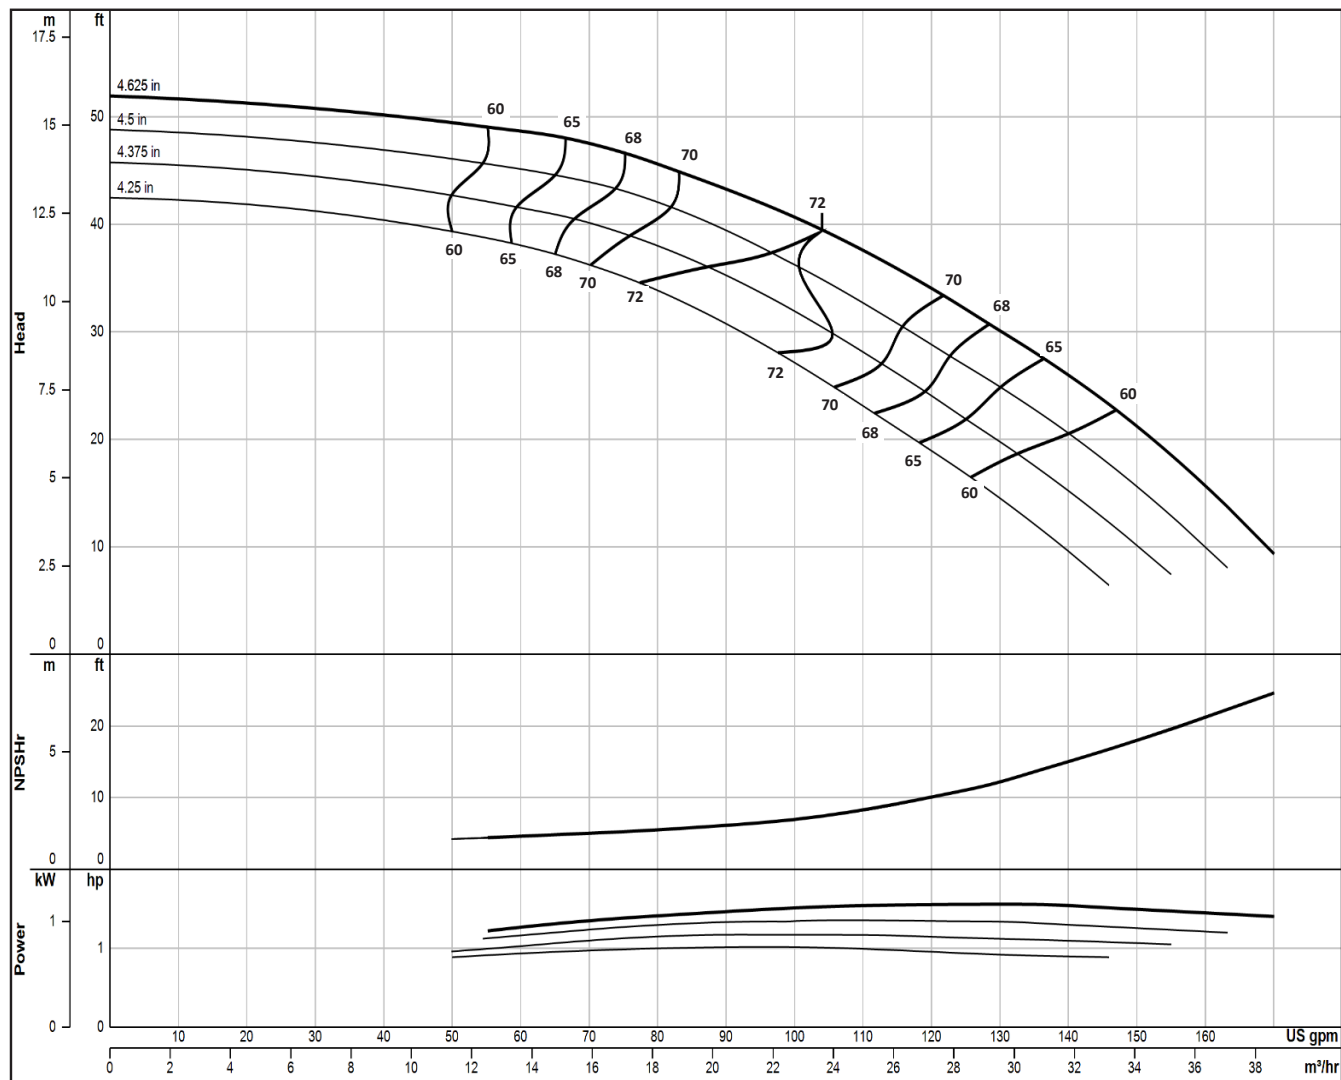

Impeller Type	Enclosed	Bowl Ø (cm)	15.2	ns (SI)	35	Qty.	Eff.
Impeller Model	SP6LL	Thd'd Discharge (cm)	8, 10	S (SI)	125	Stages	Change
One Stage Weight (kg)	26.3	Thd'd Suction (cm)	10	PEIcl	0.95	1	-4
Add'l Stage Wt. (kg)	8.2	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.54	2	-3
Impeller Wt. (kg)	1.2	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.67	3	-2
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	5912	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	46.8	D.I. Bowl Rating (kPa)	12809	K-Factor (kg/m-tdh)	4.0	5	0
Add'l Stage Length (cm)	12.2	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.002		

Δ Consult factory for availability

2022-10-20

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP6M

2875 RPM

ONE ()
STAGE STAGE

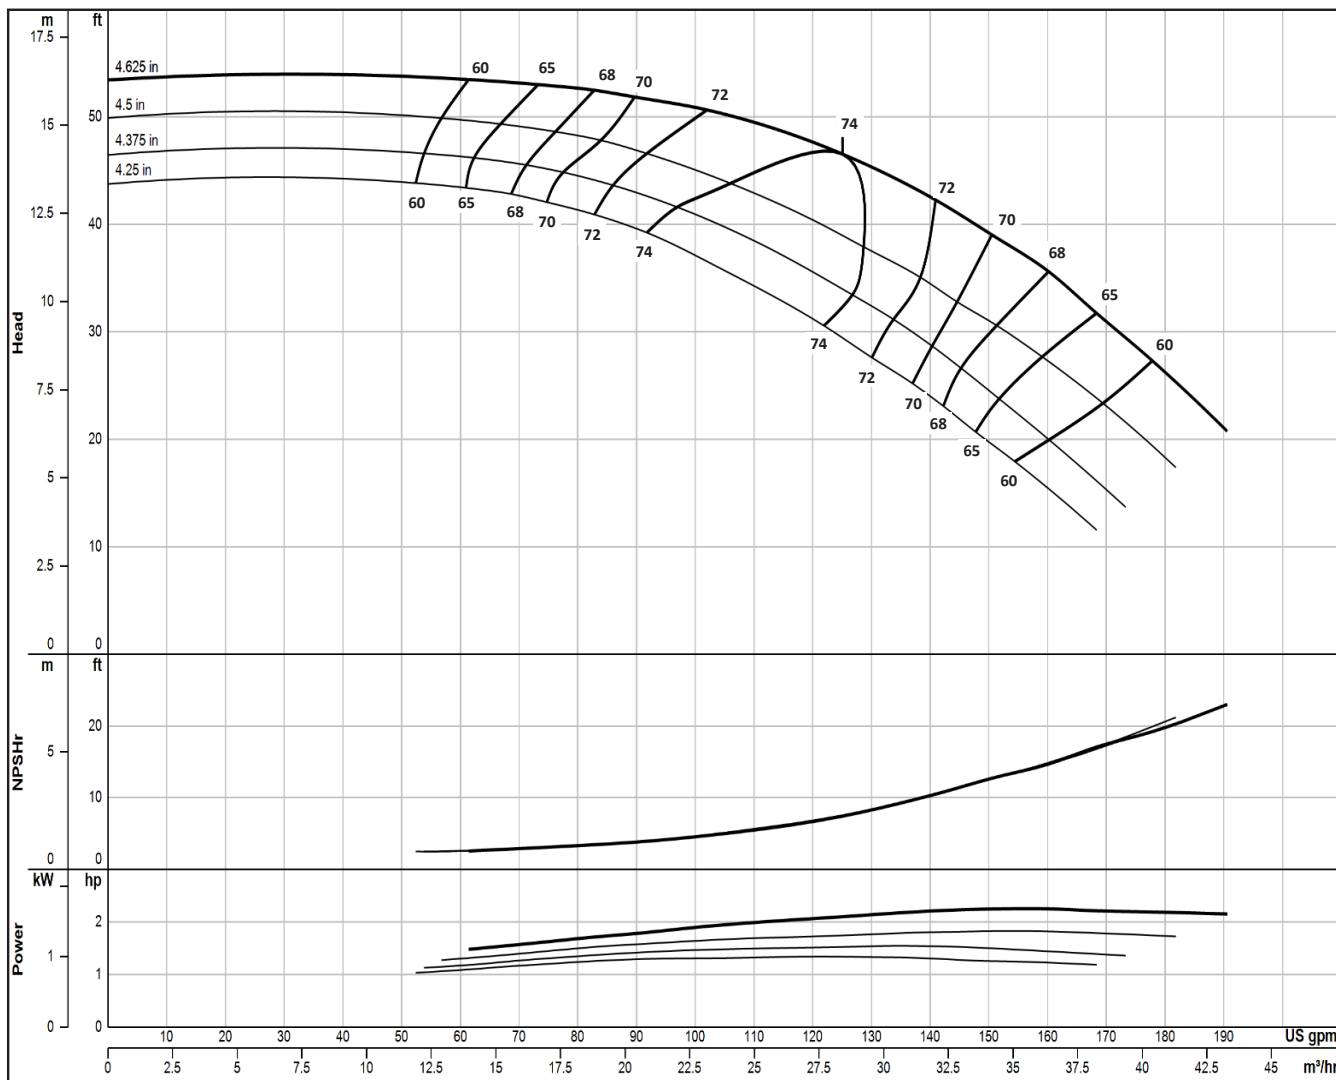

Impeller Type	Enclosed	Bowl Ø (cm)	15.2	ns (SI)	35	Qty.	Eff.
Impeller Model	SP6M	Thd'd Discharge (cm)	8, 10	S (SI)	138	Stages	Change
One Stage Weight (kg)	25.4	Thd'd Suction (cm)	10	PEIcI	0.97	1	-4
Add'l Stage Wt. (kg)	8.6	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.54	2	-3
Impeller Wt. (kg)	1.3	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.03	3	-2
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	5912	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	46.8	D.I. Bowl Rating (kPa)	12809	K-Factor (kg/m-tdh)	3.5	5	0
Add'l Stage Length (cm)	12.2	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.002		

Δ Consult factory for availability

2022-10-20

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP6H

2875 RPM

ONE ()
STAGE STAGE

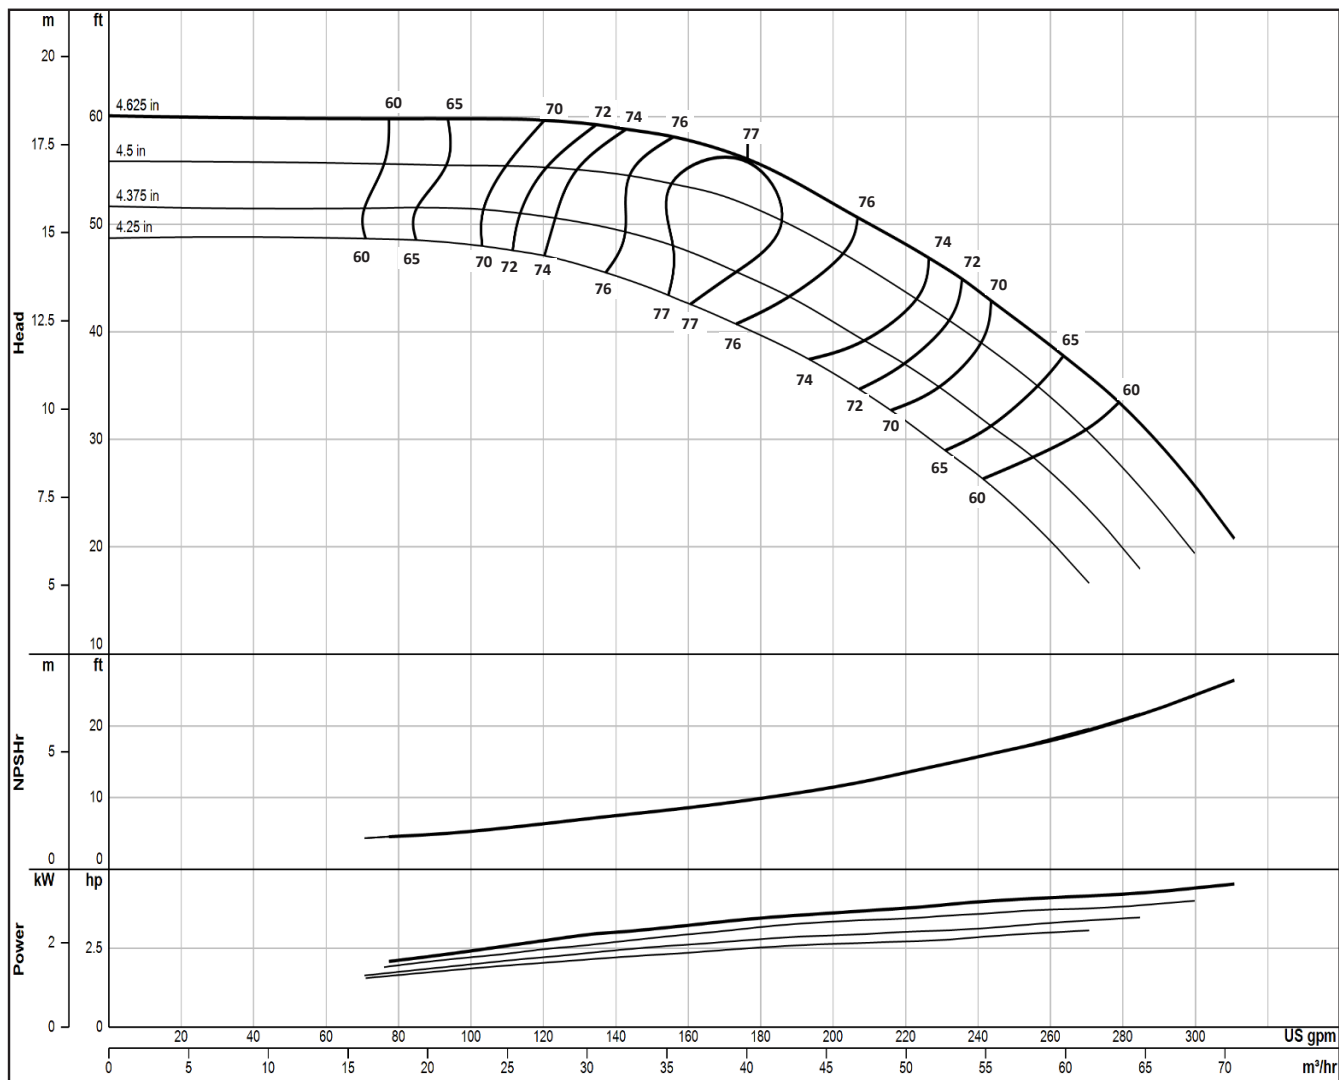

Impeller Type	Enclosed	Bowl Ø (cm)	15.2	ns (SI)	38	Qty.	Eff.
Impeller Model	SP6H	Thd'd Discharge (cm)	8, 10	S (SI)	130	Stages	Change
One Stage Weight (kg)	24.9	Thd'd Suction (cm)	10	PEIcl	0.97	1	-4
Add'l Stage Wt. (kg)	8.6	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.54	2	-3
Impeller Wt. (kg)	1.2	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	0.71	3	-2
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	5912	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	46.8	D.I. Bowl Rating (kPa)	12809	K-Factor (kg/m-tdh)	3.6	5	0
Add'l Stage Length (cm)	12.2	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.001		

Δ Consult factory for availability

2022-10-20

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP6LO

2875 RPM

ONE ()
STAGE STAGE

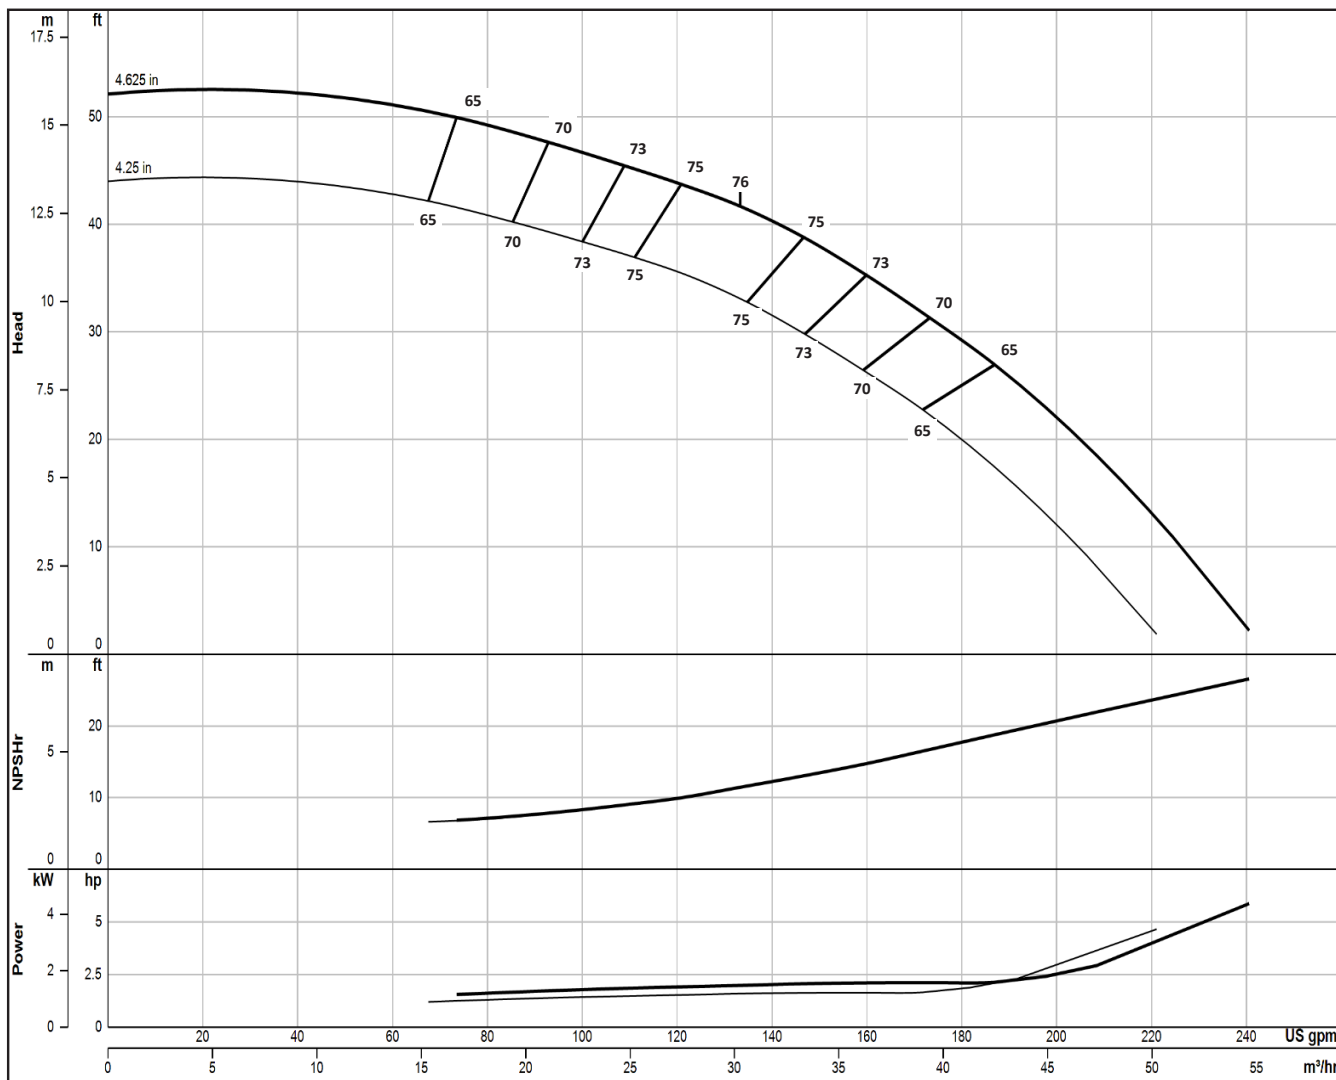

Impeller Type	Semi-Open	Bowl Ø (cm)	15.2	ns (SI)	40	Qty.	Eff.
Impeller Model	SP6LO	Thd'd Discharge (cm)	8, 10	S (SI)	104	Stages	Change
One Stage Weight (kg)	24.0	Thd'd Suction (cm)	10	PEIcI	0.95	1	-5.5
Add'l Stage Wt. (kg)	8.2	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.54	2	-4
Impeller Wt. (kg)	0.7	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.79	3	-3
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	5912	Imp. Setting (cm)	0.08	4	-1.5
One Stage Length (cm)	46.8	D.I. Bowl Rating (kPa)	12809	K-Factor (kg/m-tdh)	5.1	5	0
Add'l Stage Length (cm)	12.2	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.001		

Δ Consult factory for availability

2022-10-20

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP6MO

2875 RPM

ONE ()
STAGE STAGE

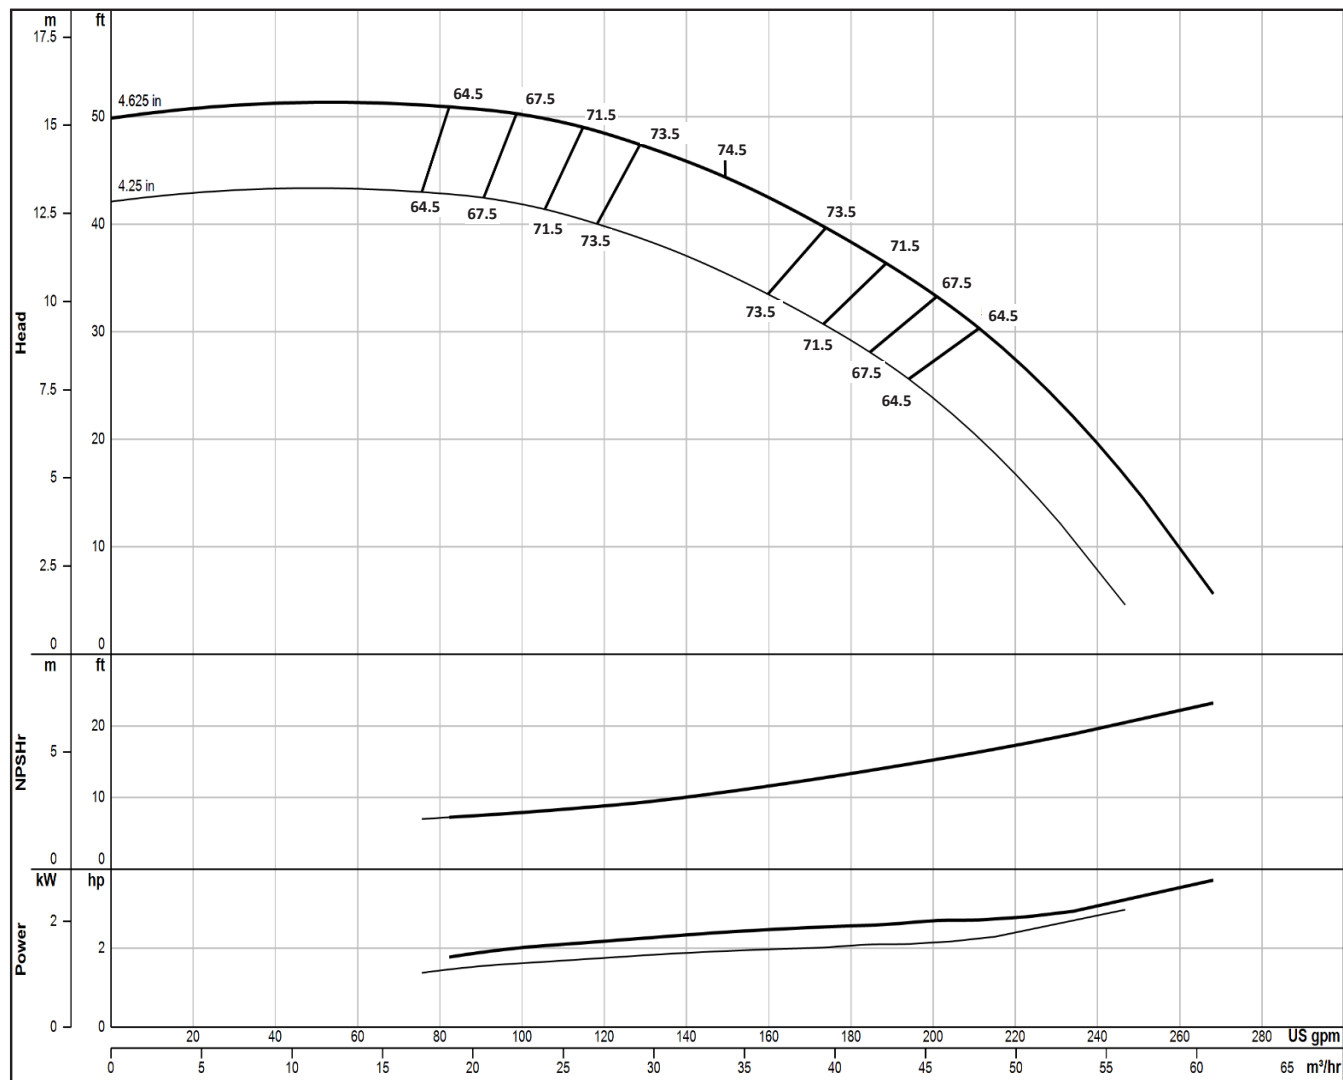

Impeller Type	Semi-Open	Bowl Ø (cm)	15.2	ns (SI)	40	Qty.	Eff. Change
Impeller Model	SP6MO	Thd'd Discharge (cm)	8, 10	S (SI)	117	Stages	
One Stage Weight (kg)	24.0	Thd'd Suction (cm)	10	PEIcl	0.96	1	-5
Add'l Stage Wt. (kg)	8.2	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.54	2	-4
Impeller Wt. (kg)	0.6	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.42	3	-3
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	5912	Imp. Setting (cm)	0.08	4	-1.5
One Stage Length (cm)	46.8	D.I. Bowl Rating (kPa)	12809	K-Factor (kg/m-tdh)	7.4	5	0
Add'l Stage Length (cm)	12.2	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.001		

Δ Consult factory for availability

2022-10-20

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM6M

2875 RPM

ONE ()
STAGE STAGE

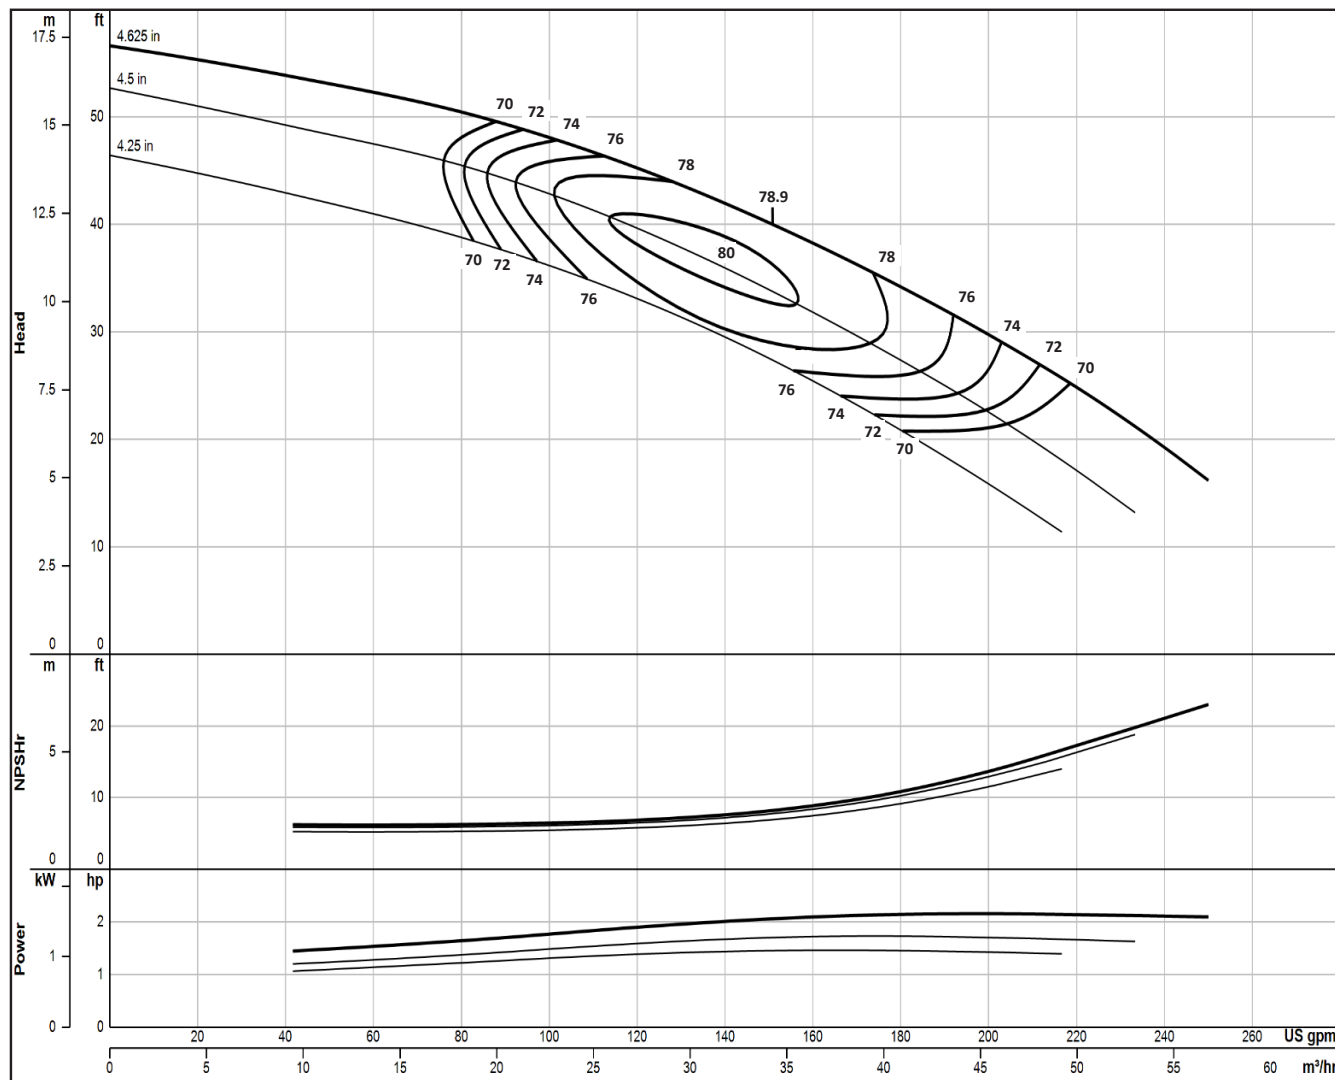

Impeller Type	Enclosed	Bowl Ø (cm)	15.2	ns (SI)	43	Qty.	Eff.
Impeller Model	SM6M	Thd'd Discharge (cm)	8, 10	S (SI)	139	Stages	Change
One Stage Weight (kg)	26.3	Thd'd Suction (cm)	10	PEIcl	0.88	1	-5
Add'l Stage Wt. (kg)	9.1	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.54	2	-4
Impeller Wt. (kg)	1.1	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.43	3	-3
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	-1.5
One Stage Length (cm)	47.5	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	3.1	5	0
Add'l Stage Length (cm)	13.3	316 Bowl Rating (kPa)	9883	Imp. WR ² (kg-m²)	0.002		

Δ Consult factory for availability

2022-10-22

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM6H

2875 RPM

ONE ()
STAGE STAGE

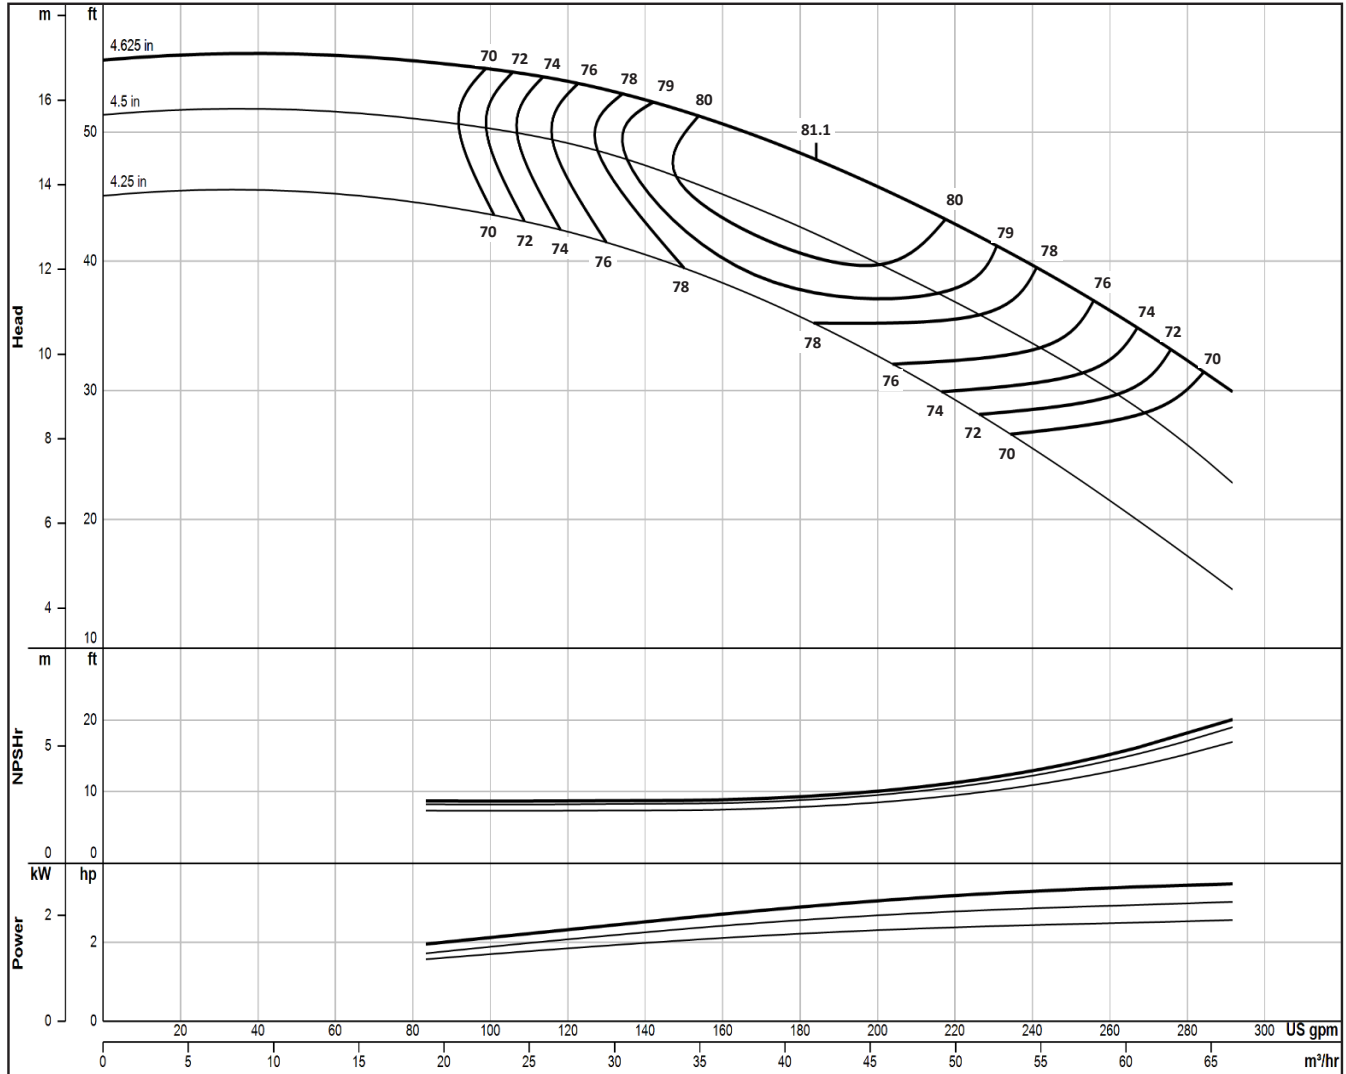

Impeller Type	Enclosed	Bowl Ø (cm)	15.2	ns (SI)	42	Qty.	Eff.
Impeller Model	SM6H	Thd'd Discharge (cm)	8, 10	S (SI)	140	Stages	Change
One Stage Weight (kg)	26.3	Thd'd Suction (cm)	10	PEIcl	0.88	1	-5
Add'l Stage Wt. (kg)	9.1	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.54	2	-4
Impeller Wt. (kg)	1.1	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.43	3	-3
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	-1.5
One Stage Length (cm)	47.5	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	3.1	5	0
Add'l Stage Length (cm)	13.3	316 Bowl Rating (kPa)	9883	Imp. WR² (kg-m²)	0.002		

Δ Consult factory for availability

2022-10-20


Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

SK6HH

2875 RPM

ONE ()
STAGE STAGE

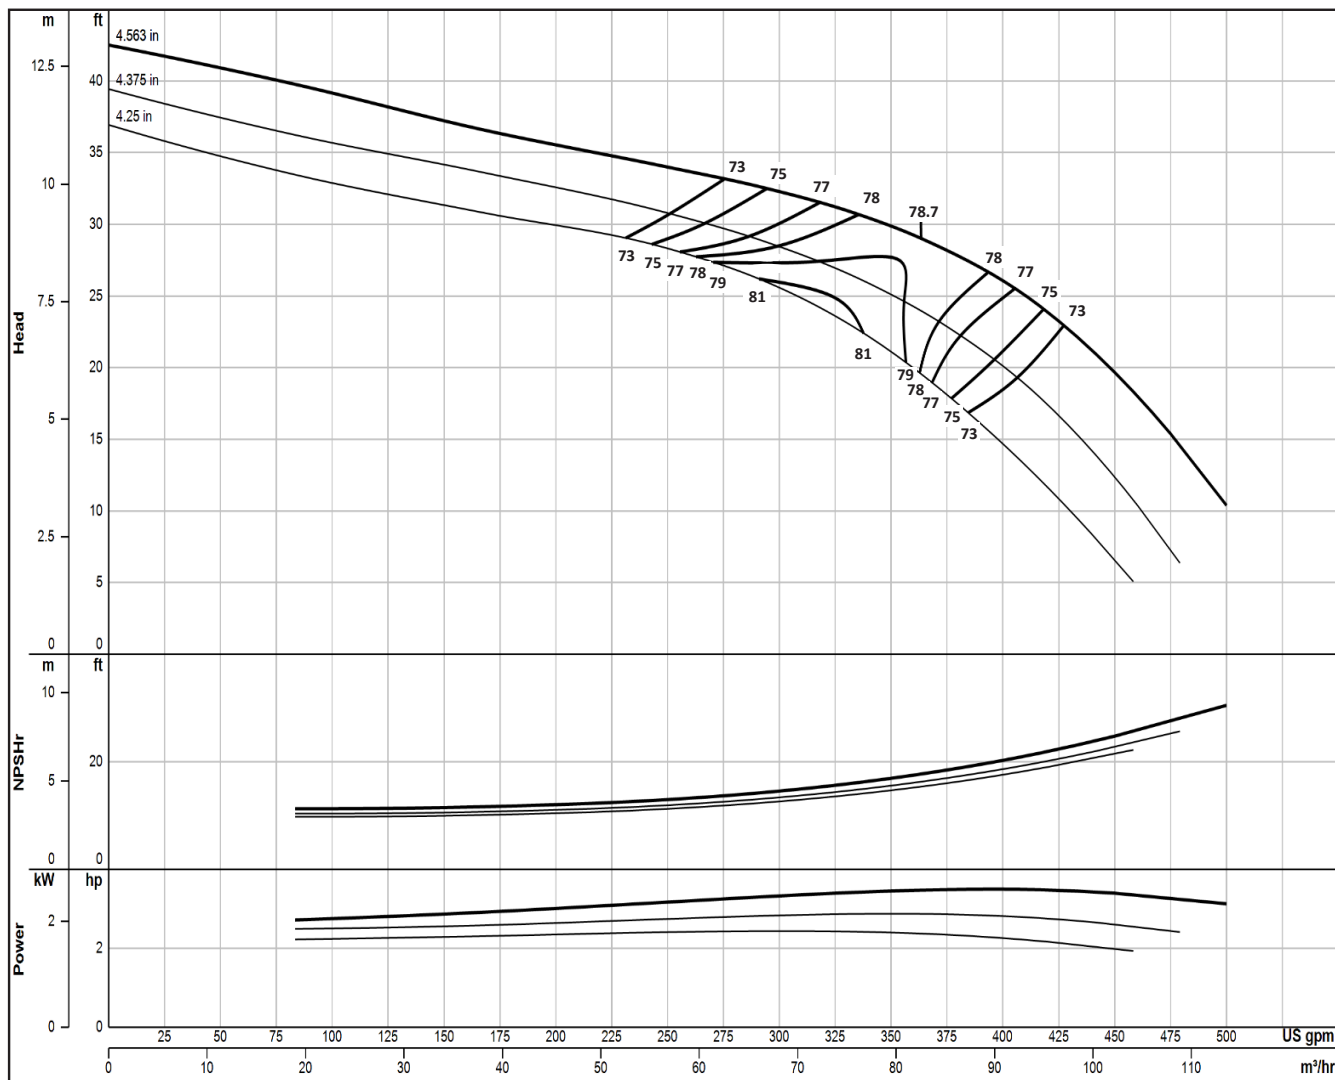

Impeller Type	Enclosed	Bowl Ø (cm)	14.0	ns (SI)	85	Qty.	Eff.
Impeller Model	SK6HH	Thd'd Discharge (cm)	8, 10	S (SI)	123	Stages	Change
One Stage Weight (kg)	23.3	Thd'd Suction (cm)	10	PEIcI	0.91	1	-2
Add'l Stage Wt. (kg)	7.3	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.54	2	-1.5
Impeller Wt. (kg)	1.3	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.27	3	-1
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	48.6	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	8.2	5	0
Add'l Stage Length (cm)	14.0	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.001		

Δ Consult factory for availability

2022-10-20

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP7L

2875 RPM

ONE ()
STAGE STAGE

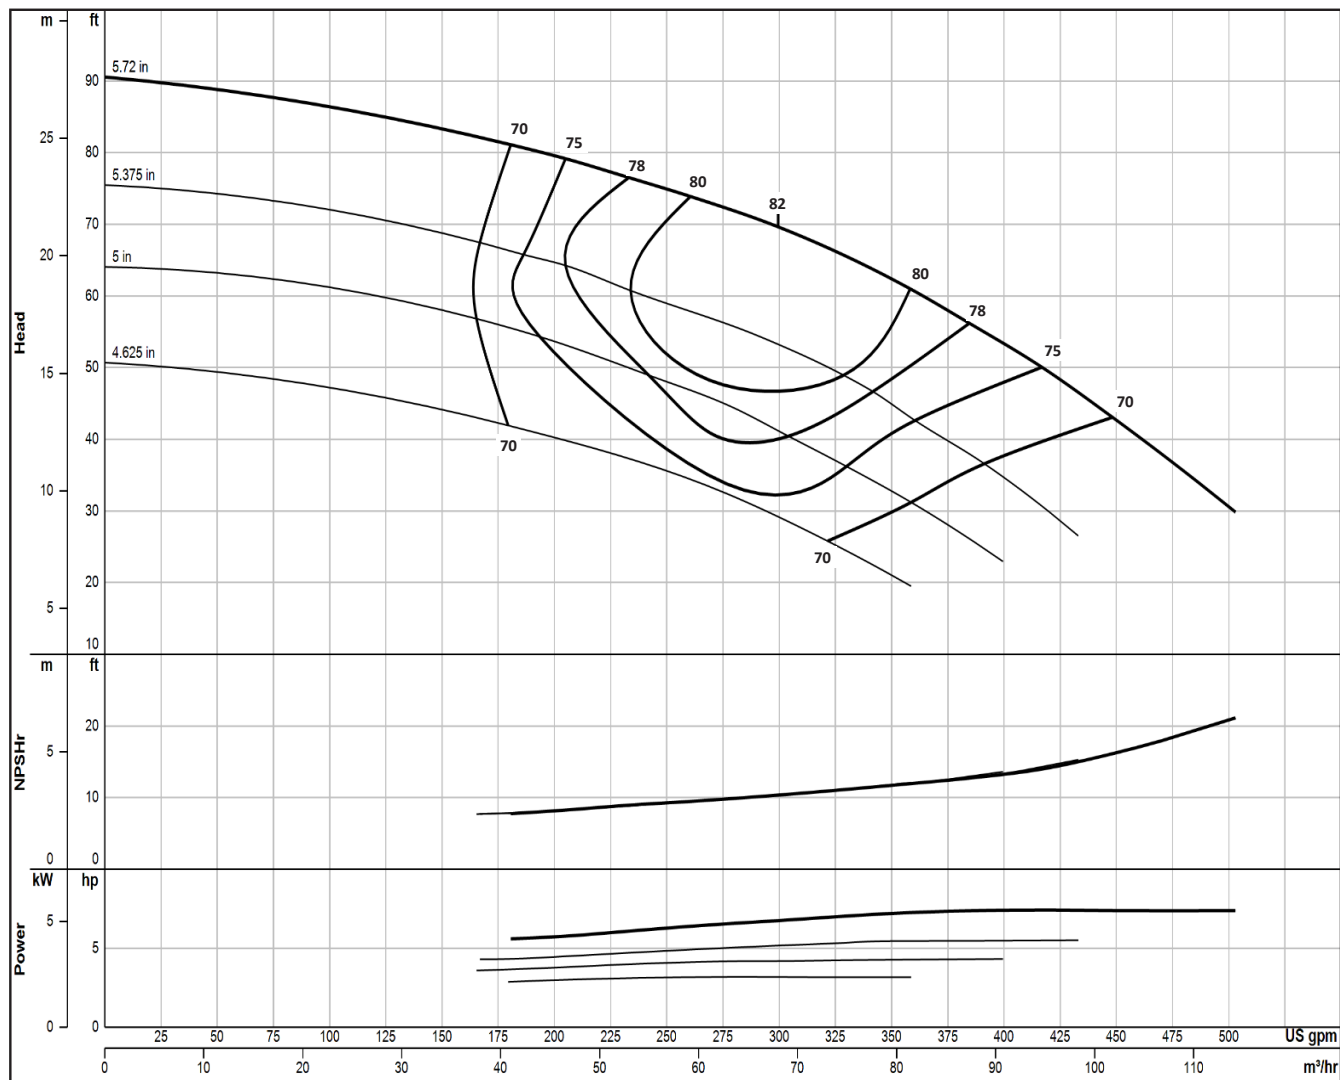

Impeller Type	Enclosed	Bowl Ø (cm)	18.3	ns (SI)	42	Qty.	Eff.
Impeller Model	SP7L	Thd'd Discharge (cm)	10, 12.5, 15	S (SI)	181	Stages	Change
One Stage Weight (kg)	45.4	Thd'd Suction (cm)	12.5	PEIcl	N/A	1	-4
Add'l Stage Wt. (kg)	15.4	Bell Suction Ø (cm)	23.8, 20.3	Bowl Shaft Ø (cm)	3.18	2	-2
Impeller Wt. (kg)	1.8	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.59	3	0
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	2608	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	57.8	D.I. Bowl Rating (kPa)	5650	K-Factor (kg/m-tdh)	6.3	5	0
Add'l Stage Length (cm)	16.2	316 Bowl Rating (kPa)	6084	Imp. WR² (kg-m²)	0.003		

Δ Consult factory for availability

2022-10-20

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP7H

2875 RPM

ONE ()
STAGE STAGE

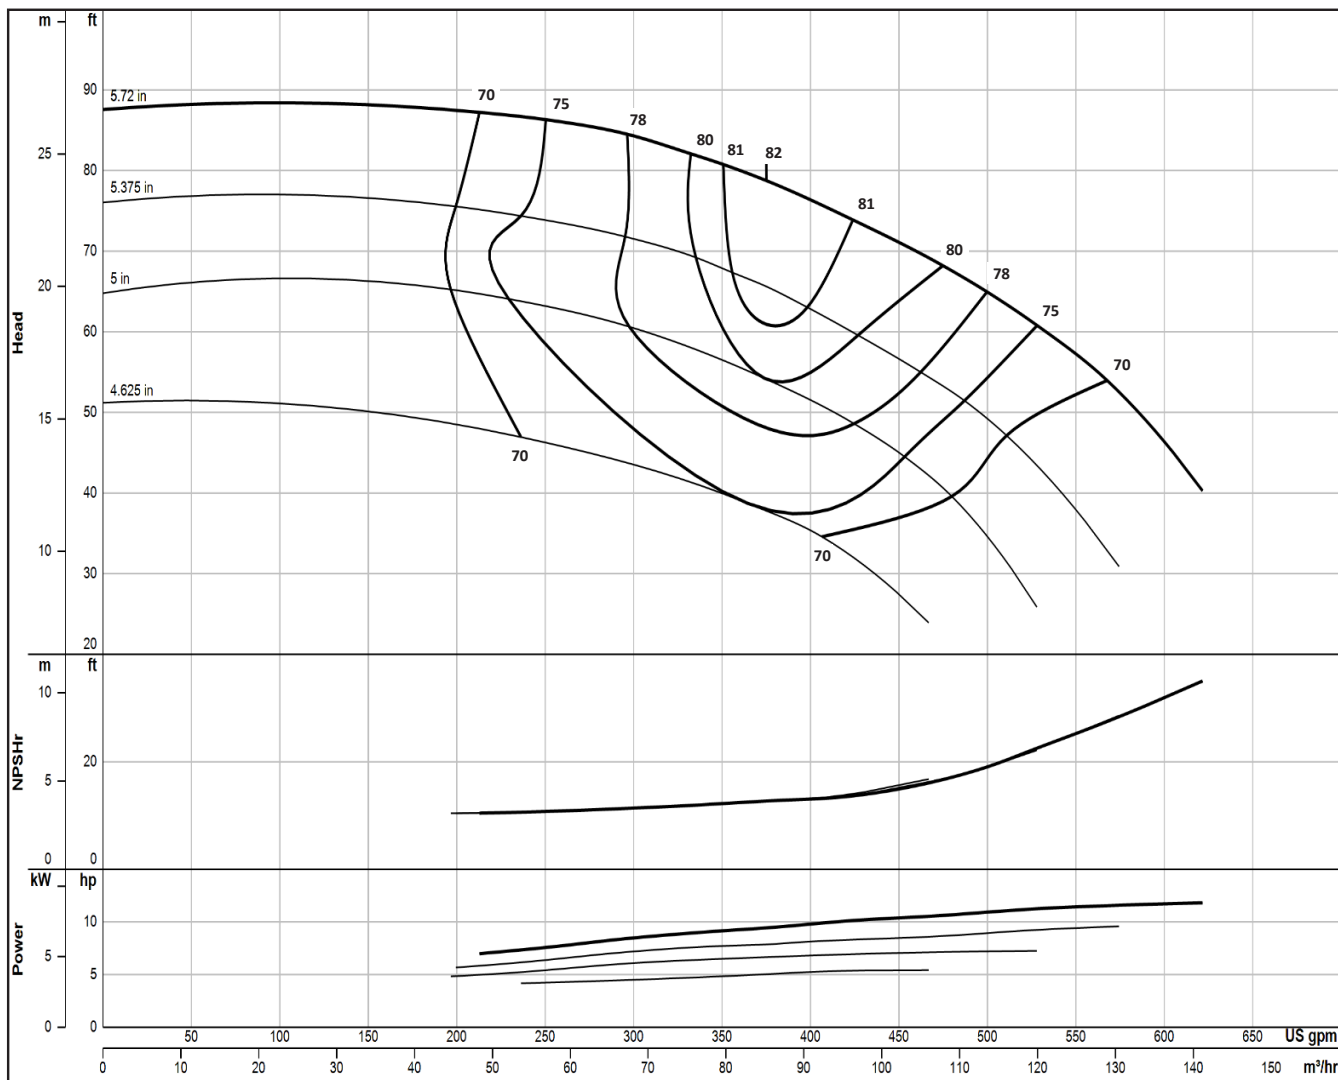

Impeller Type	Enclosed	Bowl Ø (cm)	18.3	ns (SI)	43	Qty.	Eff.
Impeller Model	SP7H	Thd'd Discharge (cm)	10, 12.5, 15	S (SI)	161	Stages	Change
One Stage Weight (kg)	45.4	Thd'd Suction (cm)	12.5	PEIcI	N/A	1	-3
Add'l Stage Wt. (kg)	15.4	Bell Suction Ø (cm)	23.8, 20.3	Bowl Shaft Ø (cm)	3.18	2	-1
Impeller Wt. (kg)	1.8	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.59	3	0
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	2608	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	57.8	D.I. Bowl Rating (kPa)	5650	K-Factor (kg/m-tdh)	6.4	5	0
Add'l Stage Length (cm)	16.2	316 Bowl Rating (kPa)	6084	Imp. WR² (kg-m²)	0.003		

Δ Consult factory for availability

2022-10-20

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SK7L

2875 RPM

ONE ()
STAGE STAGE

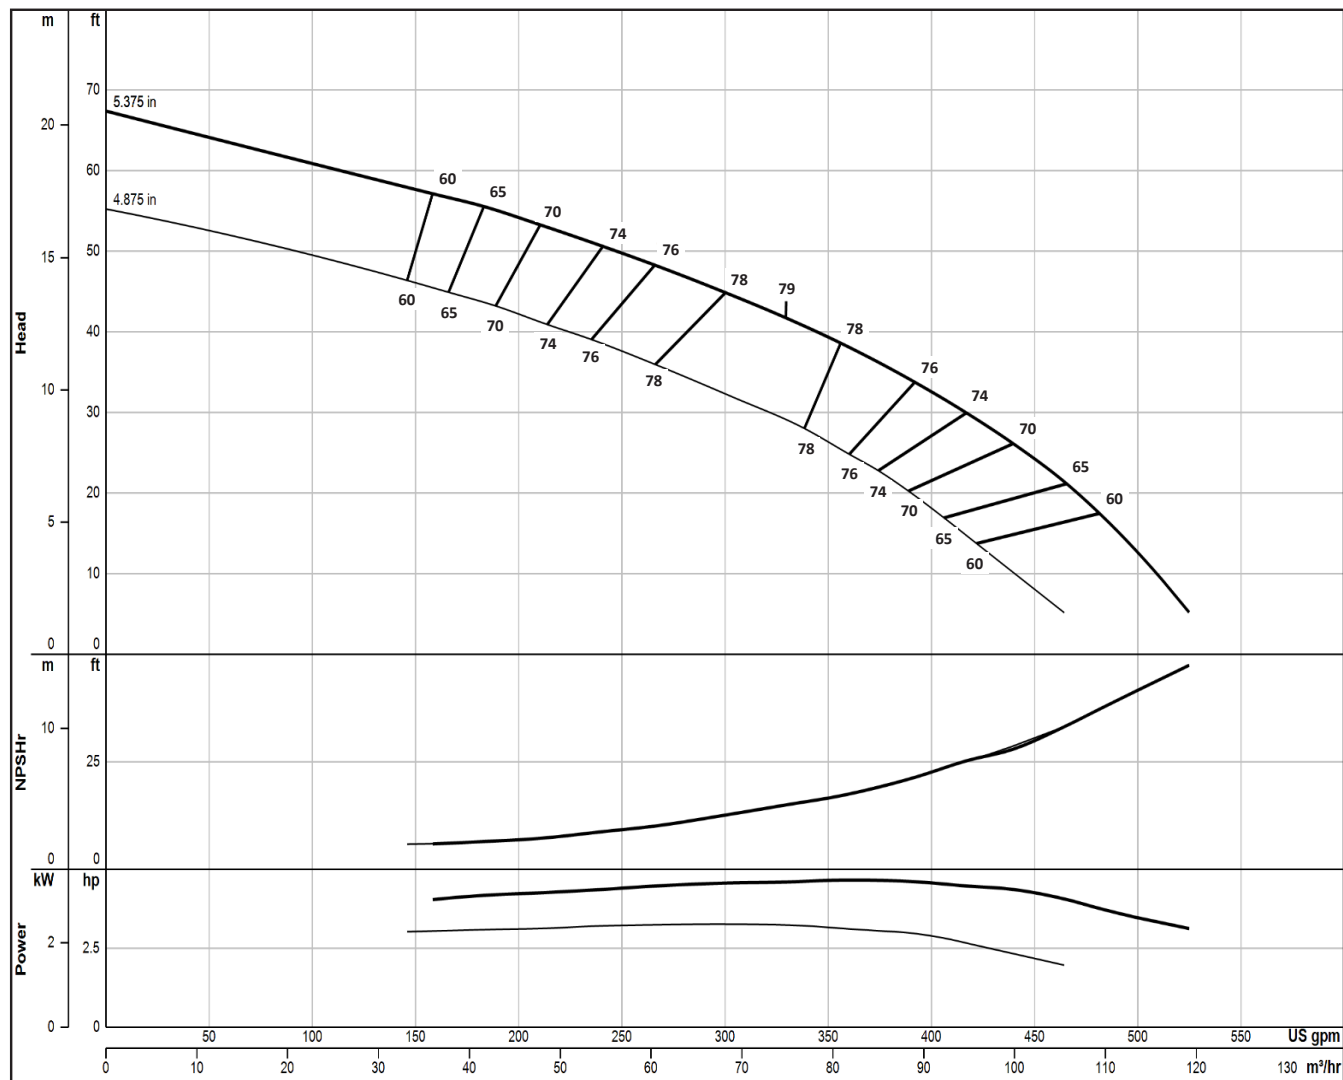

Impeller Type	Enclosed	Bowl Ø (cm)	16.7	ns (SI)	61	Qty.	Eff.
Impeller Model	SK7L	Thd'd Discharge (cm)	12.5, 15, 10	S (SI)	137	Stages	Change
One Stage Weight (kg)	27.7	Thd'd Suction (cm)	12.5	PEIcl	N/A	1	-3.5
Add'l Stage Wt. (kg)	10.0	Bell Suction Ø (cm)	23.8, 20.3	Bowl Shaft Ø (cm)	2.54	2	-2
Impeller Wt. (kg)	1.5	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	2.38	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	46.7	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	6.7	5	0
Add'l Stage Length (cm)	16.2	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.002		

Δ Consult factory for availability

2022-10-25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SK7M

2875 RPM

ONE ()
STAGE STAGE

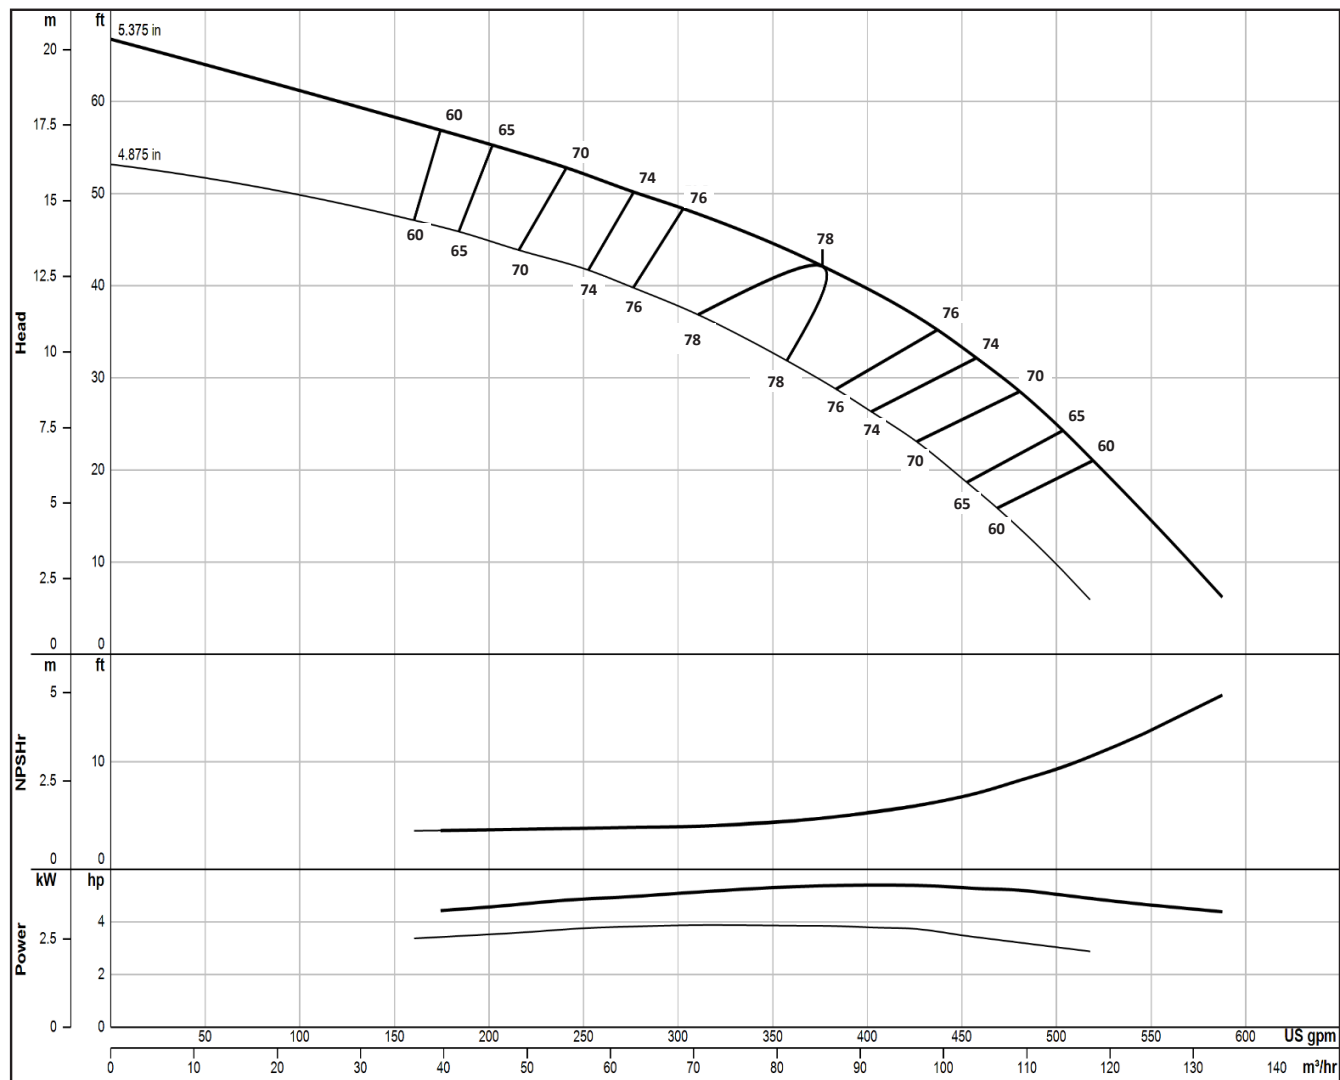

Impeller Type	Enclosed	Bowl Ø (cm)	16.7	ns (SI)	64	Qty.	Eff.
Impeller Model	SK7M	Thd'd Discharge (cm)	12.5, 15, 10	S (SI)	338	Stages	Change
One Stage Weight (kg)	26.8	Thd'd Suction (cm)	12.5	PEIcl	N/A	1	-3.5
Add'l Stage Wt. (kg)	9.1	Bell Suction Ø (cm)	23.8, 20.3	Bowl Shaft Ø (cm)	2.54	2	-2
Impeller Wt. (kg)	1.3	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.91	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	46.7	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	6.4	5	0
Add'l Stage Length (cm)	16.2	316 Bowl Rating (kPa)	Δ	Imp. WR ² (kg-m²)	0.002		

Δ Consult factory for availability

2022-10-25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SK7H

2875 RPM

ONE ()
STAGE STAGE

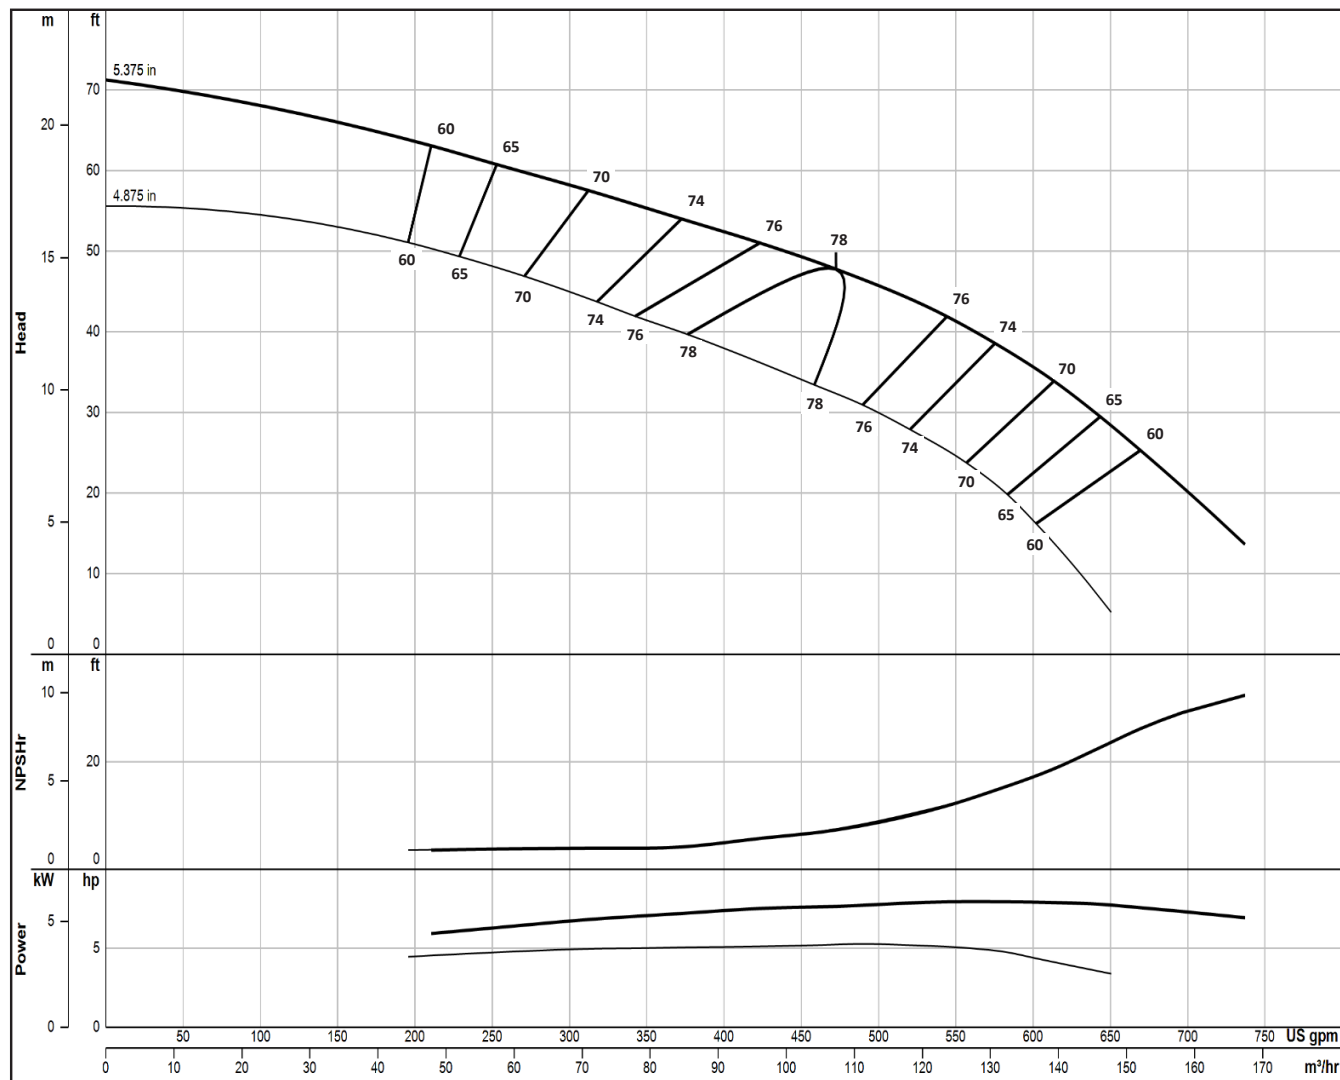

Impeller Type	Enclosed	Bowl Ø (cm)	16.7	ns (SI)	67	Qty.	Eff.
Impeller Model	SK7H	Thd'd Discharge (cm)	12.5, 15, 10	S (SI)	273	Stages	Change
One Stage Weight (kg)	27.2	Thd'd Suction (cm)	12.5	PEIcl	N/A	1	-3.5
Add'l Stage Wt. (kg)	9.5	Bell Suction Ø (cm)	23.8, 20.3	Bowl Shaft Ø (cm)	2.54	2	-2
Impeller Wt. (kg)	1.5	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.91	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	46.7	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	6.4	5	0
Add'l Stage Length (cm)	16.2	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.002		

Δ Consult factory for availability

2022-10-25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM7M

2875 RPM

ONE ()
STAGE STAGE

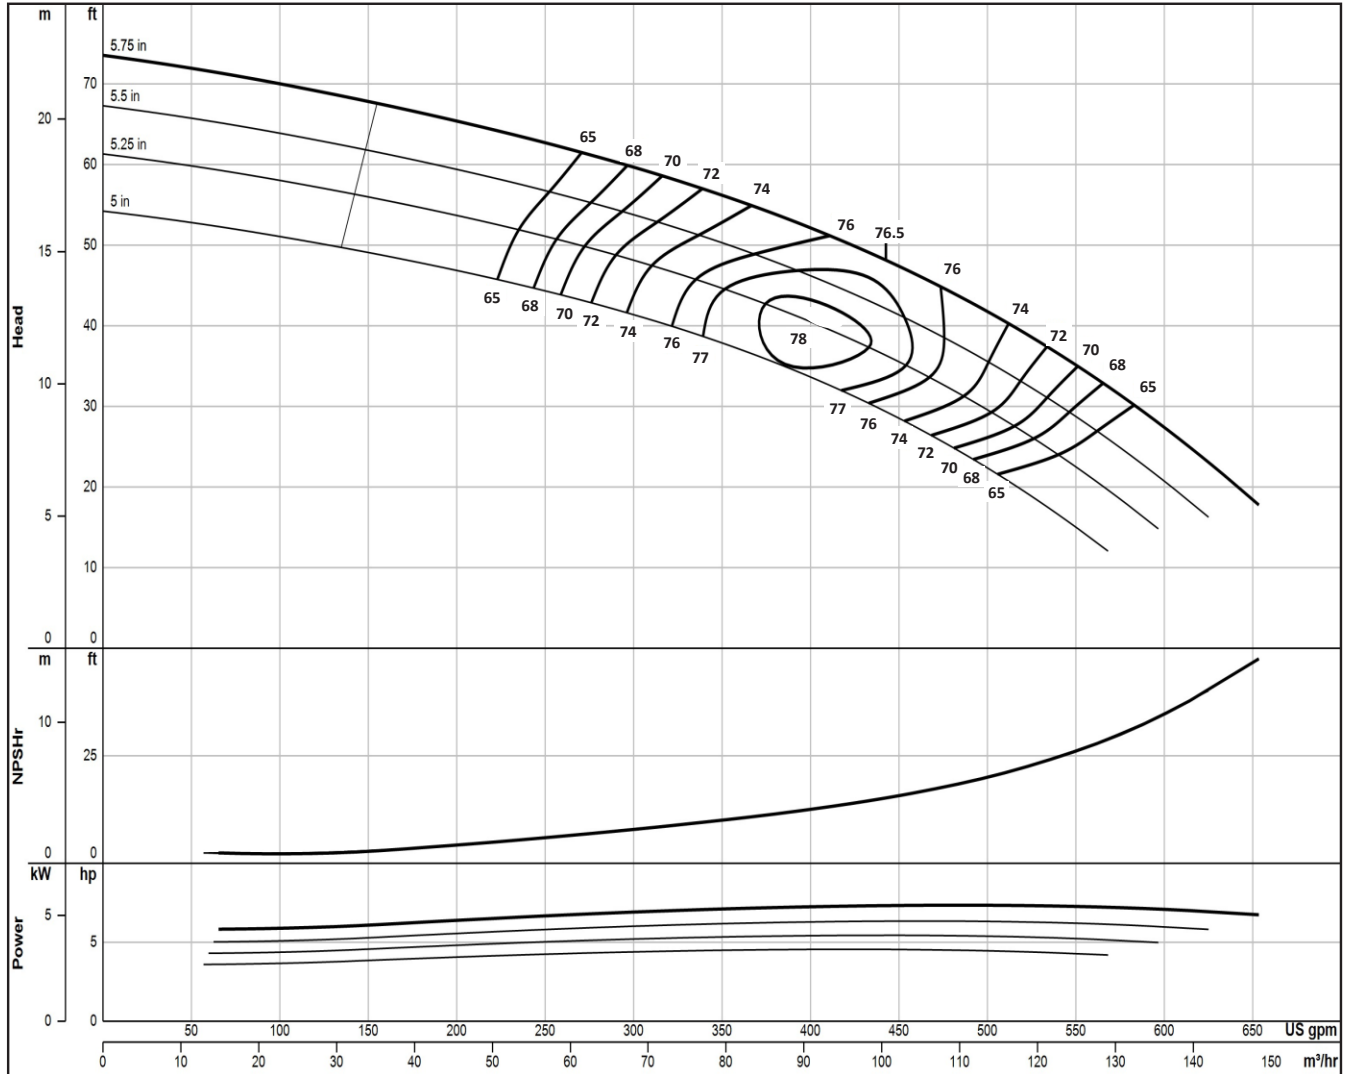

Impeller Type	Enclosed	Bowl Ø (cm)	17.8	ns (SI)	64	Qty.	Eff.
Impeller Model	SM7M	Thd'd Discharge (cm)	10, 12.5, 15	S (SI)	152	Stages	Change
One Stage Weight (kg)	45.4	Thd'd Suction (cm)	12.5	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	18.1	Bell Suction Ø (cm)	23.8, 20.3	Bowl Shaft Ø (cm)	3.18	2	-2
Impeller Wt. (kg)	2.8	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	2.38	3	-1
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	59.4	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	8.0	5	0
Add'l Stage Length (cm)	17.8	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.007		

Δ Consult factory for availability

2026-06-04

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM7H

2875 RPM

ONE ()
STAGE STAGE

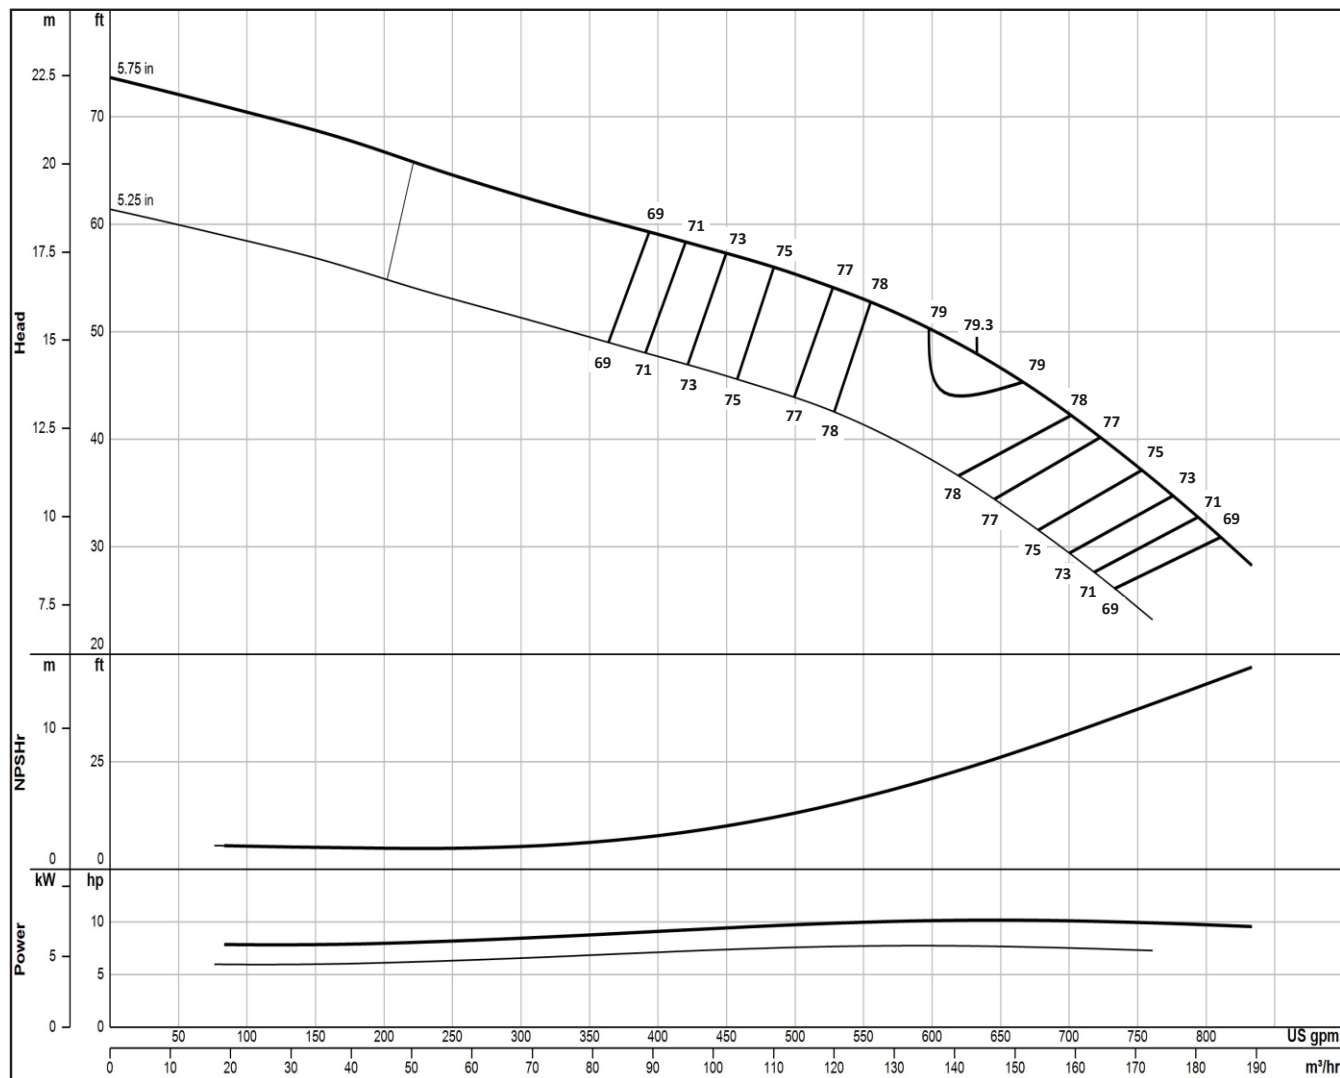

Impeller Type	Enclosed	Bowl Ø (cm)	17.8	ns (SI)	77	Qty.	Eff. Change
Impeller Model	SM7H	Thd'd Discharge (cm)	10, 12.5, 15	S (SI)	118	Stages	
One Stage Weight (kg)	45.4	Thd'd Suction (cm)	12.5	PEIcl	N/A	1	-4
Add'l Stage Wt. (kg)	18.1	Bell Suction Ø (cm)	23.8, 20.3	Bowl Shaft Ø (cm)	3.18	2	-3
Impeller Wt. (kg)	2.7	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	2.38	3	-2
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	59.4	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	8.0	5	0
Add'l Stage Length (cm)	17.8	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.006		

Δ Consult factory for availability

2026-06-04

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP8L

2875 RPM

ONE ()
STAGE STAGE

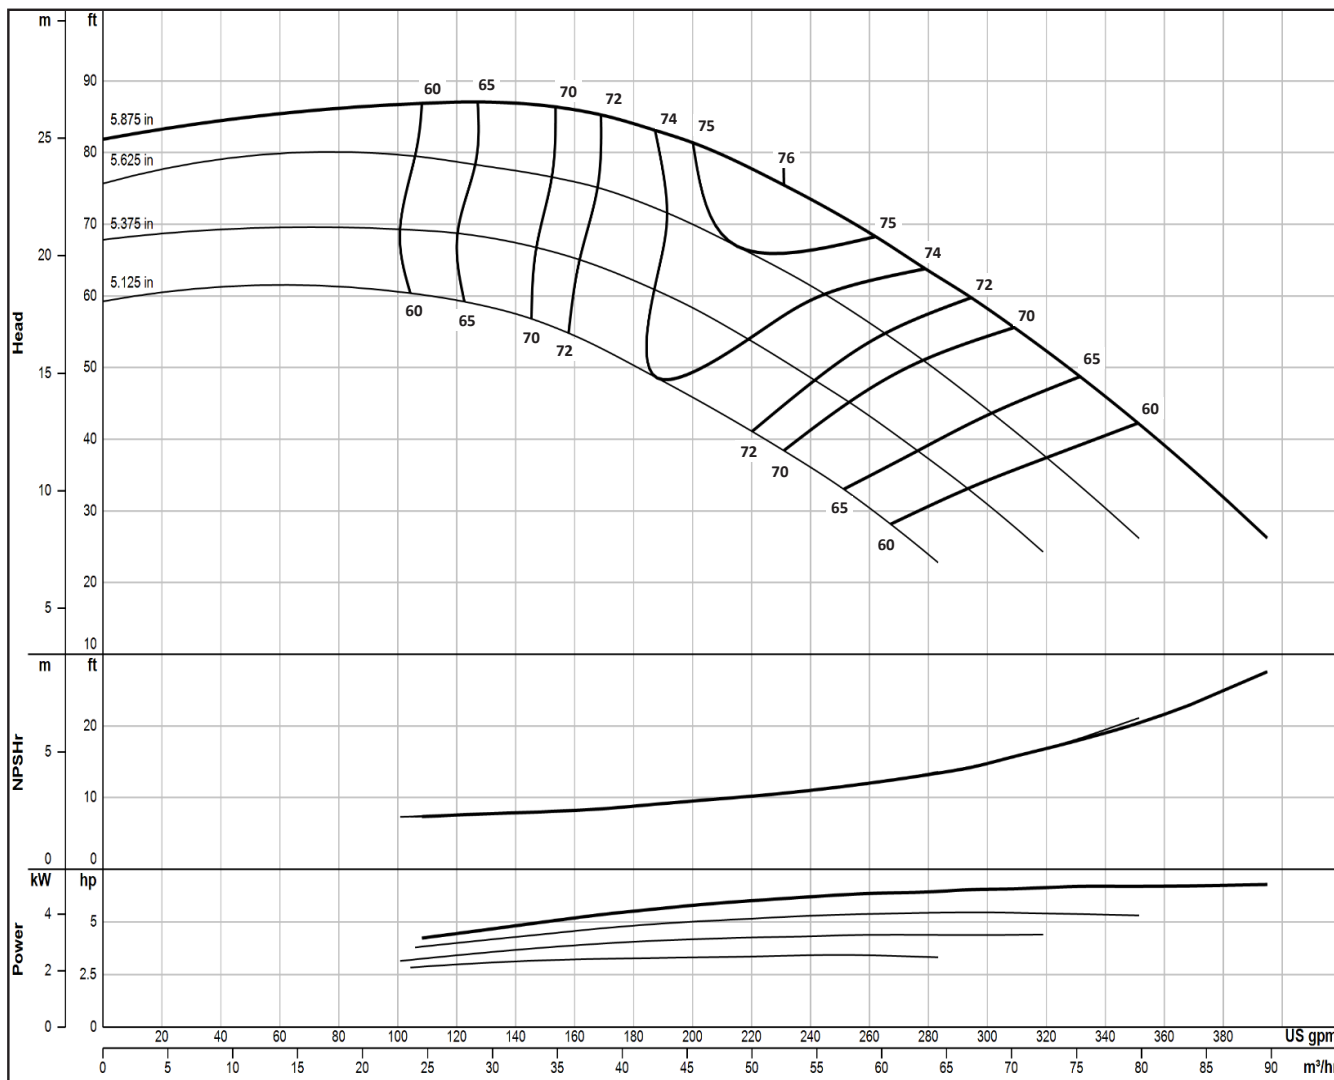

Impeller Type	Enclosed	Bowl Ø (cm)	20.0	ns (SI)	33	Qty.	Eff.
Impeller Model	SP8L	Thd'd Discharge (cm)	10, 12.5, 15	S (SI)	144	Stages	Change
One Stage Weight (kg)	55.3	Thd'd Suction (cm)	12.5	PEIcI	N/A	1	-4
Add'l Stage Wt. (kg)	18.1	Bell Suction Ø (cm)	23.8, 20.3	Bowl Shaft Ø (cm)	3.18	2	-3
Impeller Wt. (kg)	2.4	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	2.22	3	-2
Impeller Mtrl.	NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	60.0	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	5.4	5	0
Add'l Stage Length (cm)	16.2	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.005		

Δ Consult factory for availability

2022-10-25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP8M

2875 RPM

ONE ()
STAGE STAGE

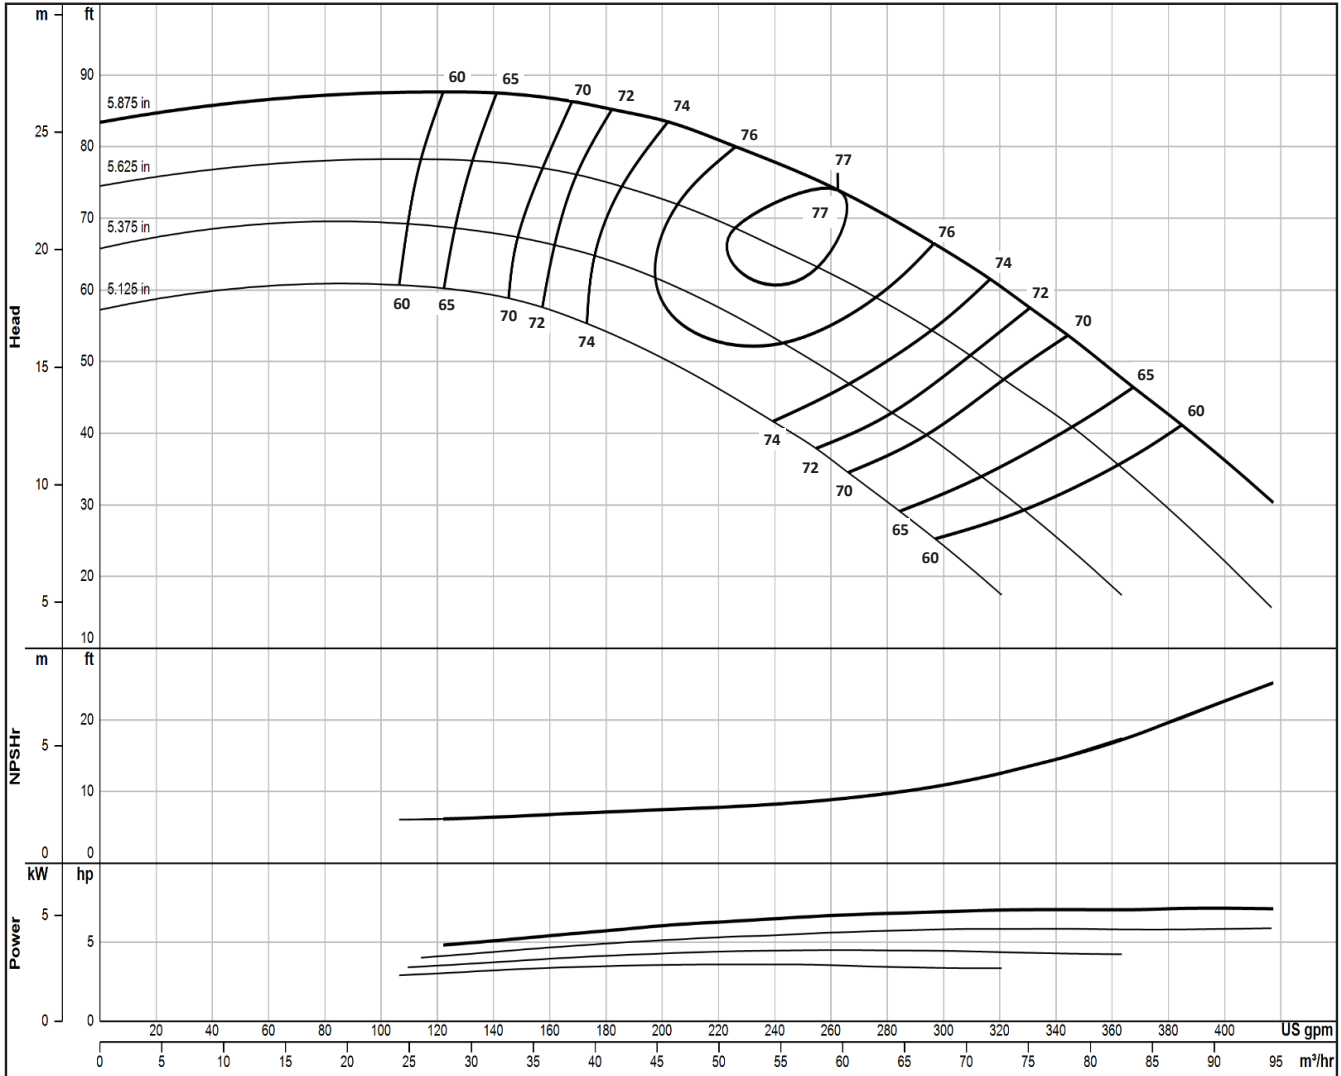

Impeller Type	Enclosed	Bowl Ø (cm)	20.0	ns (SI)	35	Qty.	Eff.
Impeller Model	SP8M	Thd'd Discharge (cm)	10, 12.5, 15	S (SI)	175	Stages	Change
One Stage Weight (kg)	45.4	Thd'd Suction (cm)	12.5	PEIcl	N/A	1	-4
Add'l Stage Wt. (kg)	18.1	Bell Suction Ø (cm)	23.8, 20.3	Bowl Shaft Ø (cm)	3.18	2	-3
Impeller Wt. (kg)	2.3	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.91	3	-2
Impeller Mtrl.	NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	60.0	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	5.3	5	0
Add'l Stage Length (cm)	16.2	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.004		

Δ Consult factory for availability

2022-10-25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP8H

2875 RPM

ONE ()
STAGE STAGE

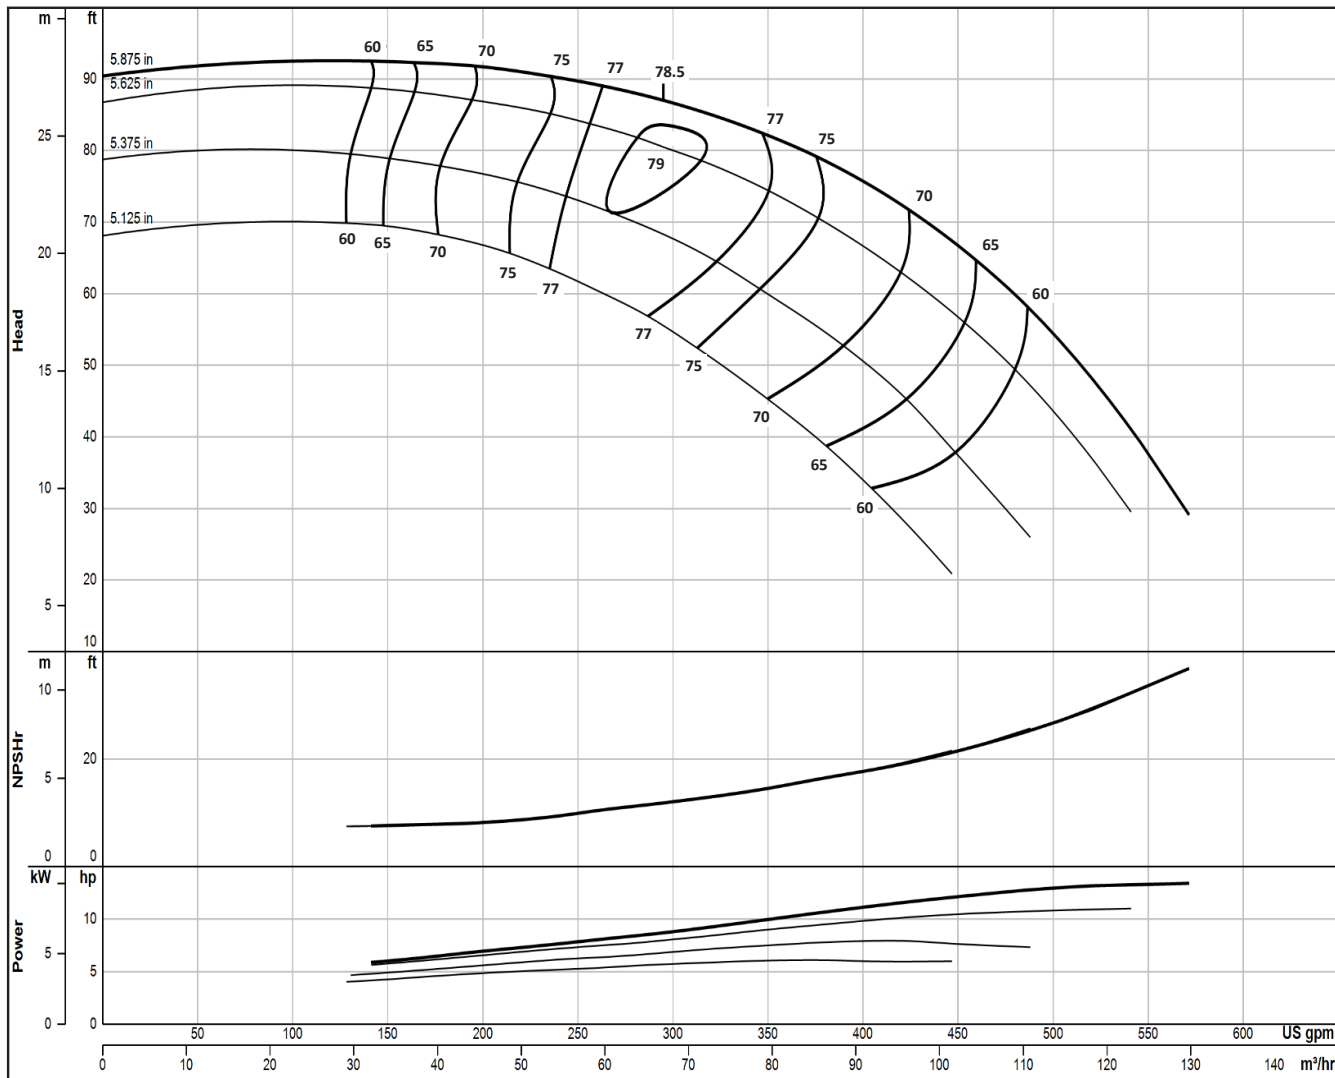

Impeller Type	Enclosed	Bowl Ø (cm)	20.0	ns (SI)	34	Qty.	Eff.
Impeller Model	SP8H	Thd'd Discharge (cm)	10, 12.5, 15	S (SI)	152	Stages	Change
One Stage Weight (kg)	45.4	Thd'd Suction (cm)	12.5	PEIcI	N/A	1	-4
Add'l Stage Wt. (kg)	18.1	Bell Suction Ø (cm)	23.8, 20.3	Bowl Shaft Ø (cm)	3.18	2	-3
Impeller Wt. (kg)	2.4	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.47	3	-2
Impeller Mtrl.	NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	60.0	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	5.2	5	0
Add'l Stage Length (cm)	16.2	316 Bowl Rating (kPa)	Δ	Imp. WR ² (kg-m²)	0.004		

Δ Consult factory for availability

2022-10-25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM8H

2875 RPM

ONE ()
STAGE STAGE

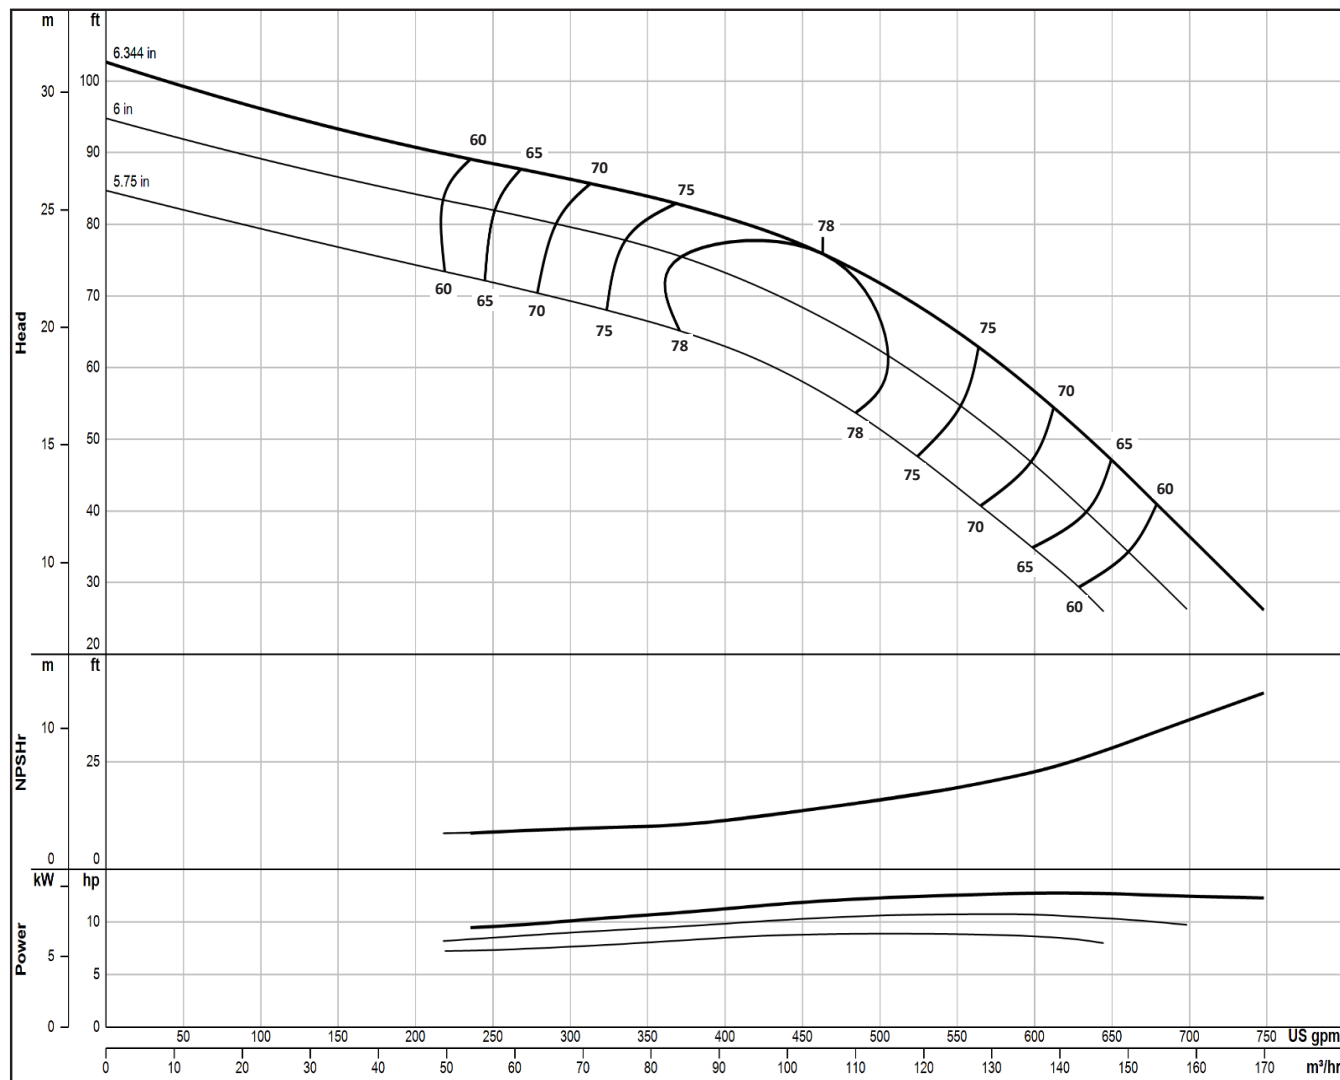

Impeller Type	Enclosed	Bowl Ø (cm)	19.5	ns (SI)	47	Qty.	Eff.
Impeller Model	SM8H	Thd'd Discharge (cm)	10, 12.5, 15	S (SI)	169	Stages	Change
One Stage Weight (kg)	45.4	Thd'd Suction (cm)	12.5	PEIcl	N/A	1	-4
Add'l Stage Wt. (kg)	18.1	Bell Suction Ø (cm)	23.8, 20.3	Bowl Shaft Ø (cm)	3.18	2	-3
Impeller Wt. (kg)	3.3	Sub. Mtr. (cm)	15, 20	Total Lateral (cm)	1.47	3	-2
Impeller Mtrl.	NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	59.1	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	11.2	5	0
Add'l Stage Length (cm)	15.2	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.007		

Δ Consult factory for availability

2022-10-25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SK8H

2875 RPM

ONE ()
STAGE STAGE

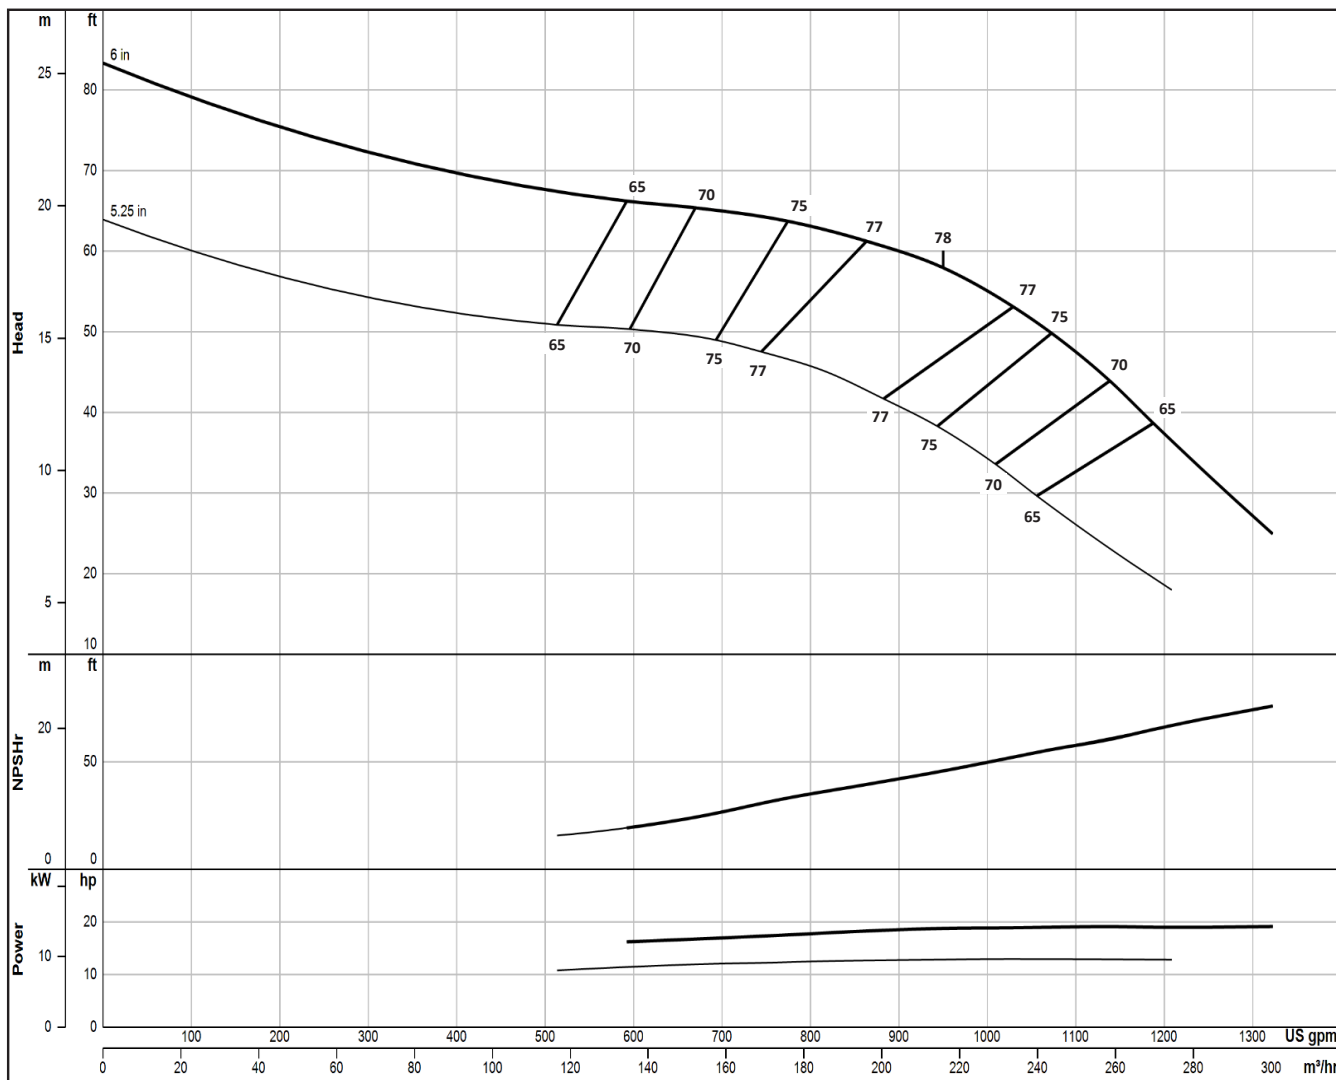

Impeller Type	Enclosed	Bowl Ø (cm)	19.1	ns (SI)	80	Qty.	Eff.
Impeller Model	SK8H	Thd'd Discharge (cm)	15	S (SI)	100	Stages	Change
One Stage Weight (kg)	81.6	Thd'd Suction (cm)	15	PEIcl	N/A	1	-4
Add'l Stage Wt. (kg)	27.2	Bell Suction Ø (cm)	N/A	Bowl Shaft Ø (cm)	3.81	2	-3
Impeller Wt. (kg)	3.0	Sub. Mtr. (cm)	15, 20	Total Lateral (cm)	2.54	3	-2
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	64.1	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	8.5	5	0
Add'l Stage Length (cm)	22.9	316 Bowl Rating (kPa)	Δ	Imp. WR ² (kg-m²)	0.006		

Δ Consult factory for availability

2022-10-25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP9L

2875 RPM

ONE ()
STAGE STAGE

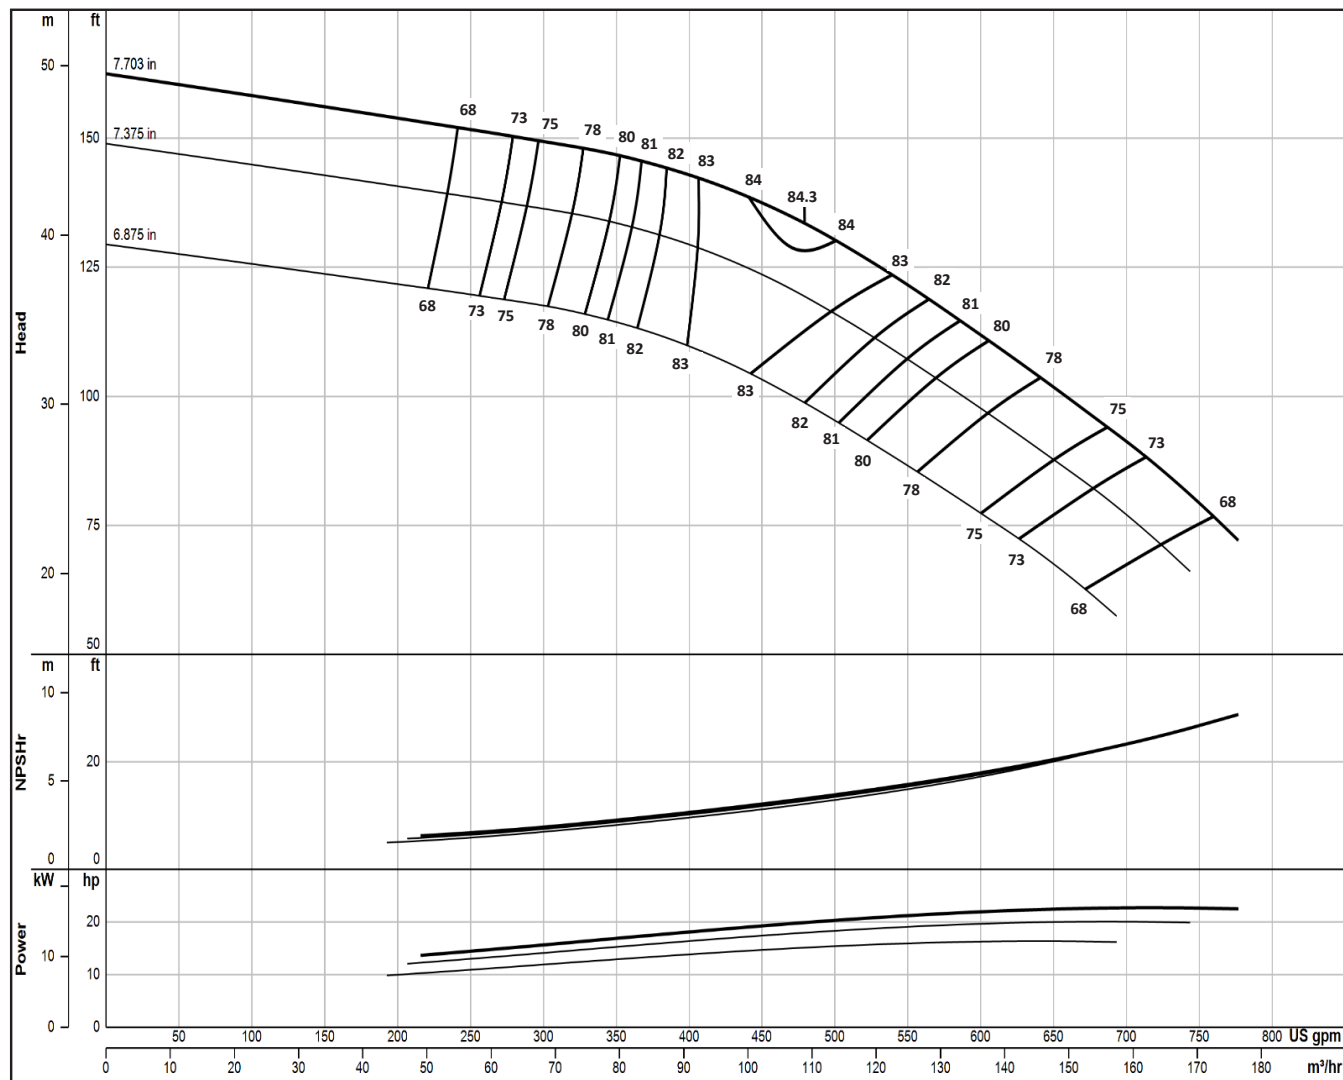

Impeller Type	Enclosed	Bowl Ø (cm)	24.1	ns (SI)	31	Qty.	Eff.
Impeller Model	SP9L	Thd'd Discharge (cm)	15, 20, 10	S (SI)	179	Stages	Change
One Stage Weight (kg)	68.0	Thd'd Suction (cm)	15	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	27.2	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-2
Impeller Wt. (kg)	4.1	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	2.39	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	2820	Imp. Setting (cm)	0.79	4	0
One Stage Length (cm)	61.3	D.I. Bowl Rating (kPa)	6110	K-Factor (kg/m-tdh)	10.4	5	0
Add'l Stage Length (cm)	19.7	316 Bowl Rating (kPa)	Δ	Imp. WR ² (kg-m ²)	0.012		

Δ Consult factory for availability

2022-10-25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP9M

2875 RPM

ONE ()
STAGE STAGE

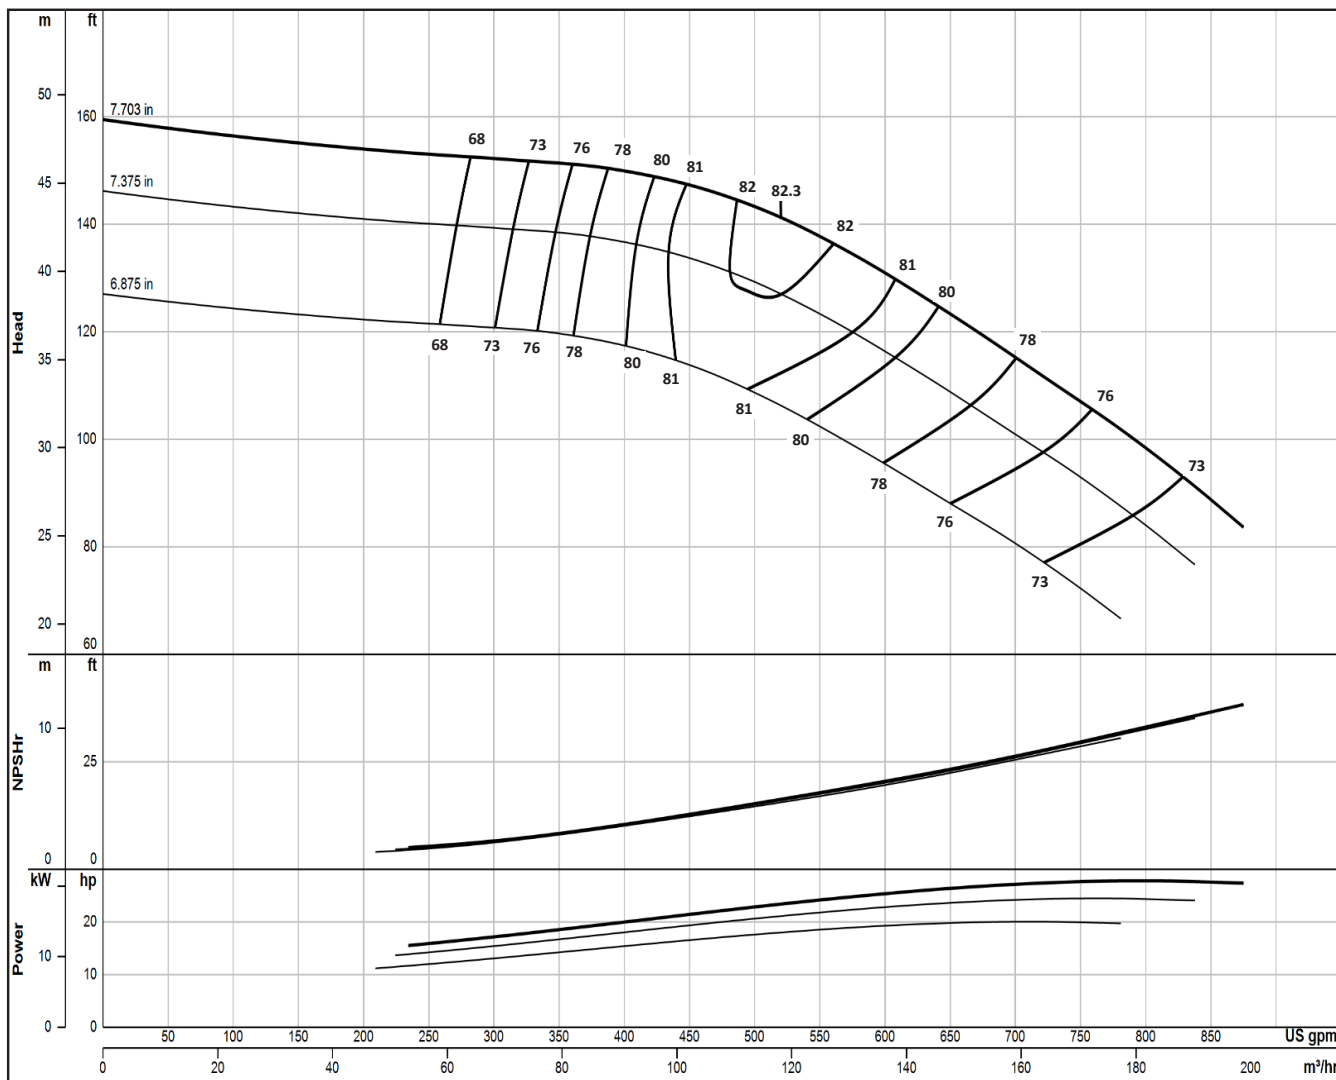

Impeller Type	Enclosed	Bowl Ø (cm)	24.1	ns (SI)	31	Qty.	Eff.
Impeller Model	SP9M	Thd'd Discharge (cm)	15, 20, 10	S (SI)	156	Stages	Change
One Stage Weight (kg)	68.0	Thd'd Suction (cm)	15	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	27.2	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-2
Impeller Wt. (kg)	4.3	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	2.39	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	2820	Imp. Setting (cm)	0.79	4	0
One Stage Length (cm)	61.3	D.I. Bowl Rating (kPa)	6110	K-Factor (kg/m-tdh)	6.7	5	0
Add'l Stage Length (cm)	19.7	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.013		

Δ Consult factory for availability

2022-10-25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM9L

2875 RPM

ONE ()
STAGE STAGE

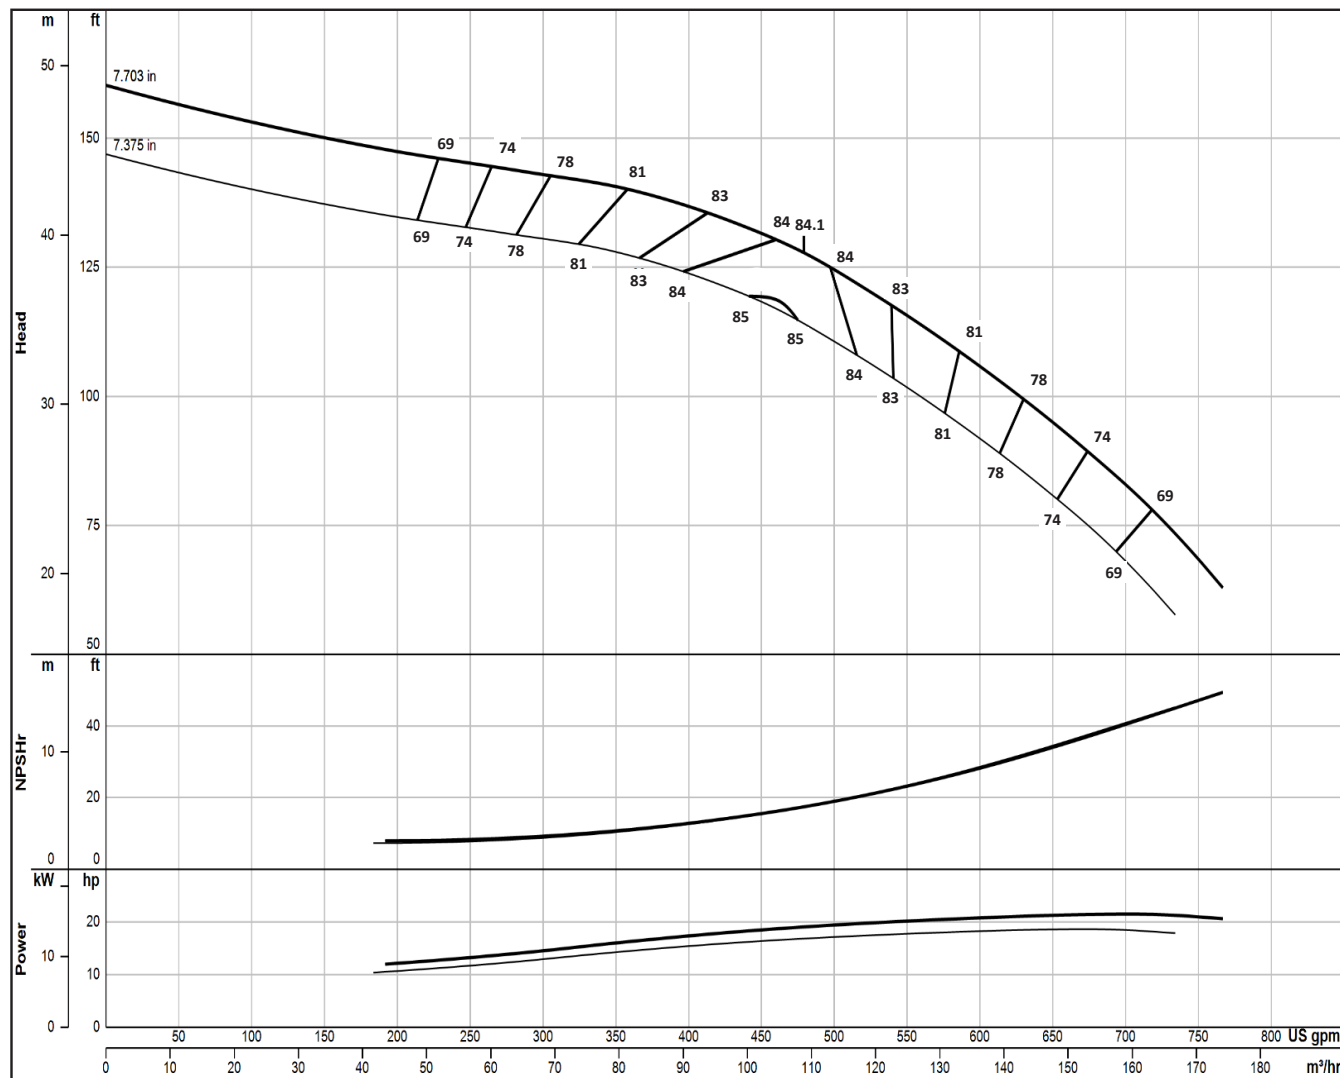

Impeller Type	Enclosed	Bowl Ø (cm)	24.1	ns (SI)	31	Qty.	Eff.
Impeller Model	SM9L	Thd'd Discharge (cm)	15, 20, 10	S (SI)	147	Stages	Change
One Stage Weight (kg)	68.0	Thd'd Suction (cm)	15	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	27.2	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-2
Impeller Wt. (kg)	4.1	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	2.24	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	2812	Imp. Setting (cm)	0.79	4	0
One Stage Length (cm)	61.3	D.I. Bowl Rating (kPa)	6093	K-Factor (kg/m-tdh)	7.1	5	0
Add'l Stage Length (cm)	19.7	316 Bowl Rating (kPa)	6562	Imp. WR² (kg-m²)	0.012		

Δ Consult factory for availability

2022-10-25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM9M

2875 RPM

ONE ()
STAGE STAGE

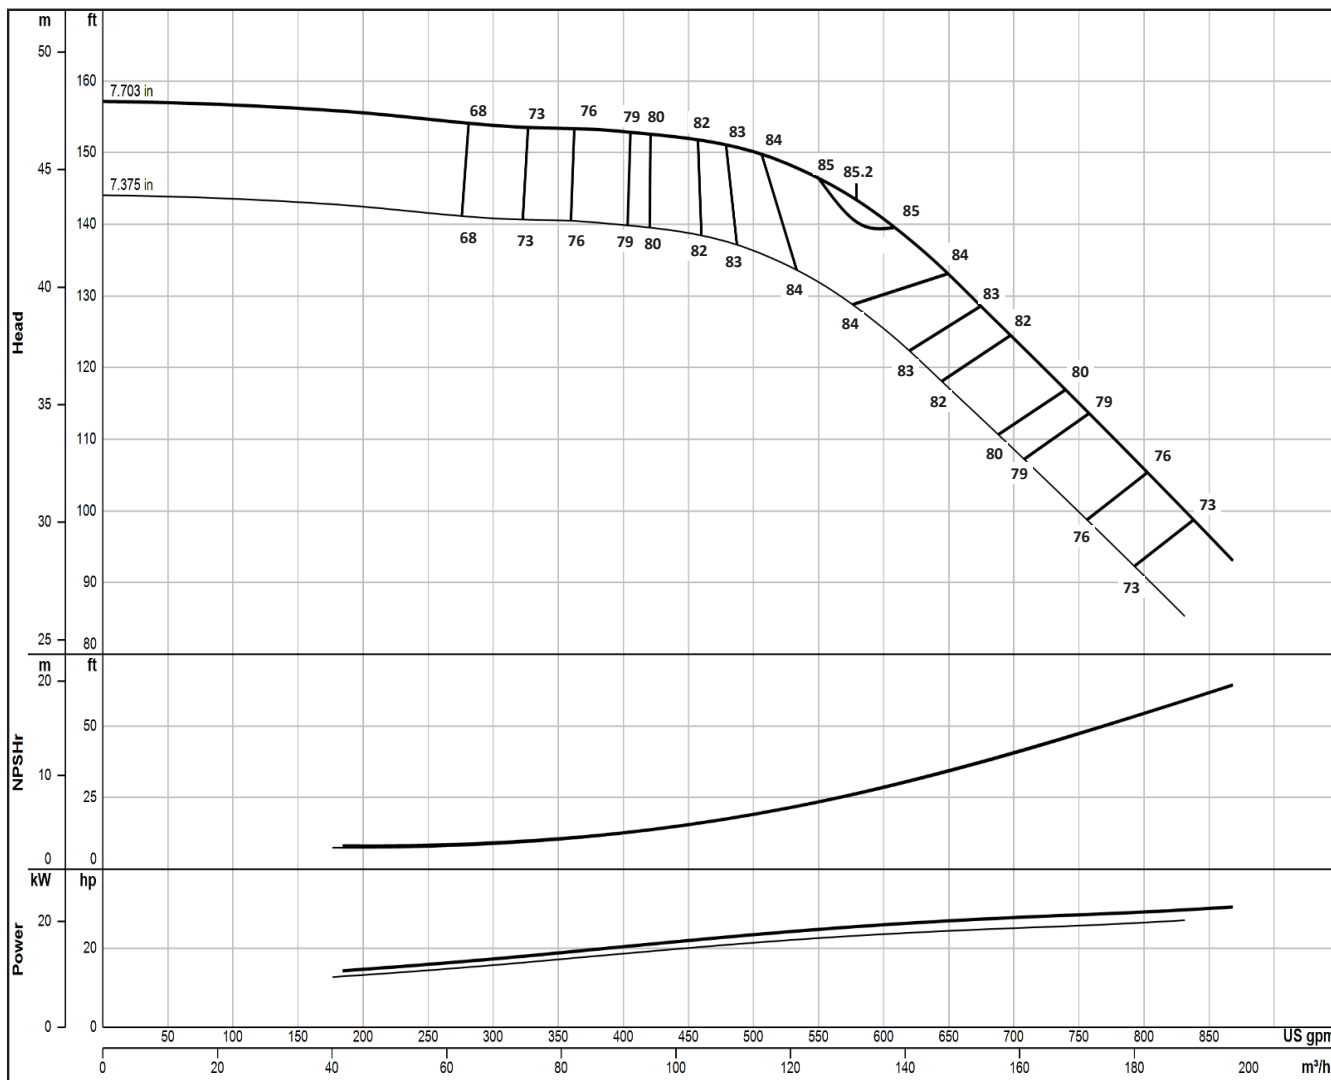

Impeller Type	Enclosed	Bowl Ø (cm)	24.1	ns (SI)	32	Qty.	Eff.
Impeller Model	SM9M	Thd'd Discharge (cm)	15, 20, 10	S (SI)	117	Stages	Change
One Stage Weight (kg)	68.0	Thd'd Suction (cm)	15	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	27.2	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-2
Impeller Wt. (kg)	4.3	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	2.24	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	2812	Imp. Setting (cm)	0.79	4	0
One Stage Length (cm)	61.3	D.I. Bowl Rating (kPa)	6093	K-Factor (kg/m-tdh)	8.0	5	0
Add'l Stage Length (cm)	19.7	316 Bowl Rating (kPa)	6562	Imp. WR² (kg-m²)	0.013		

Δ Consult factory for availability

2022-10-25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SL9H

2875 RPM

ONE ()
STAGE STAGE

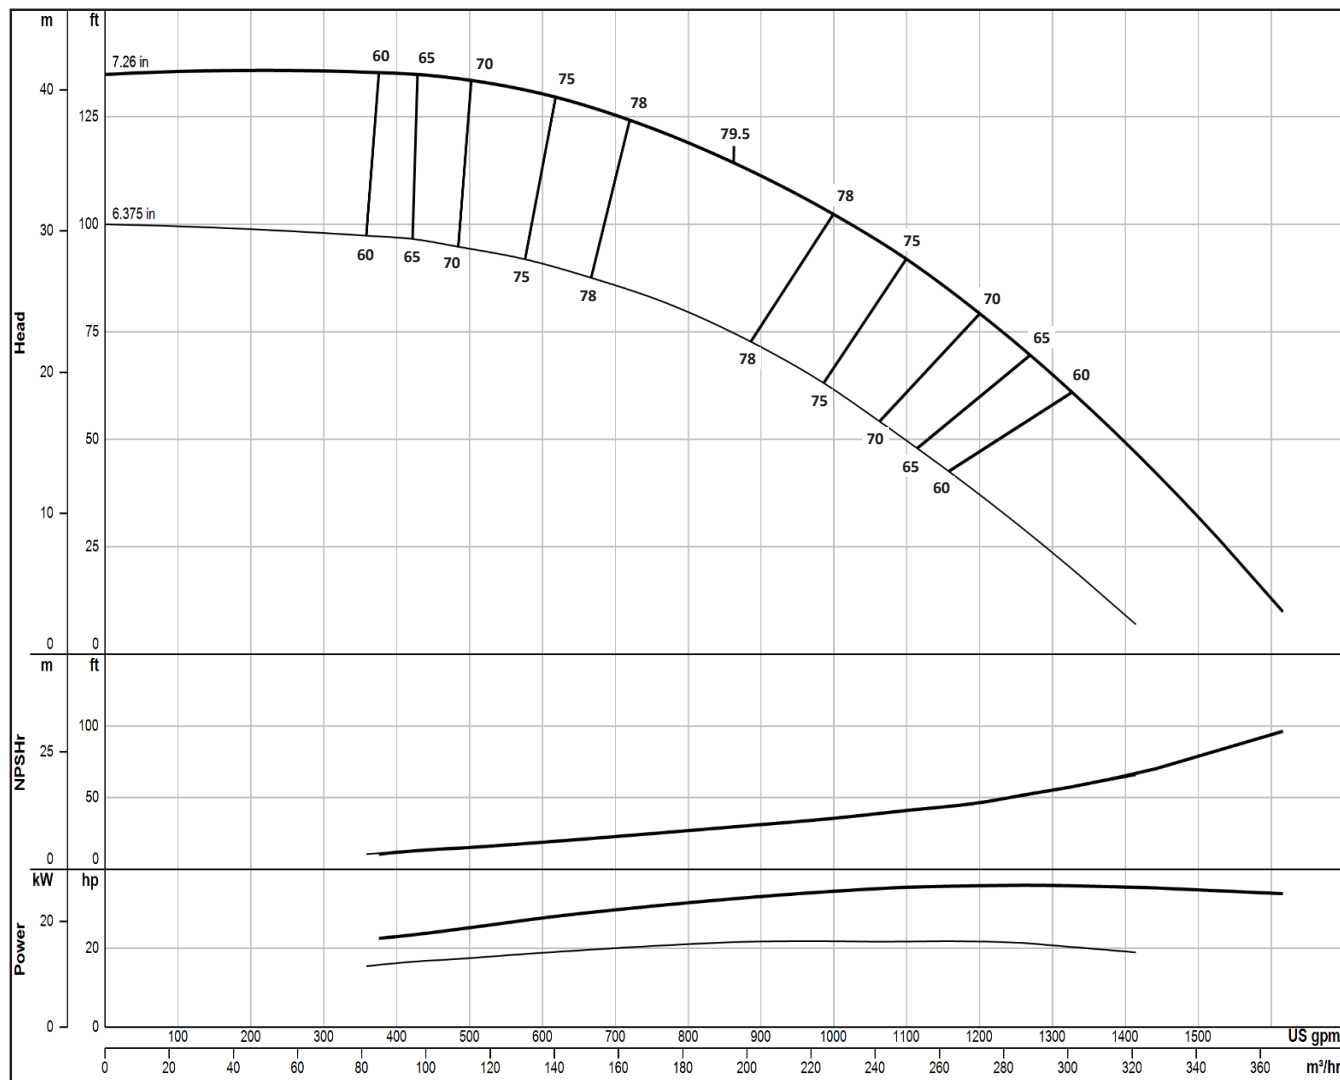

Impeller Type	Enclosed	Bowl Ø (cm)	22.9	ns (SI)	45	Qty.	Eff.
Impeller Model	SL9H	Thd'd Discharge (cm)	15, 20, 10	S (SI)	147	Stages	Change
One Stage Weight (kg)	61.2	Thd'd Suction (cm)	15	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	24.0	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-2
Impeller Wt. (kg)	3.9	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	2.54	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	63.2	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	8.5	5	0
Add'l Stage Length (cm)	21.6	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.010		

Δ Consult factory for availability

2022-10-25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SF9H

2875 RPM

ONE ()
STAGE STAGE

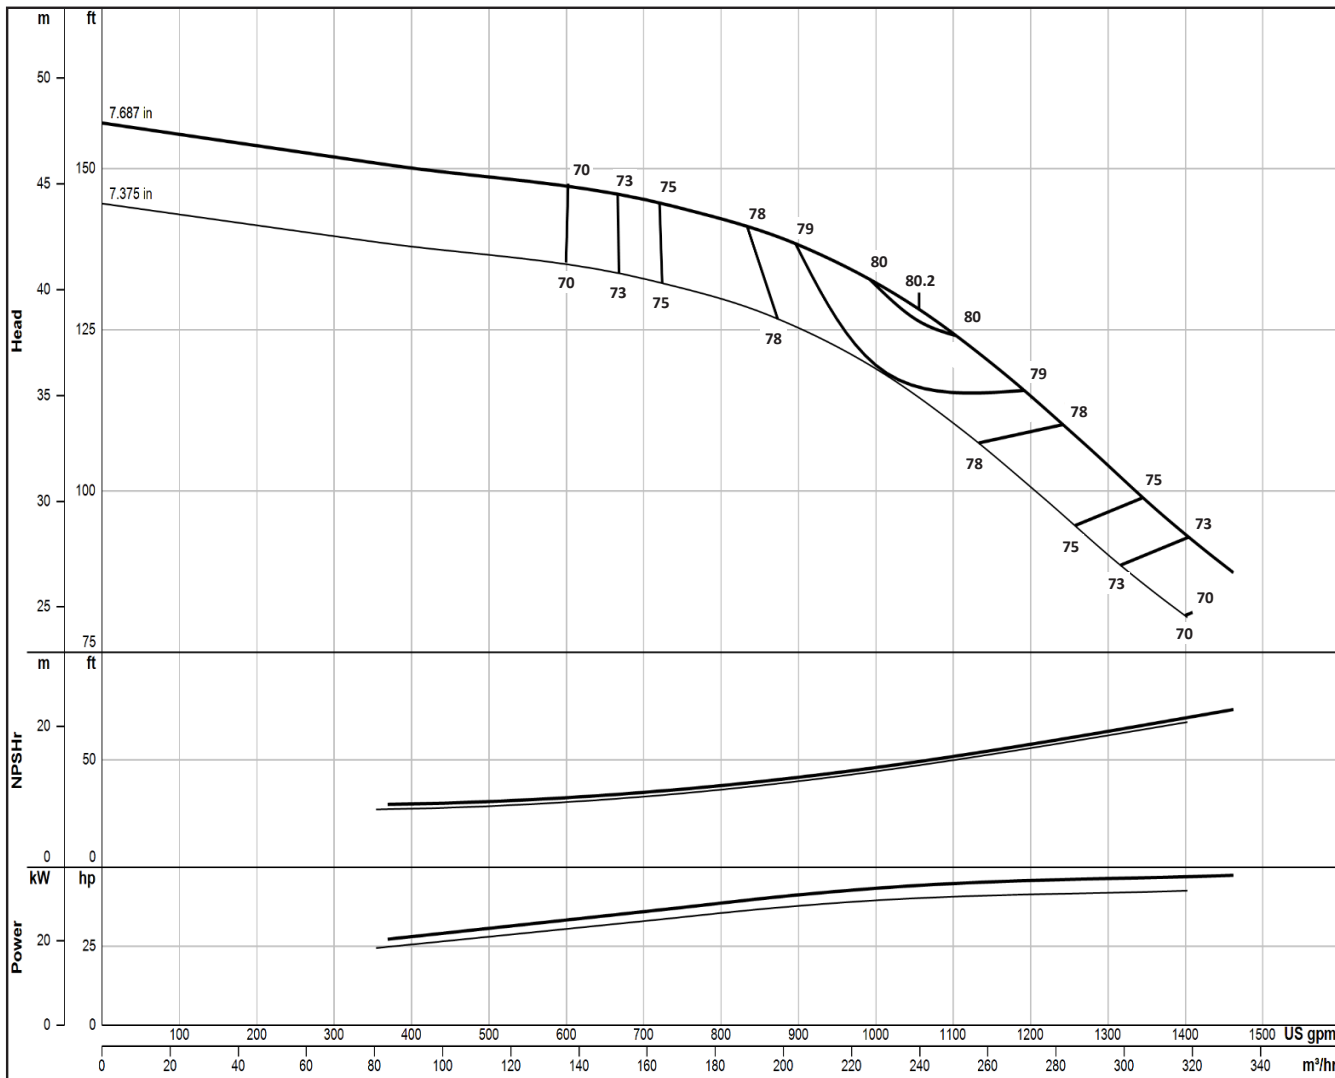

Impeller Type	Enclosed	Bowl Ø (cm)	24.1	ns (SI)	44	Qty.	Eff.
Impeller Model	SF9H	Thd'd Discharge (cm)	15, 20, 10	S (SI)	99	Stages	Change
One Stage Weight (kg)	83.9	Thd'd Suction (cm)	15	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	30.4	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-2
Impeller Wt. (kg)	4.1	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	2.38	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	60.0	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	16.1	5	0
Add'l Stage Length (cm)	19.1	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.012		

Δ Consult factory for availability

2022-10-25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SK9M

2875 RPM

ONE ()
STAGE STAGE

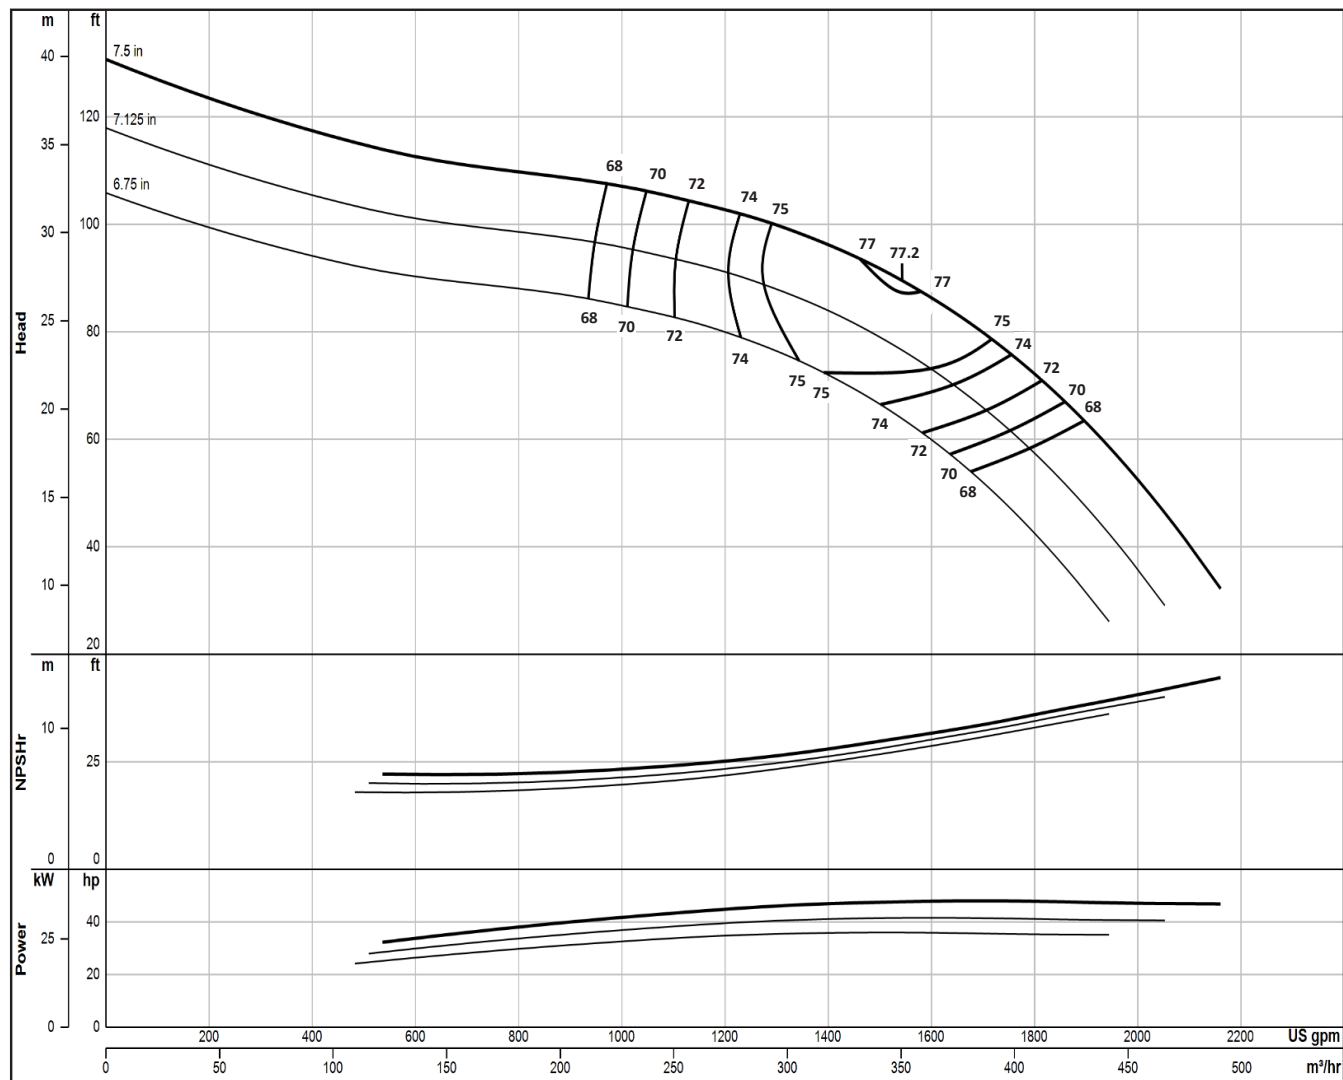

Impeller Type	Enclosed	Bowl Ø (cm)	24.0	ns (SI)	74	Qty.	Eff.
Impeller Model	SK9M	Thd'd Discharge (cm)	15, 20, 10	S (SI)	170	Stages	Change
One Stage Weight (kg)	113.4	Thd'd Suction (cm)	20	PEIcl	N/A	1	-4
Add'l Stage Wt. (kg)	38.6	Bell Suction Ø (cm)	N/A	Bowl Shaft Ø (cm)	4.29	2	-3
Impeller Wt. (kg)	6.8	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	3.65	3	-2
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	68.6	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	14.1	5	0
Add'l Stage Length (cm)	27.0	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.019		

Δ Consult factory for availability

2022-10-25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP10M

2875 RPM

ONE ()
STAGE STAGE

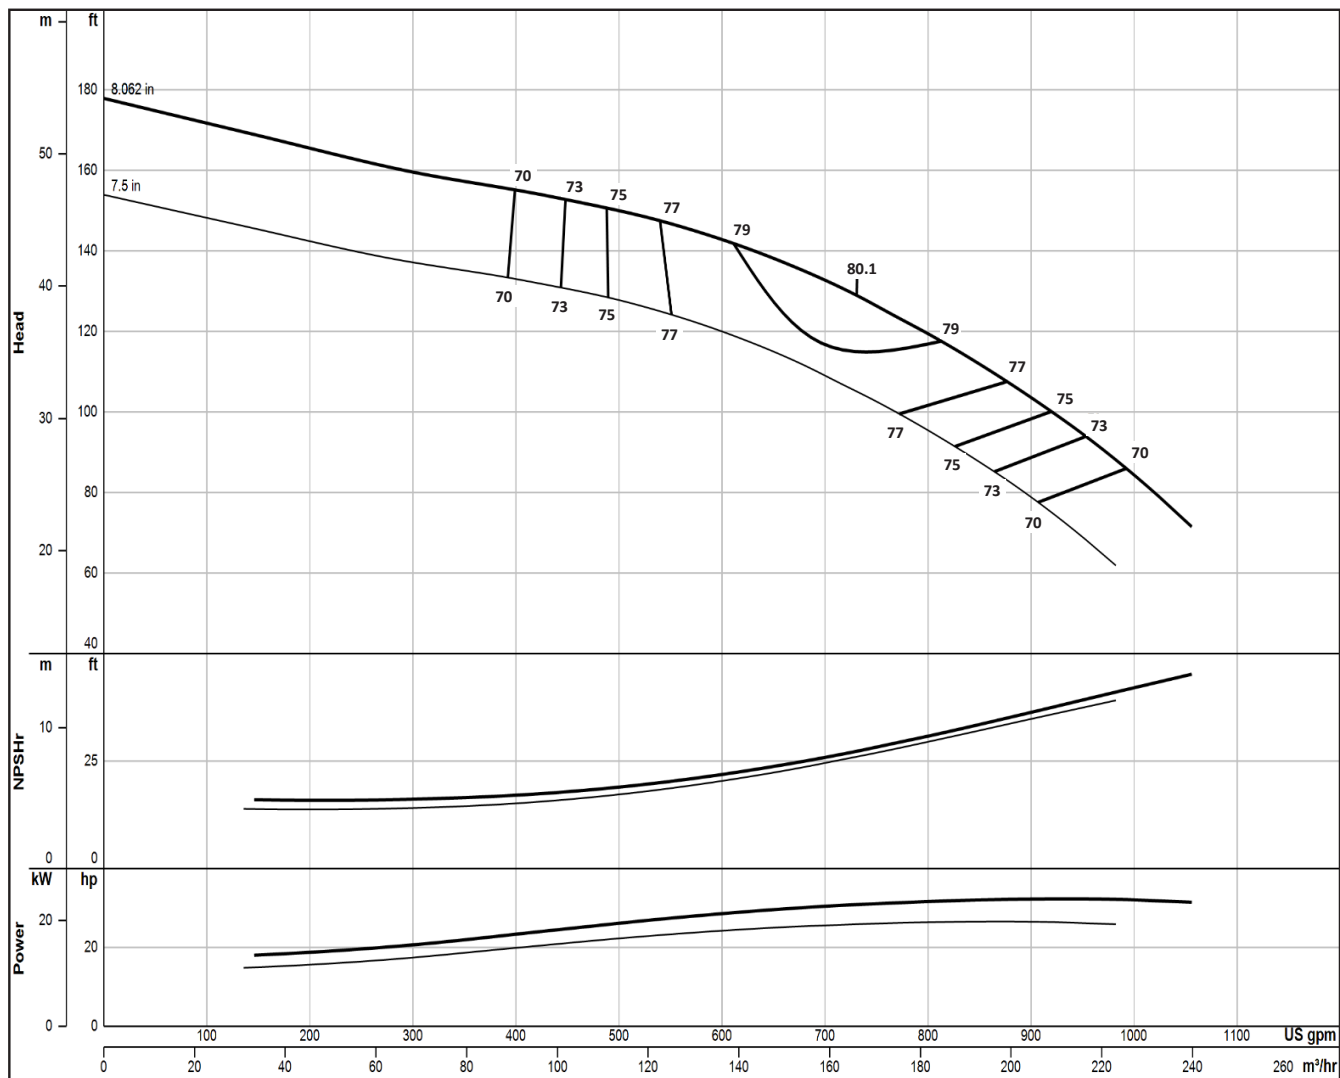

Impeller Type	Enclosed	Bowl Ø (cm)	25.9	ns (SI)	38	Qty.	Eff.
Impeller Model	SP10M	Thd'd Discharge (cm)	15, 20, 10	S (SI)	127	Stages	Change
One Stage Weight (kg)	86.2	Thd'd Suction (cm)	15	PEIcI	N/A	1	-3
Add'l Stage Wt. (kg)	34.0	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-2
Impeller Wt. (kg)	4.0	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	2.38	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	5034	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	59.4	D.I. Bowl Rating (kPa)	10908	K-Factor (kg/m-tdh)	11.5	5	0
Add'l Stage Length (cm)	18.4	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.014		

Δ Consult factory for availability

2022-10-25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP10H

2875 RPM

ONE ()
STAGE STAGE

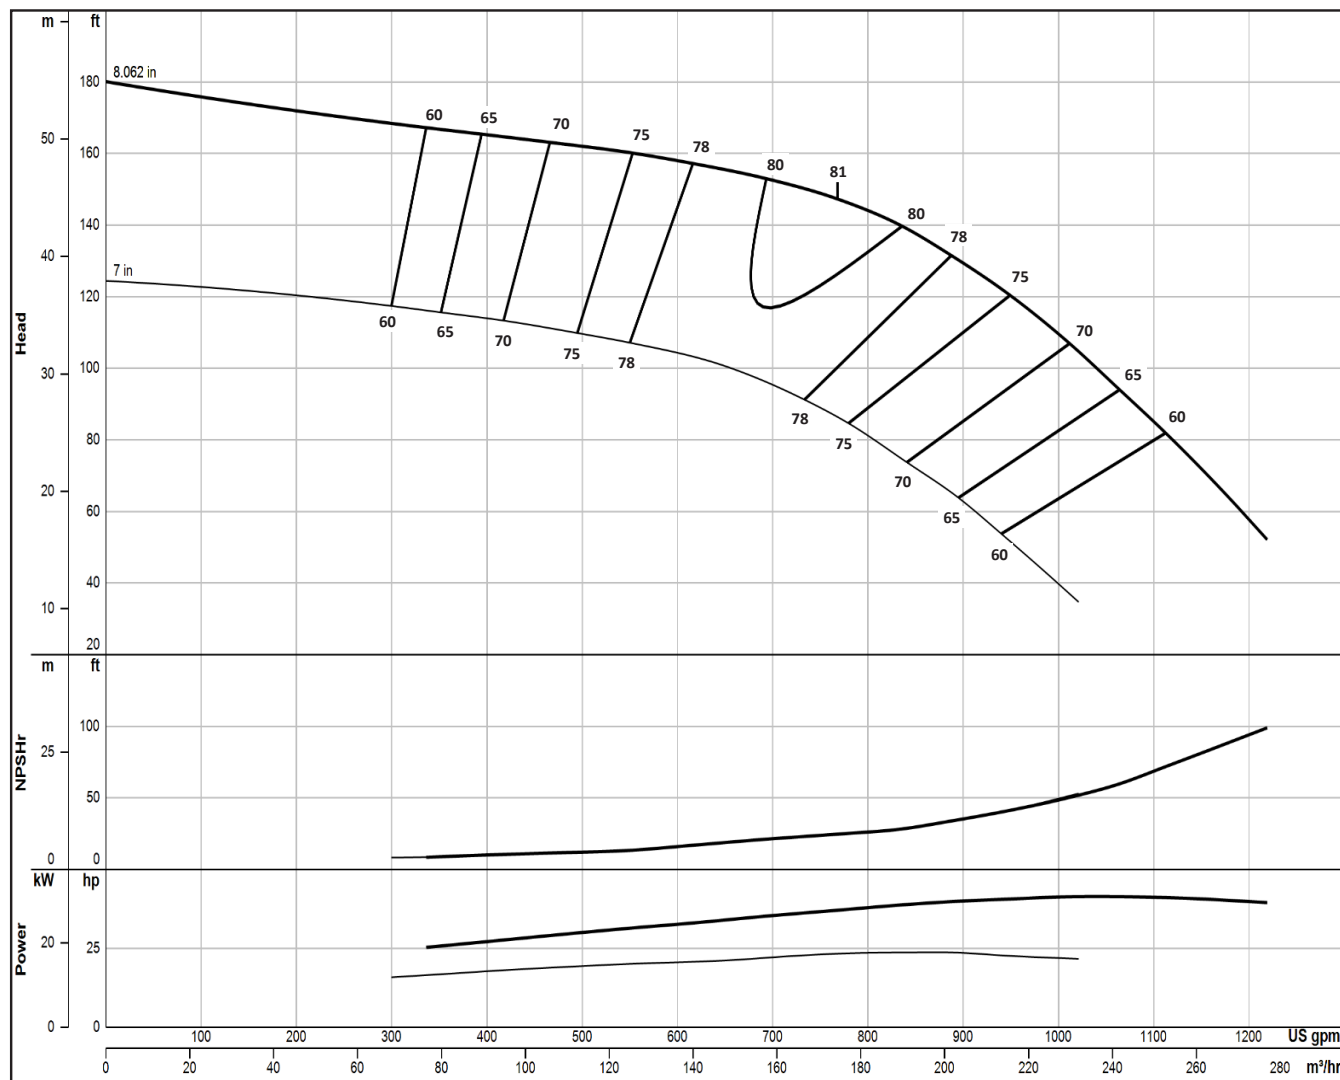

Impeller Type	Enclosed	Bowl Ø (cm)	25.9	ns (SI)	36	Qty.	Eff.
Impeller Model	SP10H	Thd'd Discharge (cm)	15, 20, 10	S (SI)	151	Stages	Change
One Stage Weight (kg)	86.2	Thd'd Suction (cm)	15	PEIcl	N/A	1	-4
Add'l Stage Wt. (kg)	34.0	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-3
Impeller Wt. (kg)	4.1	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	1.59	3	-2
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	5034	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	59.4	D.I. Bowl Rating (kPa)	10908	K-Factor (kg/m-tdh)	7.8	5	0
Add'l Stage Length (cm)	18.4	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.013		

Δ Consult factory for availability

2022-10-25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM10MO

2875 RPM

ONE ()
STAGE STAGE

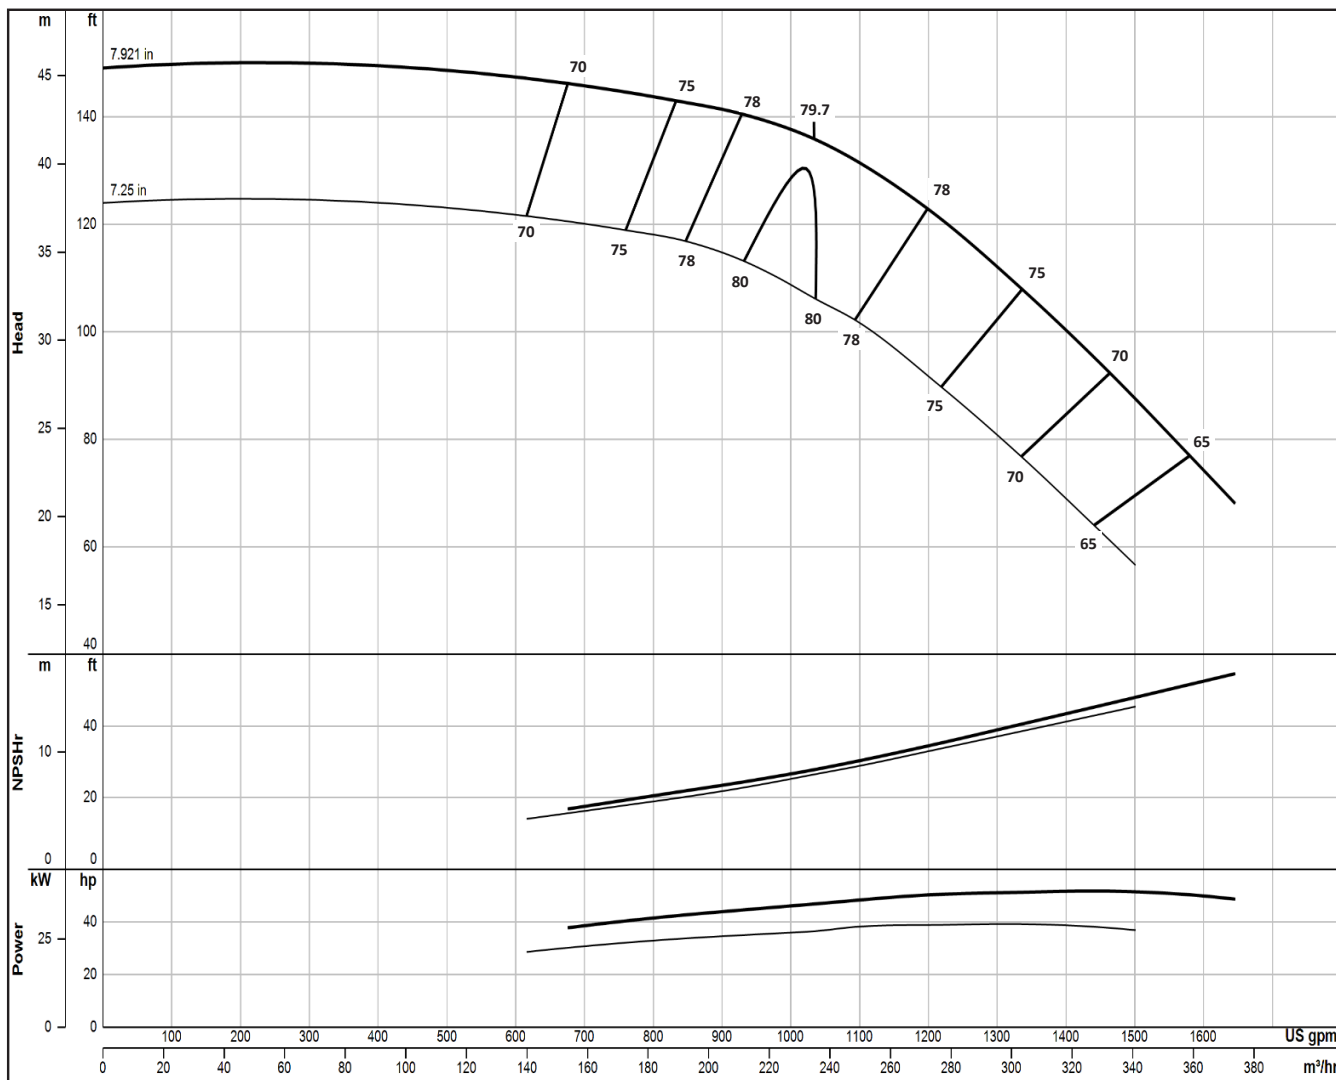

Impeller Type	Semi-Open	Bowl Ø (cm)	25.9	ns (SI)	46	Qty.	Eff.
Impeller Model	SM10MO	Thd'd Discharge (cm)	15, 20, 10	S (SI)	149	Stages	Change
One Stage Weight (kg)	86.2	Thd'd Suction (cm)	15	PEIcl	N/A	1	-4
Add'l Stage Wt. (kg)	34.0	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-3
Impeller Wt. (kg)	2.8	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	3.96	3	-2
Impeller Mtrl.	NaB	C.I. Bowl Rating (kPa)	3368	Imp. Setting (cm)	0.08	4	-1
One Stage Length (cm)	63.5	D.I. Bowl Rating (kPa)	7298	K-Factor (kg/m-tdh)	10.0	5	0
Add'l Stage Length (cm)	22.6	316 Bowl Rating (kPa)	Δ	Imp. WR ² (kg-m ²)	0.009		

Δ Consult factory for availability

2022-10-25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM10HO

2875 RPM

ONE ()
STAGE STAGE

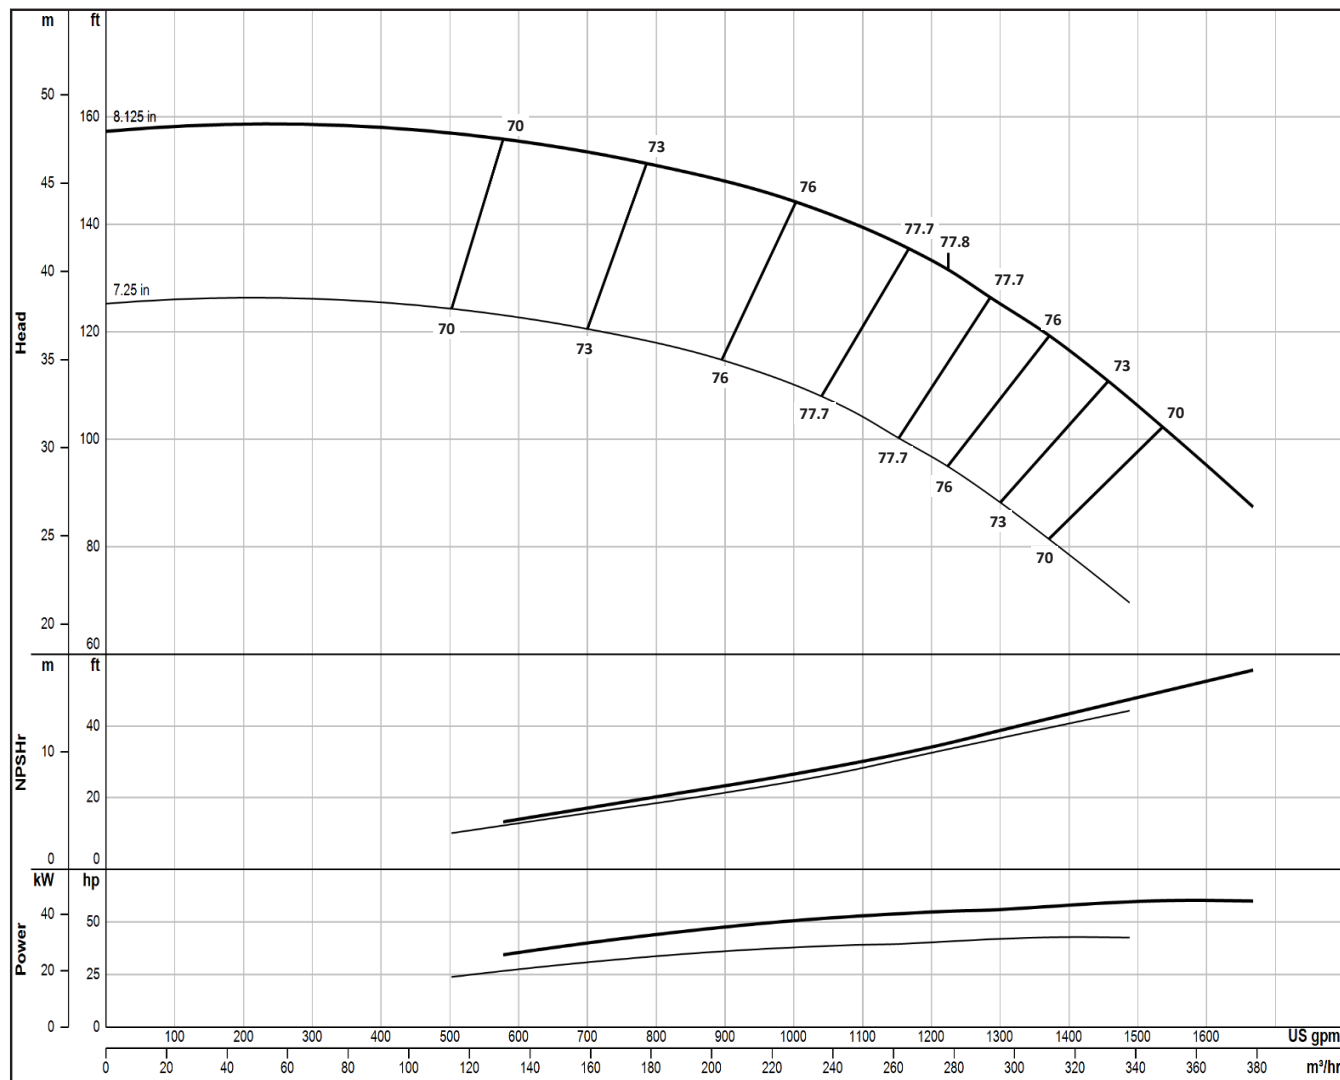

Impeller Type	Semi-Open	Bowl Ø (cm)	25.9	ns (SI)	45	Qty.	Eff.
Impeller Model	SM10HO	Thd'd Discharge (cm)	15, 20, 10	S (SI)	148	Stages	Change
One Stage Weight (kg)	86.2	Thd'd Suction (cm)	15	PEIcl	N/A	1	-4
Add'l Stage Wt. (kg)	34.0	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-3
Impeller Wt. (kg)	2.8	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	3.18	3	-2
Impeller Mtrl.	NaB	C.I. Bowl Rating (kPa)	3368	Imp. Setting (cm)	0.08	4	-1
One Stage Length (cm)	63.5	D.I. Bowl Rating (kPa)	7298	K-Factor (kg/m-tdh)	9.5	5	0
Add'l Stage Length (cm)	22.6	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.009		

Δ Consult factory for availability

2022-10-25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM10M

2875 RPM

ONE ()
STAGE STAGE

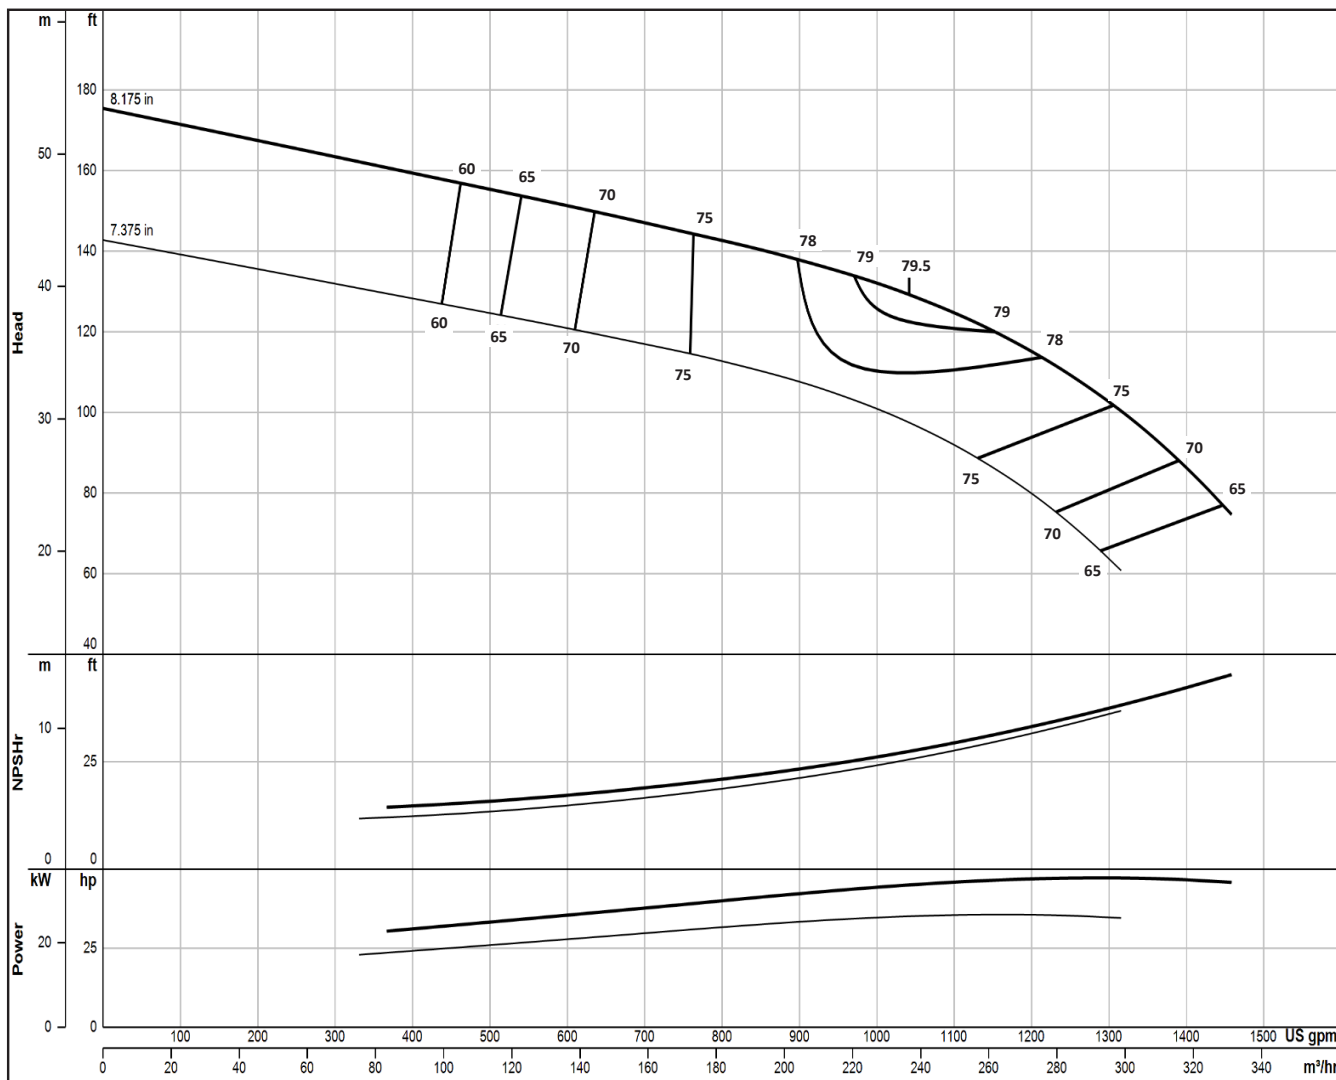

Impeller Type	Enclosed	Bowl Ø (cm)	25.9	ns (SI)	48	Qty.	Eff.
Impeller Model	SM10M	Thd'd Discharge (cm)	15, 20, 10	S (SI)	148	Stages	Change
One Stage Weight (kg)	88.5	Thd'd Suction (cm)	15	PEIcl	N/A	1	-4
Add'l Stage Wt. (kg)	34.0	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-3
Impeller Wt. (kg)	4.4	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	2.70	3	-2
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	3368	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	63.5	D.I. Bowl Rating (kPa)	7298	K-Factor (kg/m-tdh)	13.2	5	0
Add'l Stage Length (cm)	22.6	316 Bowl Rating (kPa)	7859	Imp. WR² (kg-m²)	0.015		

Δ Consult factory for availability

2021-06-08

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM10H

2875 RPM

ONE ()
STAGE STAGE

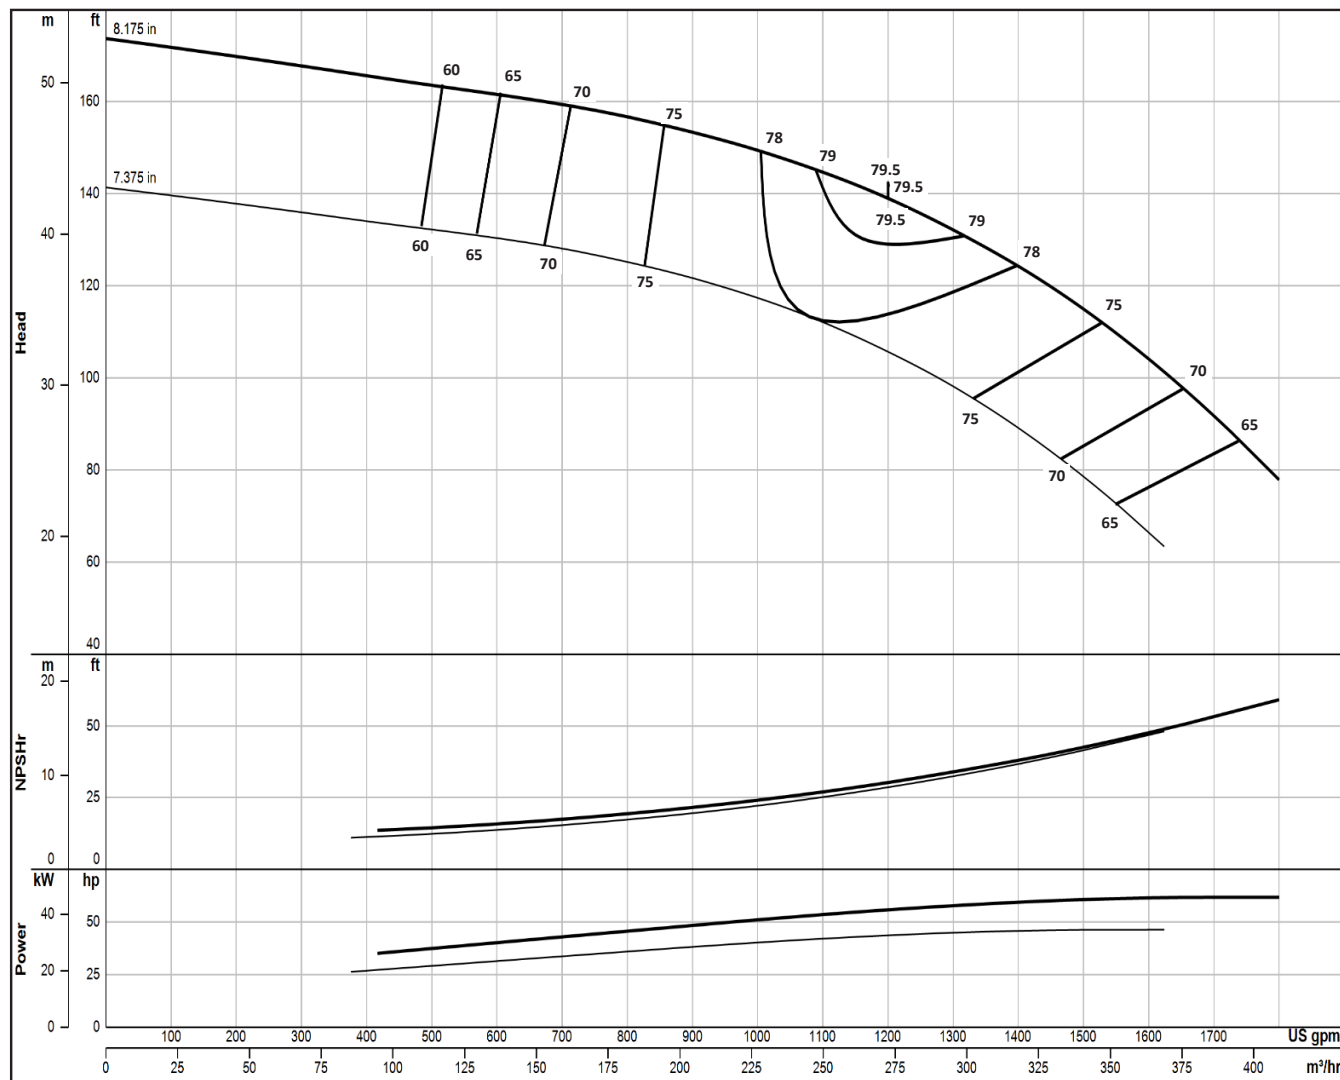

Impeller Type	Enclosed	Bowl Ø (cm)	25.9	ns (SI)	48	Qty.	Eff.
Impeller Model	SM10H	Thd'd Discharge (cm)	15, 20, 10	S (SI)	149	Stages	Change
One Stage Weight (kg)	88.5	Thd'd Suction (cm)	15	PEIcl	N/A	1	-4
Add'l Stage Wt. (kg)	34.5	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-3
Impeller Wt. (kg)	4.9	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	2.70	3	-2
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	3368	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	63.5	D.I. Bowl Rating (kPa)	7298	K-Factor (kg/m-tdh)	13.2	5	0
Add'l Stage Length (cm)	22.6	316 Bowl Rating (kPa)	7859	Imp. WR ² (kg-m²)	0.016		

Δ Consult factory for availability

2021-06-08

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM11M

2875 RPM

ONE ()
STAGE STAGE

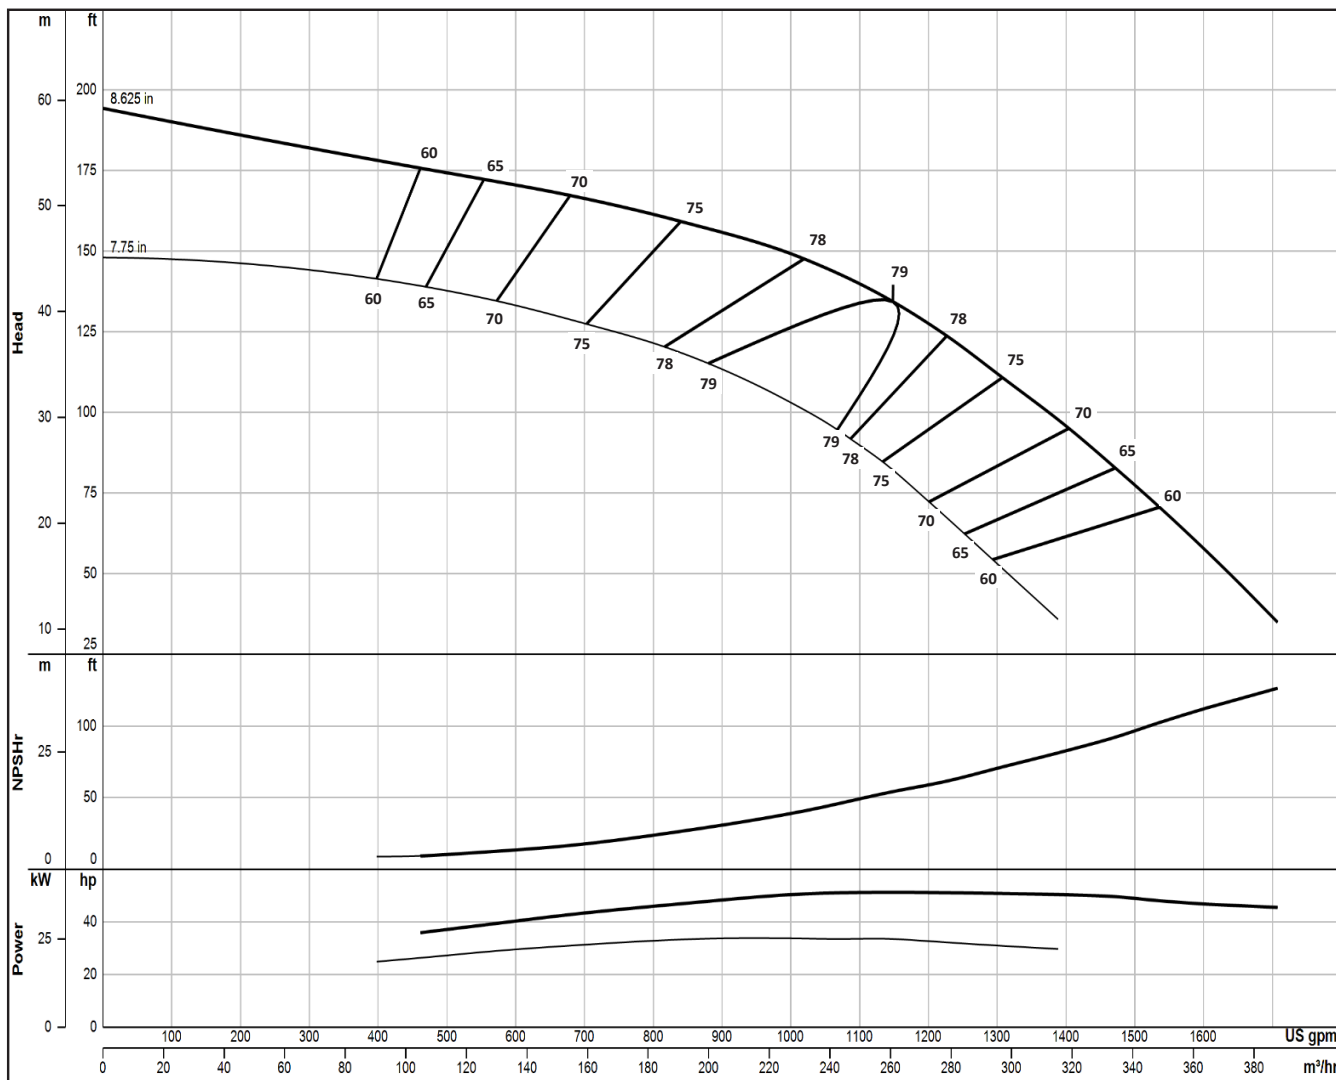

Impeller Type	Enclosed	Bowl Ø (cm)	27.0	ns (SI)	45	Qty.	Eff.
Impeller Model	SM11M	Thd'd Discharge (cm)	15, 20, 10	S (SI)	102	Stages	Change
One Stage Weight (kg)	88.5	Thd'd Suction (cm)	20	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	34.0	Bell Suction Ø (cm)	28.9	Bowl Shaft Ø (cm)	3.81	2	-2
Impeller Wt. (kg)	4.3	Sub. Mtr. (cm)	20, 25, 30	Total Lateral (cm)	2.22	3	-1
Impeller Mtrl.	NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	66.4	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	8.9	5	0
Add'l Stage Length (cm)	21.9	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.016		

Δ Consult factory for availability

2022-10-25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SL11L

2875 RPM

ONE ()
STAGE STAGE

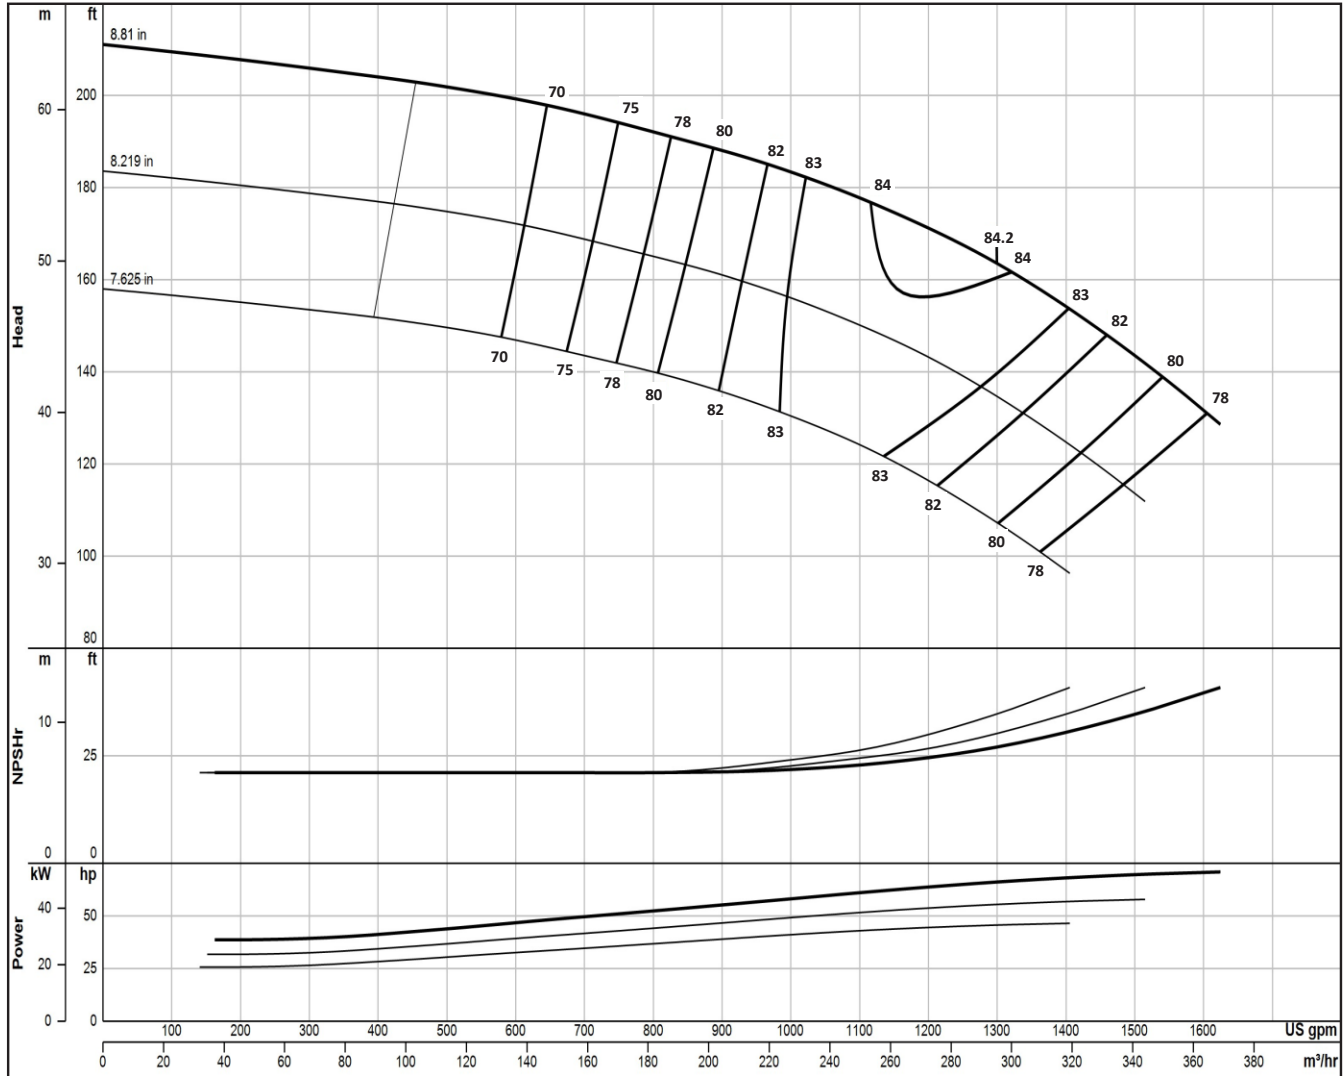

Impeller Type	Enclosed	Bowl Ø (cm)	27.9	ns (SI)	41	Qty.	Eff.
Impeller Model	SL11L	Thd'd Discharge (cm)	15, 20, 10	S (SI)	173	Stages	Change
One Stage Weight (kg)	90.7	Thd'd Suction (cm)	20	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	36.7	Bell Suction Ø (cm)	28.9	Bowl Shaft Ø (cm)	4.29	2	-2
Impeller Wt. (kg)	4.4	Sub. Mtr. (cm)	20, 25, 30	Total Lateral (cm)	3.18	3	-1
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	69.9	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	10.4	5	0
Add'l Stage Length (cm)	25.4	316 Bowl Rating (kPa)	Δ	Imp. WR ² (kg-m ²)	0.013		

Δ Consult factory for availability

2025-06-27

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SL11M

2875 RPM

ONE ()
STAGE STAGE

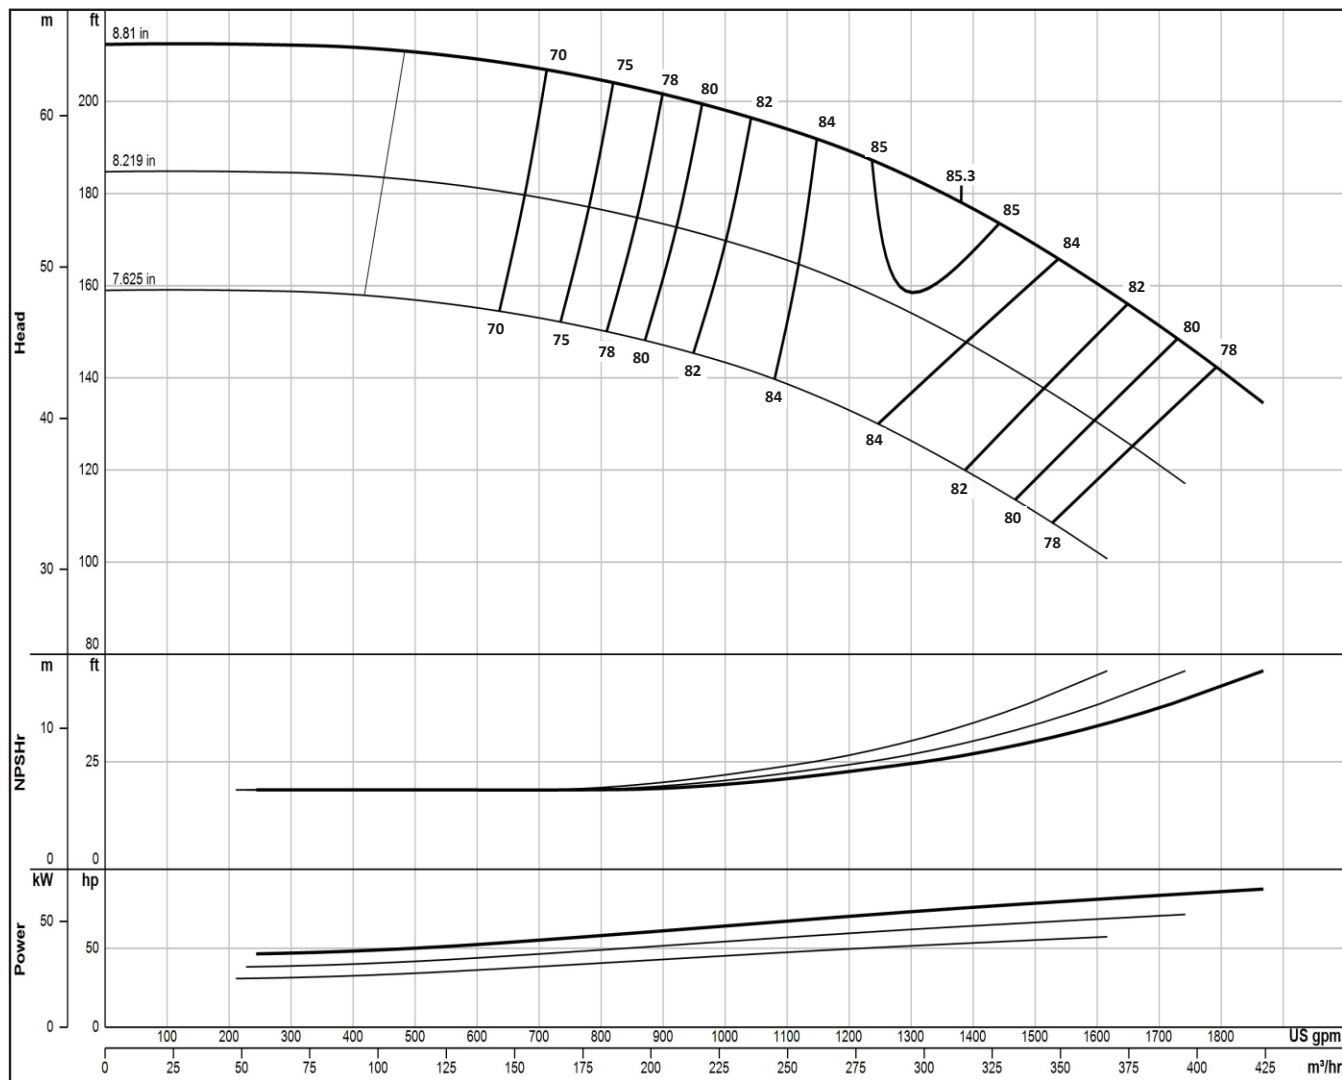

Impeller Type	Enclosed	Bowl Ø (cm)	27.9	ns (SI)	42	Qty.	Eff.
Impeller Model	SL11M	Thd'd Discharge (cm)	15, 20, 10	S (SI)	180	Stages	Change
One Stage Weight (kg)	90.7	Thd'd Suction (cm)	20	PEIcI	N/A	1	-3
Add'l Stage Wt. (kg)	36.7	Bell Suction Ø (cm)	28.9	Bowl Shaft Ø (cm)	4.29	2	-2
Impeller Wt. (kg)	5.0	Sub. Mtr. (cm)	20, 25, 30	Total Lateral (cm)	3.18	3	-1
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	69.9	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	10.4	5	0
Add'l Stage Length (cm)	25.4	316 Bowl Rating (kPa)	Δ	Imp. WR ² (kg-m ²)	0.014		

Δ Consult factory for availability

2025-06-27

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SL11H

2875 RPM

ONE ()
STAGE STAGE

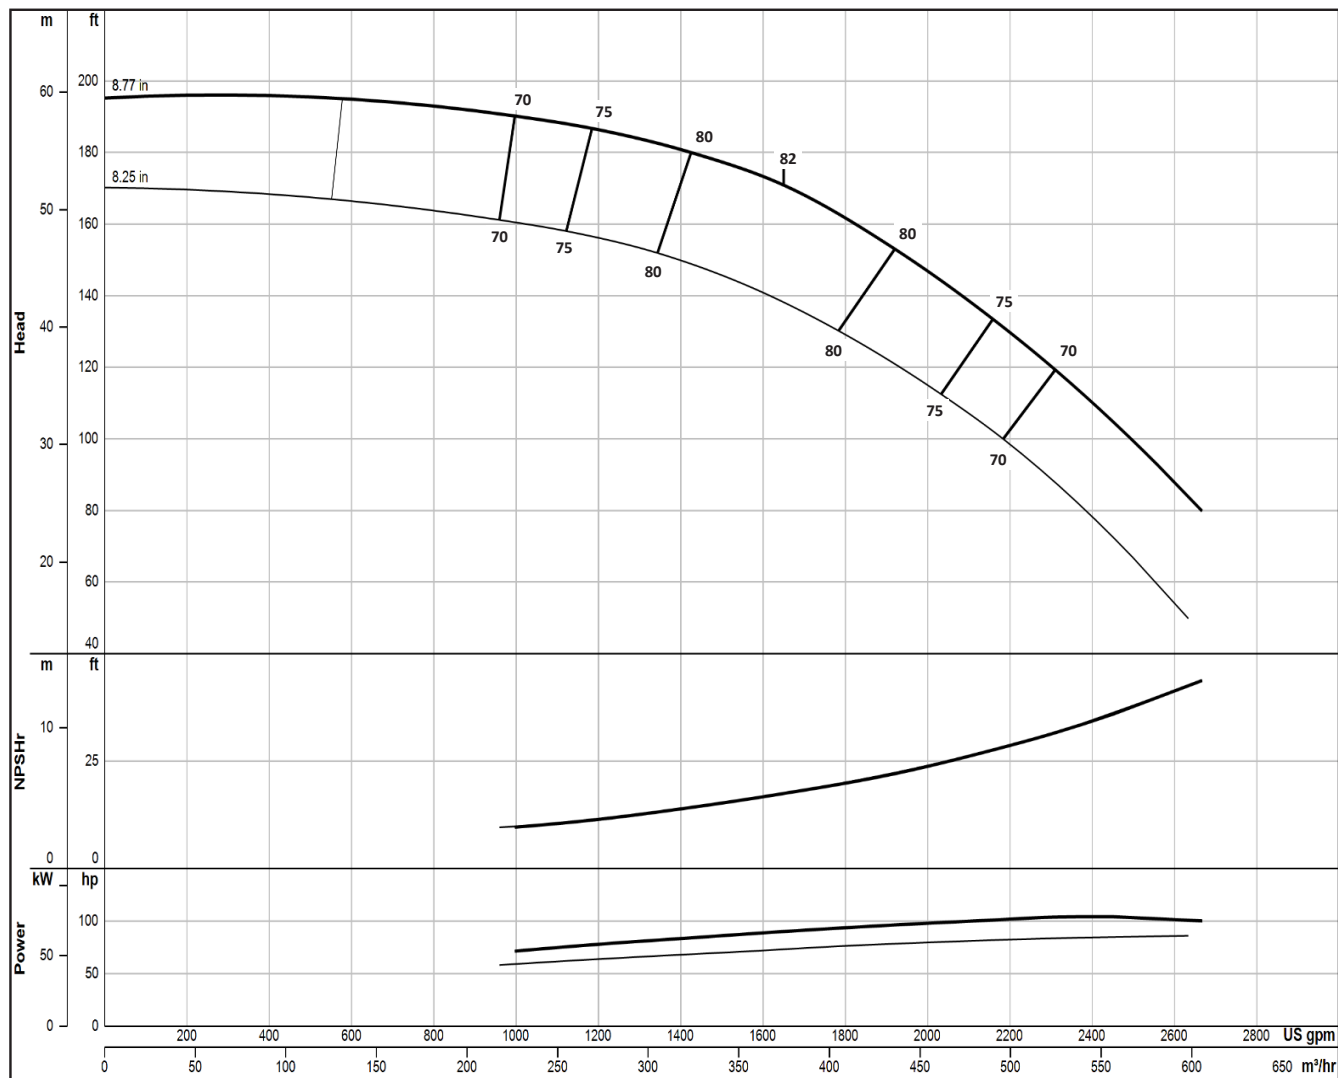

Impeller Type	Enclosed	Bowl Ø (cm)	27.9	ns (SI)	48	Qty.	Eff.
Impeller Model	SL11H	Thd'd Discharge (cm)	15, 20, 10	S (SI)	270	Stages	Change
One Stage Weight (kg)	90.7	Thd'd Suction (cm)	20	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	36.7	Bell Suction Ø (cm)	28.9	Bowl Shaft Ø (cm)	4.29	2	-2
Impeller Wt. (kg)	5.4	Sub. Mtr. (cm)	20, 25, 30	Total Lateral (cm)	2.86	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	69.9	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	11.3	5	0
Add'l Stage Length (cm)	25.4	316 Bowl Rating (kPa)	Δ	Imp. WR ² (kg-m ²)	0.018		

Δ Consult factory for availability

2022-10-25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



**1450 RPM
Selection Chart**

Model	Bowl Dia. (cm.)	Peak Eff. (Max Dia.)	BEP Flow (m ³ /h)	BEP Head (m. / Stage)	BEP NPSHr (m. H ₂ O)	POR (m ³ /h)	ns (SI)	S (SI)
SP5XXL	13.3	66.4	9.2	2.7	0.3	6-11	35	179
SP5XL	13.3	78.0	11.8	4.2	0.6	8-14	35	147
SP5L	13.3	76.3	14.2	4.9	0.6	10-17	34	160
SP5LO	13.3	76.6	11.1	4.1	0.6	8-13	34	137
SM5M	13.3	77.8	23.2	2.4	1.0	16-28	74	143
SM5H	13.3	77.9	31.6	3.0	1.4	22-38	72	131
SP6LL	15.2	65.6	16.8	4.5	1.1	12-20	39	112
SP6M	15.2	68.1	19.8	5.3	1.2	14-24	37	118
SP6H	15.2	69.3	26.3	6.0	4.4	18-32	40	50
SP6LO	15.2	75.8	18.8	4.8	1.3	13-23	40	106
SP6MO	15.2	75.4	21.6	5.1	1.2	15-26	41	117
SM6M	15.2	76.3	20.3	4.3	0.9	14-24	45	143
SM6H	15.2	79.1	25.9	5.5	1.1	18-31	42	140
SK6HH	14.0	72.9	48.2	3.6	1.3	34-58	78	165
SK7L	16.7	78.9	46.8	5.4	2.4	33-56	57	106
SK7M	16.7	78.4	52.7	4.9	0.7	37-63	65	273
SK7H	16.7	76.5	63.8	6.2	1.0	45-77	60	234
SP7L	18.3	79.1	48.4	7.4	1.1	34-58	46	185
SP7H	18.3	81.7	60.4	8.8	1.6	42-72	45	159
SM7M	17.8	78.4	69.0	5.5	1.4	48-83	68	187
SM7H	17.8	77.9	85.9	5.7	2.2	60-103	74	153
SK8H	19.1	78.2	129.2	6.8	5.7	90-155	80	91
SM9L	24.1	83.1	64.0	15.2	1.8	45-77	31	149
SM9M	24.1	82.2	85.9	16.4	3.5	60-103	34	107
SM9H	24.1	81.8	96.5	15.5	3.2	68-116	37	122
SP9L	24.1	81.9	66.5	15.6	1.4	47-80	31	183
SP9M	24.1	80.0	73.4	16.4	1.9	51-88	31	158
SL9H	22.9	78.6	123.1	16.1	3.0	86-148	41	145
SF9H	24.1	80.7	143.1	15.8	5.3	100-172	45	101
SK9M	24.0	77.1	213.7	10.4	3.4	150-256	74	171
SK9H	24.0	77.1	281.6	11.2	5.9	197-338	81	130
SP10M	25.9	80.1	99.7	15.1	3.1	70-120	38	127
SP10H	25.9	83.0	111.7	16.7	2.6	78-134	38	151
SM10MO	25.9	80.5	148.1	15.3	3.1	104-178	46	154
SM10HO	25.9	78.2	165.1	15.6	3.5	116-198	48	147
SM10M	25.9	82.5	149.0	14.7	3.2	104-179	48	149
SM10H	25.9	81.0	169.0	22.1	3.5	118-203	38	149

v26.1



**1450 RPM
Selection Chart**

Model	Bowl Dia. (cm.)	Peak Eff. (Max Dia.)	BEP Flow (m ³ /h)	BEP Head (m. / Stage)	BEP NPSHr (m. H ₂ O)	POR (m ³ /h)	ns (SI)	S (SI)
SM11M	27.0	81.6	120.9	11.5	2.4	85-145	43	136
SM11H	27.0	76.3	149.5	11.2	4.1	105-179	49	105
SR11MO	29.2	81.2	179.4	14.1	3.6	126-215	45	125
SR11HO	29.2	83.0	219.9	16.0	3.9	154-264	46	131
SL11L	27.9	84.2	142.3	13.6	2.0	100-171	41	173
SL11M	27.9	84.2	156.9	14.4	2.0	110-188	42	180
SL11H	27.9	84.2	170.9	14.9	2.0	120-205	42	188
SP11L	28.6	85.3	196.8	11.2	2.2	138-236	56	190
SP11M	28.6	81.5	229.8	11.4	2.1	161-276	60	210
SP11H	28.6	83.1	289.2	12.3	3.5	202-347	64	165
SW12L	30.5	83.1	98.6	14.7	1.9	69-118	33	151
SW12M	30.5	82.2	112.0	17.9	1.9	78-134	30	159
SL12M	29.8	85.3	149.9	13.7	1.7	105-180	42	202
SL12H	29.8	85.6	168.1	15.4	1.8	118-202	41	202
SJ12M	30.5	81.5	243.6	15.3	4.1	171-292	50	133
SJ12H	30.5	81.5	283.5	16.8	5.2	198-340	50	120
SM12L	30.2	83.0	150.3	13.7	2.2	105-180	42	167
SM12M	30.2	82.3	170.0	16.0	2.3	119-204	40	172
SM12H	30.2	83.4	187.0	17.0	2.5	131-224	40	167
SM14LL	35.6	86.9	342.6	15.6	3.3	240-411	58	185
SM14M	35.6	86.2	450.7	16.8	4.4	315-541	63	172
SM14H	35.6	81.3	537.5	17.8	5.7	376-645	66	154
SM14HH	35.6	84.4	564.4	18.9	4.8	395-677	64	180
SM14MO	35.6	84.2	457.8	18.5	4.5	320-549	59	171
SM14HO	35.6	83.4	516.7	20.0	5.3	362-620	59	161
SM16MO	38.7	82.1	703.5	20.3	4.7	492-844	68	204
SM16HO	38.7	83.1	826.5	21.6	5.9	579-992	71	186
SM16M	38.7	86.3	755.2	20.2	4.7	529-906	71	212
SM16H	38.7	86.8	890.7	22.9	6.2	623-1069	70	186
SJ18M	45.1	84.7	1019	21.1	8.0	713-1223	80	165
SJ18H	45.1	87.4	1173	23.5	8.5	821-1408	79	170
SJ18N	45.1	85.3	1085	24.3	7.1	759-1301	74	187
SM20M	48.9	5.3	1200	32.8	10.1	840-1440	62	150
SM20H	48.9	82.2	1295	35.1	13.1	907-1554	61	129
SJ20M	53.0	83.4	1780	28.9	6.9	1246-2136	83	243
SJ20H	53.0	83.6	2098	35.9	6.3	1468-2517	77	284
SJ20N	53.0	86.4	1791	36.3	6.4	1254-2149	70	259


v26.1



SP5XL

1450 RPM

ONE ()
STAGE STAGE

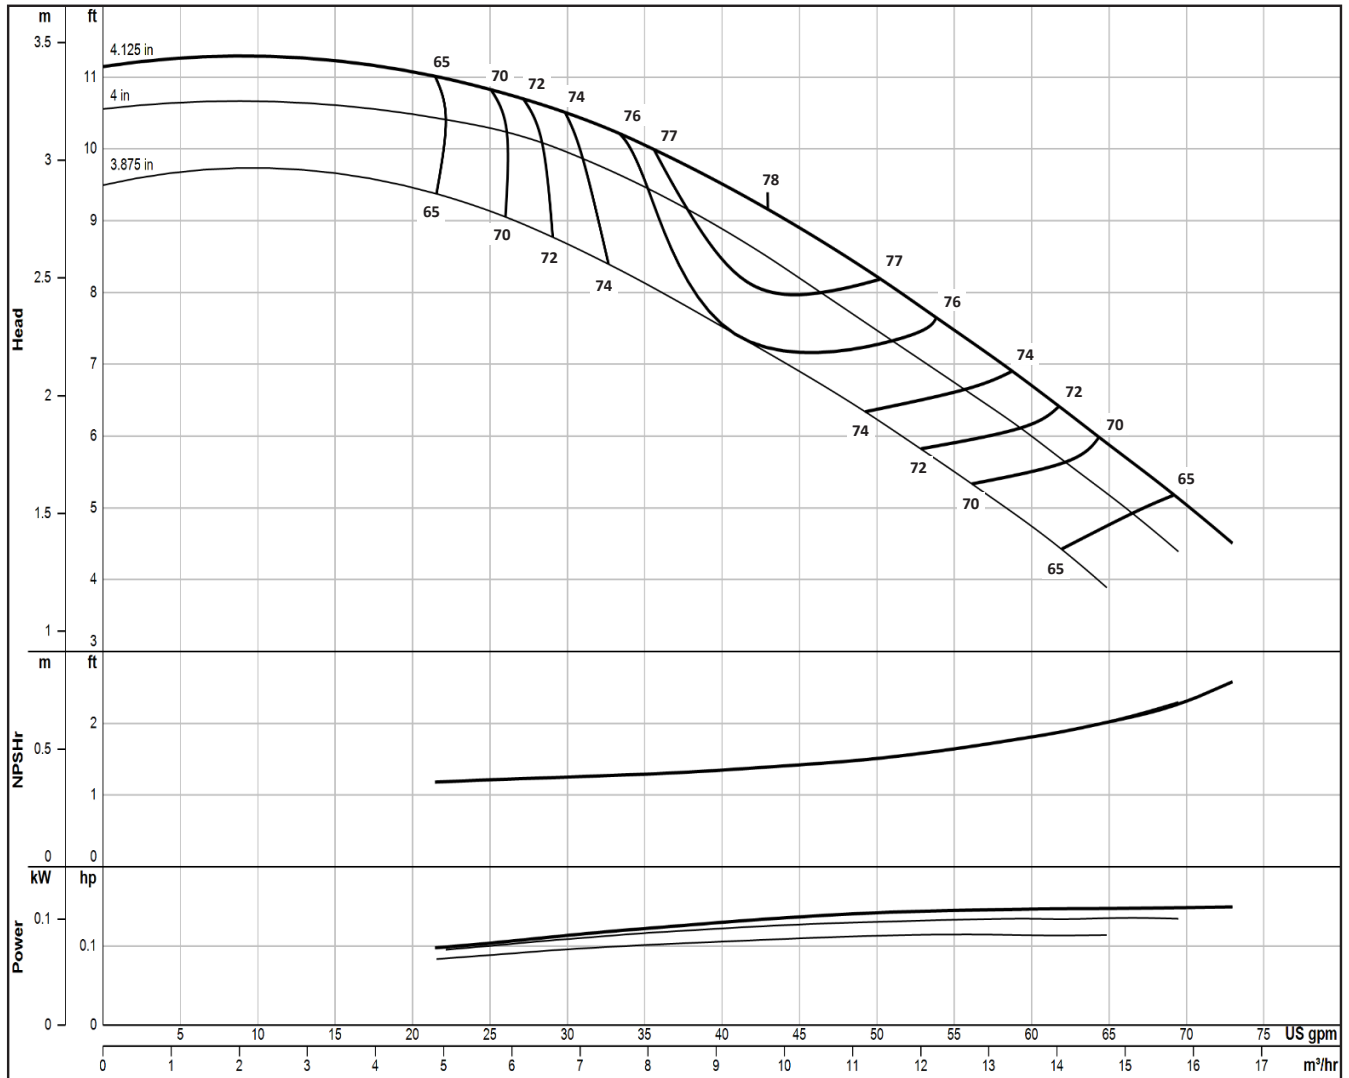

Impeller Type	Enclosed	Bowl Ø (cm)	13.3	ns (SI)	35	Qty.	Eff.
Impeller Model	SP5XL	Thd'd Discharge (cm)	8, 10	S (SI)	147	Stages	Change
One Stage Weight (kg)	22.7	Thd'd Suction (cm)	10	PEIcl	0.83	1	-4
Add'l Stage Wt. (kg)	6.4	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.22	2	-3
Impeller Wt. (kg)	0.8	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	0.75	3	-2
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	3647	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	45.4	D.I. Bowl Rating (kPa)	7902	K-Factor (kg/m-tdh)	3.4	5	0
Add'l Stage Length (cm)	11.8	316 Bowl Rating (kPa)	8510	Imp. WR² (kg-m²)	0.001		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP5L

1450 RPM

ONE ()
STAGE STAGE

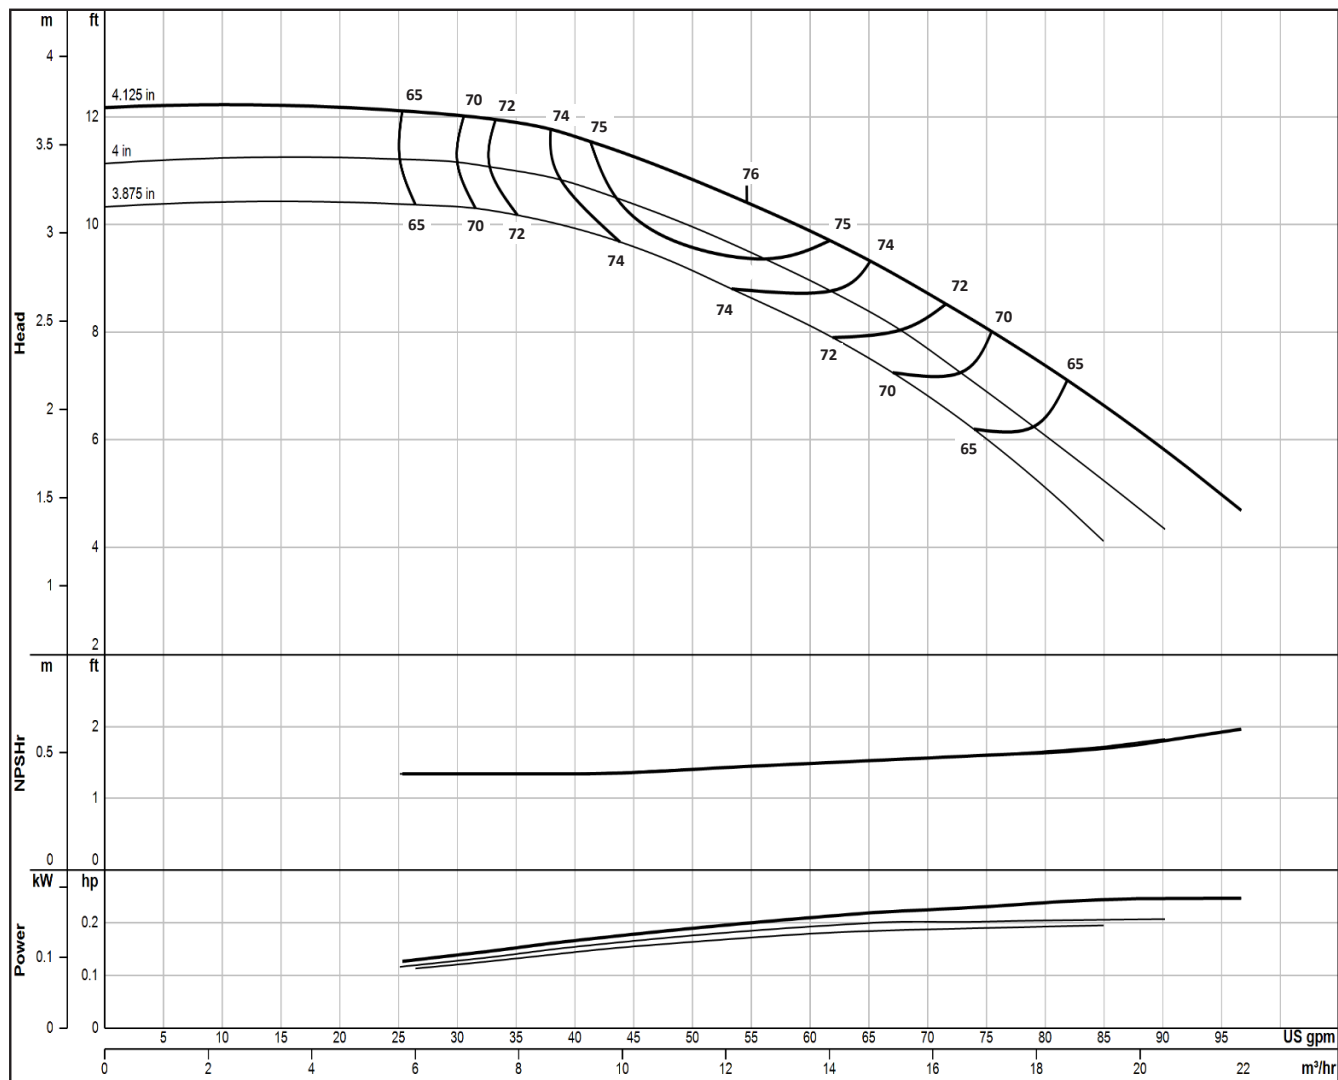

Impeller Type	Enclosed	Bowl Ø (cm)	13.3	ns (SI)	34	Qty.	Eff.
Impeller Model	SP5L	Thd'd Discharge (cm)	8, 10	S (SI)	160	Stages	Change
One Stage Weight (kg)	22.7	Thd'd Suction (cm)	10	PEIcl	0.84	1	-4
Add'l Stage Wt. (kg)	6.4	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.22	2	-3
Impeller Wt. (kg)	0.8	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	0.75	3	-2
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	3647	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	45.4	D.I. Bowl Rating (kPa)	7902	K-Factor (kg/m-tdh)	3.6	5	0
Add'l Stage Length (cm)	11.8	316 Bowl Rating (kPa)	8510	Imp. WR ² (kg-m²)	0.001		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM5M

1450 RPM

ONE ()
STAGE STAGE

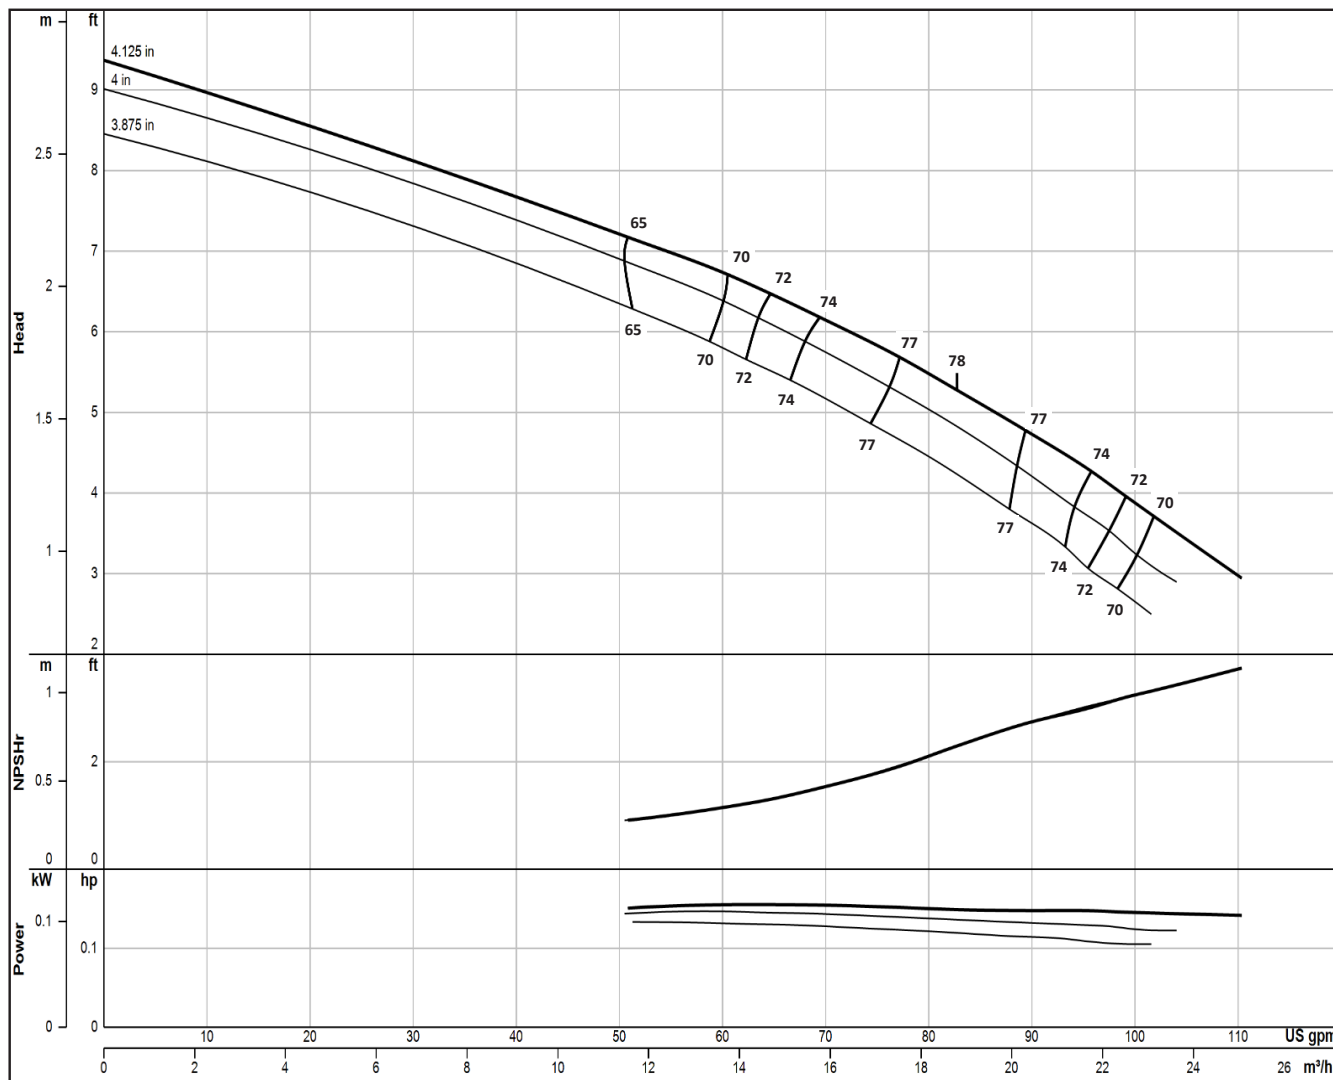

Impeller Type	Enclosed	Bowl Ø (cm)	13.3	ns (SI)	74	Qty.	Eff.
Impeller Model	SM5M	Thd'd Discharge (cm)	8, 10	S (SI)	143	Stages	Change
One Stage Weight (kg)	22.7	Thd'd Suction (cm)	10	PEIcI	0.86	1	-4
Add'l Stage Wt. (kg)	6.4	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.22	2	-3
Impeller Wt. (kg)	0.8	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.39	3	-2
Impeller Mtrl.	NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	46.1	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	3.7	5	0
Add'l Stage Length (cm)	12.4	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.001		

Δ Consult factory for availability

2022-10-20

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM5H

1450 RPM

ONE ()
STAGE STAGE

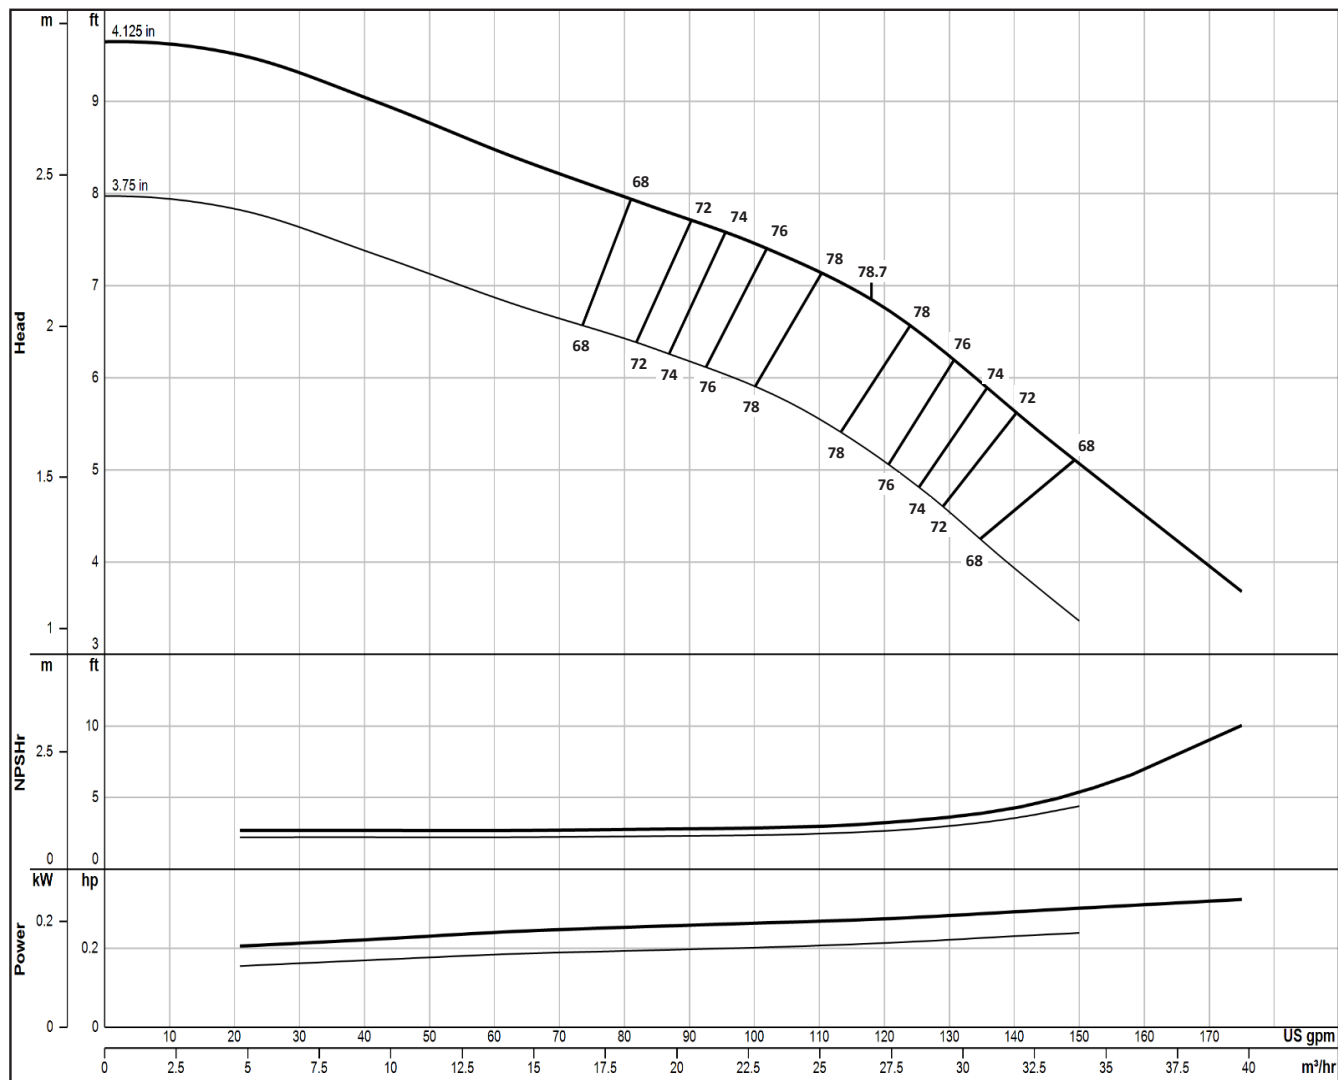

Impeller Type	Enclosed	Bowl Ø (cm)	13.3	ns (SI)	72	Qty.	Eff. Change
Impeller Model	SM5H	Thd'd Discharge (cm)	8, 10	S (SI)	131	Stages	
One Stage Weight (kg)	22.7	Thd'd Suction (cm)	10	PEIcl	0.80	1	-4
Add'l Stage Wt. (kg)	6.4	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.22	2	-3
Impeller Wt. (kg)	0.9	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.39	3	-2
Impeller Mtrl.	NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	46.1	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	3.7	5	0
Add'l Stage Length (cm)	12.4	316 Bowl Rating (kPa)	Δ	Imp. WR ² (kg-m²)	0.001		

Δ Consult factory for availability

2020-07-06

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP5LO

1450 RPM

ONE ()
STAGE STAGE

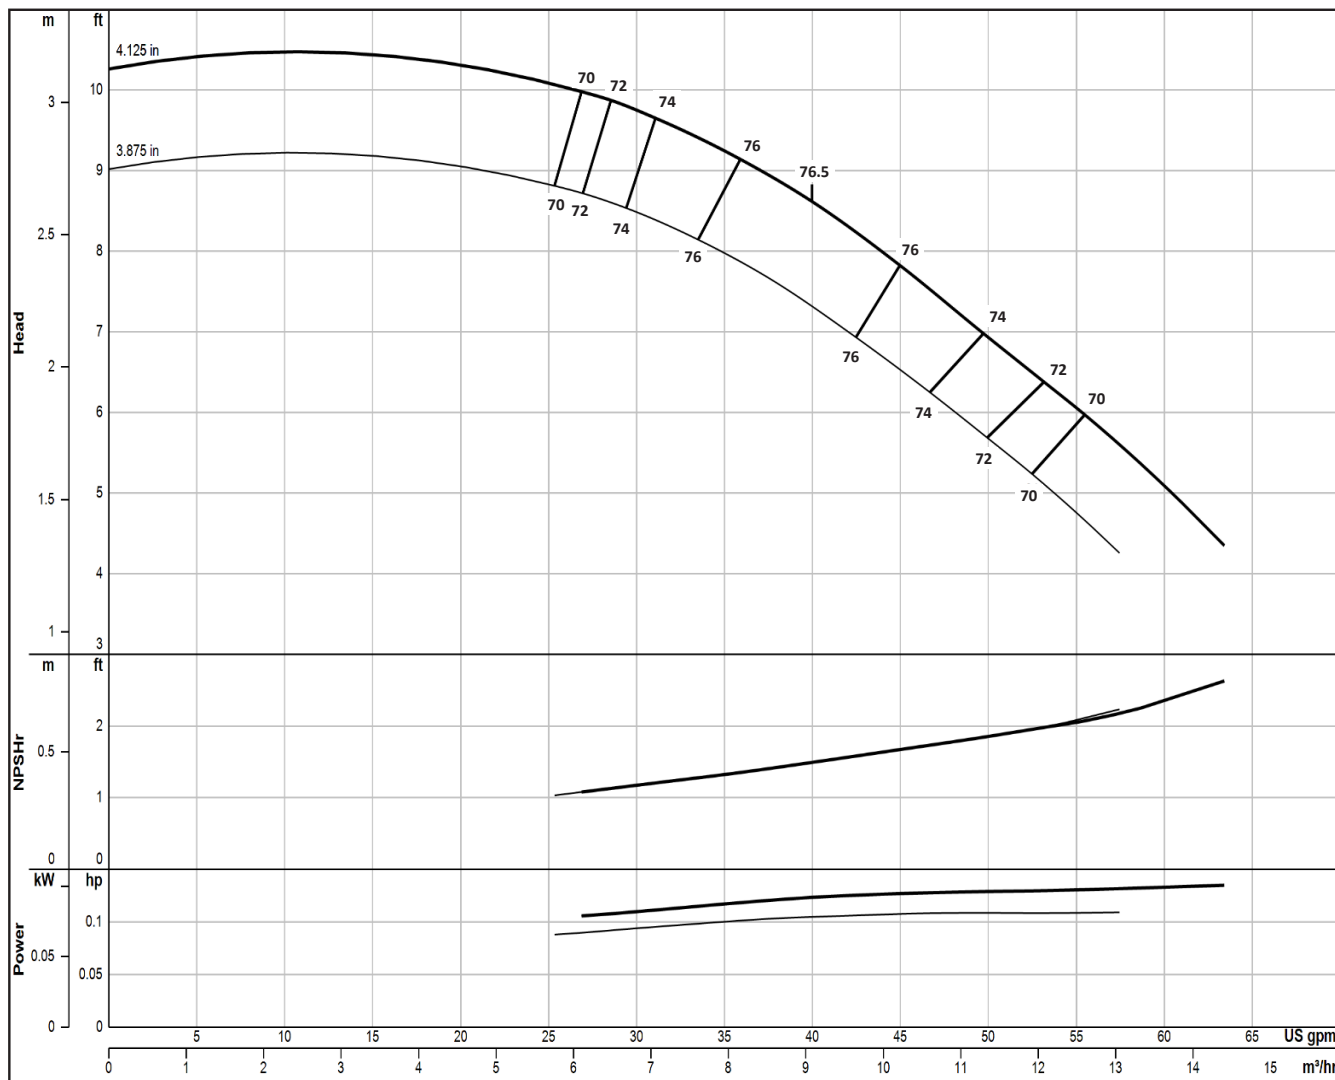

Impeller Type	Semi-Open	Bowl Ø (cm)	13.3	ns (SI)	34	Qty.	Eff.
Impeller Model	SP5LO	Thd'd Discharge (cm)	8, 10	S (SI)	137	Stages	Change
One Stage Weight (kg)	22.7	Thd'd Suction (cm)	10	PEIcl	0.77	1	-6
Add'l Stage Wt. (kg)	6.4	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.22	2	-4
Impeller Wt. (kg)	0.6	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	0.40	3	-3
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	3647	Imp. Setting (cm)	0.08	4	-1.5
One Stage Length (cm)	44.6	D.I. Bowl Rating (kPa)	7902	K-Factor (kg/m-tdh)	7.0	5	0
Add'l Stage Length (cm)	10.9	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.001		

Δ Consult factory for availability

2020-08-20


Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



SP6LL
1450 RPM

ONE STAGE	() STAGE
--------------	--------------

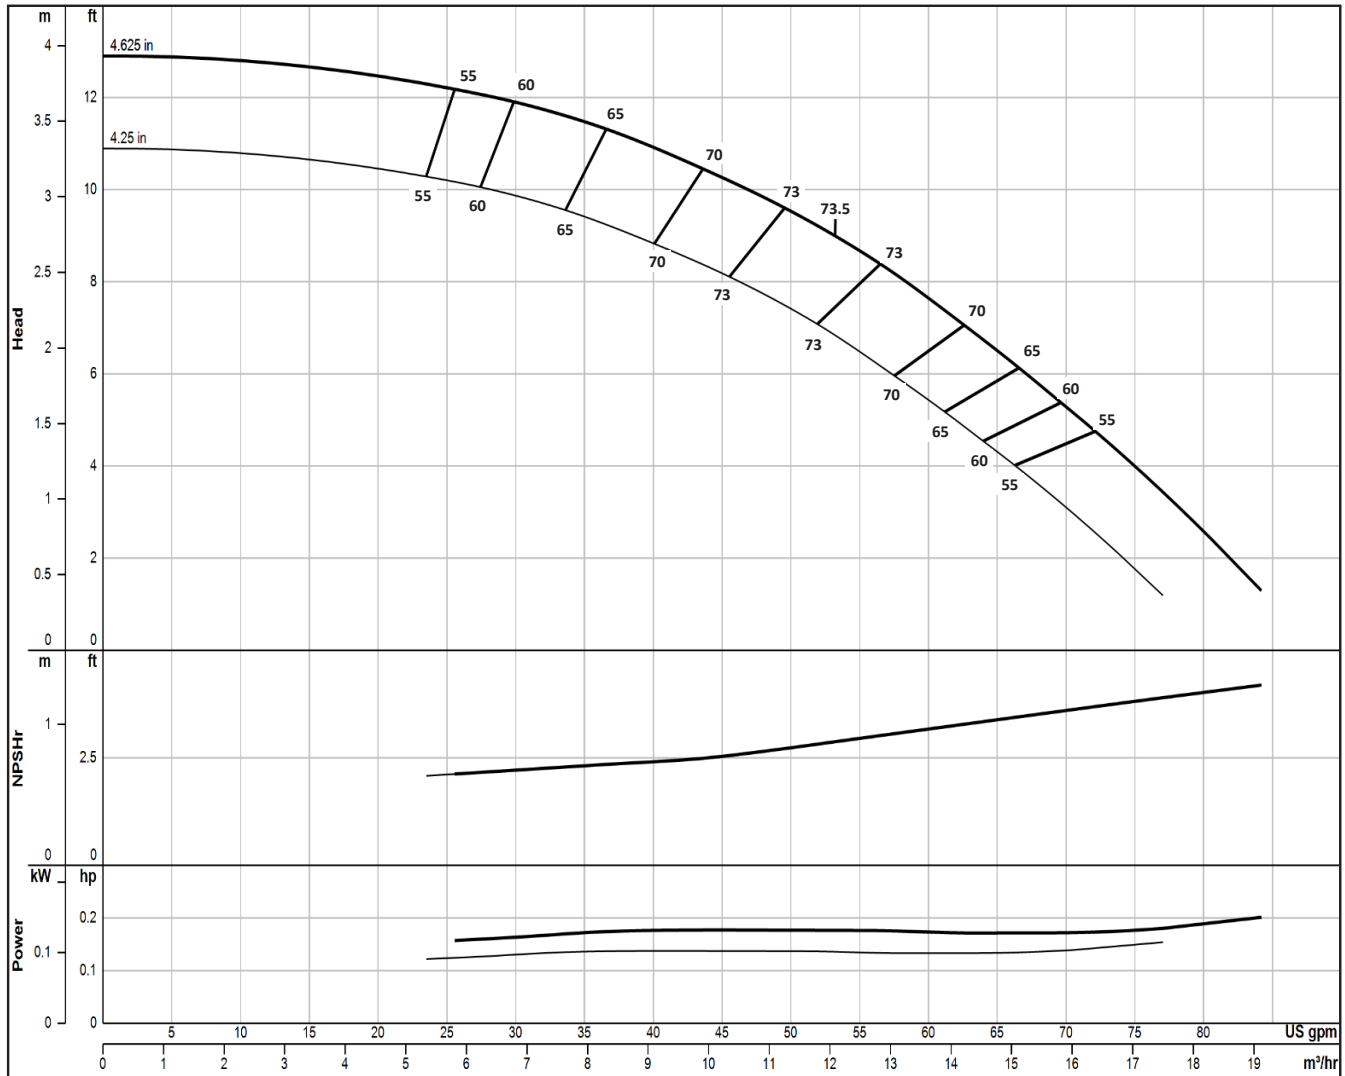

Impeller Type	Enclosed	Bowl Ø (cm)	15.2	ns (SI)	39	Qty.	Eff.
Impeller Model	SP6LL	Thd'd Discharge (cm)	8, 10	S (SI)	112	Stages	Change
One Stage Weight (kg)	26.3	Thd'd Suction (cm)	10	PEIcl	0.89	1	-5
Add'l Stage Wt. (kg)	8.2	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.54	2	-4
Impeller Wt. (kg)	1.2	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.67	3	-3
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	5912	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	46.8	D.I. Bowl Rating (kPa)	12809	K-Factor (kg/m-tdh)	4.0	5	0
Add'l Stage Length (cm)	12.2	316 Bowl Rating (kPa)	Δ	Imp. WR ² (kg-m ²)	0.002		

Δ Consult factory for availability

2020-08-21

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP6M

1450 RPM

ONE ()
STAGE STAGE

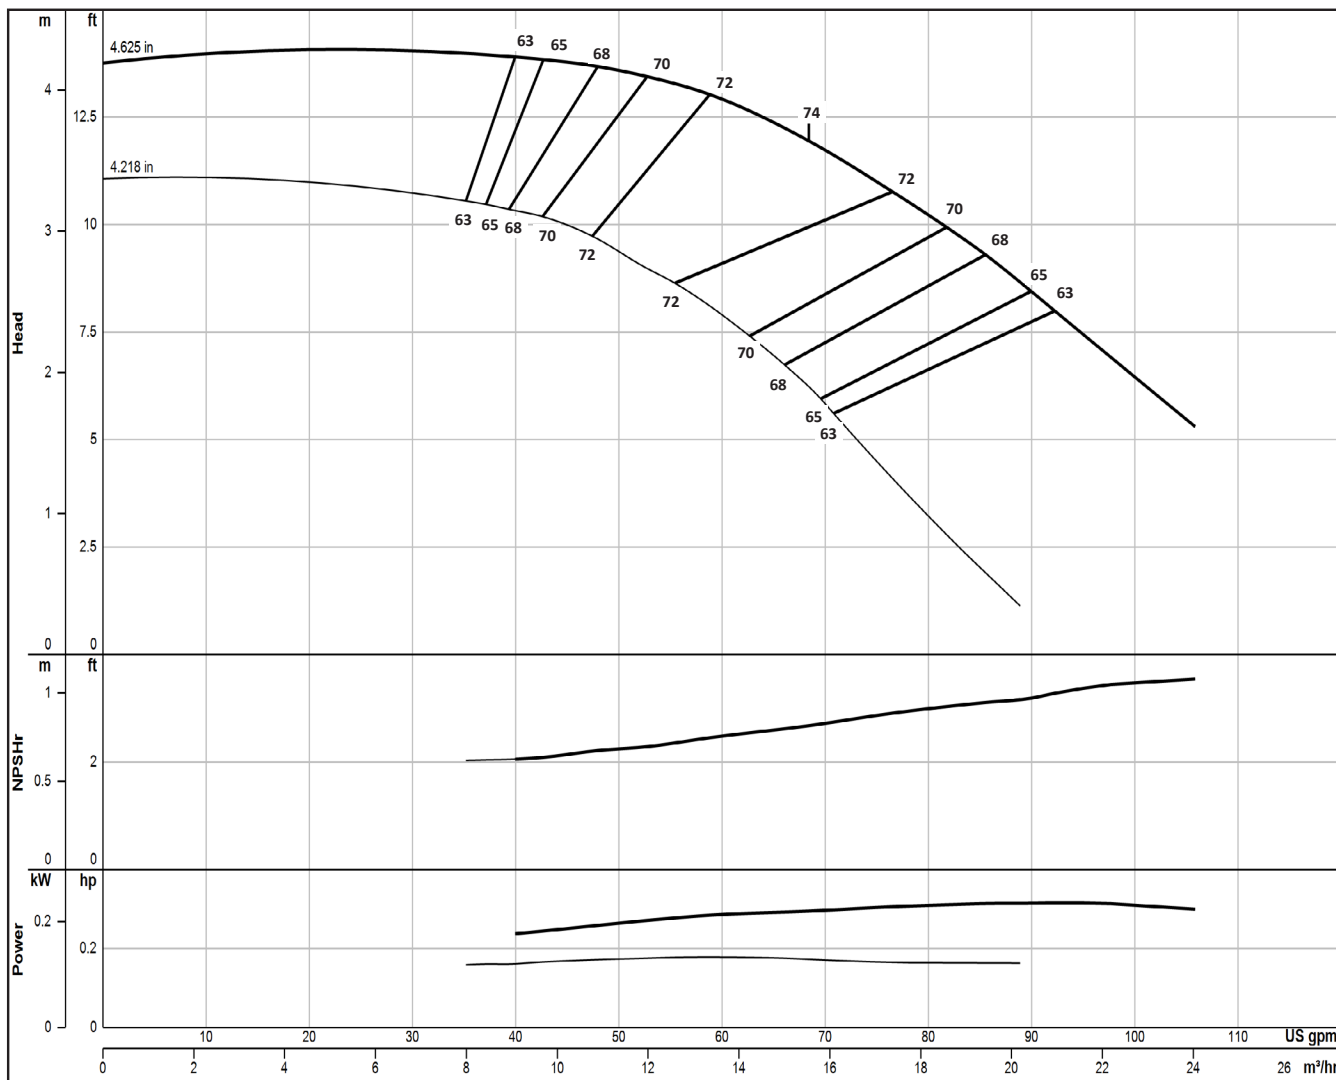

Impeller Type	Enclosed	Bowl Ø (cm)	15.2	ns (SI)	37	Qty.	Eff.
Impeller Model	SP6M	Thd'd Discharge (cm)	8, 10	S (SI)	118	Stages	Change
One Stage Weight (kg)	25.4	Thd'd Suction (cm)	10	PEIcl	0.88	1	-4
Add'l Stage Wt. (kg)	8.6	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.54	2	-3
Impeller Wt. (kg)	1.3	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.03	3	-2
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	5912	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	46.8	D.I. Bowl Rating (kPa)	12809	K-Factor (kg/m-tdh)	3.6	5	0
Add'l Stage Length (cm)	12.2	316 Bowl Rating (kPa)	Δ	Imp. WR ² (kg-m²)	0.002		

Δ Consult factory for availability

2020-08-21

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP6H

1450 RPM

ONE ()
STAGE STAGE

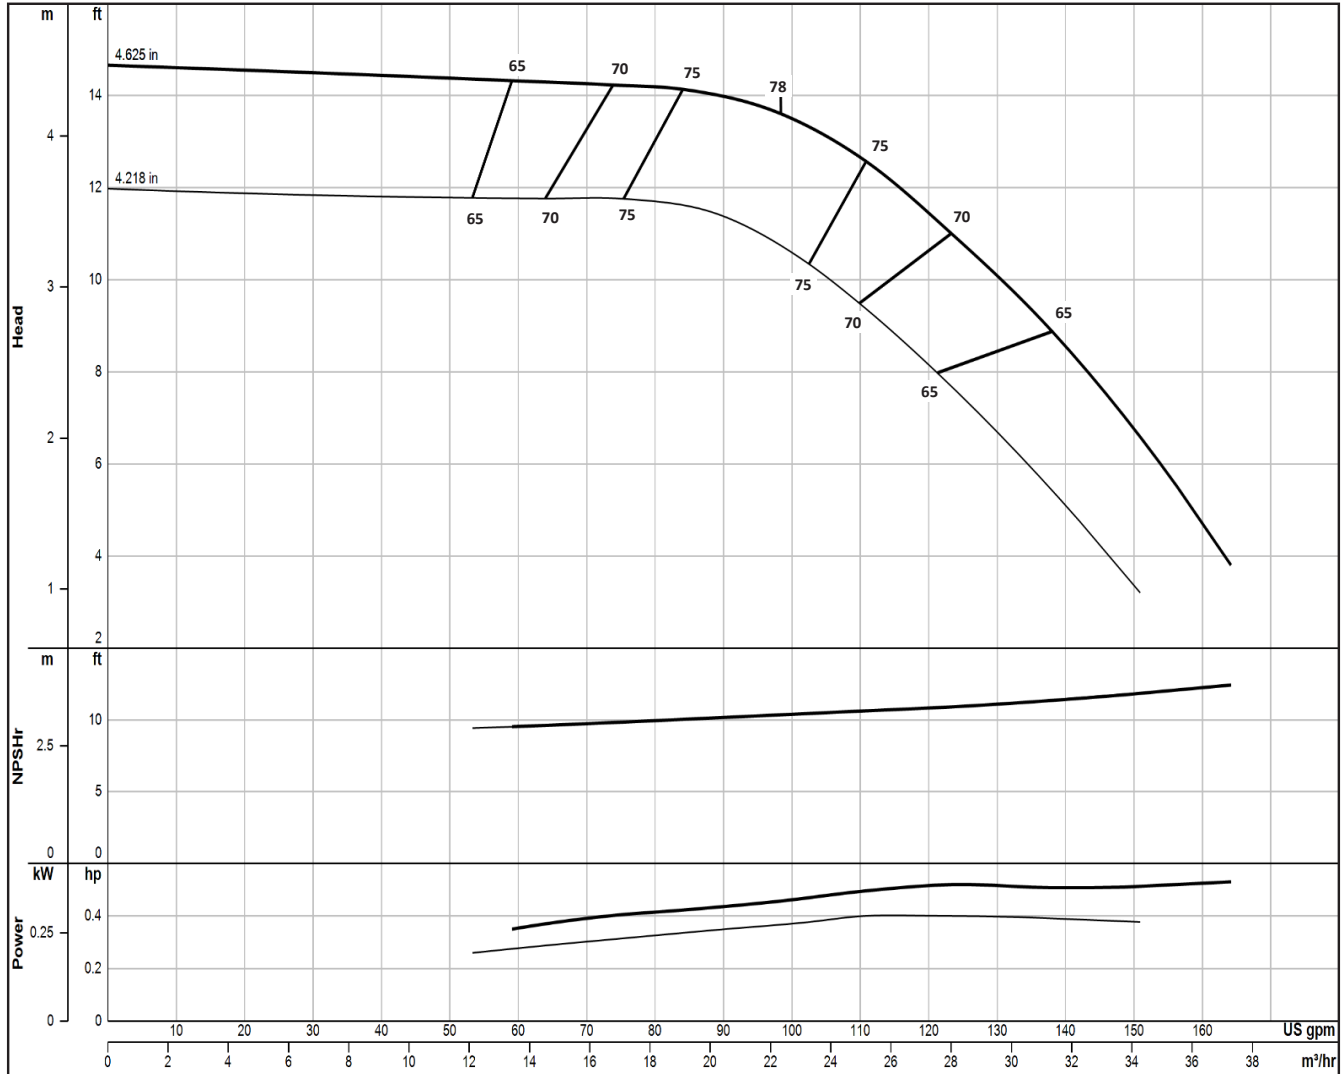

Impeller Type	Enclosed	Bowl Ø (cm)	15.2	ns (SI)	40	Qty.	Eff.
Impeller Model	SP6H	Thd'd Discharge (cm)	8, 10	S (SI)	50	Stages	Change
One Stage Weight (kg)	24.9	Thd'd Suction (cm)	10	PEIcl	0.90	1	-4
Add'l Stage Wt. (kg)	8.6	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.54	2	-3
Impeller Wt. (kg)	1.2	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	0.71	3	-2
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	5912	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	46.8	D.I. Bowl Rating (kPa)	12809	K-Factor (kg/m-tdh)	3.6	5	0
Add'l Stage Length (cm)	12.2	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.001		

Δ Consult factory for availability

2021-06-08

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP6LO

1450 RPM

ONE ()
STAGE STAGE

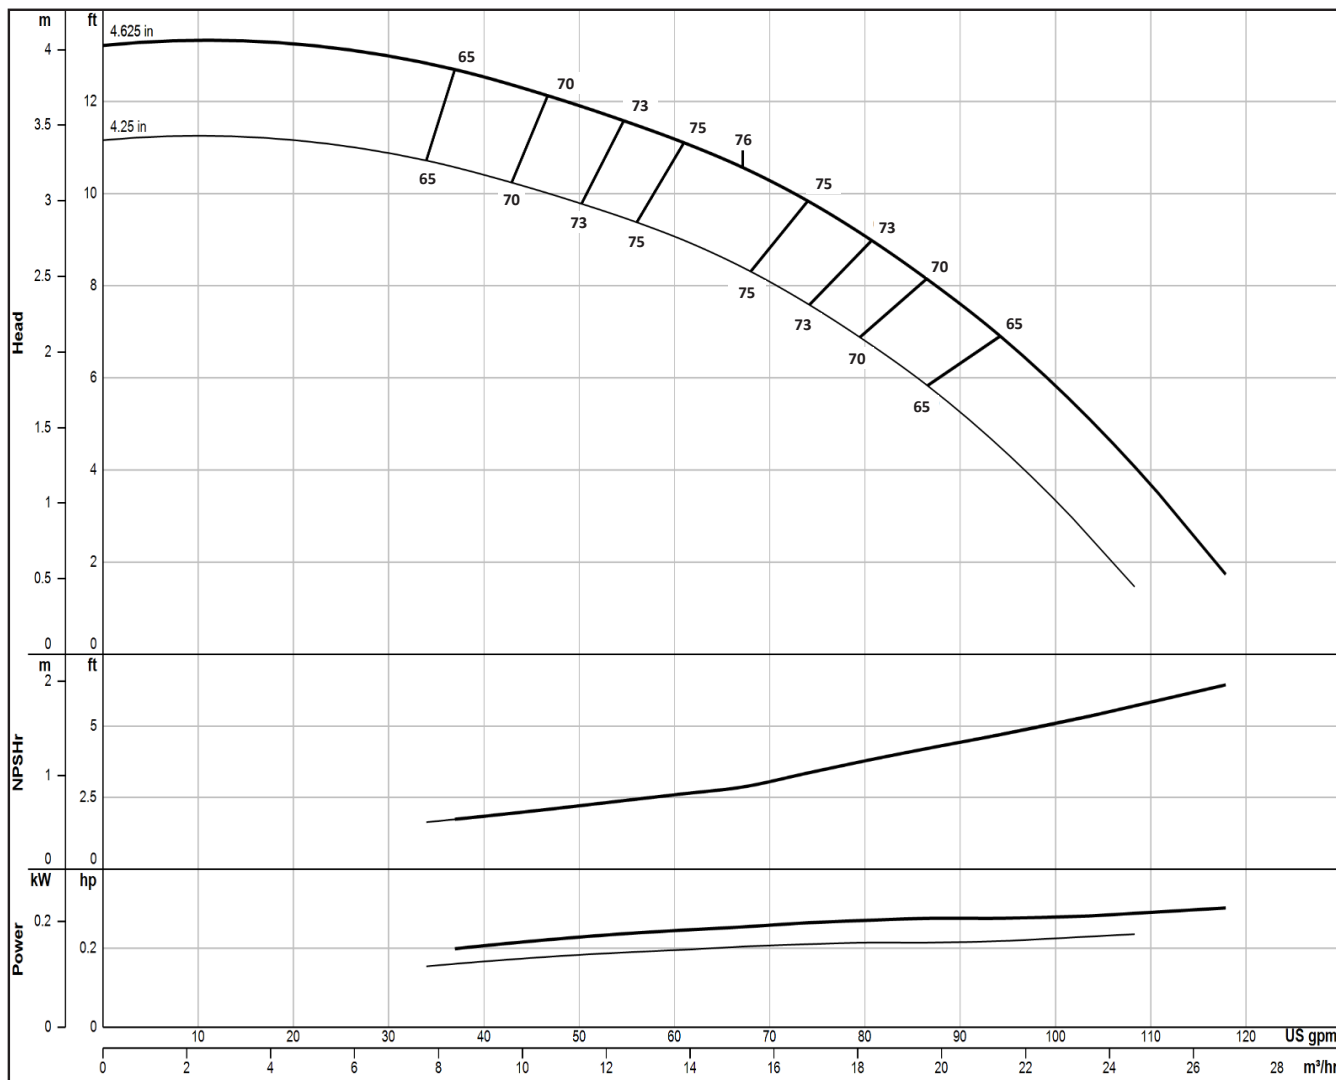

Impeller Type	Semi-Open	Bowl Ø (cm)	15.2	ns (SI)	40	Qty.	Eff.
Impeller Model	SP6LO	Thd'd Discharge (cm)	8, 10	S (SI)	106	Stages	Change
One Stage Weight (kg)	24.0	Thd'd Suction (cm)	10	PEIcl	0.79	1	-5.5
Add'l Stage Wt. (kg)	8.2	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.54	2	-4
Impeller Wt. (kg)	0.7	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.79	3	-3
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	5912	Imp. Setting (cm)	0.08	4	-1.5
One Stage Length (cm)	46.8	D.I. Bowl Rating (kPa)	12809	K-Factor (kg/m-tdh)	5.1	5	0
Add'l Stage Length (cm)	12.2	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.001		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP6MO

1450 RPM

ONE ()
STAGE STAGE

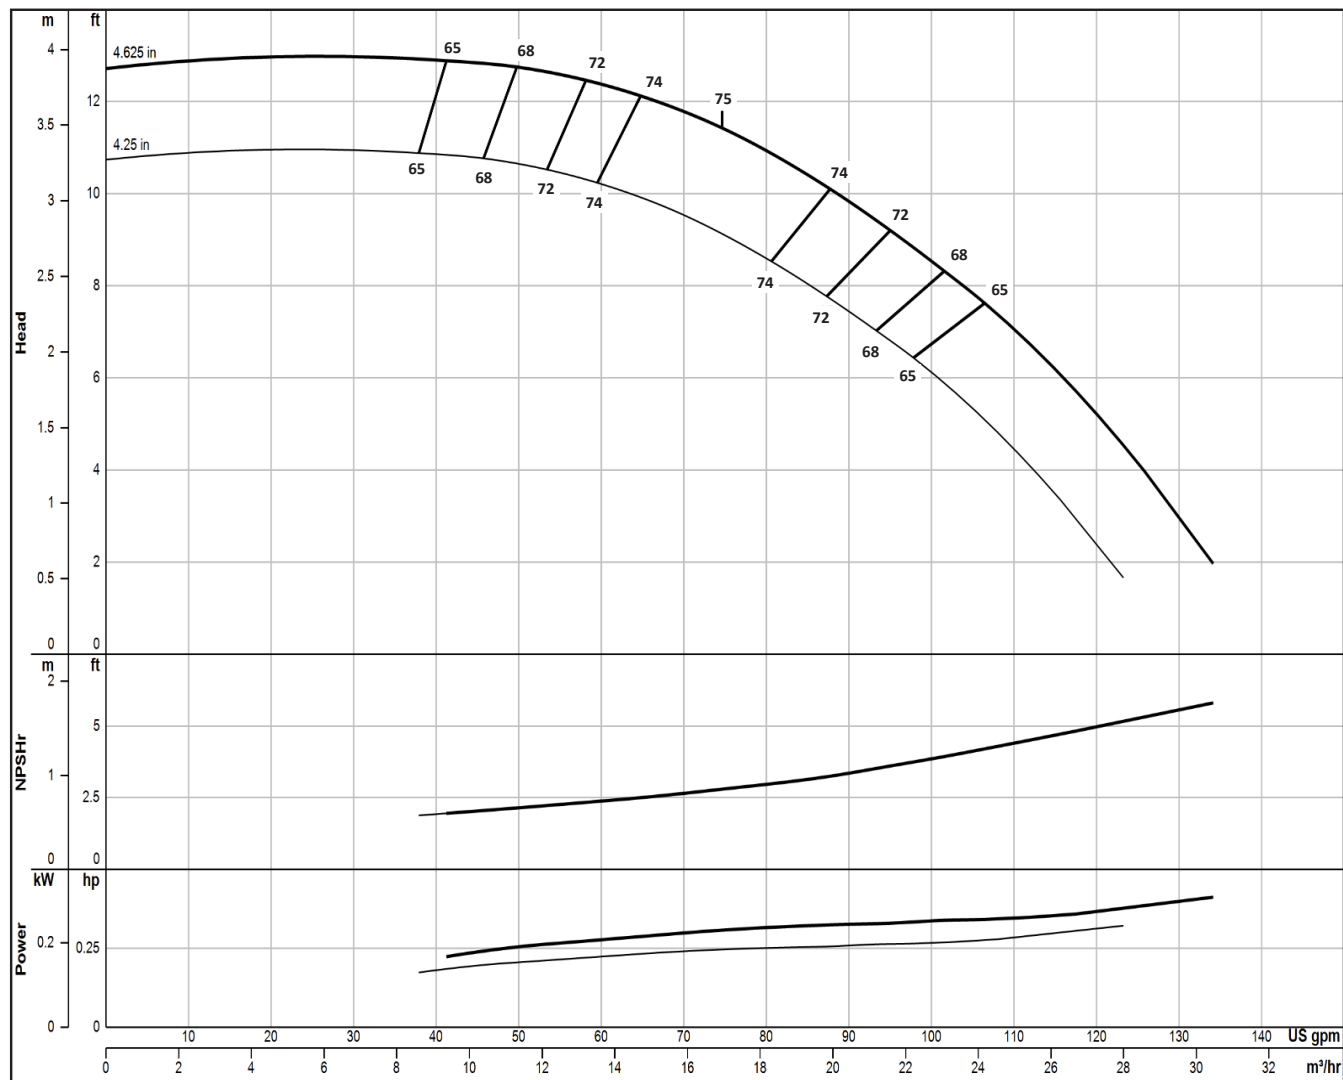

Impeller Type	Semi-Open	Bowl Ø (cm)	15.2	ns (SI)	41	Qty.	Eff.
Impeller Model	SP6MO	Thd'd Discharge (cm)	8, 10	S (SI)	117	Stages	Change
One Stage Weight (kg)	24.0	Thd'd Suction (cm)	10	PEIcl	0.82	1	-5
Add'l Stage Wt. (kg)	8.2	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.54	2	-4
Impeller Wt. (kg)	0.6	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.42	3	-3
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	5912	Imp. Setting (cm)	0.08	4	-1.5
One Stage Length (cm)	46.8	D.I. Bowl Rating (kPa)	12809	K-Factor (kg/m-tdh)	7.4	5	0
Add'l Stage Length (cm)	12.2	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.001		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM6M

1450 RPM

ONE ()
STAGE STAGE

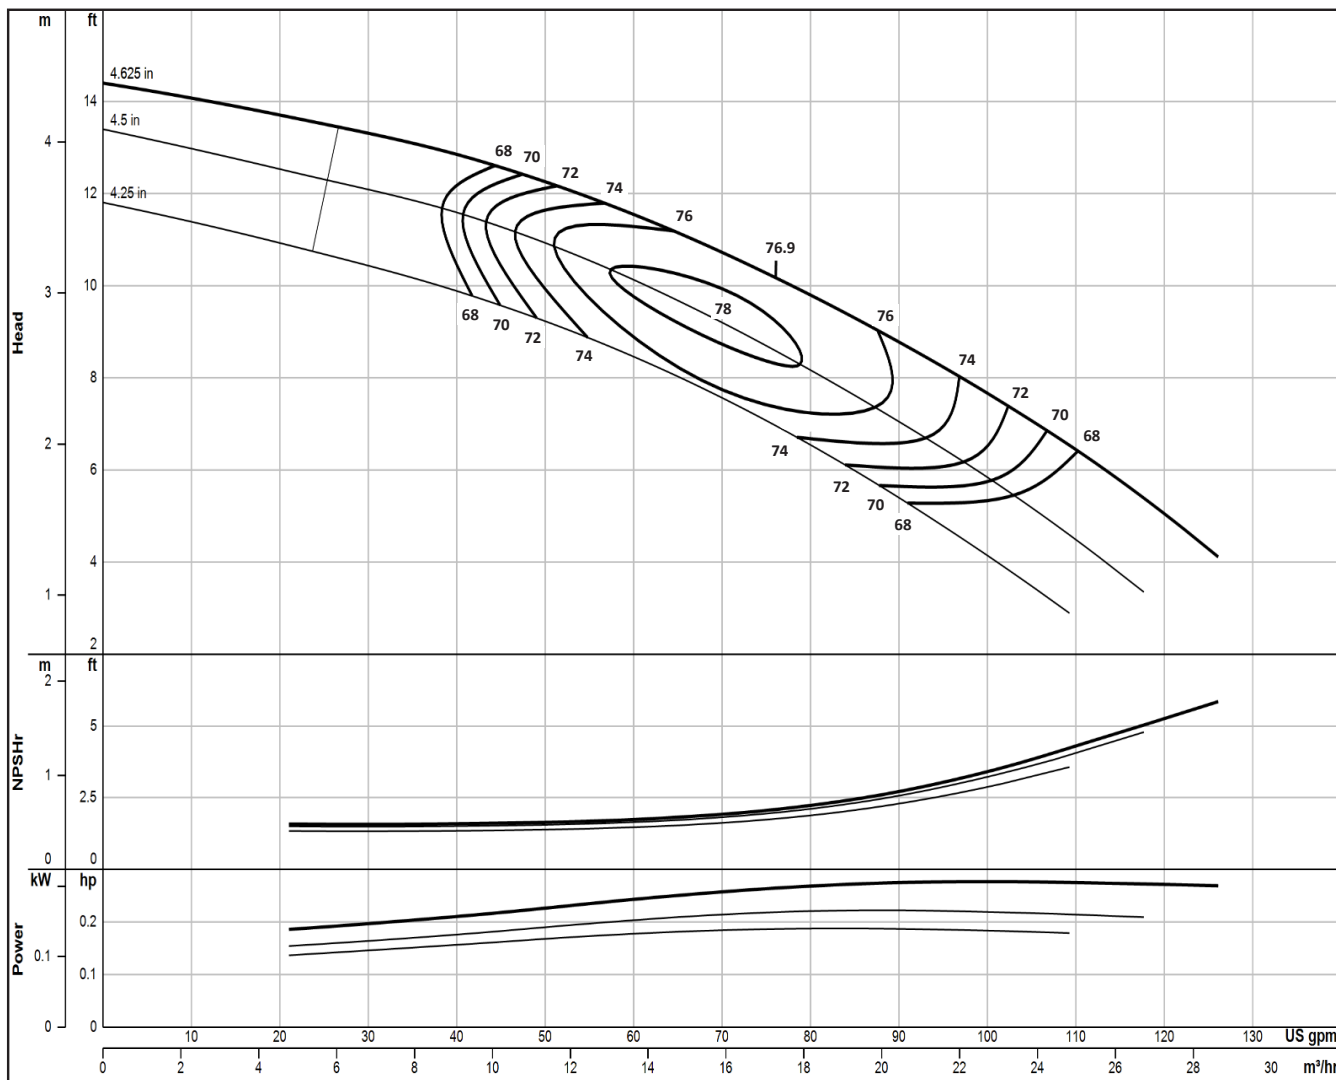

Impeller Type	Enclosed	Bowl Ø (cm)	15.2	ns (SI)	45	Qty.	Eff.
Impeller Model	SM6M	Thd'd Discharge (cm)	8, 10	S (SI)	143	Stages	Change
One Stage Weight (kg)	26.3	Thd'd Suction (cm)	10	PEIcl	0.79	1	-3
Add'l Stage Wt. (kg)	9.1	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.54	2	-2
Impeller Wt. (kg)	1.1	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.43	3	-1
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	47.5	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	3.1	5	0
Add'l Stage Length (cm)	13.3	316 Bowl Rating (kPa)	9883	Imp. WR ² (kg-m²)	0.002		

Δ Consult factory for availability

2026-04-07

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM6H

1450 RPM

ONE ()
STAGE STAGE

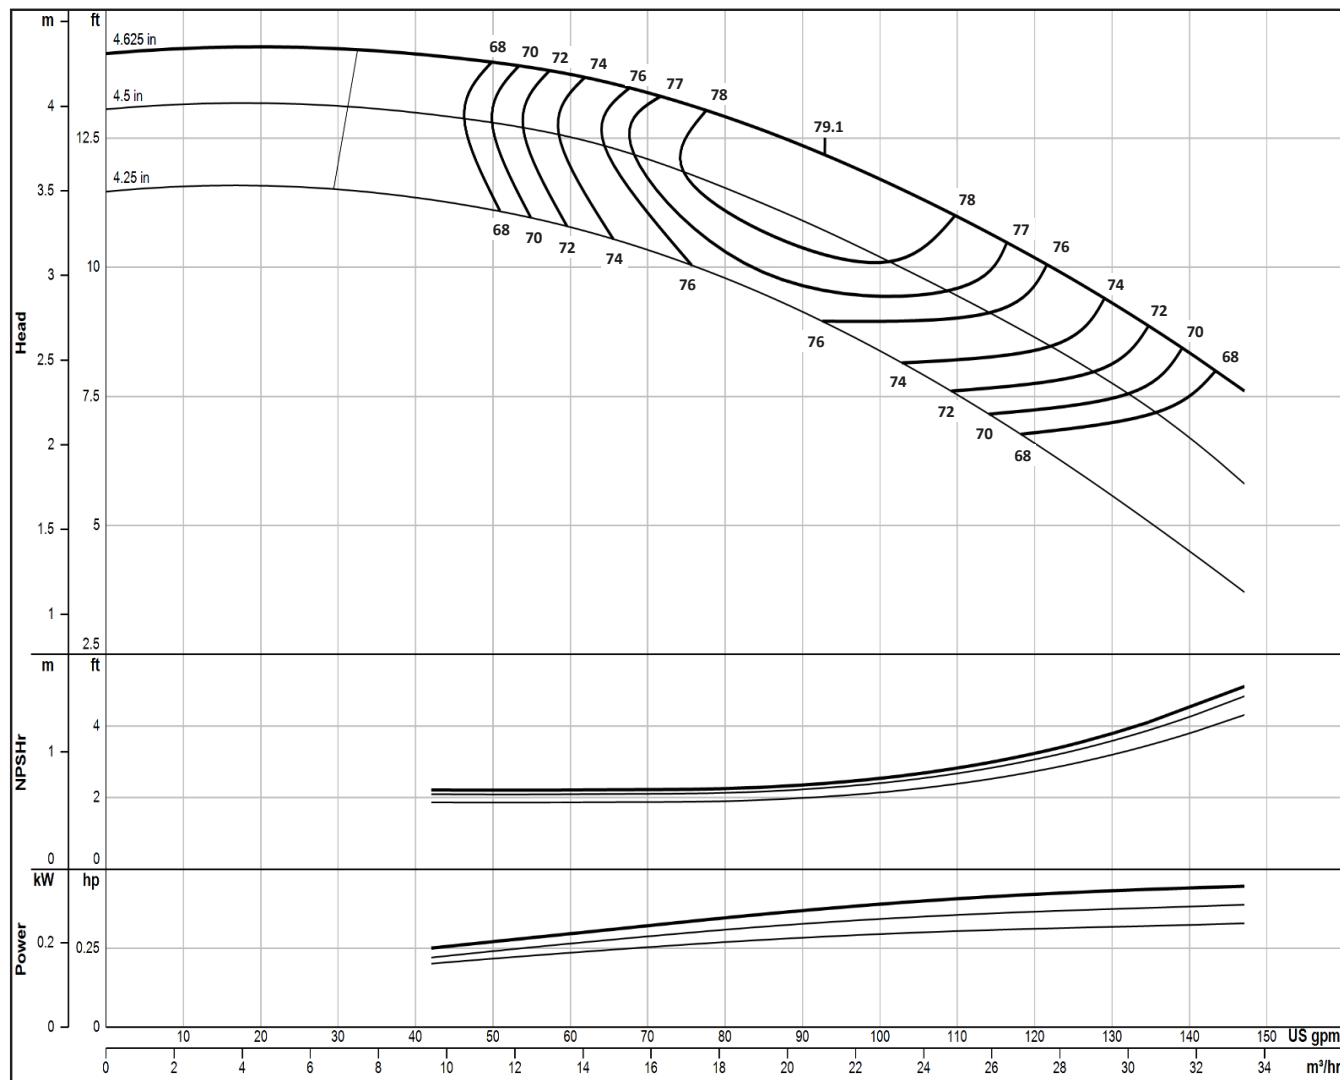

Impeller Type	Enclosed	Bowl Ø (cm)	15.2	ns (SI)	42	Qty.	Eff.
Impeller Model	SM6H	Thd'd Discharge (cm)	8, 10	S (SI)	140	Stages	Change
One Stage Weight (kg)	26.3	Thd'd Suction (cm)	10	PEIcl	0.85	1	-3
Add'l Stage Wt. (kg)	9.1	Bell Suction Ø (cm)	20.3, 15.2	Bowl Shaft Ø (cm)	2.54	2	-2
Impeller Wt. (kg)	1.1	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.43	3	-1
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	47.5	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	3.1	5	0
Add'l Stage Length (cm)	13.3	316 Bowl Rating (kPa)	9883	Imp. WR ² (kg-m ²)	0.002		

Δ Consult factory for availability

2026-04-07

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP7L

1450 RPM

ONE ()
STAGE STAGE

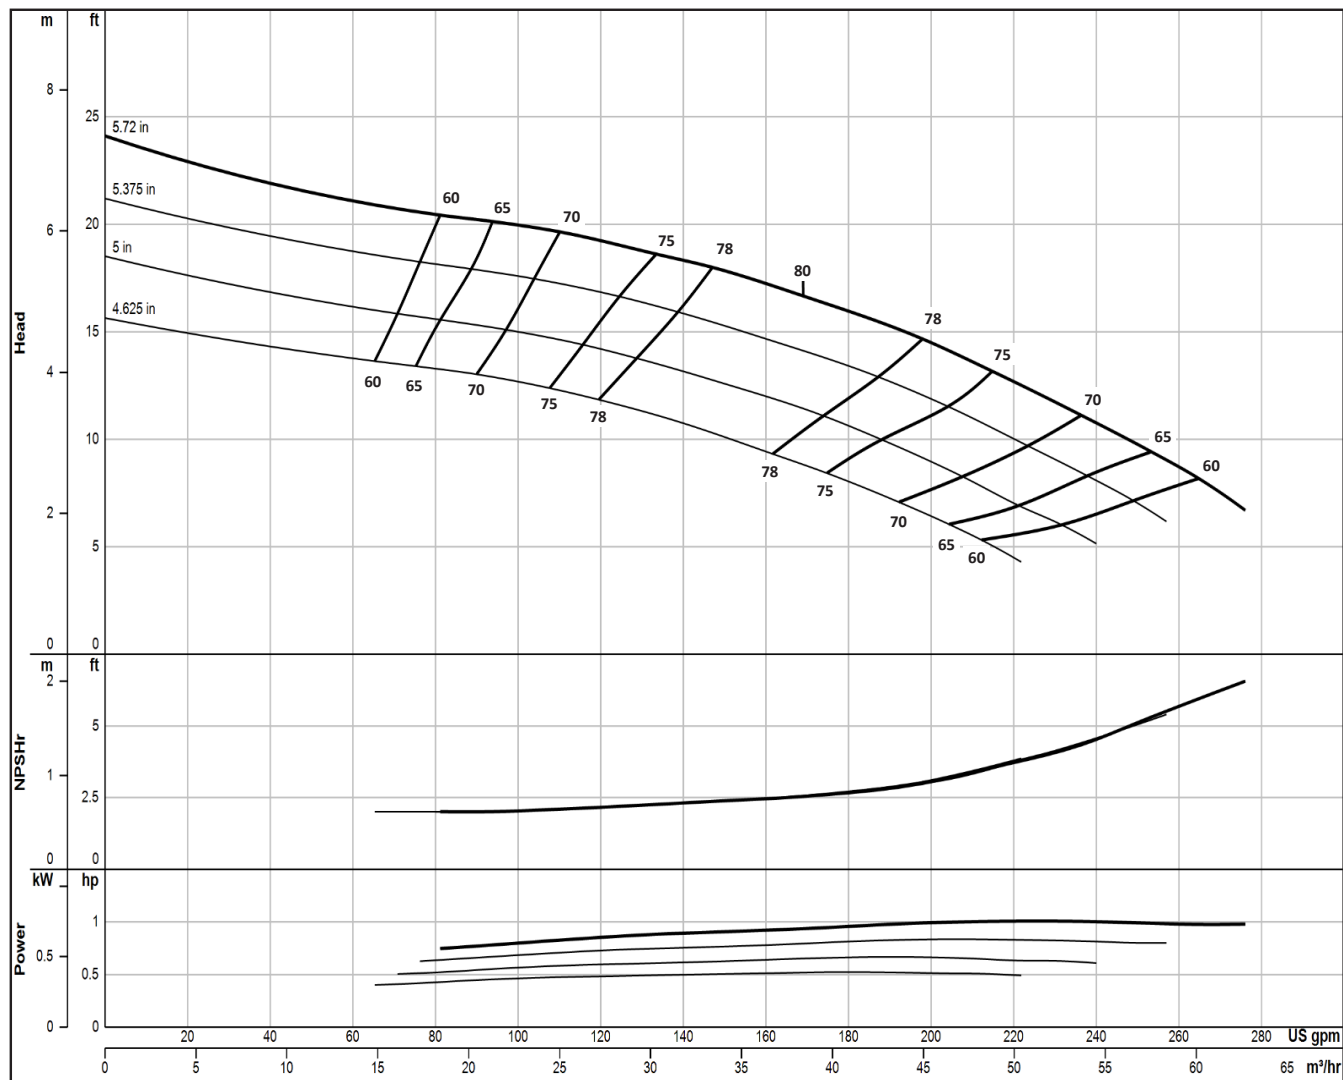

Impeller Type	Enclosed	Bowl Ø (cm)	18.3	ns (SI)	46	Qty.	Eff.
Impeller Model	SP7L	Thd'd Discharge (cm)	10, 12.5, 15	S (SI)	185	Stages	Change
One Stage Weight (kg)	45.4	Thd'd Suction (cm)	12.5	PEIcl	N/A	1	-4
Add'l Stage Wt. (kg)	15.4	Bell Suction Ø (cm)	23.8, 20.3	Bowl Shaft Ø (cm)	3.18	2	-2
Impeller Wt. (kg)	1.8	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.59	3	0
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	2608	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	57.8	D.I. Bowl Rating (kPa)	5650	K-Factor (kg/m-tdh)	6.3	5	0
Add'l Stage Length (cm)	16.2	316 Bowl Rating (kPa)	6084	Imp. WR² (kg-m²)	0.003		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP7H

1450 RPM

ONE ()
STAGE STAGE

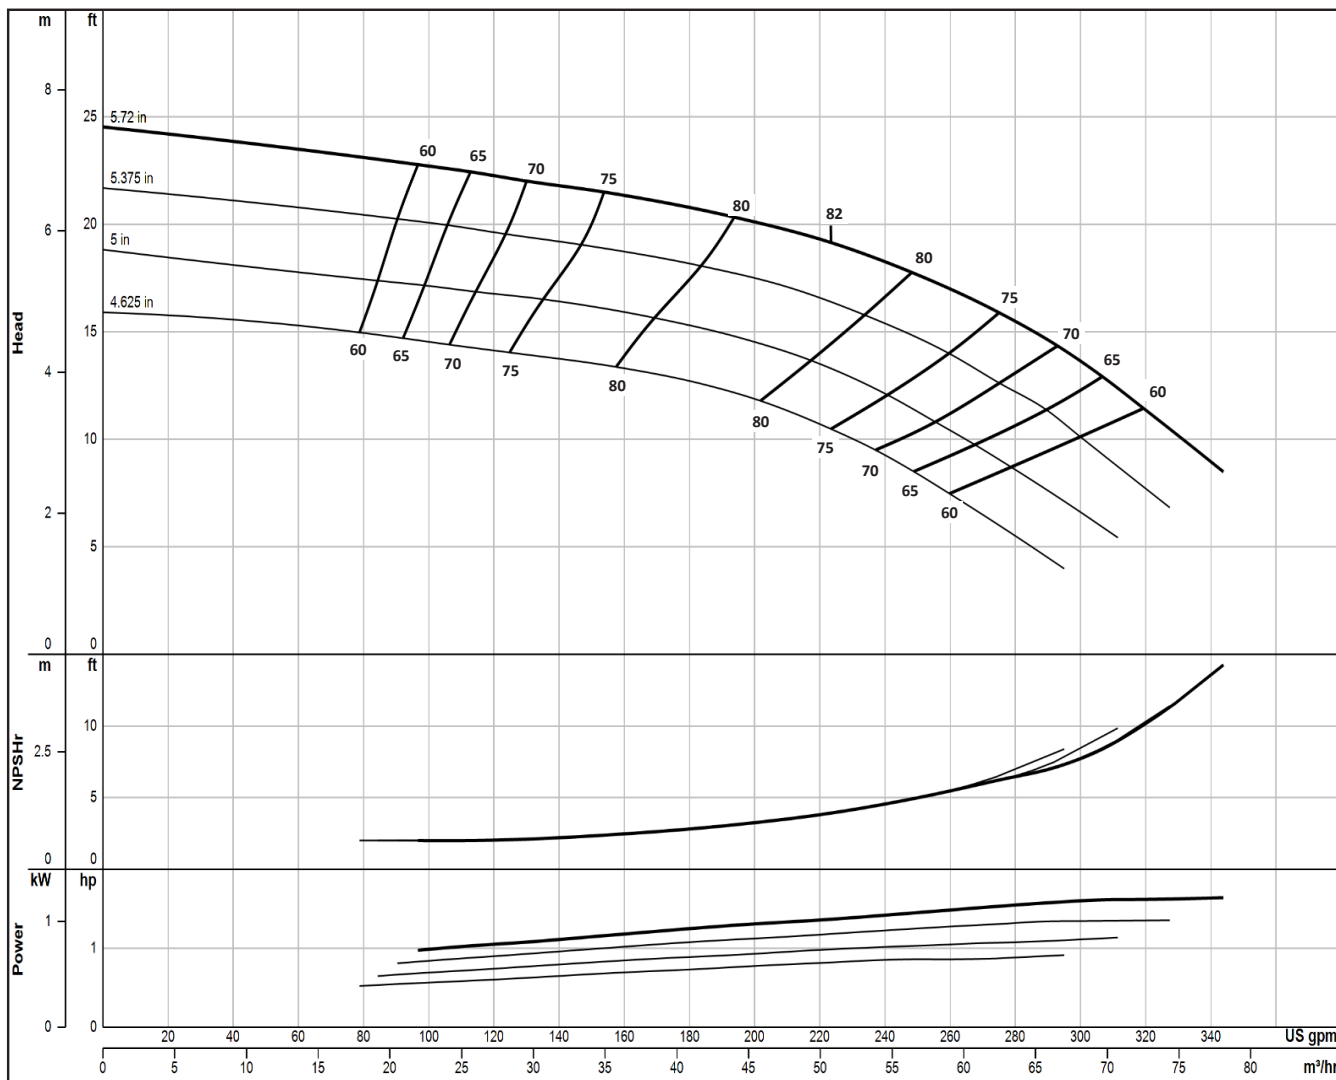

Impeller Type	Enclosed	Bowl Ø (cm)	18.3	ns (SI)	45	Qty.	Eff.
Impeller Model	SP7H	Thd'd Discharge (cm)	10, 12.5, 15	S (SI)	159	Stages	Change
One Stage Weight (kg)	45.4	Thd'd Suction (cm)	12.5	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	15.4	Bell Suction Ø (cm)	23.8, 20.3	Bowl Shaft Ø (cm)	3.18	2	-1
Impeller Wt. (kg)	1.8	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.59	3	0
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	2608	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	57.8	D.I. Bowl Rating (kPa)	5650	K-Factor (kg/m-tdh)	6.4	5	0
Add'l Stage Length (cm)	16.2	316 Bowl Rating (kPa)	6084	Imp. WR² (kg-m²)	0.003		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SK7L

1450 RPM

ONE ()
STAGE STAGE

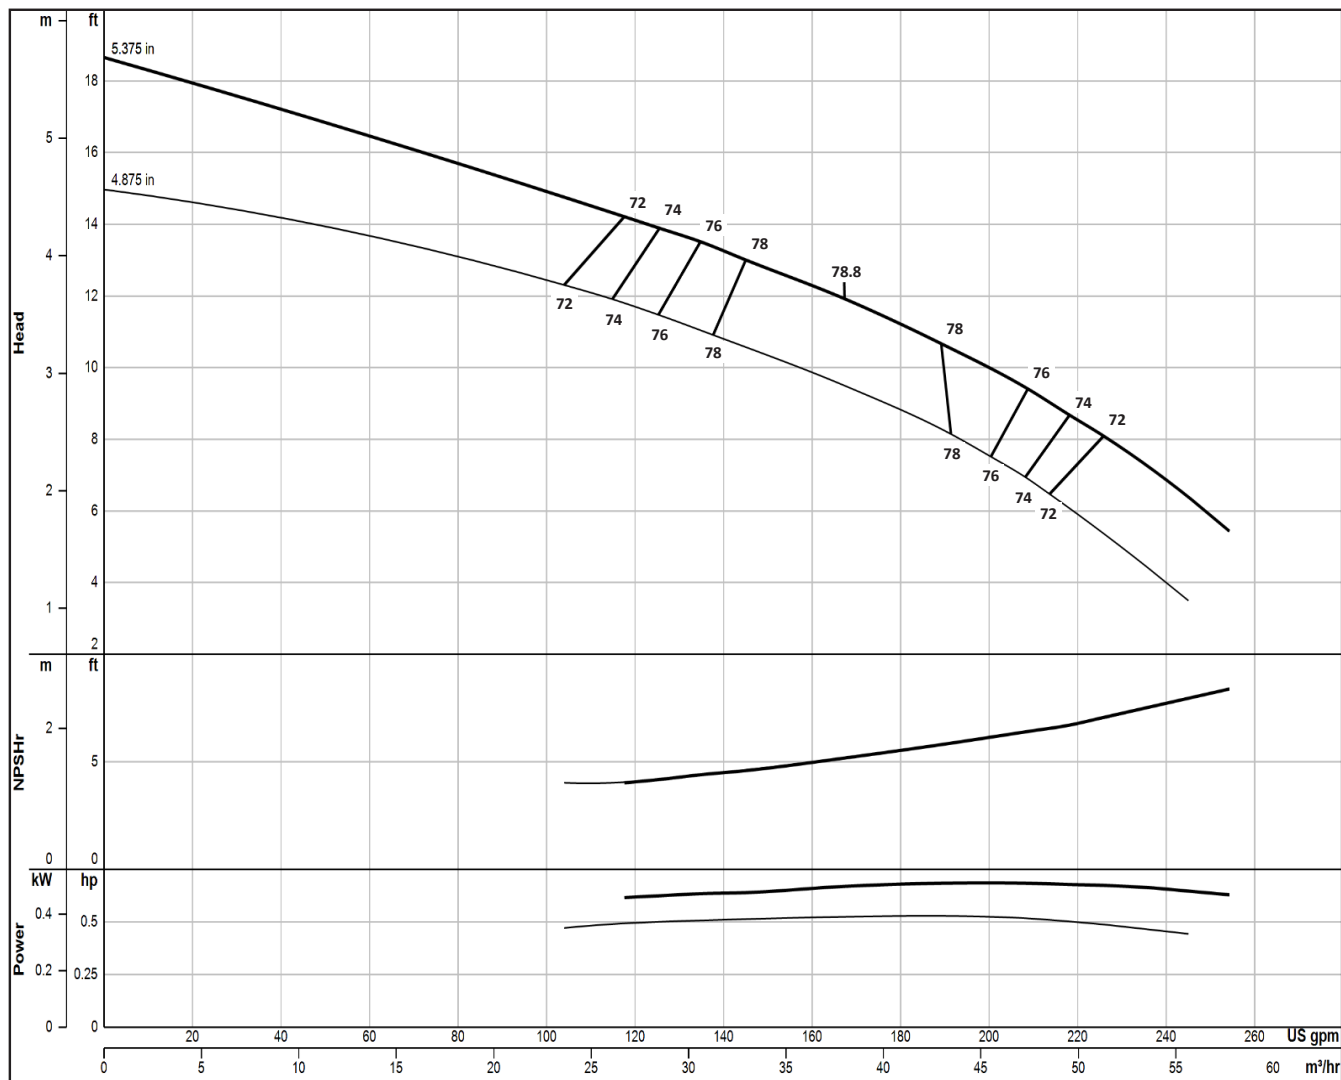

Impeller Type	Enclosed	Bowl Ø (cm)	16.7	ns (SI)	57	Qty.	Eff.
Impeller Model	SK7L	Thd'd Discharge (cm)	12.5, 15, 10	S (SI)	106	Stages	Change
One Stage Weight (kg)	27.7	Thd'd Suction (cm)	12.5	PEIcl	N/A	1	-3.5
Add'l Stage Wt. (kg)	10.0	Bell Suction Ø (cm)	23.8, 20.3	Bowl Shaft Ø (cm)	2.54	2	-2
Impeller Wt. (kg)	1.5	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	2.38	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	46.7	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	6.7	5	0
Add'l Stage Length (cm)	16.2	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.002		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SK7M

1450 RPM

ONE ()
STAGE STAGE

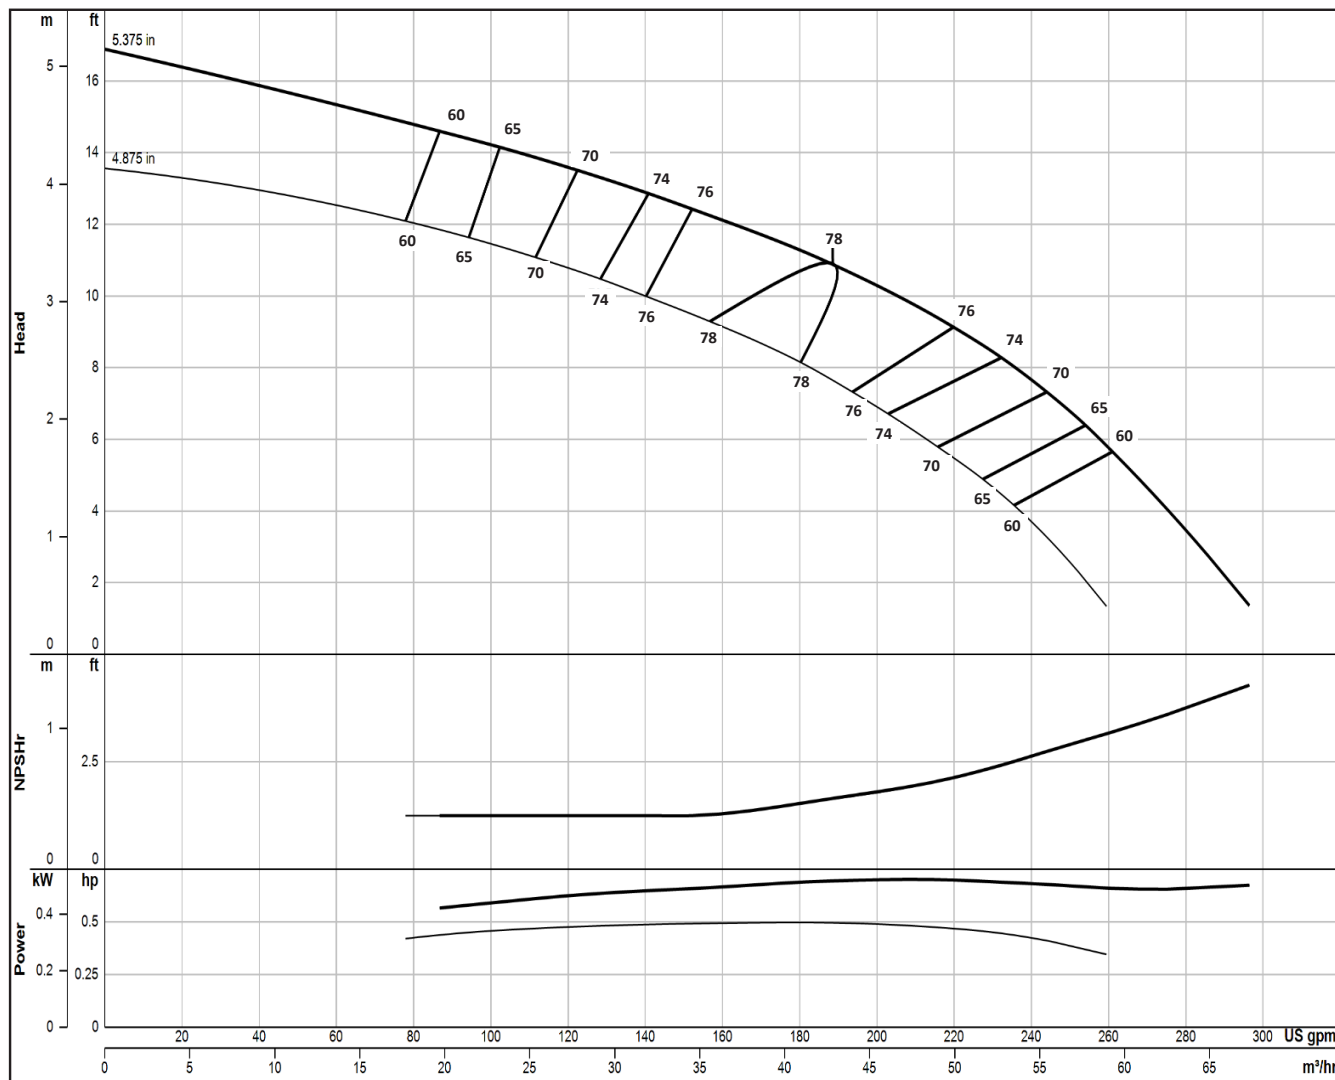

Impeller Type	Enclosed	Bowl Ø (cm)	16.7	ns (SI)	65	Qty.	Eff. Change
Impeller Model	SK7M	Thd'd Discharge (cm)	12.5, 15, 10	S (SI)	273	Stages	
One Stage Weight (kg)	26.8	Thd'd Suction (cm)	12.5	PEIcl	N/A	1	-3.5
Add'l Stage Wt. (kg)	9.1	Bell Suction Ø (cm)	23.8, 20.3	Bowl Shaft Ø (cm)	2.54	2	-2
Impeller Wt. (kg)	1.3	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.91	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	46.7	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	6.4	5	0
Add'l Stage Length (cm)	16.2	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.002		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SK7H

1450 RPM

ONE ()
STAGE STAGE

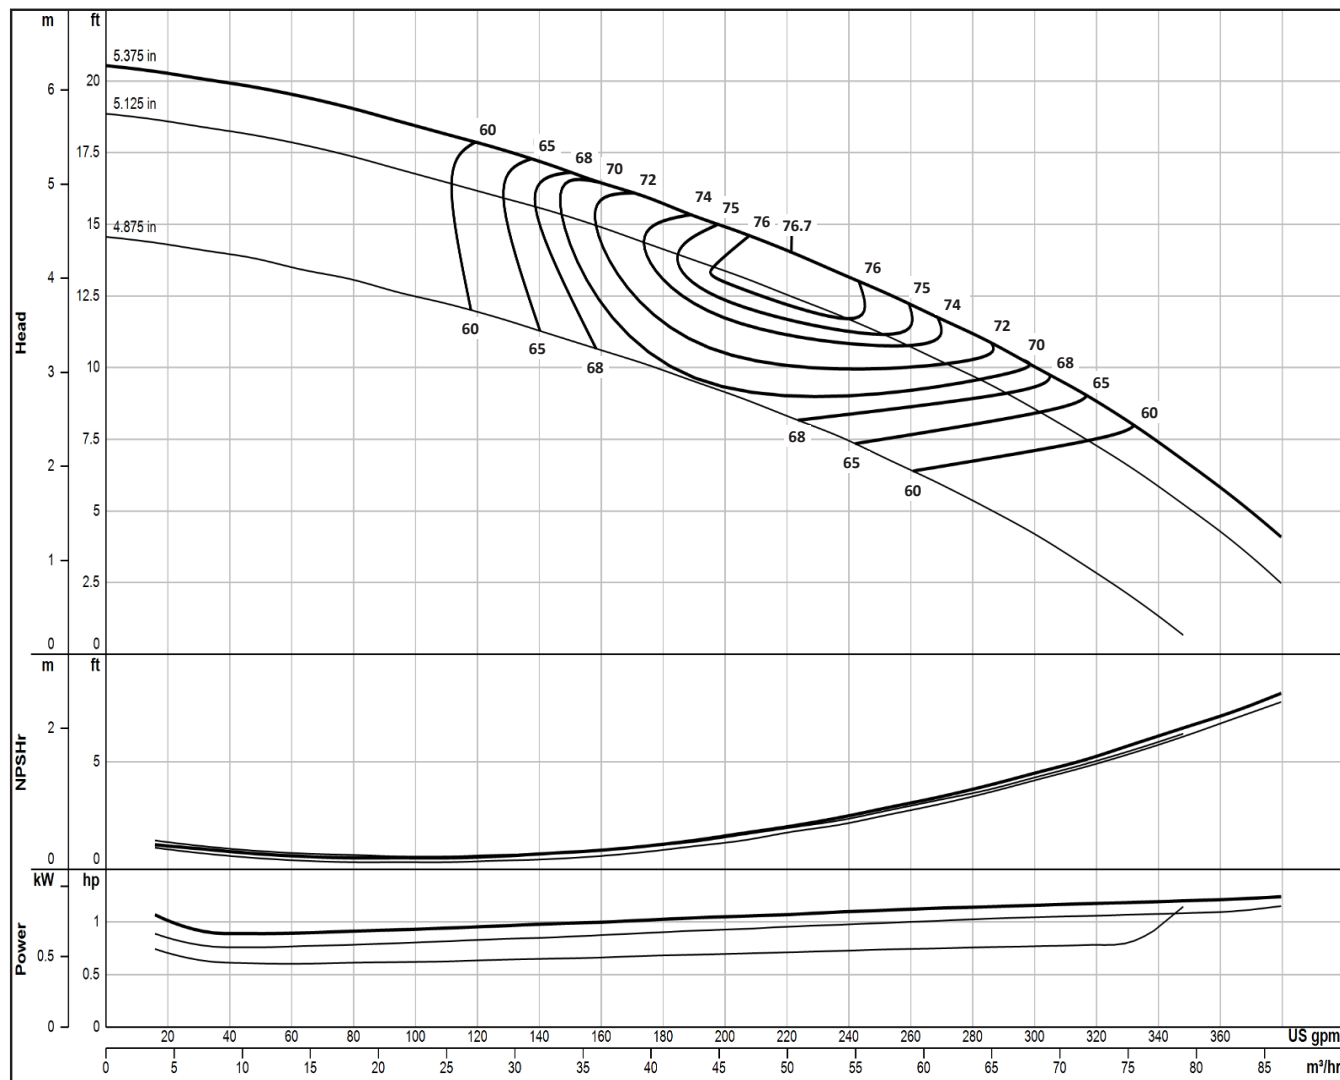

Impeller Type	Enclosed	Bowl Ø (cm)	16.7	ns (SI)	60	Qty.	Eff.
Impeller Model	SK7H	Thd'd Discharge (cm)	12.5, 15, 10	S (SI)	234	Stages	Change
One Stage Weight (kg)	27.2	Thd'd Suction (cm)	12.5	PEIcl	N/A	1	-3.5
Add'l Stage Wt. (kg)	9.5	Bell Suction Ø (cm)	23.8, 20.3	Bowl Shaft Ø (cm)	2.54	2	-2
Impeller Wt. (kg)	1.5	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	1.91	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	46.7	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	6.4	5	0
Add'l Stage Length (cm)	16.2	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.002		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM7M

1450 RPM

ONE ()
STAGE STAGE

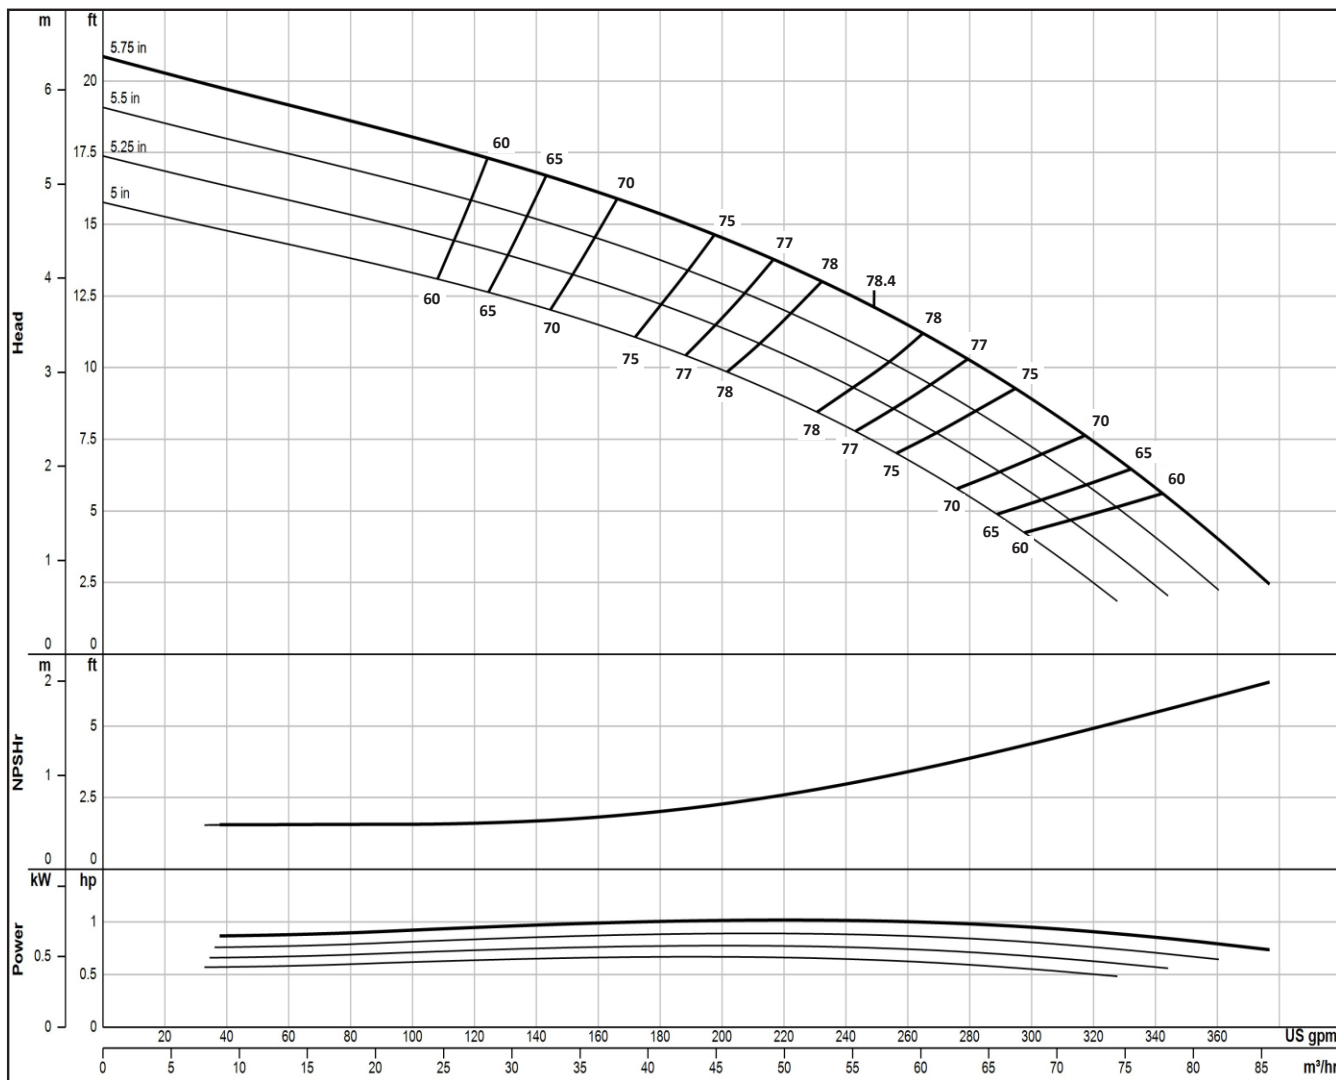

Impeller Type	Enclosed	Bowl Ø (cm)	17.8	ns (SI)	68	Qty.	Eff.
Impeller Model	SM7M	Thd'd Discharge (cm)	10, 12.5, 15	S (SI)	187	Stages	Change
One Stage Weight (kg)	45.4	Thd'd Suction (cm)	12.5	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	18.1	Bell Suction Ø (cm)	23.8, 20.3	Bowl Shaft Ø (cm)	3.18	2	-2
Impeller Wt. (kg)	2.8	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	2.38	3	-1
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	59.4	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	7.8	5	0
Add'l Stage Length (cm)	17.8	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.007		

Δ Consult factory for availability

2026-06-04

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM7H

1450 RPM

ONE ()
STAGE STAGE

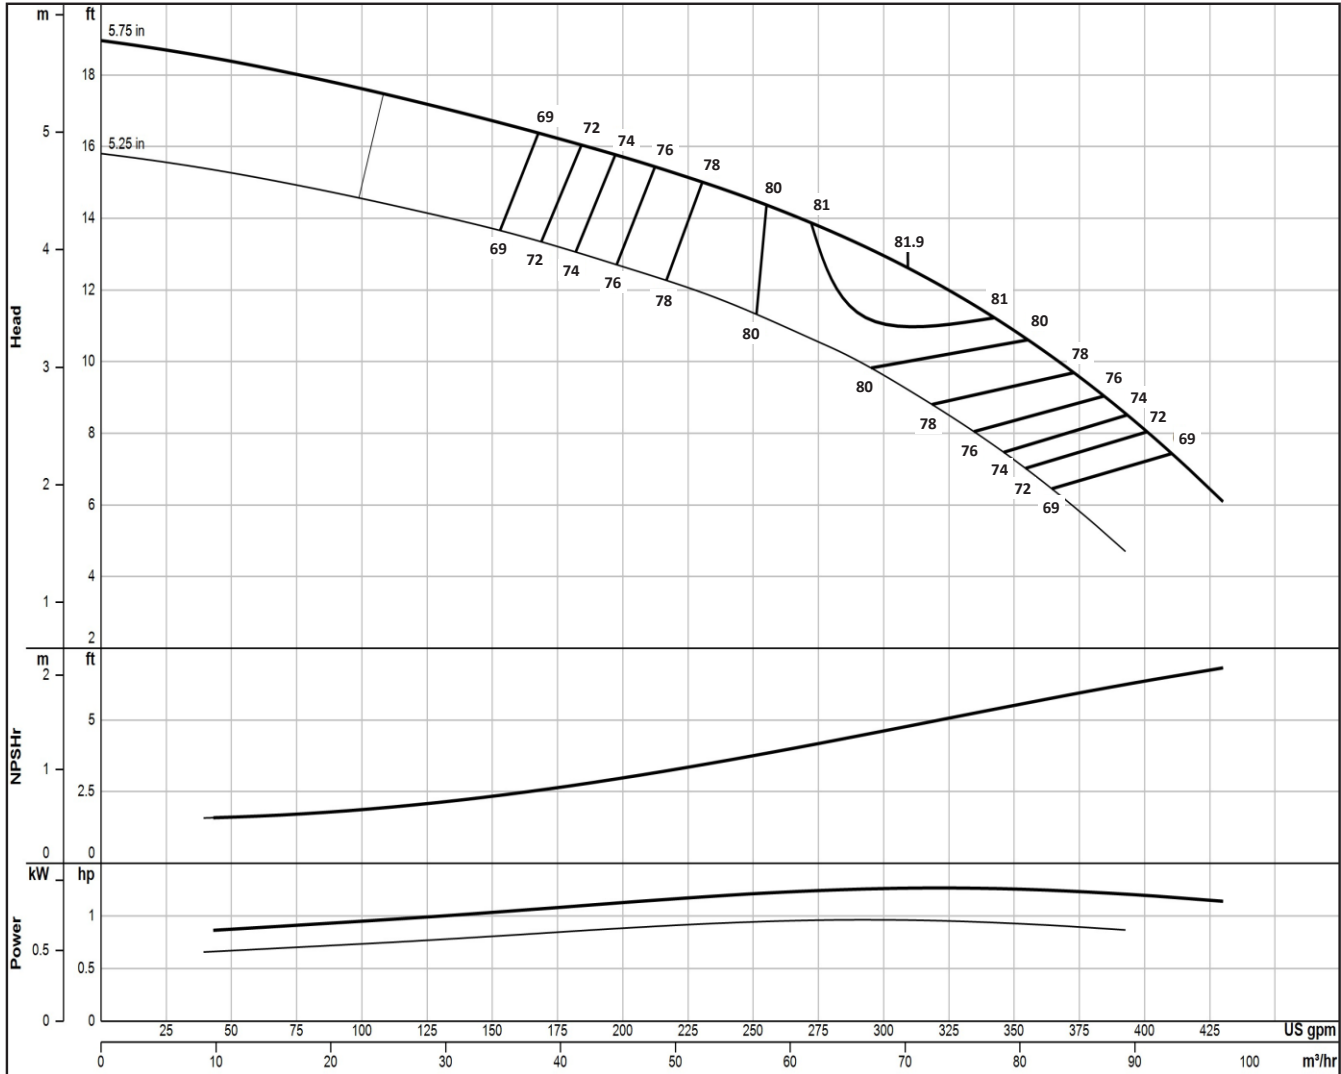

Impeller Type	Enclosed	Bowl Ø (cm)	17.8	ns (SI)	74	Qty.	Eff.
Impeller Model	SM7H	Thd'd Discharge (cm)	10, 12.5, 15	S (SI)	153	Stages	Change
One Stage Weight (kg)	45.4	Thd'd Suction (cm)	12.5	PEIcl	N/A	1	-4
Add'l Stage Wt. (kg)	18.1	Bell Suction Ø (cm)	23.8, 20.3	Bowl Shaft Ø (cm)	3.18	2	-3
Impeller Wt. (kg)	2.7	Sub. Mtr. (cm)	10, 15, 20	Total Lateral (cm)	2.38	3	-2
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	59.4	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	7.8	5	0
Add'l Stage Length (cm)	17.8	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.006		

Δ Consult factory for availability

2026-06-04

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SK8H

1450 RPM

ONE ()
STAGE STAGE

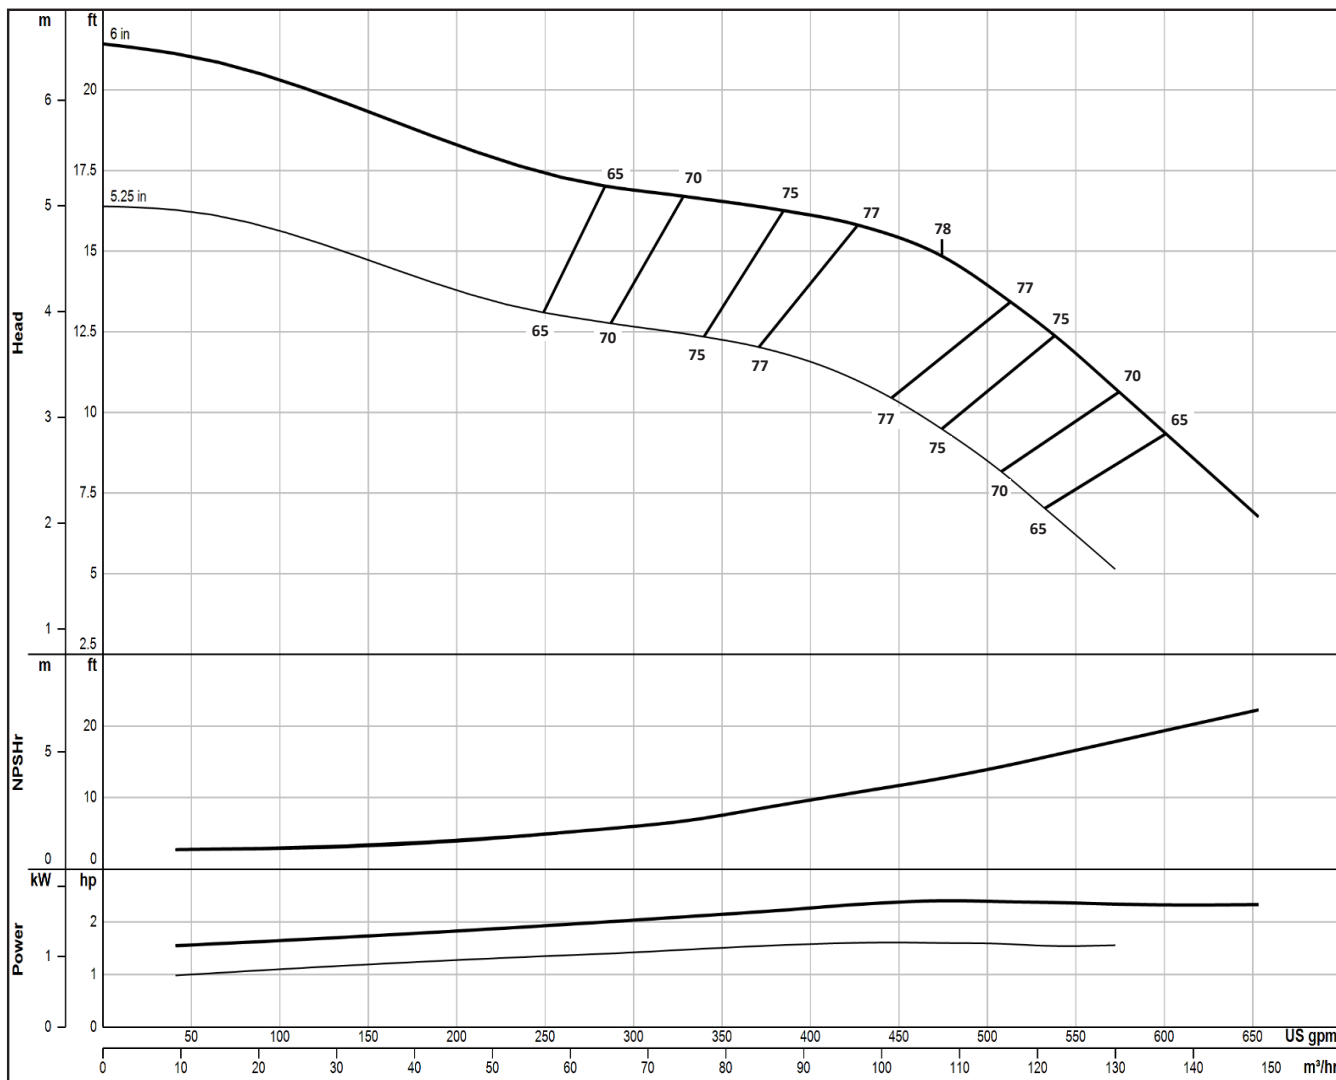

Impeller Type	Enclosed	Bowl Ø (cm)	19.1	ns (SI)	80	Qty.	Eff.
Impeller Model	SK8H	Thd'd Discharge (cm)	15	S (SI)	91	Stages	Change
One Stage Weight (kg)	81.6	Thd'd Suction (cm)	15	PEIcl	N/A	1	-4
Add'l Stage Wt. (kg)	27.2	Bell Suction Ø (cm)	N/A	Bowl Shaft Ø (cm)	3.81	2	-3
Impeller Wt. (kg)	3.0	Sub. Mtr. (cm)	15, 20	Total Lateral (cm)	2.54	3	-2
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	64.1	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	9.7	5	0
Add'l Stage Length (cm)	22.9	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.006		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP9L

1450 RPM

ONE ()
STAGE STAGE

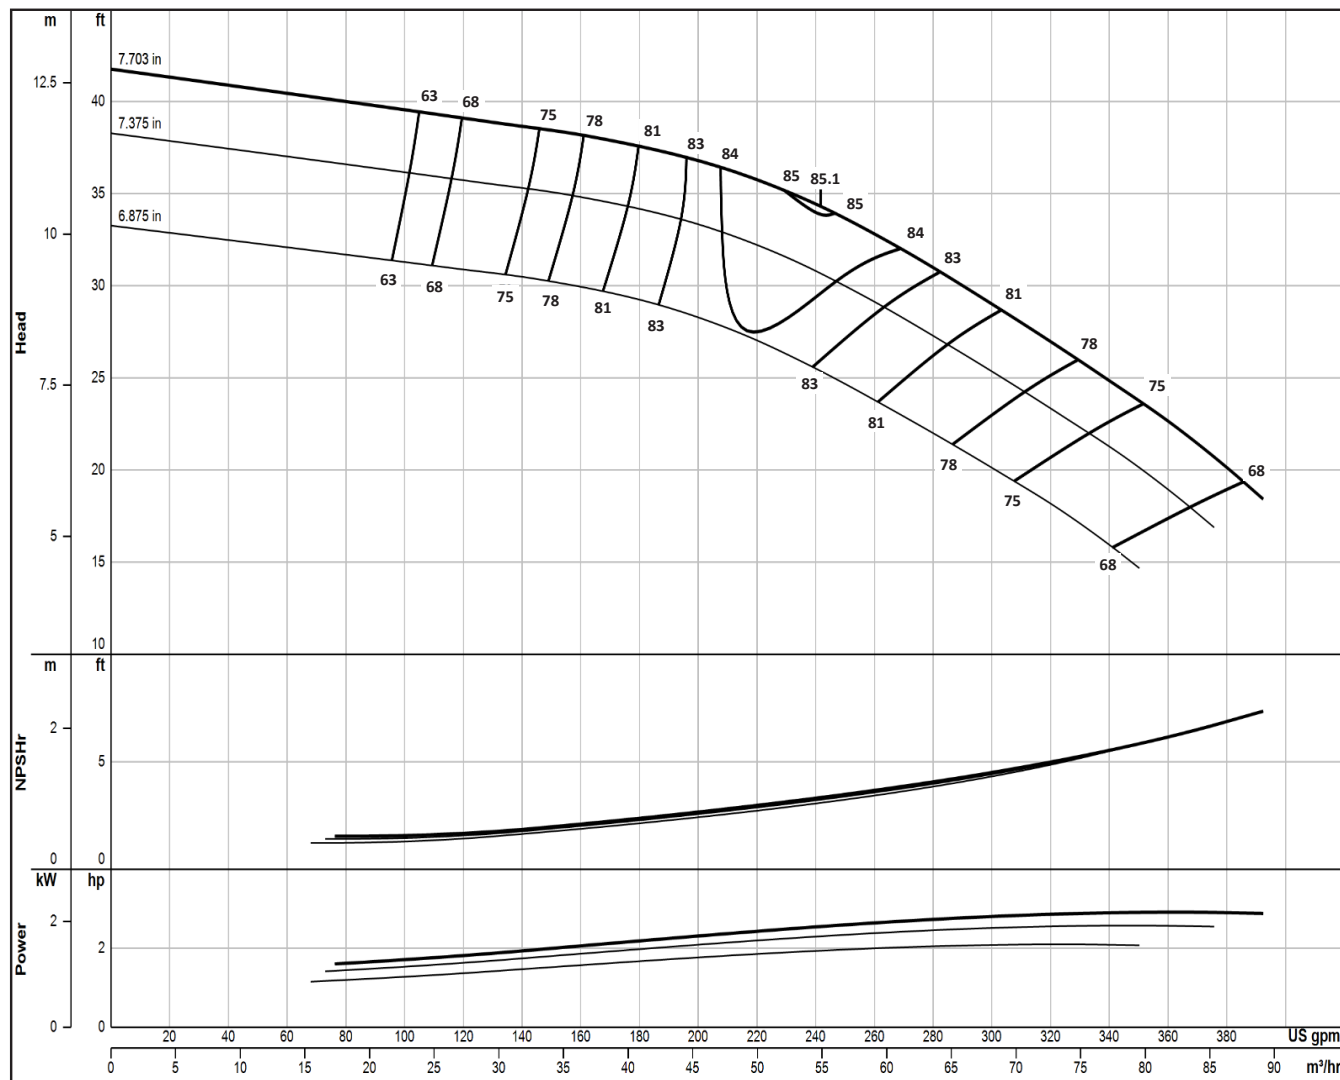

Impeller Type	Enclosed	Bowl Ø (cm)	24.1	ns (SI)	31	Qty.	Eff.
Impeller Model	SP9L	Thd'd Discharge (cm)	15, 20, 10	S (SI)	183	Stages	Change
One Stage Weight (kg)	68.0	Thd'd Suction (cm)	15	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	27.2	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-2
Impeller Wt. (kg)	4.1	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	2.39	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	2820	Imp. Setting (cm)	0.79	4	0
One Stage Length (cm)	61.3	D.I. Bowl Rating (kPa)	6110	K-Factor (kg/m-tdh)	7.6	5	0
Add'l Stage Length (cm)	19.7	316 Bowl Rating (kPa)	Δ	Imp. WR ² (kg-m ²)	0.012		

Δ Consult factory for availability

2022-10-25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP9M

1450 RPM

ONE ()
STAGE STAGE

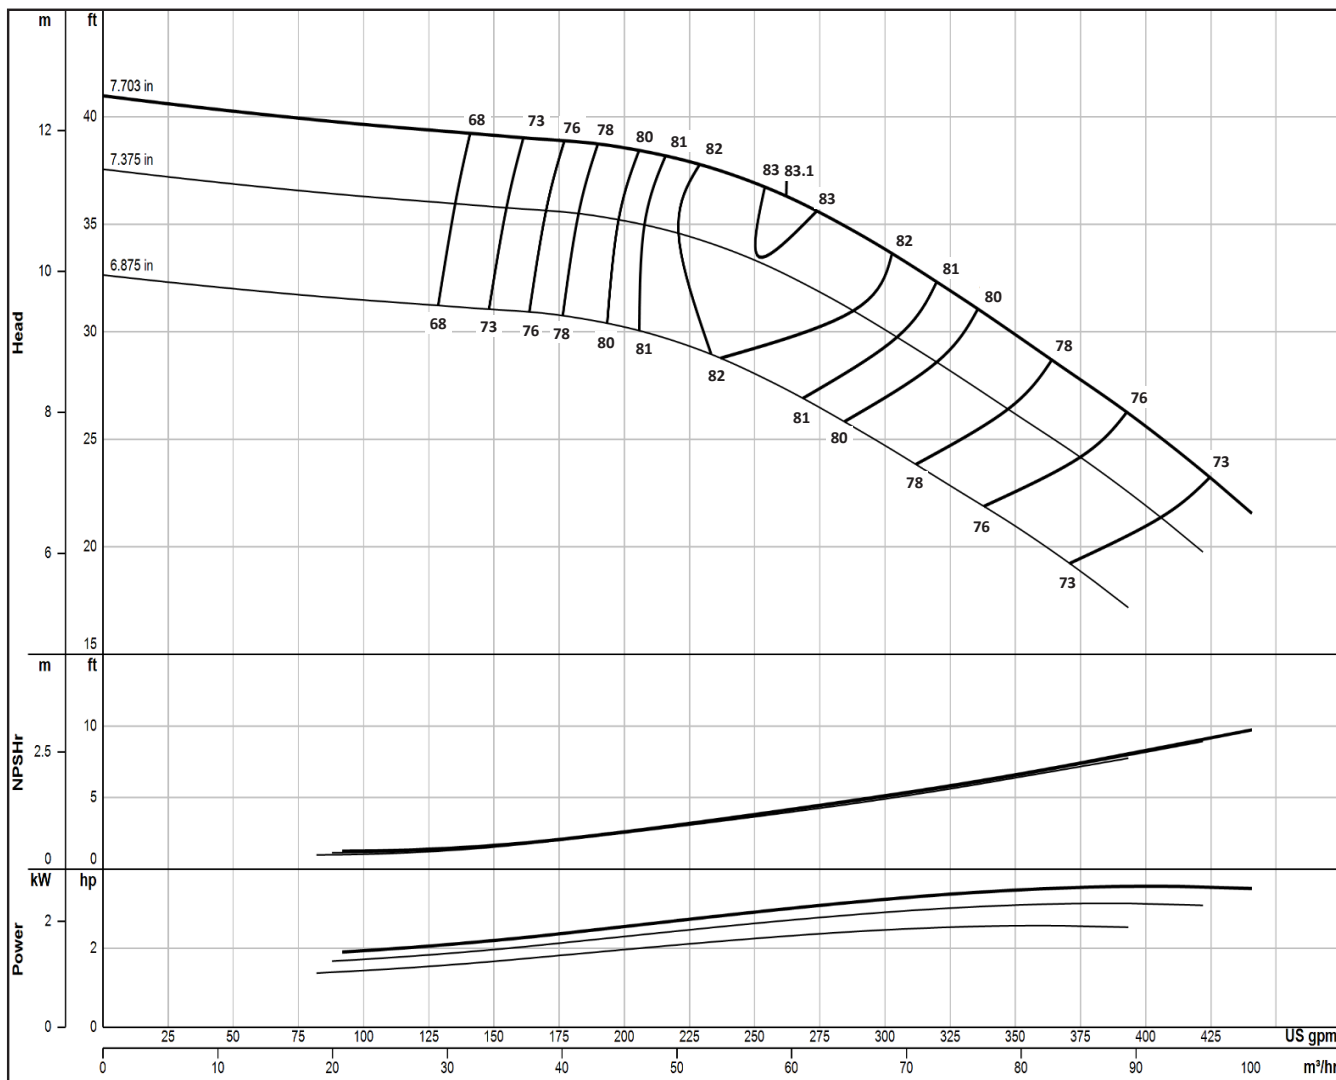

Impeller Type	Enclosed	Bowl Ø (cm)	24.1	ns (SI)	31	Qty.	Eff.
Impeller Model	SP9M	Thd'd Discharge (cm)	15, 20, 10	S (SI)	158	Stages	Change
One Stage Weight (kg)	68.0	Thd'd Suction (cm)	15	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	27.2	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-2
Impeller Wt. (kg)	4.3	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	2.39	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	2820	Imp. Setting (cm)	0.79	4	0
One Stage Length (cm)	61.3	D.I. Bowl Rating (kPa)	6110	K-Factor (kg/m-tdh)	6.7	5	0
Add'l Stage Length (cm)	19.7	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.013		

Δ Consult factory for availability

2022-10-25

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM9L

1450 RPM

ONE ()
STAGE STAGE

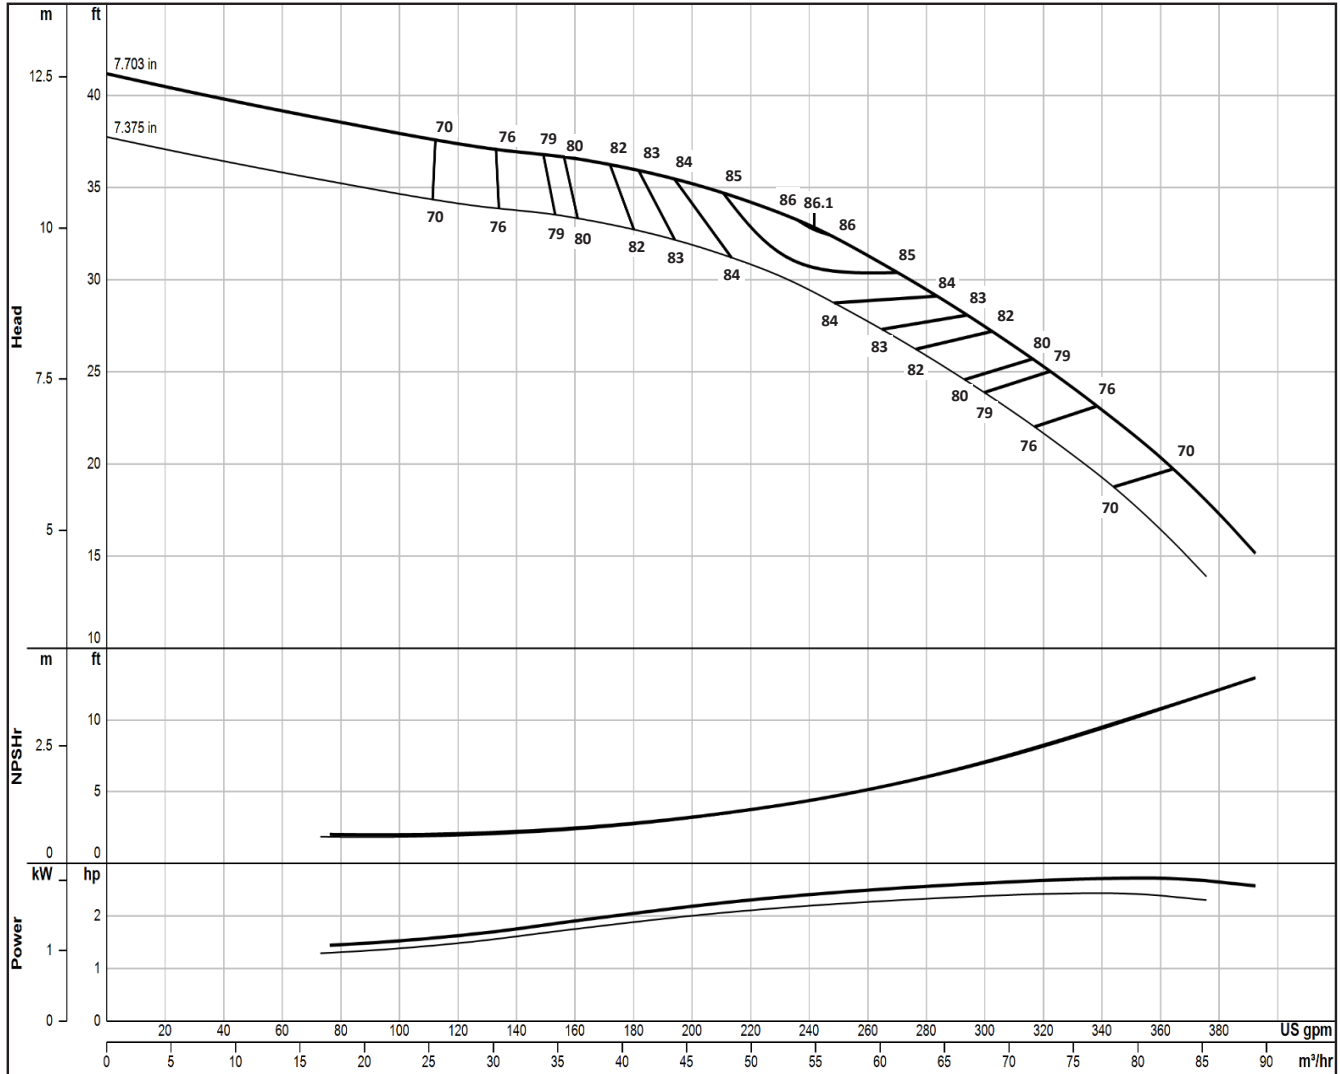

Impeller Type	Enclosed	Bowl Ø (cm)	24.1	ns (SI)	31	Qty.	Eff.
Impeller Model	SM9L	Thd'd Discharge (cm)	15, 20, 10	S (SI)	149	Stages	Change
One Stage Weight (kg)	68.0	Thd'd Suction (cm)	15	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	27.2	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-2
Impeller Wt. (kg)	4.1	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	2.24	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	2812	Imp. Setting (cm)	0.79	4	0
One Stage Length (cm)	61.3	D.I. Bowl Rating (kPa)	6093	K-Factor (kg/m-tdh)	9.7	5	0
Add'l Stage Length (cm)	19.7	316 Bowl Rating (kPa)	6562	Imp. WR² (kg-m²)	0.012		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM9M

1450 RPM

ONE ()
STAGE STAGE

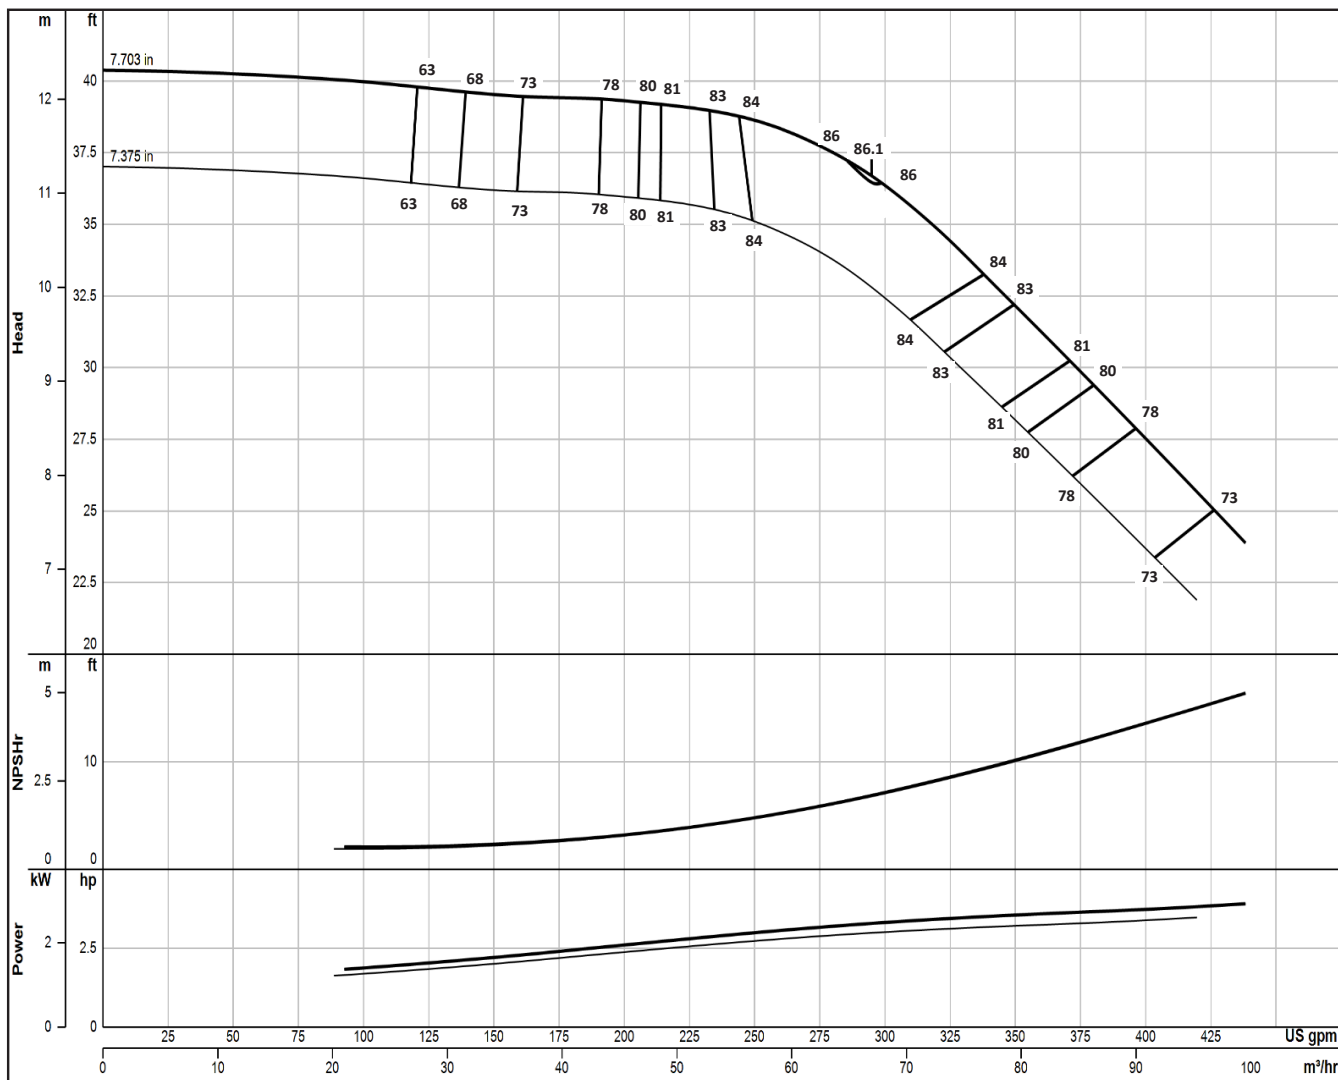

Impeller Type	Enclosed	Bowl Ø (cm)	24.1	ns (SI)	34	Qty.	Eff.
Impeller Model	SM9M	Thd'd Discharge (cm)	15, 20, 10	S (SI)	107	Stages	Change
One Stage Weight (kg)	68.0	Thd'd Suction (cm)	15	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	27.2	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-2
Impeller Wt. (kg)	4.3	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	2.24	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	2812	Imp. Setting (cm)	0.79	4	0
One Stage Length (cm)	61.3	D.I. Bowl Rating (kPa)	6093	K-Factor (kg/m-tdh)	7.1	5	0
Add'l Stage Length (cm)	19.7	316 Bowl Rating (kPa)	6562	Imp. WR ² (kg-m²)	0.013		

Δ Consult factory for availability

2026-03-23

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM9H

1450 RPM

ONE ()
STAGE STAGE

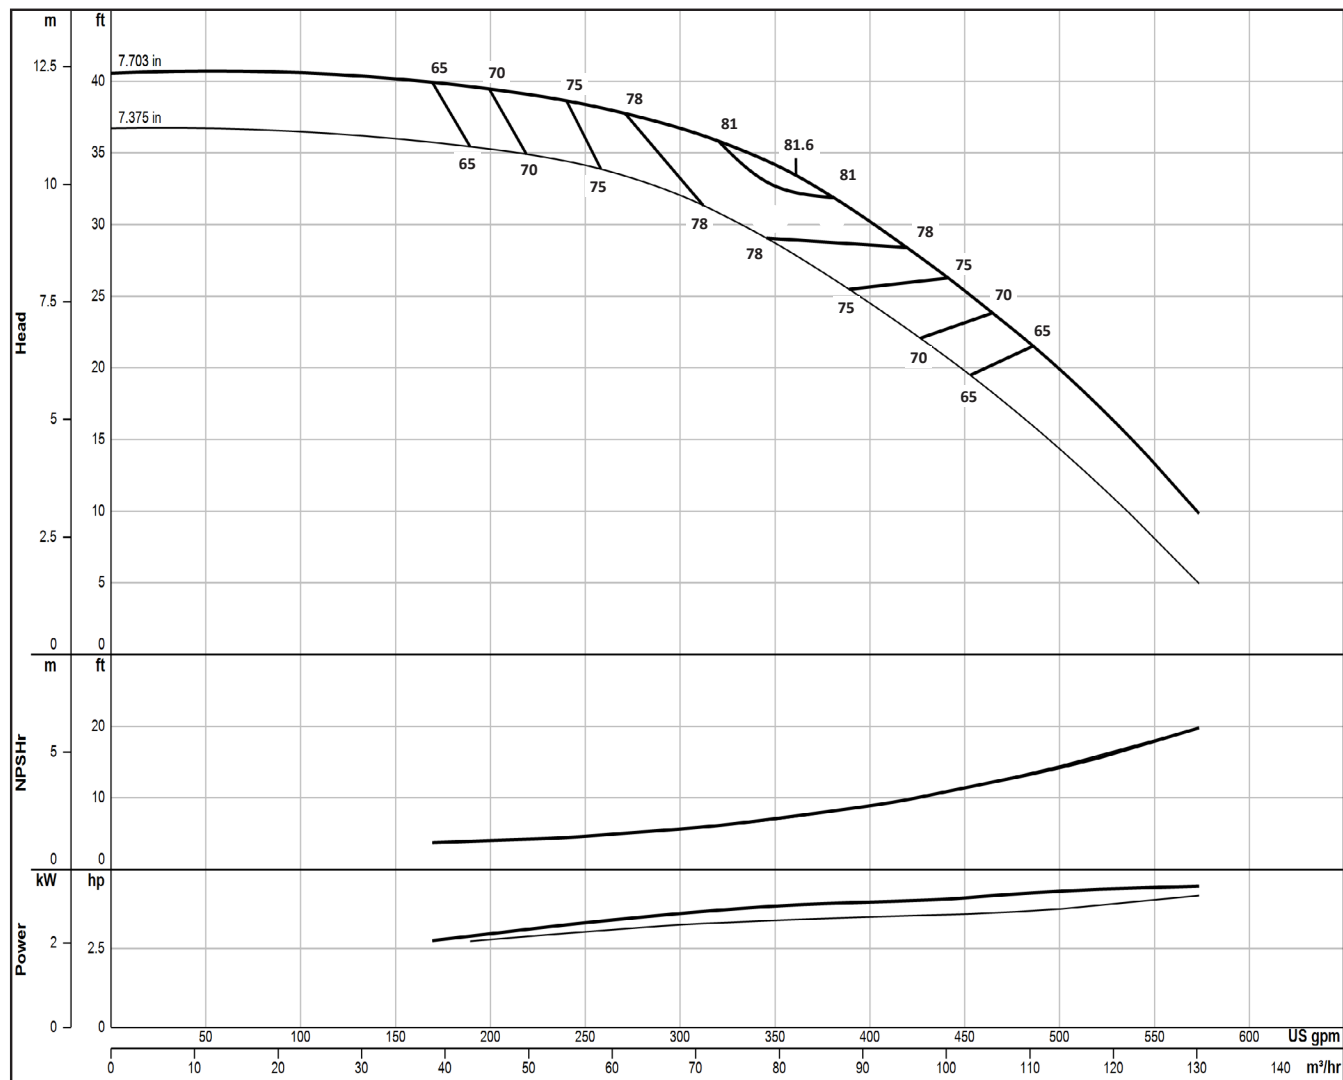

Impeller Type	Enclosed	Bowl Ø (cm)	24.1	ns (SI)	37	Qty.	Eff.
Impeller Model	SM9H	Thd'd Discharge (cm)	15, 20, 10	S (SI)	122	Stages	Change
One Stage Weight (kg)	68.0	Thd'd Suction (cm)	15	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	27.2	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-2
Impeller Wt. (kg)	4.3	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	1.91	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	2812	Imp. Setting (cm)	0.79	4	0
One Stage Length (cm)	61.3	D.I. Bowl Rating (kPa)	6093	K-Factor (kg/m-tdh)	7.1	5	0
Add'l Stage Length (cm)	19.7	316 Bowl Rating (kPa)	6562	Imp. WR² (kg-m²)	0.013		

Δ Consult factory for availability

2021-06-08

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SL9H

1450 RPM

ONE ()
STAGE STAGE

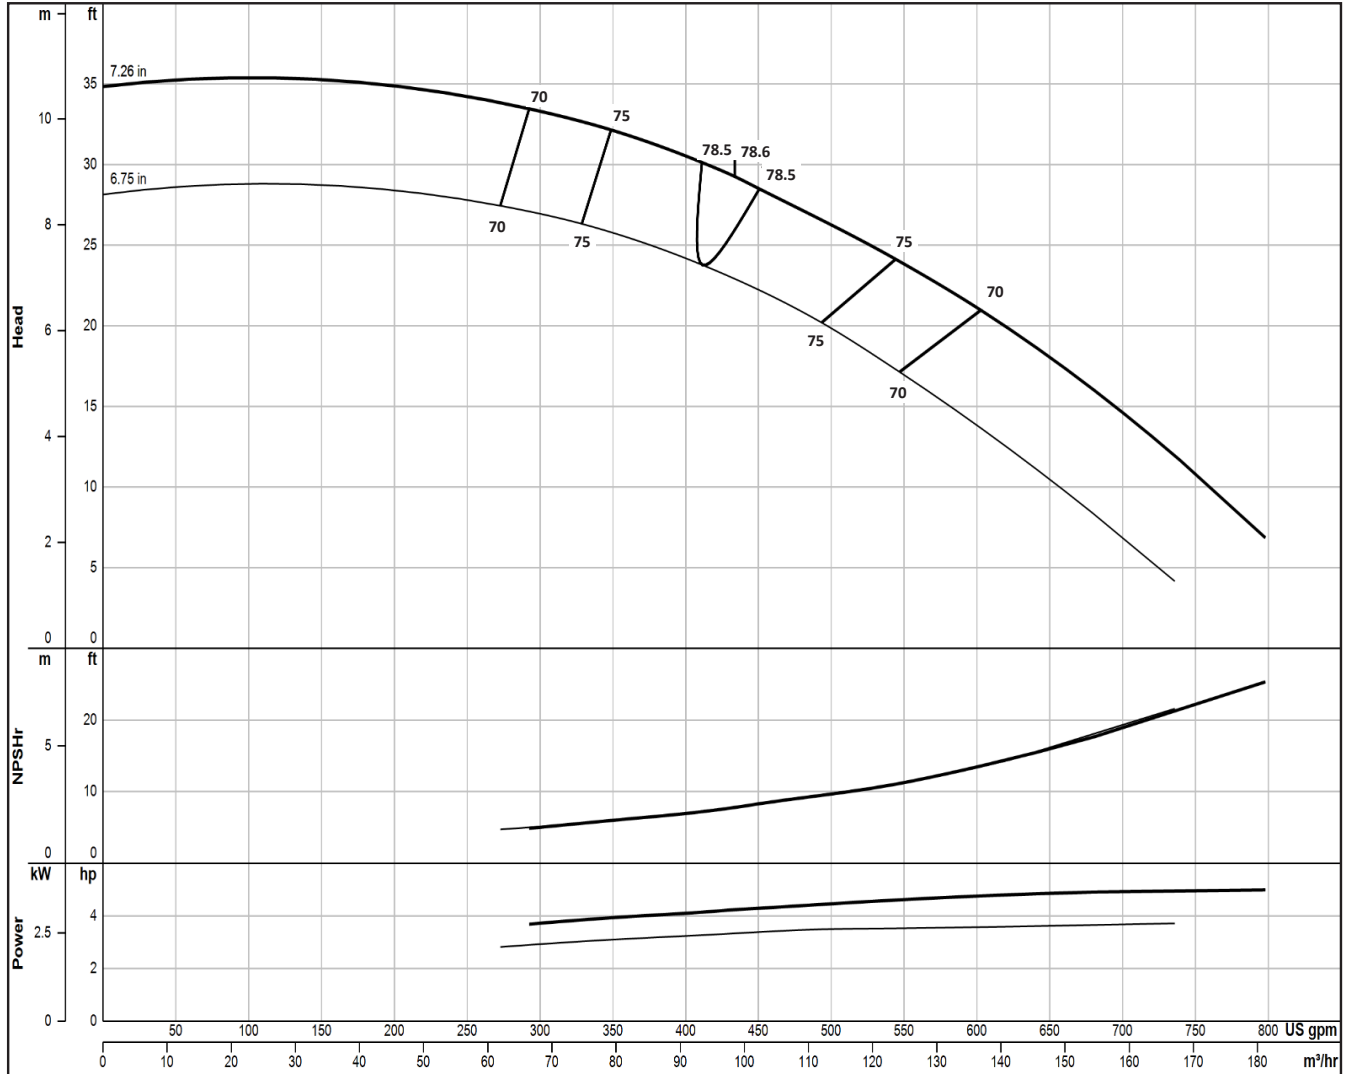

Impeller Type	Enclosed	Bowl Ø (cm)	22.9	ns (SI)	41	Qty.	Eff.
Impeller Model	SL9H	Thd'd Discharge (cm)	15, 20, 10	S (SI)	145	Stages	Change
One Stage Weight (kg)	61.2	Thd'd Suction (cm)	15	PEIcI	N/A	1	-3
Add'l Stage Wt. (kg)	24.0	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-2
Impeller Wt. (kg)	3.9	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	2.54	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	63.2	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	8.5	5	0
Add'l Stage Length (cm)	21.6	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.010		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SF9H

1450 RPM

ONE ()
STAGE STAGE

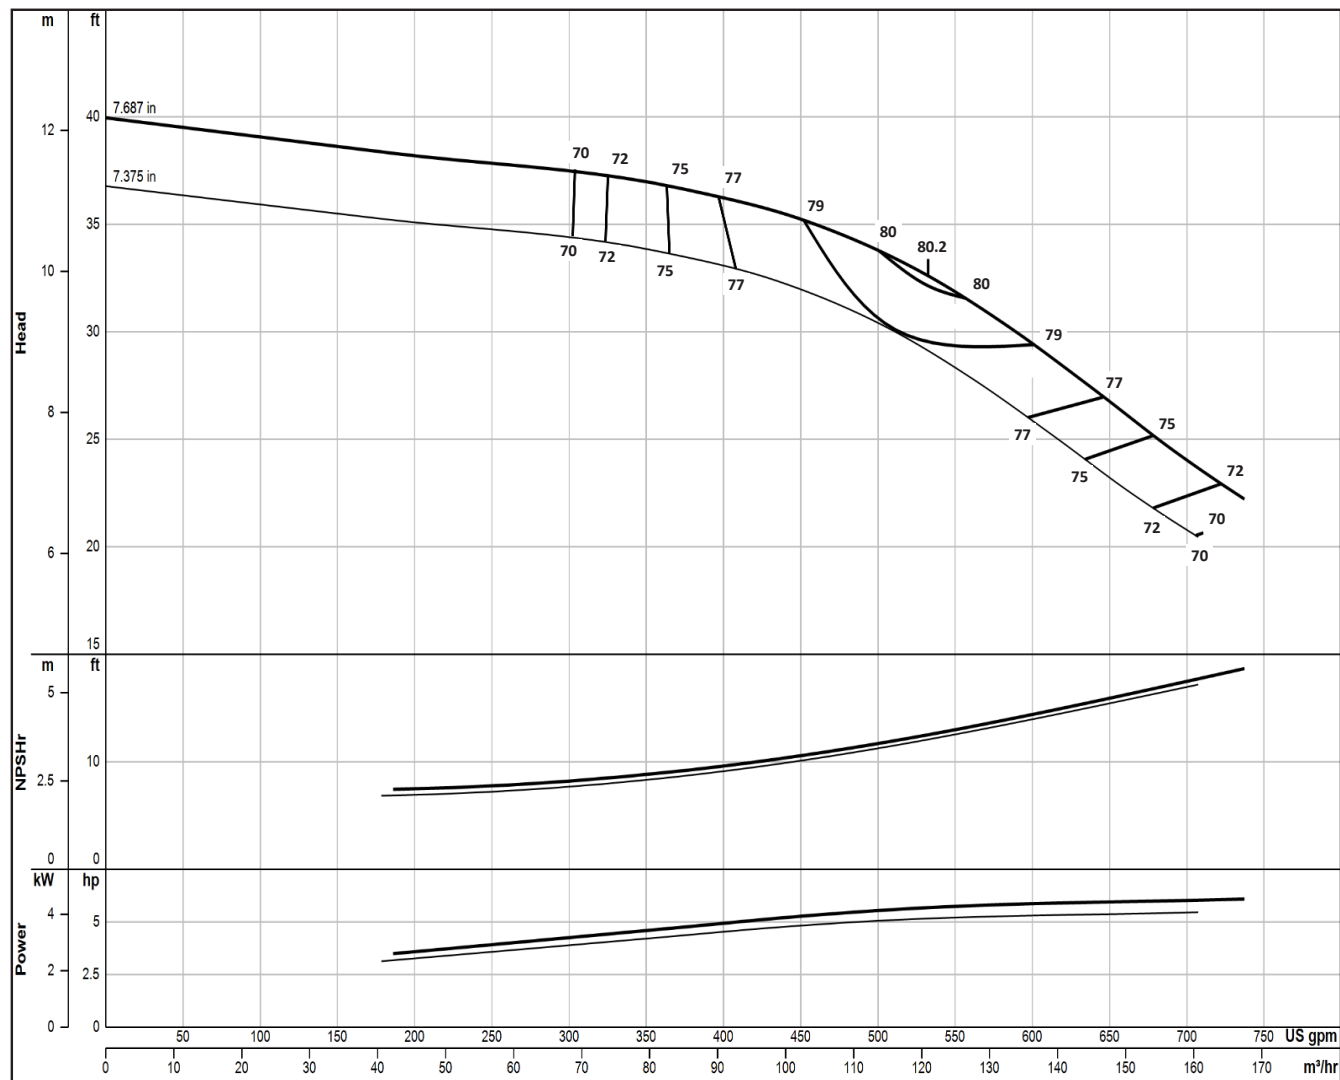

Impeller Type	Enclosed	Bowl Ø (cm)	24.1	ns (SI)	45	Qty.	Eff.
Impeller Model	SF9H	Thd'd Discharge (cm)	15, 20, 10	S (SI)	101	Stages	Change
One Stage Weight (kg)	83.9	Thd'd Suction (cm)	15	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	30.4	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-2
Impeller Wt. (kg)	4.1	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	2.38	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	60.0	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	8.6	5	0
Add'l Stage Length (cm)	19.1	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.012		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SK9M

1450 RPM

ONE ()
STAGE STAGE

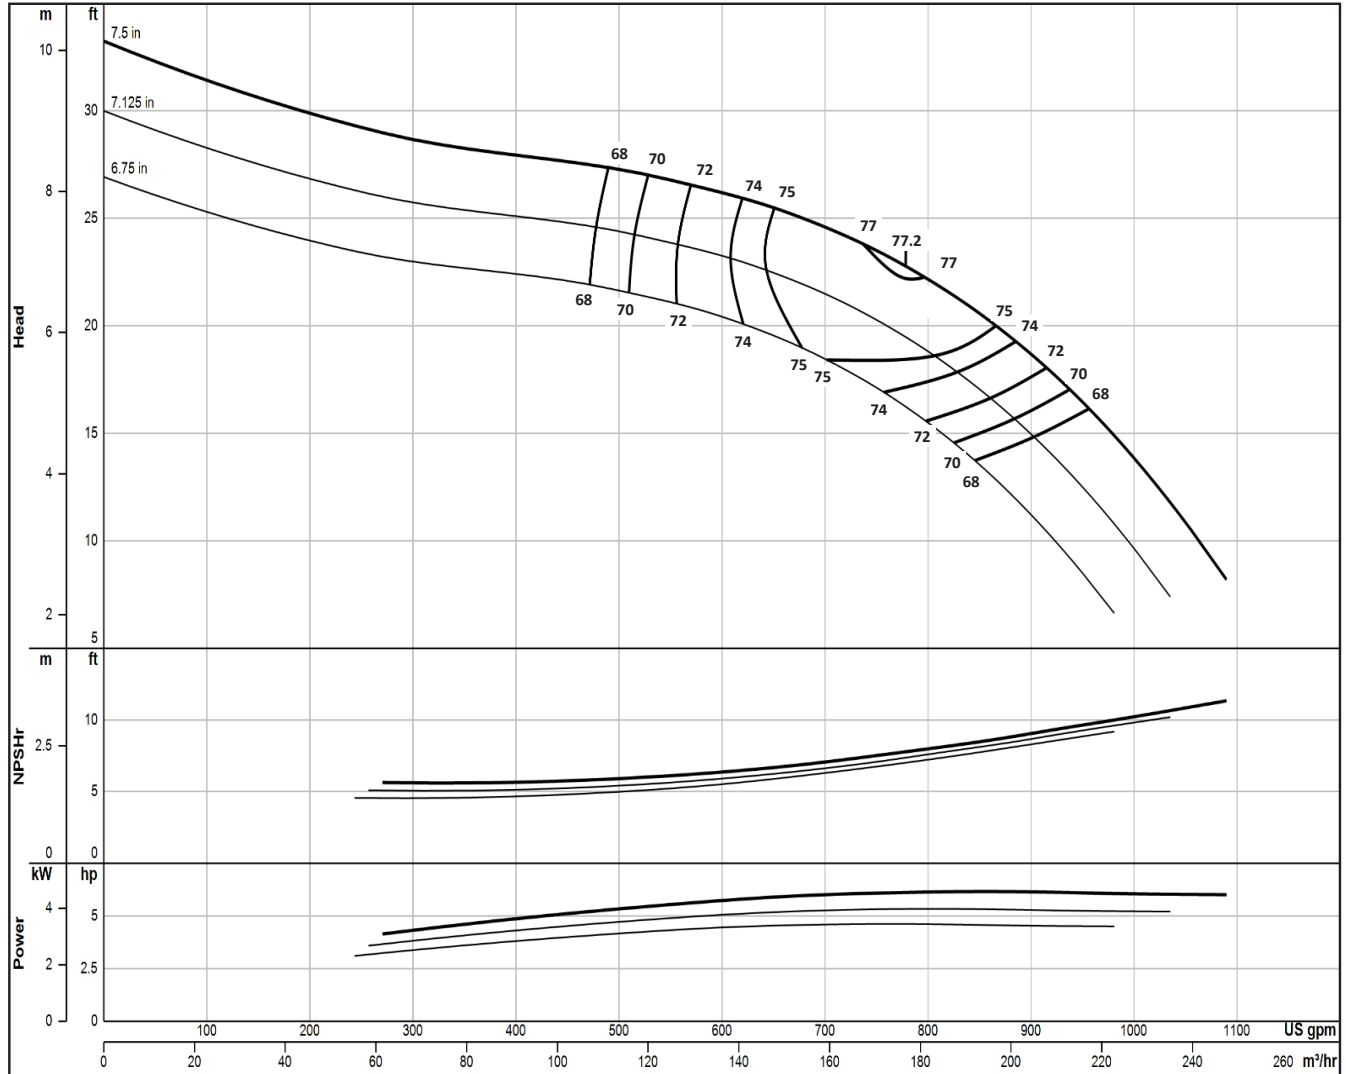

Impeller Type	Enclosed	Bowl Ø (cm)	24.0	ns (SI)	74	Qty.	Eff.
Impeller Model	SK9M	Thd'd Discharge (cm)	15, 20, 10	S (SI)	171	Stages	Change
One Stage Weight (kg)	113.4	Thd'd Suction (cm)	20	PEIcI	N/A	1	-4
Add'l Stage Wt. (kg)	38.6	Bell Suction Ø (cm)	N/A	Bowl Shaft Ø (cm)	4.29	2	-3
Impeller Wt. (kg)	6.8	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	3.65	3	-2
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	68.6	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	14.7	5	0
Add'l Stage Length (cm)	27.0	316 Bowl Rating (kPa)	Δ	Imp. WR ² (kg-m²)	0.019		

Δ Consult factory for availability

2021-06-08

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SK9H

1450 RPM

ONE ()
STAGE STAGE

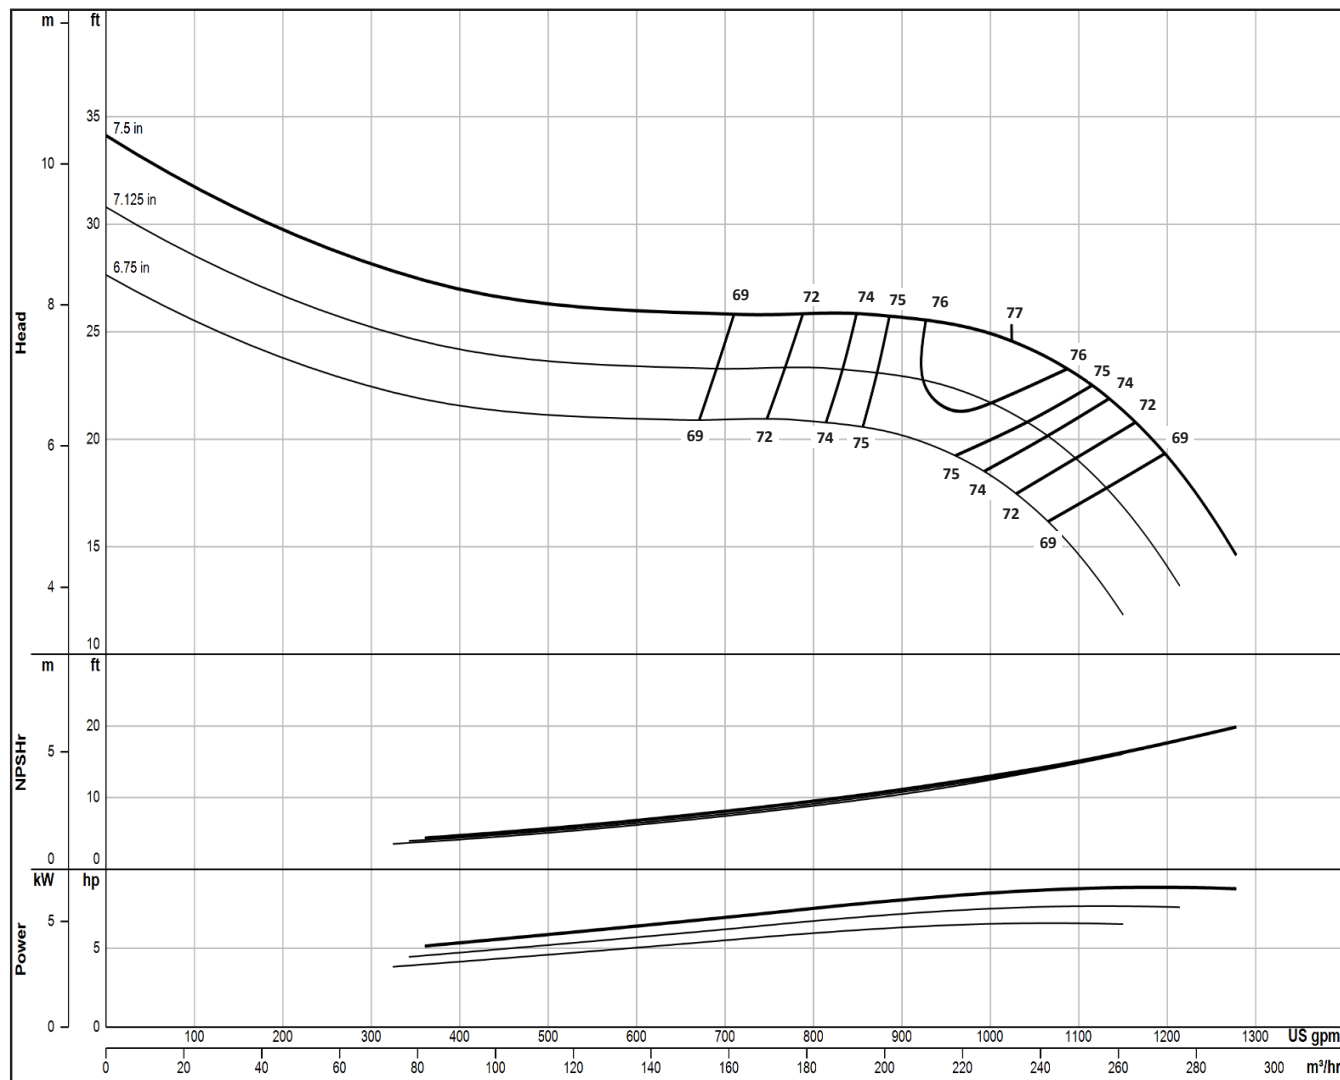

Impeller Type	Enclosed	Bowl Ø (cm)	24.0	ns (SI)	81	Qty.	Eff.
Impeller Model	SK9H	Thd'd Discharge (cm)	15, 20, 10	S (SI)	130	Stages	Change
One Stage Weight (kg)	113.4	Thd'd Suction (cm)	20	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	38.6	Bell Suction Ø (cm)	N/A	Bowl Shaft Ø (cm)	4.29	2	-2
Impeller Wt. (kg)	5.9	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	2.54	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	68.6	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	14.7	5	0
Add'l Stage Length (cm)	27.0	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.018		

Δ Consult factory for availability

2021-06-08

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP10M

1450 RPM

ONE ()
STAGE STAGE

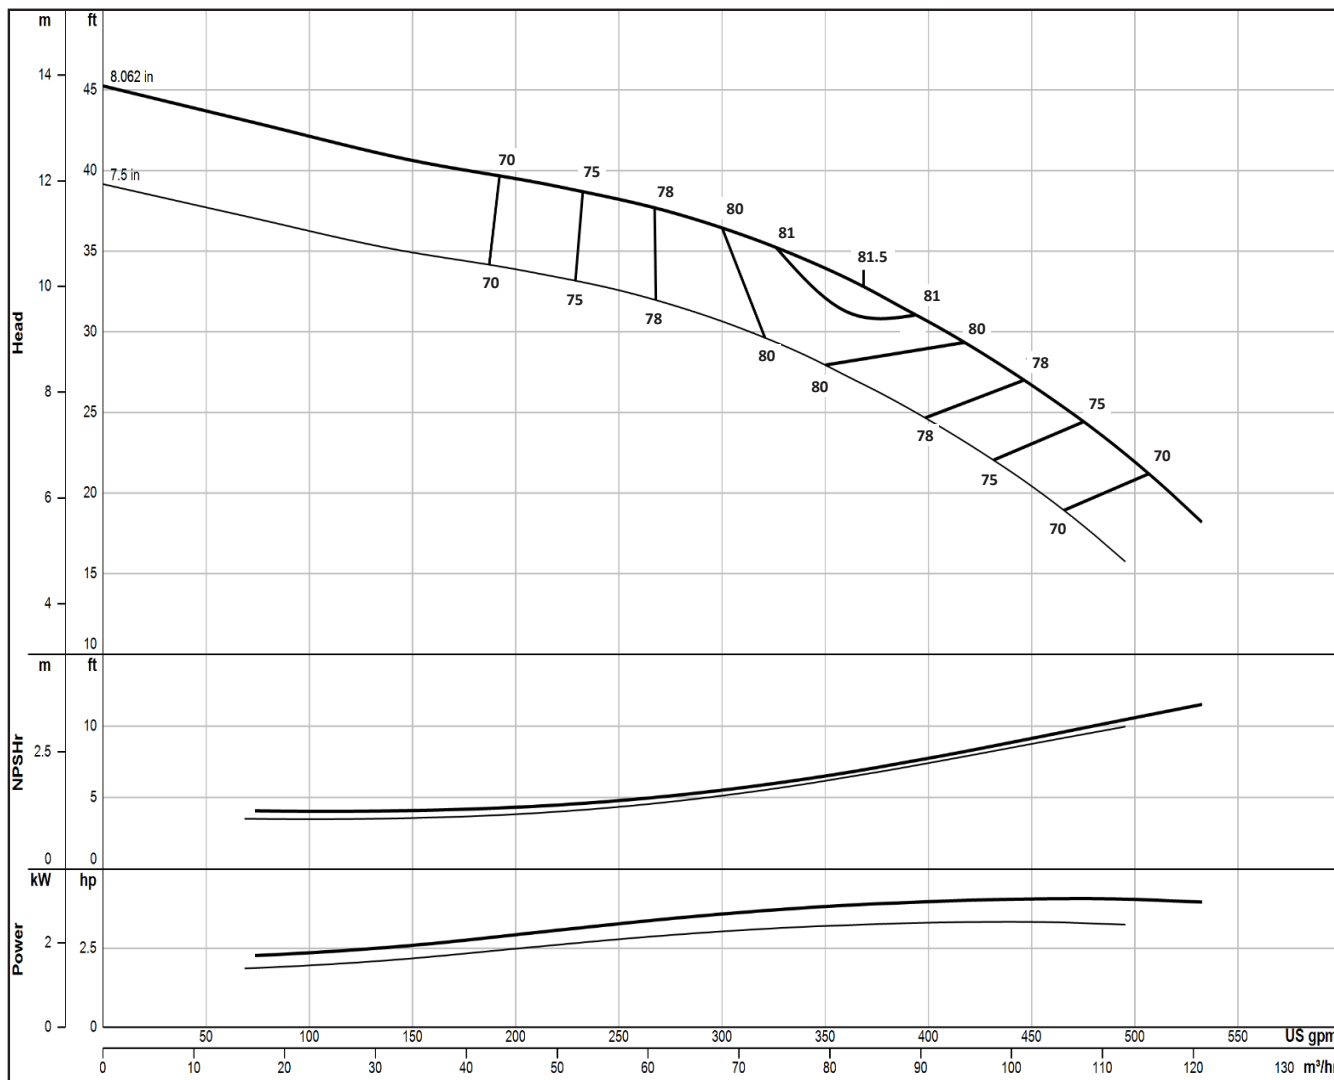

Impeller Type	Enclosed	Bowl Ø (cm)	25.9	ns (SI)	38	Qty.	Eff.
Impeller Model	SP10M	Thd'd Discharge (cm)	15, 20, 10	S (SI)	127	Stages	Change
One Stage Weight (kg)	86.2	Thd'd Suction (cm)	15	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	34.0	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-2
Impeller Wt. (kg)	4.0	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	2.38	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	5034	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	59.4	D.I. Bowl Rating (kPa)	10908	K-Factor (kg/m-tdh)	7.5	5	0
Add'l Stage Length (cm)	18.4	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.014		

Δ Consult factory for availability

2024-01-15

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP10H

1450 RPM

ONE ()
STAGE STAGE

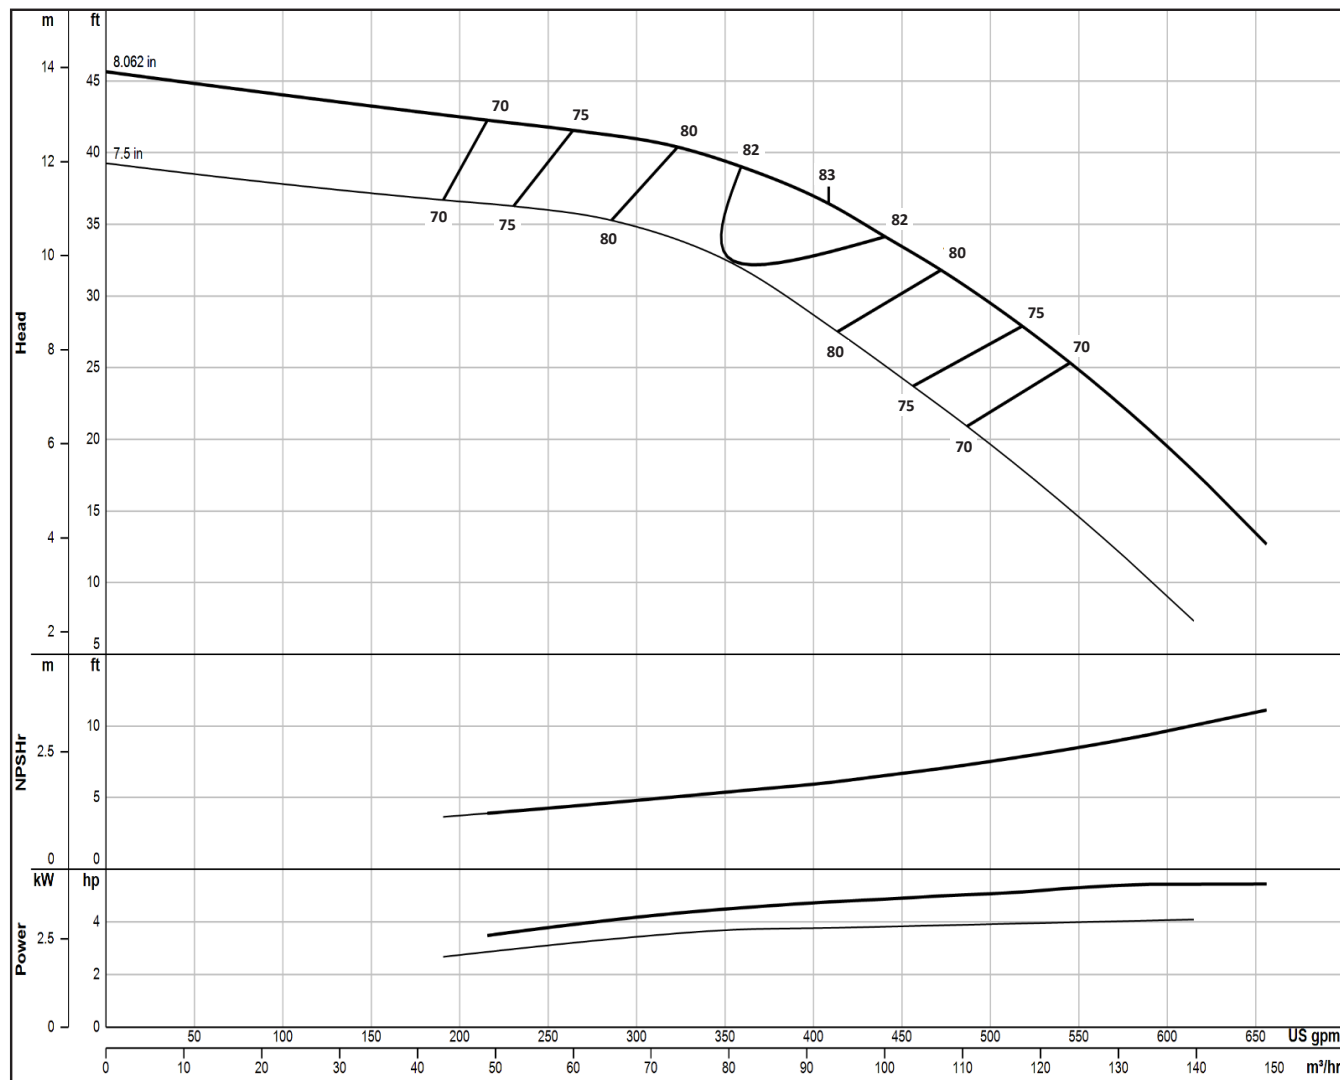

Impeller Type	Enclosed	Bowl Ø (cm)	25.9	ns (SI)	38	Qty.	Eff.
Impeller Model	SP10H	Thd'd Discharge (cm)	15, 20, 10	S (SI)	151	Stages	Change
One Stage Weight (kg)	86.2	Thd'd Suction (cm)	15	PEIcl	N/A	1	-4
Add'l Stage Wt. (kg)	34.0	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-3
Impeller Wt. (kg)	4.1	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	1.59	3	-2
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	5034	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	59.4	D.I. Bowl Rating (kPa)	10908	K-Factor (kg/m-tdh)	7.9	5	0
Add'l Stage Length (cm)	18.4	316 Bowl Rating (kPa)	Δ	Imp. WR ² (kg-m ²)	0.013		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM10MO

1450 RPM

ONE ()
STAGE STAGE

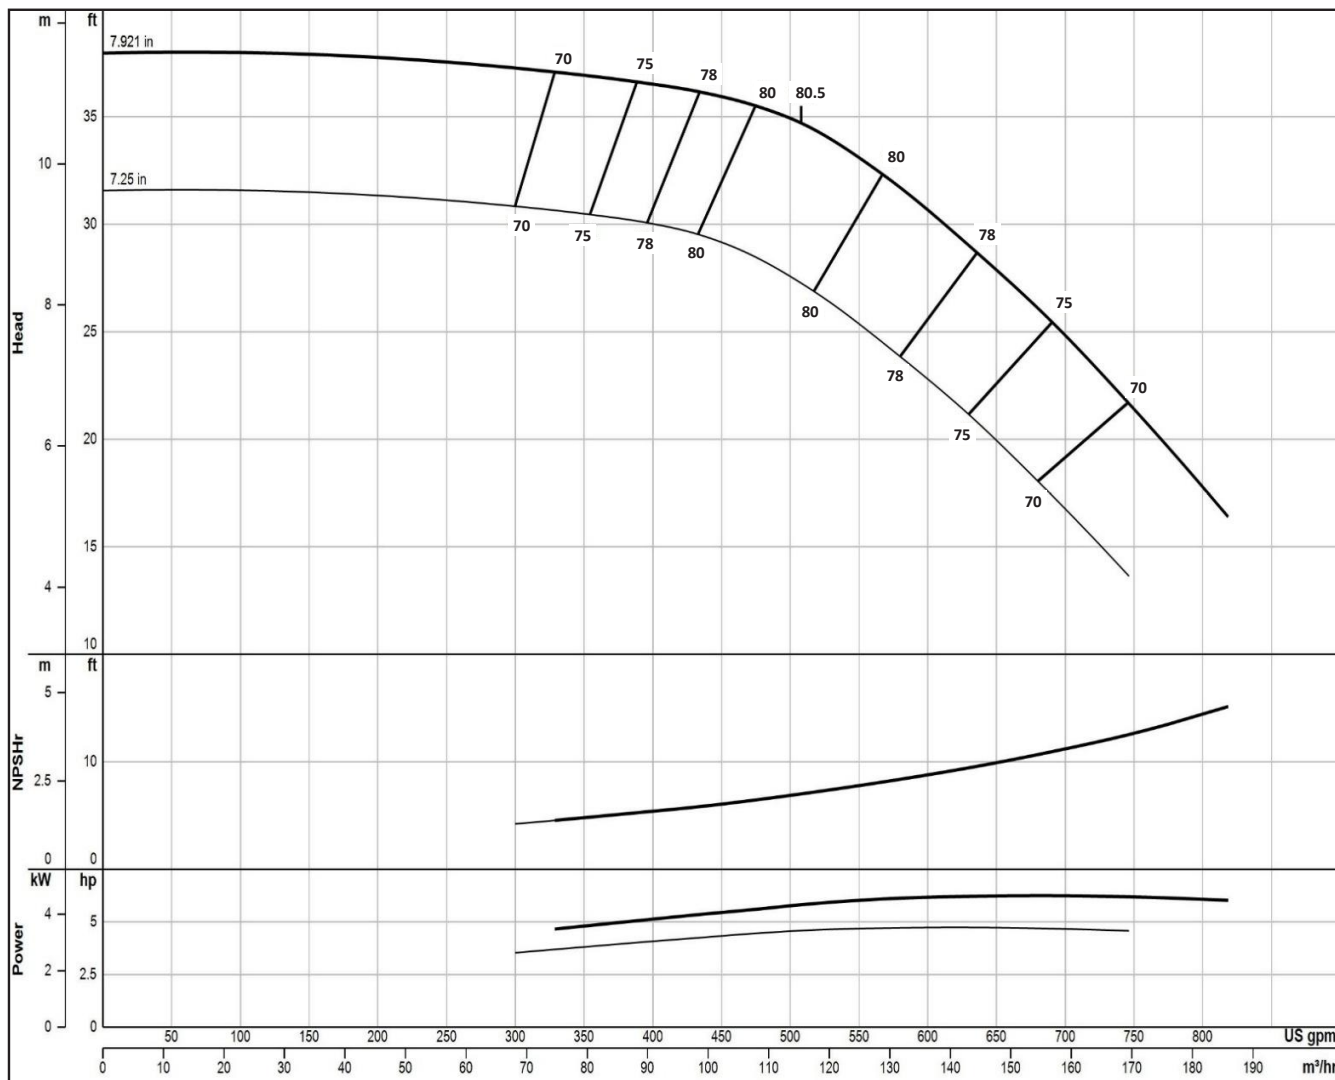

Impeller Type	Semi-Open	Bowl Ø (cm)	25.9	ns (SI)	46	Qty.	Eff.
Impeller Model	SM10MO	Thd'd Discharge (cm)	15, 20, 10	S (SI)	154	Stages	Change
One Stage Weight (kg)	86.2	Thd'd Suction (cm)	15	PEIcI	N/A	1	-4
Add'l Stage Wt. (kg)	34.0	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-3
Impeller Wt. (kg)	2.8	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	3.96	3	-2
Impeller Mtrl.	NaB	C.I. Bowl Rating (kPa)	3368	Imp. Setting (cm)	0.08	4	-1
One Stage Length (cm)	63.5	D.I. Bowl Rating (kPa)	7298	K-Factor (kg/m-tdh)	13.1	5	0
Add'l Stage Length (cm)	22.6	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.009		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM10HO

1450 RPM

ONE ()
STAGE STAGE

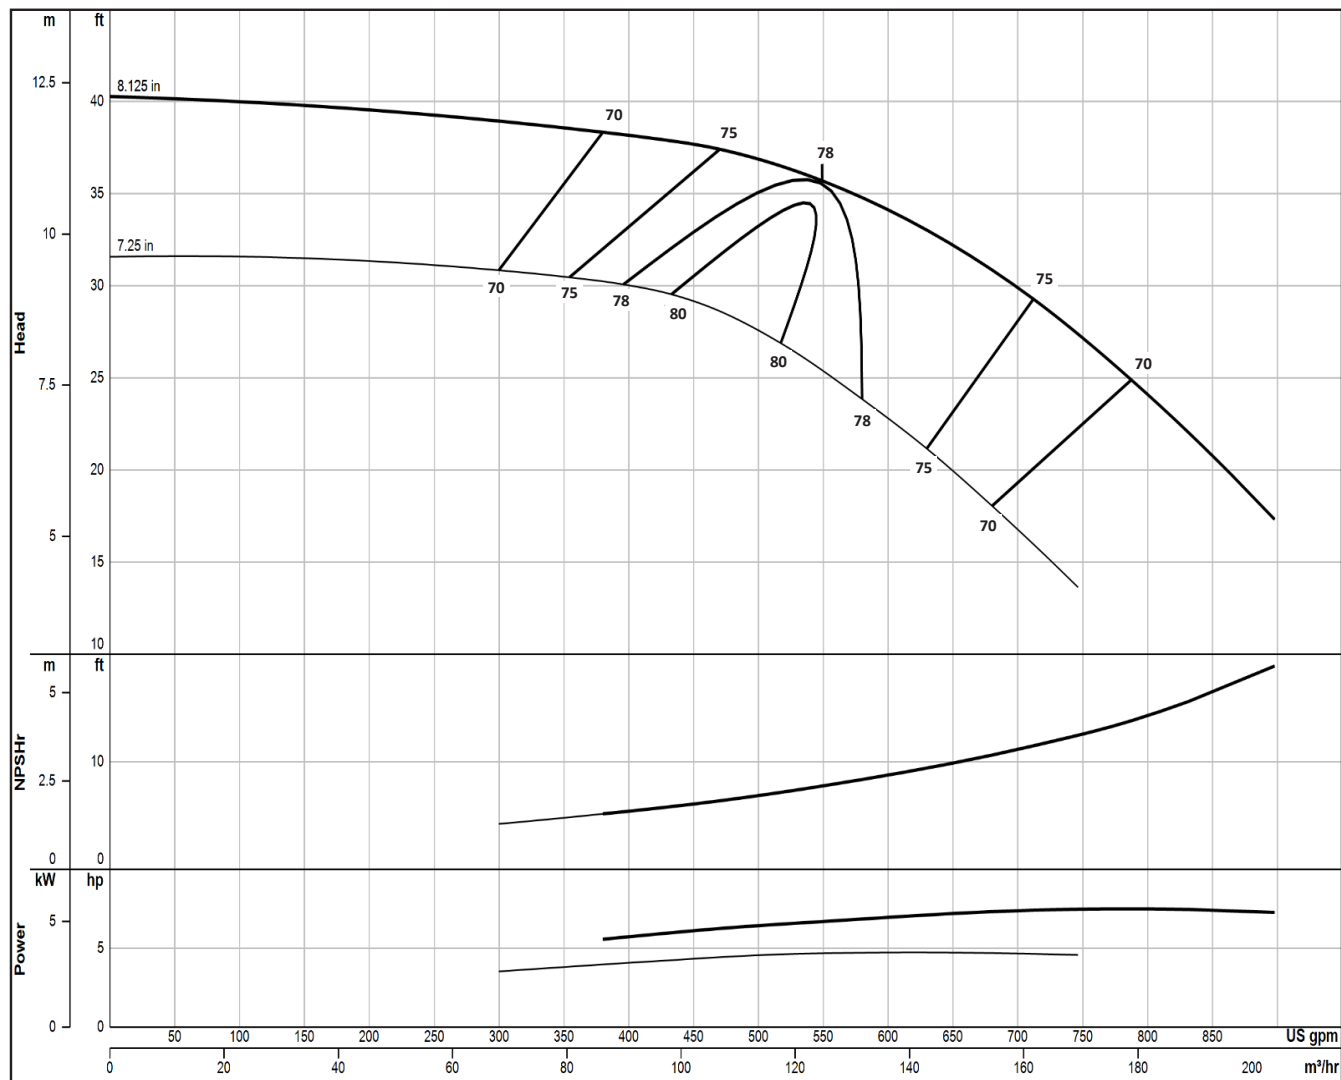

Impeller Type	Semi-Open	Bowl Ø (cm)	25.9	ns (SI)	48	Qty.	Eff.
Impeller Model	SM10HO	Thd'd Discharge (cm)	15, 20, 10	S (SI)	147	Stages	Change
One Stage Weight (kg)	86.2	Thd'd Suction (cm)	15	PEIcl	N/A	1	-4
Add'l Stage Wt. (kg)	34.0	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-3
Impeller Wt. (kg)	2.8	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	3.18	3	-2
Impeller Mtrl.	NaB	C.I. Bowl Rating (kPa)	3368	Imp. Setting (cm)	0.08	4	-1
One Stage Length (cm)	63.5	D.I. Bowl Rating (kPa)	7298	K-Factor (kg/m-tdh)	13.2	5	0
Add'l Stage Length (cm)	22.6	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.009		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM10M

1450 RPM

ONE ()
STAGE STAGE

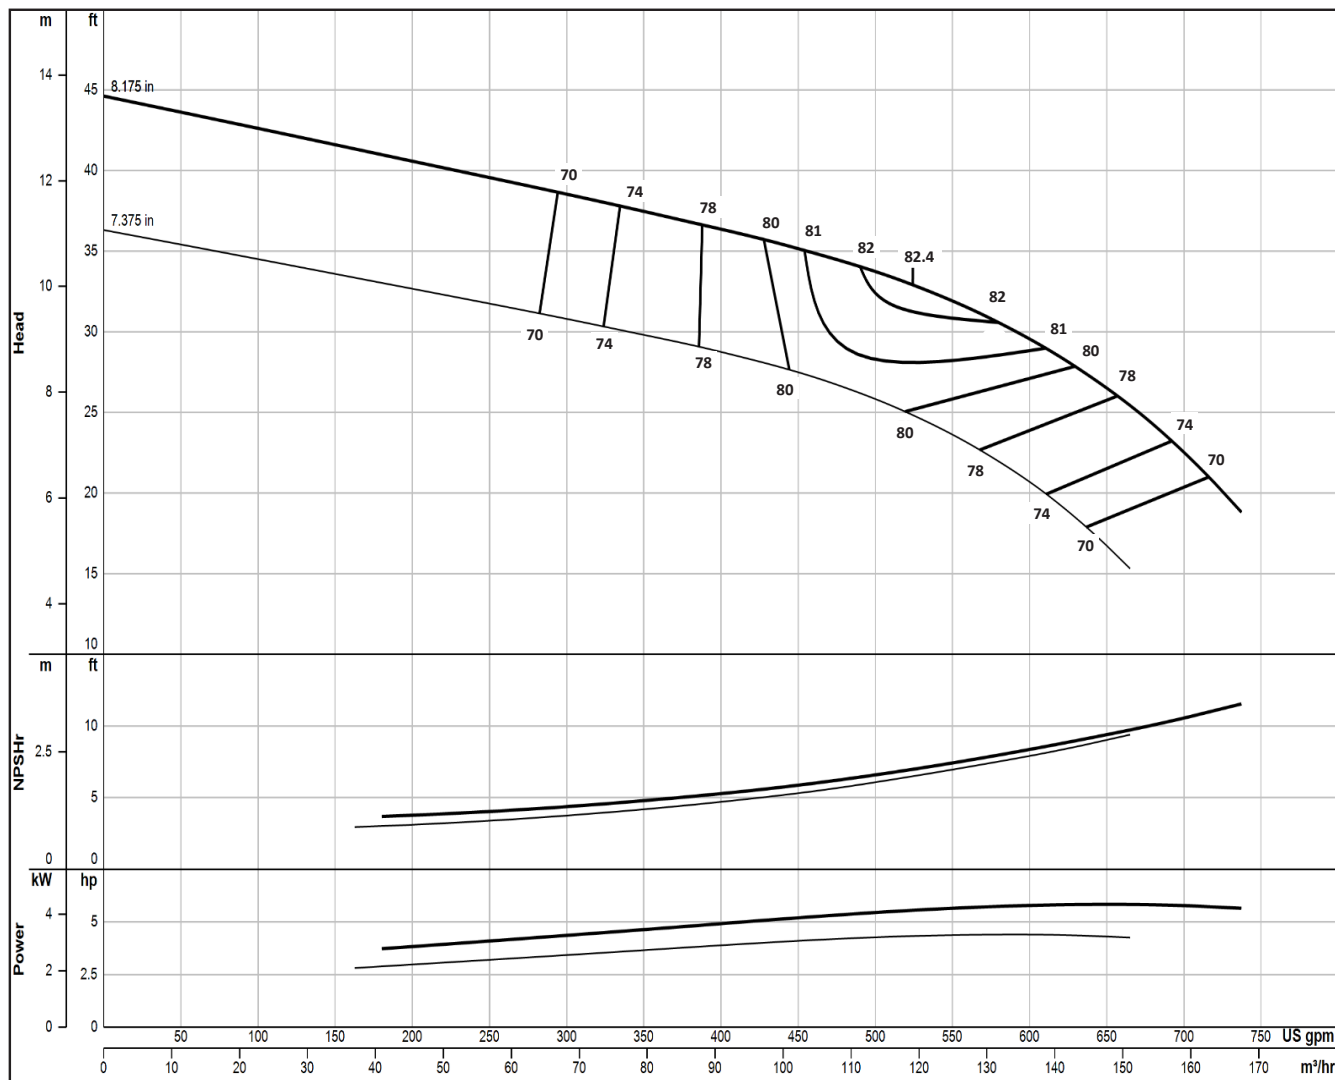

Impeller Type	Enclosed	Bowl Ø (cm)	25.9	ns (SI)	48	Qty.	Eff.
Impeller Model	SM10M	Thd'd Discharge (cm)	15, 20, 10	S (SI)	149	Stages	Change
One Stage Weight (kg)	88.5	Thd'd Suction (cm)	15	PEIcl	N/A	1	-4
Add'l Stage Wt. (kg)	34.0	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-3
Impeller Wt. (kg)	4.4	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	2.70	3	-2
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	3368	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	63.5	D.I. Bowl Rating (kPa)	7298	K-Factor (kg/m-tdh)	9.3	5	0
Add'l Stage Length (cm)	22.6	316 Bowl Rating (kPa)	7859	Imp. WR² (kg-m²)	0.015		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM10H

1450 RPM

ONE ()
STAGE STAGE

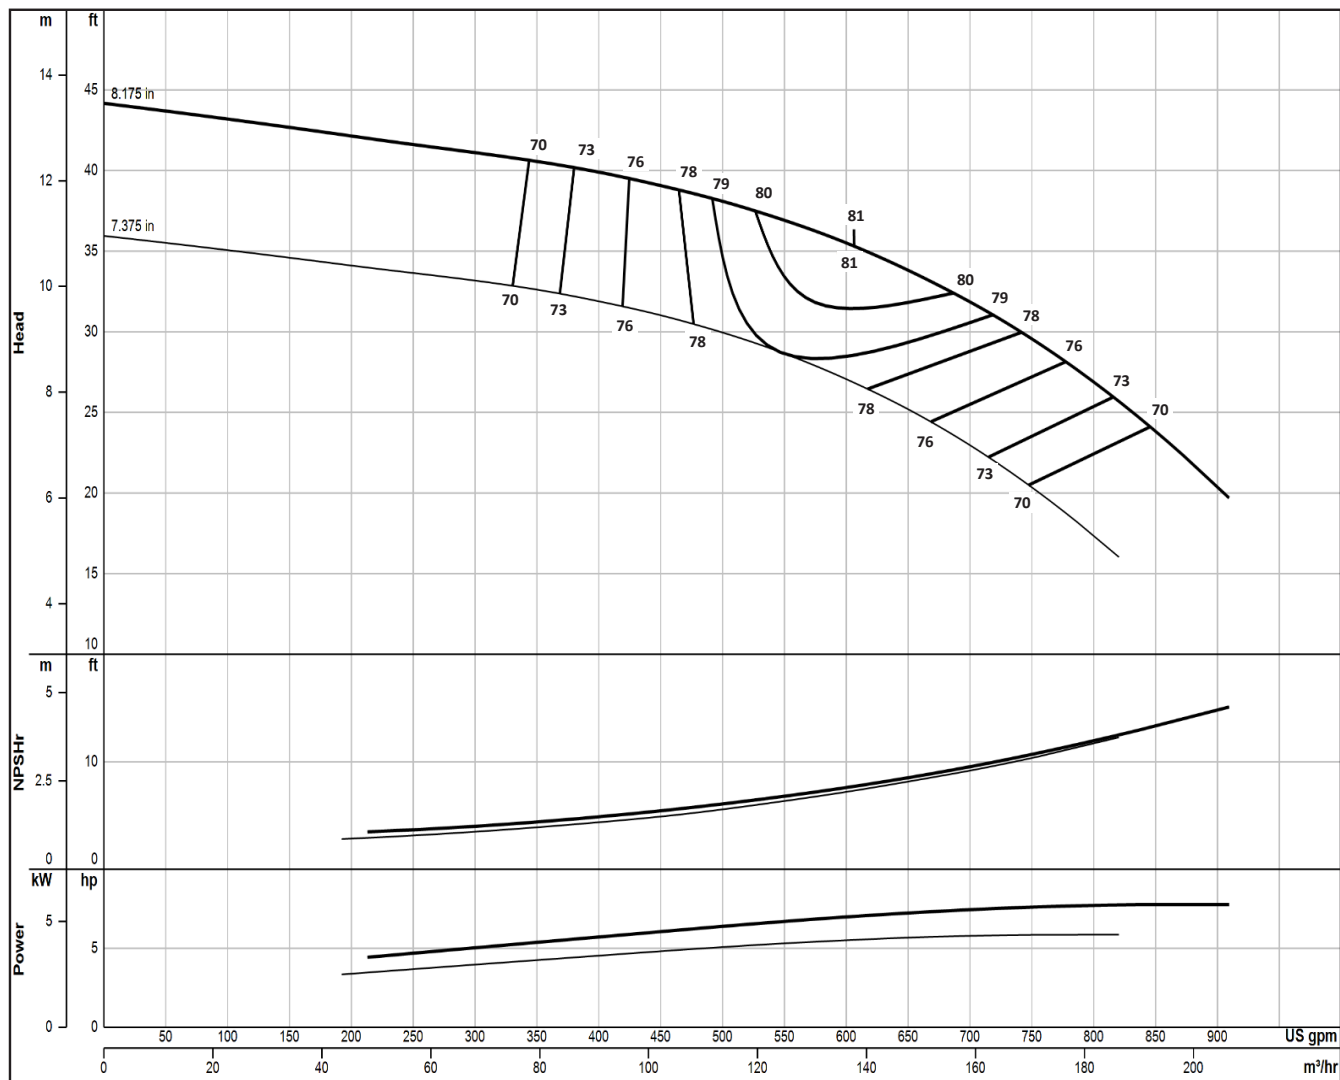

Impeller Type	Enclosed	Bowl Ø (cm)	25.9	ns (SI)	38	Qty.	Eff.
Impeller Model	SM10H	Thd'd Discharge (cm)	15, 20, 10	S (SI)	149	Stages	Change
One Stage Weight (kg)	88.5	Thd'd Suction (cm)	15	PEIcl	N/A	1	-4
Add'l Stage Wt. (kg)	34.5	Bell Suction Ø (cm)	25.4	Bowl Shaft Ø (cm)	3.81	2	-3
Impeller Wt. (kg)	4.9	Sub. Mtr. (cm)	15, 20, 25, 30	Total Lateral (cm)	2.70	3	-2
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	3368	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	63.5	D.I. Bowl Rating (kPa)	7298	K-Factor (kg/m-tdh)	11.6	5	0
Add'l Stage Length (cm)	22.6	316 Bowl Rating (kPa)	7859	Imp. WR² (kg-m²)	0.016		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM11M

1450 RPM

ONE ()
STAGE STAGE

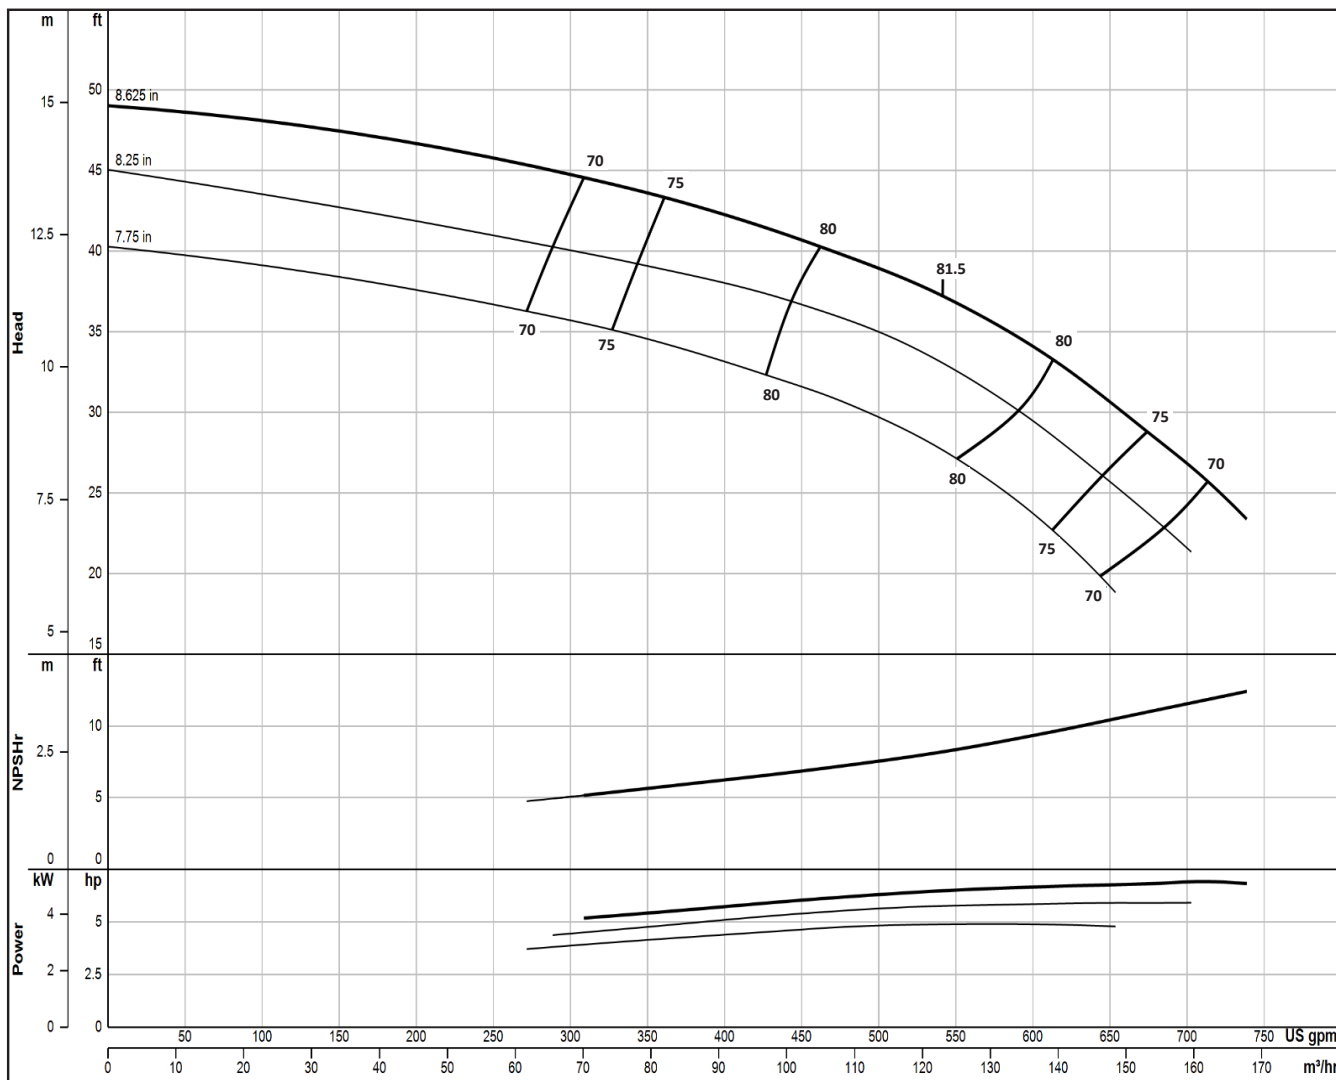

Impeller Type	Enclosed	Bowl Ø (cm)	27.0	ns (SI)	43	Qty.	Eff.
Impeller Model	SM11M	Thd'd Discharge (cm)	15, 20, 10	S (SI)	136	Stages	Change
One Stage Weight (kg)	88.5	Thd'd Suction (cm)	20	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	34.0	Bell Suction Ø (cm)	28.9	Bowl Shaft Ø (cm)	3.81	2	-2
Impeller Wt. (kg)	4.3	Sub. Mtr. (cm)	20, 25, 30	Total Lateral (cm)	2.22	3	-1
Impeller Mtrl.	NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	66.4	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	8.9	5	0
Add'l Stage Length (cm)	21.9	316 Bowl Rating (kPa)	Δ	Imp. WR ² (kg-m²)	0.016		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM11H

1450 RPM

ONE ()
STAGE STAGE

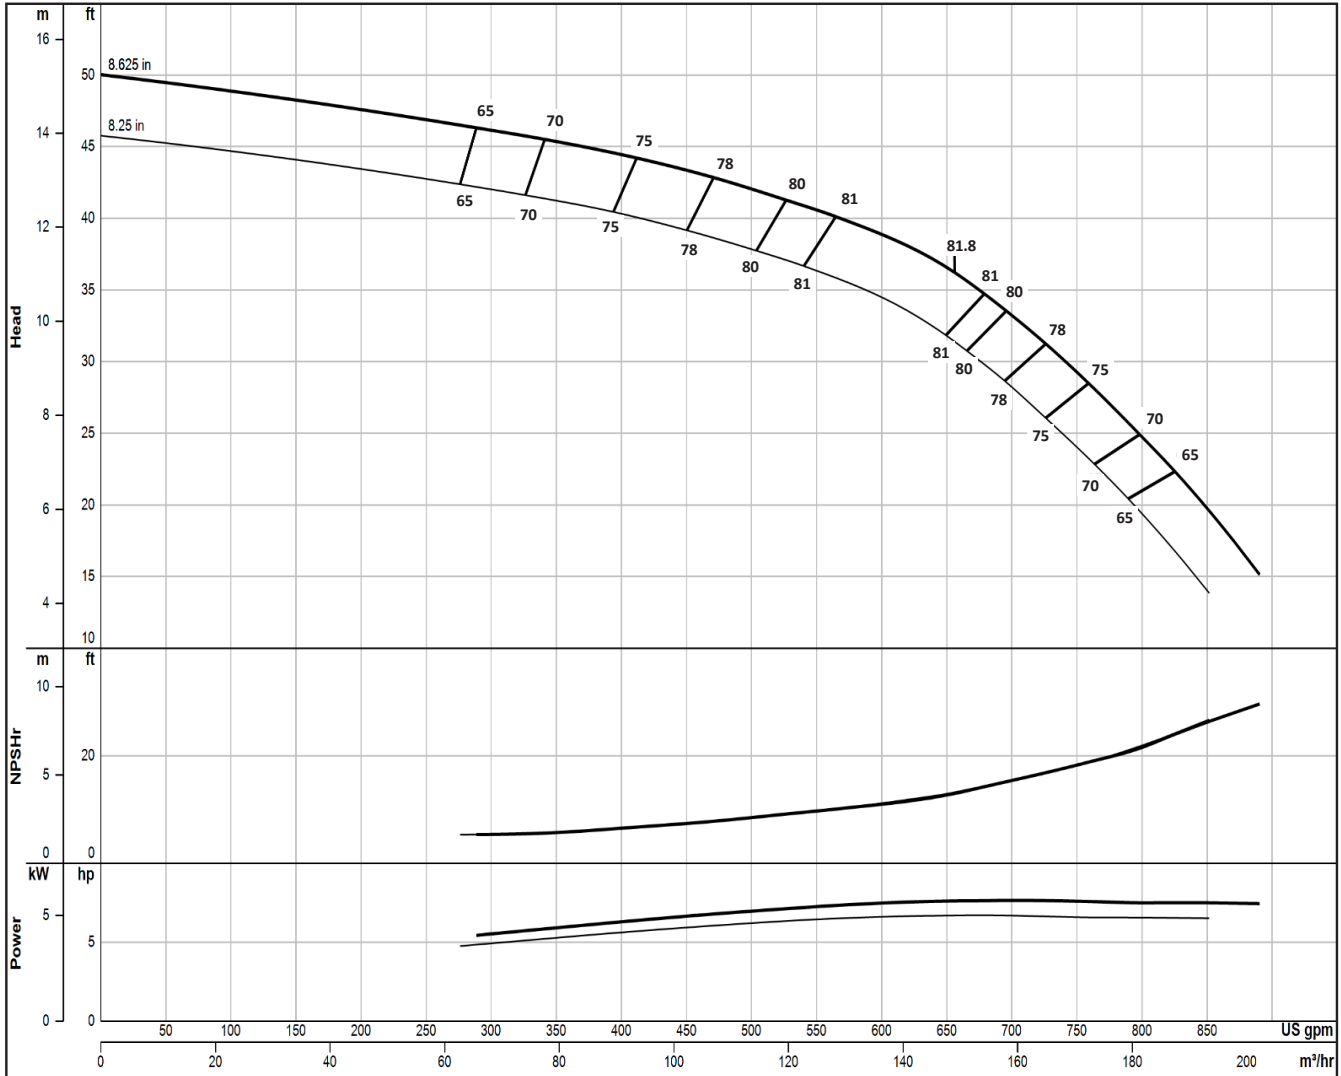

Impeller Type	Enclosed	Bowl Ø (cm)	27.0	ns (SI)	49	Qty.	Eff.
Impeller Model	SM11H	Thd'd Discharge (cm)	15, 20, 10	S (SI)	105	Stages	Change
One Stage Weight (kg)	88.5	Thd'd Suction (cm)	20	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	34.0	Bell Suction Ø (cm)	28.9	Bowl Shaft Ø (cm)	3.81	2	-2
Impeller Wt. (kg)	5.0	Sub. Mtr. (cm)	20, 25, 30	Total Lateral (cm)	2.38	3	-1
Impeller Mtrl.	NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	66.4	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	9.2	5	0
Add'l Stage Length (cm)	21.9	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.019		

Δ Consult factory for availability

2026-03-23

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SL11L

1450 RPM

ONE ()
STAGE STAGE

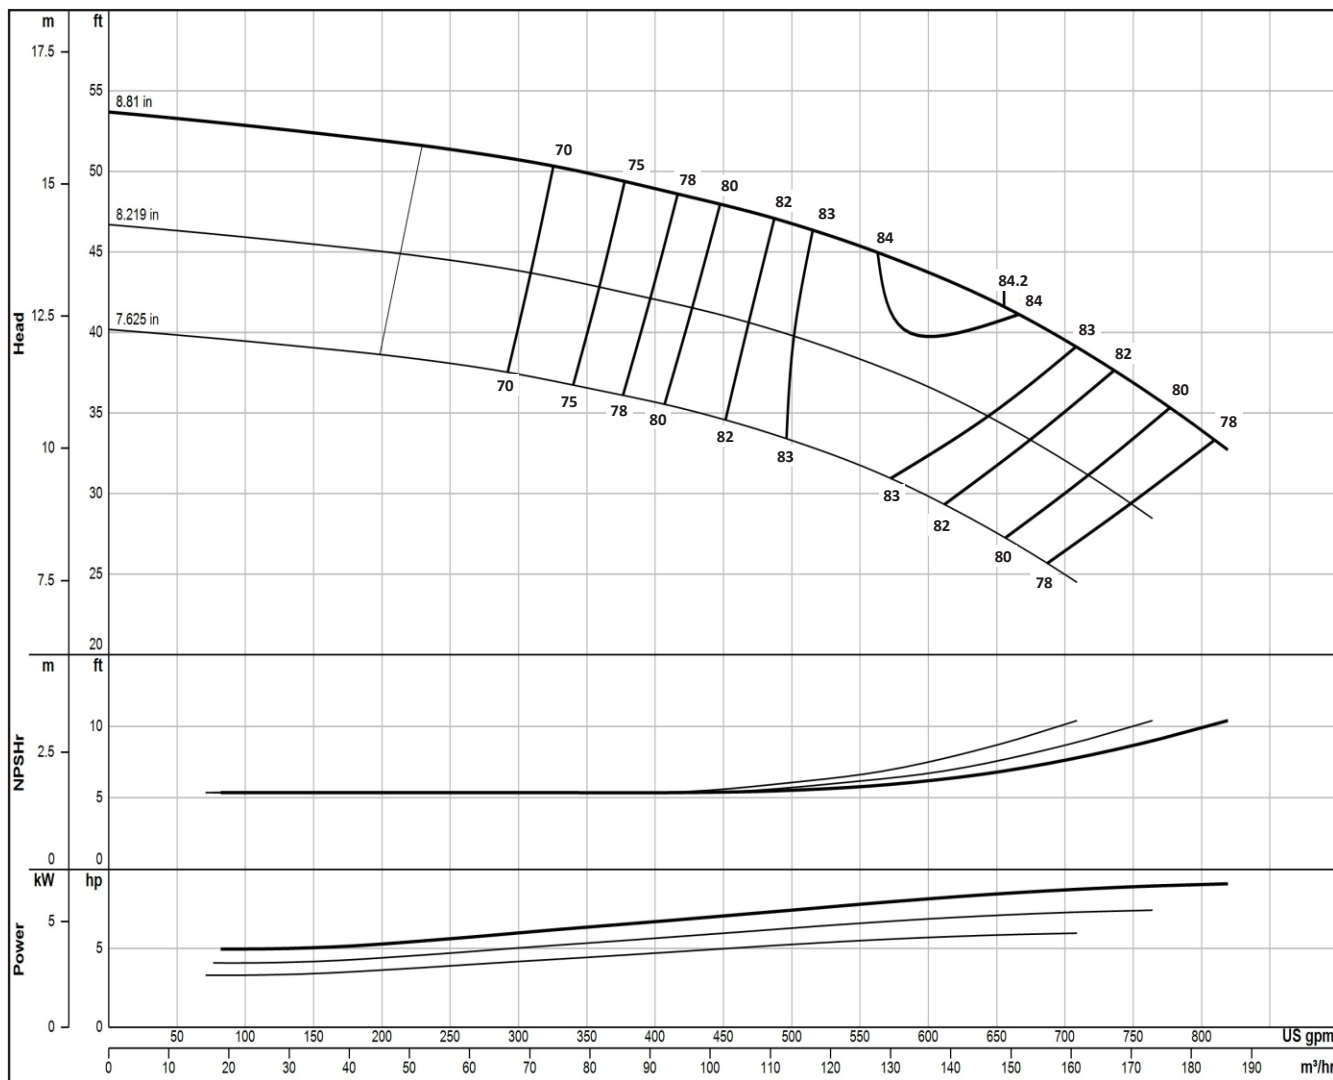

Impeller Type	Enclosed	Bowl Ø (cm)	27.9	ns (SI)	41	Qty.	Eff.
Impeller Model	SL11L	Thd'd Discharge (cm)	15, 20, 10	S (SI)	173	Stages	Change
One Stage Weight (kg)	90.7	Thd'd Suction (cm)	20	PEIcI	N/A	1	-3
Add'l Stage Wt. (kg)	36.7	Bell Suction Ø (cm)	28.9	Bowl Shaft Ø (cm)	4.29	2	-2
Impeller Wt. (kg)	4.4	Sub. Mtr. (cm)	20, 25, 30	Total Lateral (cm)	3.18	3	-1
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	69.9	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	10.4	5	0
Add'l Stage Length (cm)	25.4	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.013		

Δ Consult factory for availability

2025-06-02

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SL11M

1450 RPM

ONE ()
STAGE STAGE

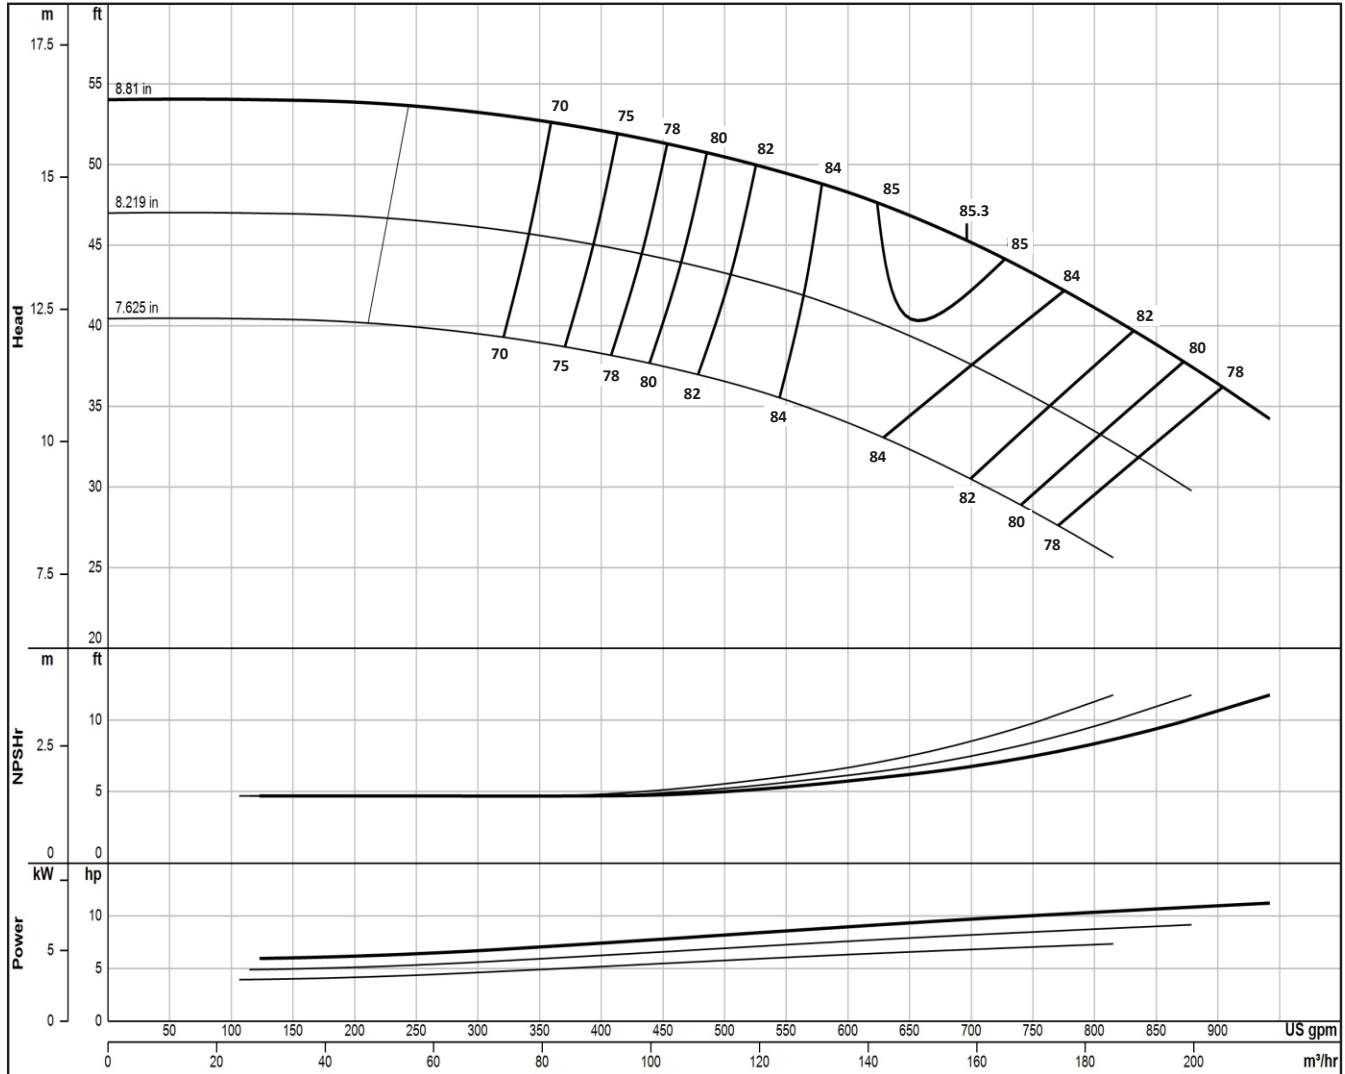

Impeller Type	Enclosed	Bowl Ø (cm)	27.9	ns (SI)	42	Qty.	Eff.
Impeller Model	SL11M	Thd'd Discharge (cm)	15, 20, 10	S (SI)	180	Stages	Change
One Stage Weight (kg)	90.7	Thd'd Suction (cm)	20	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	36.7	Bell Suction Ø (cm)	28.9	Bowl Shaft Ø (cm)	4.29	2	-2
Impeller Wt. (kg)	5.0	Sub. Mtr. (cm)	20, 25, 30	Total Lateral (cm)	3.18	3	-1
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	69.9	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	10.4	5	0
Add'l Stage Length (cm)	25.4	316 Bowl Rating (kPa)	Δ	Imp. WR ² (kg-m ²)	0.014		

Δ Consult factory for availability

2025-06-02

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SL11H

1450 RPM

ONE ()
STAGE STAGE

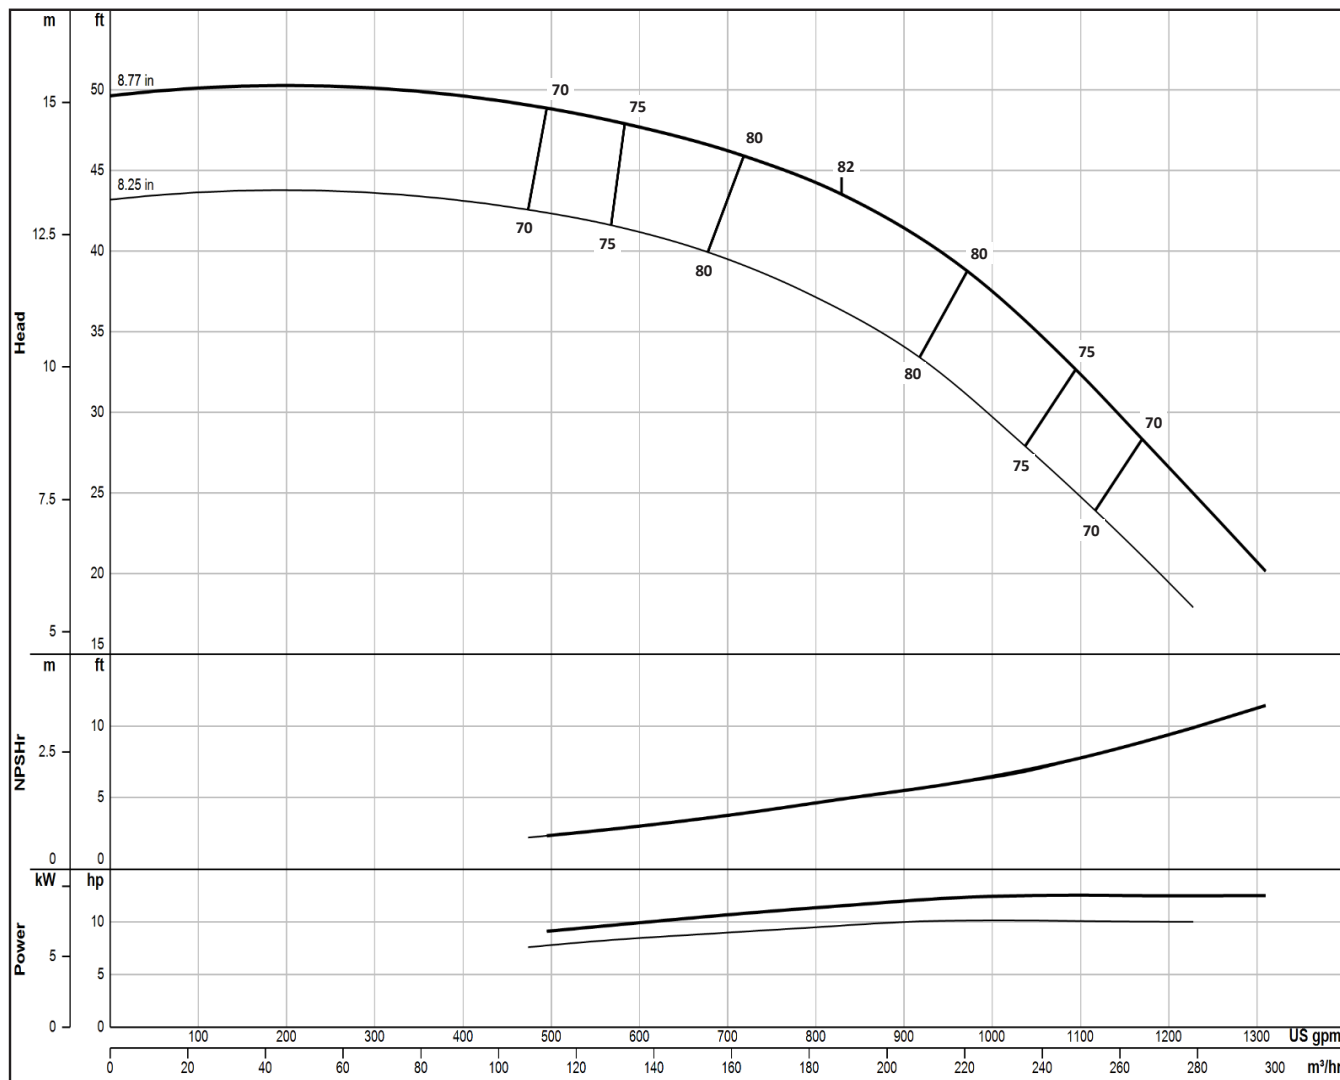

Impeller Type	Enclosed	Bowl Ø (cm)	27.9	ns (SI)	42	Qty.	Eff.
Impeller Model	SL11H	Thd'd Discharge (cm)	15, 20, 10	S (SI)	188	Stages	Change
One Stage Weight (kg)	90.7	Thd'd Suction (cm)	20	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	36.7	Bell Suction Ø (cm)	28.9	Bowl Shaft Ø (cm)	4.29	2	-2
Impeller Wt. (kg)	5.4	Sub. Mtr. (cm)	20, 25, 30	Total Lateral (cm)	2.86	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	69.9	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	11.3	5	0
Add'l Stage Length (cm)	25.4	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.018		

Δ Consult factory for availability

2023-08-22

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SR11MO

1450 RPM

ONE ()
STAGE STAGE

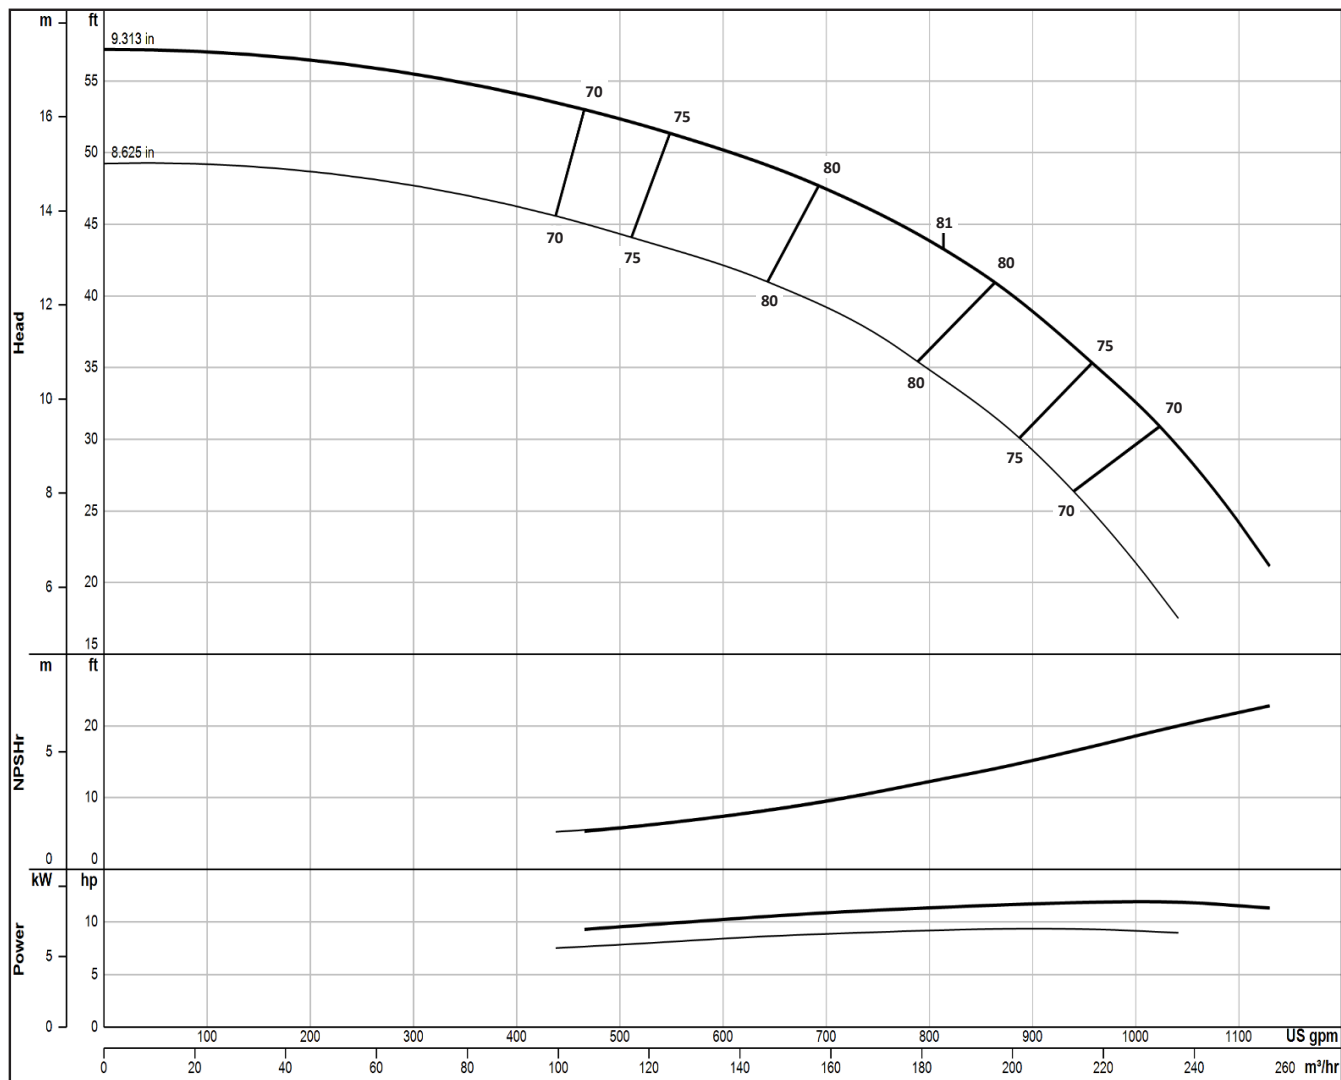

Impeller Type	Semi-Open	Bowl Ø (cm)	29.2	ns (SI)	45	Qty.	Eff.
Impeller Model	SR11MO	Thd'd Discharge (cm)	20, 25, 15	S (SI)	125	Stages	Change
One Stage Weight (kg)	122.5	Thd'd Suction (cm)	20	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	45.4	Bell Suction Ø (cm)	28.9	Bowl Shaft Ø (cm)	4.29	2	-2
Impeller Wt. (kg)	3.6	Sub. Mtr. (cm)	20, 25, 30	Total Lateral (cm)	2.86	3	-1
Impeller Mtrl.	NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.08	4	0
One Stage Length (cm)	71.1	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	19.0	5	0
Add'l Stage Length (cm)	24.1	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.016		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SR11HO

1450 RPM

ONE ()
STAGE STAGE

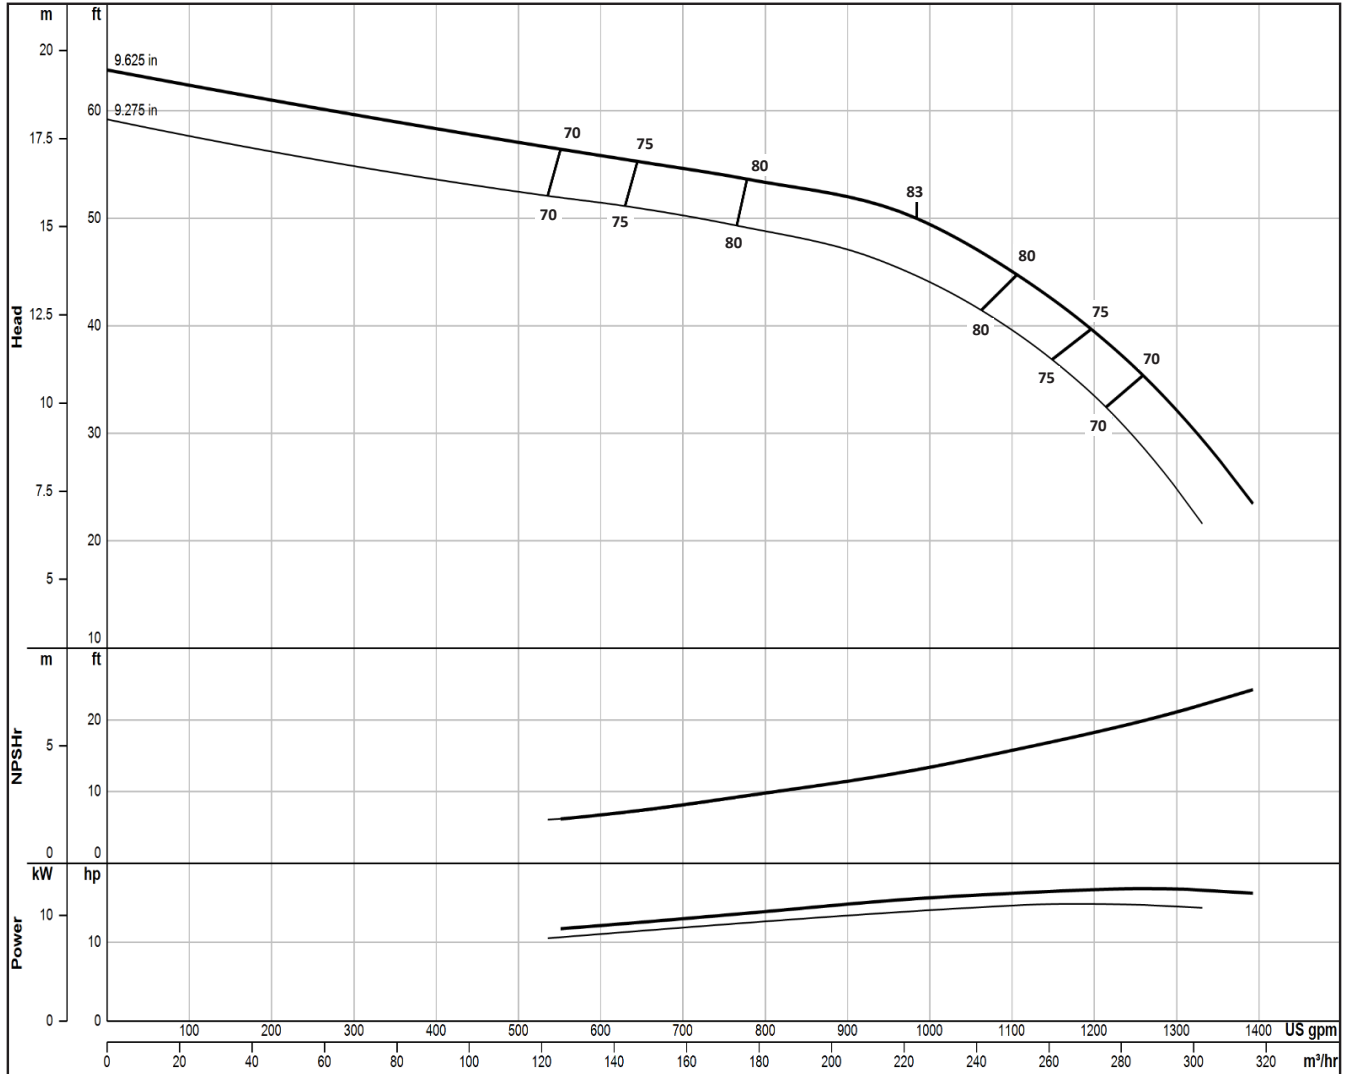

Impeller Type	Semi-Open	Bowl Ø (cm)	29.2	ns (SI)	46	Qty.	Eff.
Impeller Model	SR11HO	Thd'd Discharge (cm)	20, 25, 15	S (SI)	131	Stages	Change
One Stage Weight (kg)	122.5	Thd'd Suction (cm)	20	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	45.4	Bell Suction Ø (cm)	28.9	Bowl Shaft Ø (cm)	4.29	2	-2
Impeller Wt. (kg)	3.8	Sub. Mtr. (cm)	20, 25, 30	Total Lateral (cm)	1.83	3	-1
Impeller Mtrl.	NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.08	4	0
One Stage Length (cm)	71.1	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	19.3	5	0
Add'l Stage Length (cm)	24.1	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.017		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP11L

1450 RPM

ONE ()
STAGE STAGE

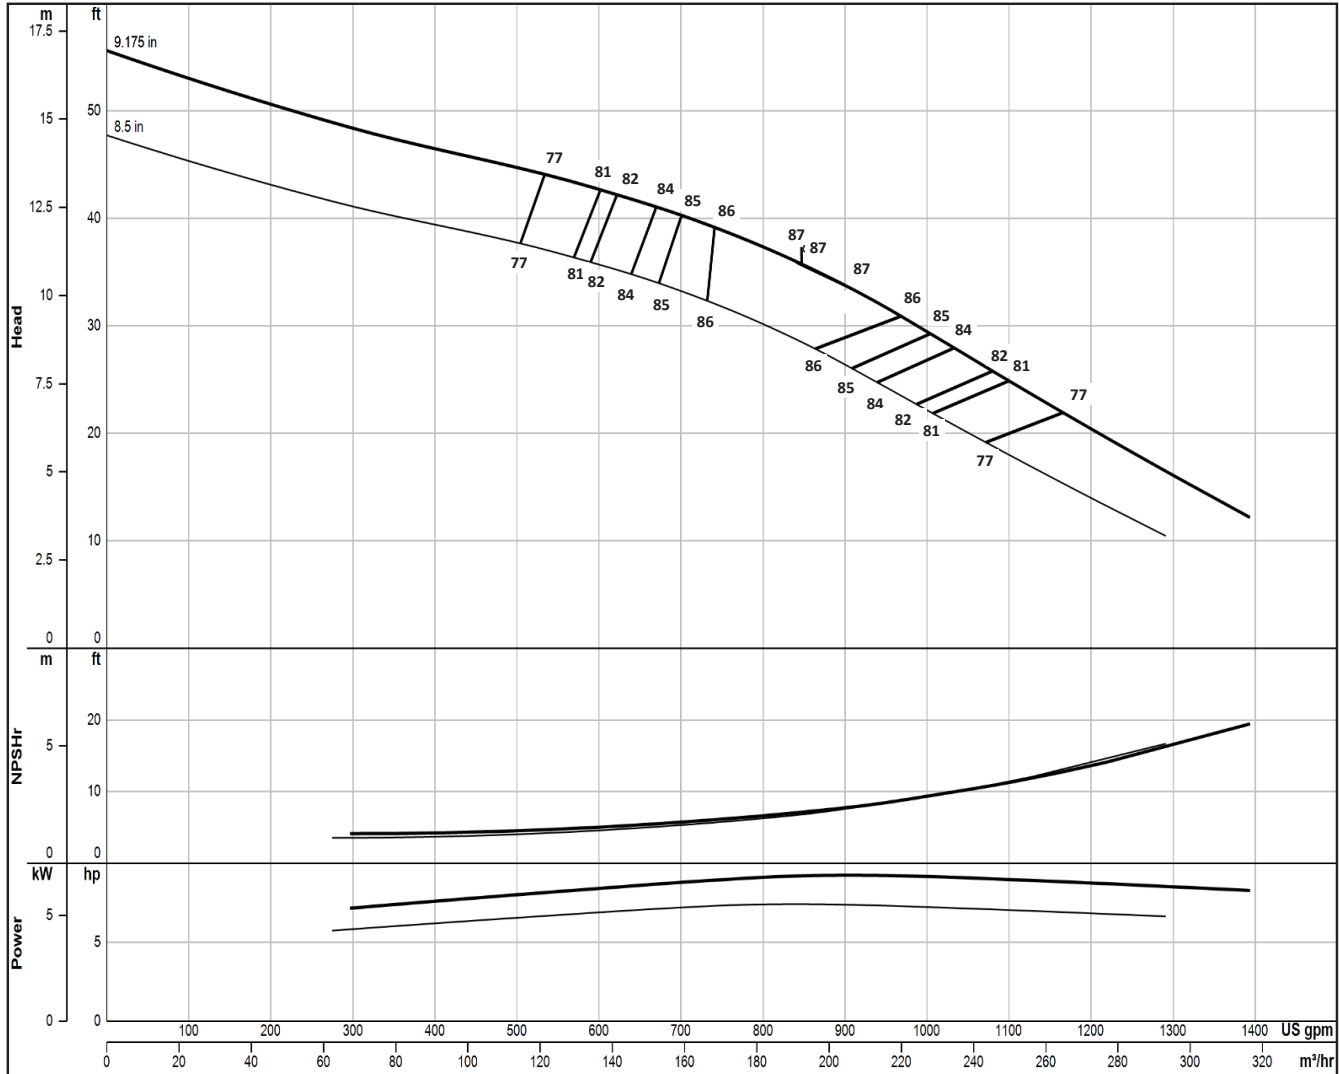

Impeller Type	Enclosed	Bowl Ø (cm)	28.6	ns (SI)	56	Qty.	Eff.
Impeller Model	SP11L	Thd'd Discharge (cm)	20, 25, 15	S (SI)	190	Stages	Change
One Stage Weight (kg)	131.5	Thd'd Suction (cm)	20	PEIcl	N/A	1	-4
Add'l Stage Wt. (kg)	47.6	Bell Suction Ø (cm)	28.9	Bowl Shaft Ø (cm)	4.92	2	-3
Impeller Wt. (kg)	7.4	Sub. Mtr. (cm)	20, 25, 30	Total Lateral (cm)	2.86	3	-2
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	2941	Imp. Setting (cm)	0.32	4	-1
One Stage Length (cm)	72.4	D.I. Bowl Rating (kPa)	6372	K-Factor (kg/m-tdh)	14.9	5	0
Add'l Stage Length (cm)	25.4	316 Bowl Rating (kPa)	6862	Imp. WR ² (kg-m²)	0.032		

Δ Consult factory for availability

2023-08-18

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP11M

1450 RPM

ONE ()
STAGE STAGE

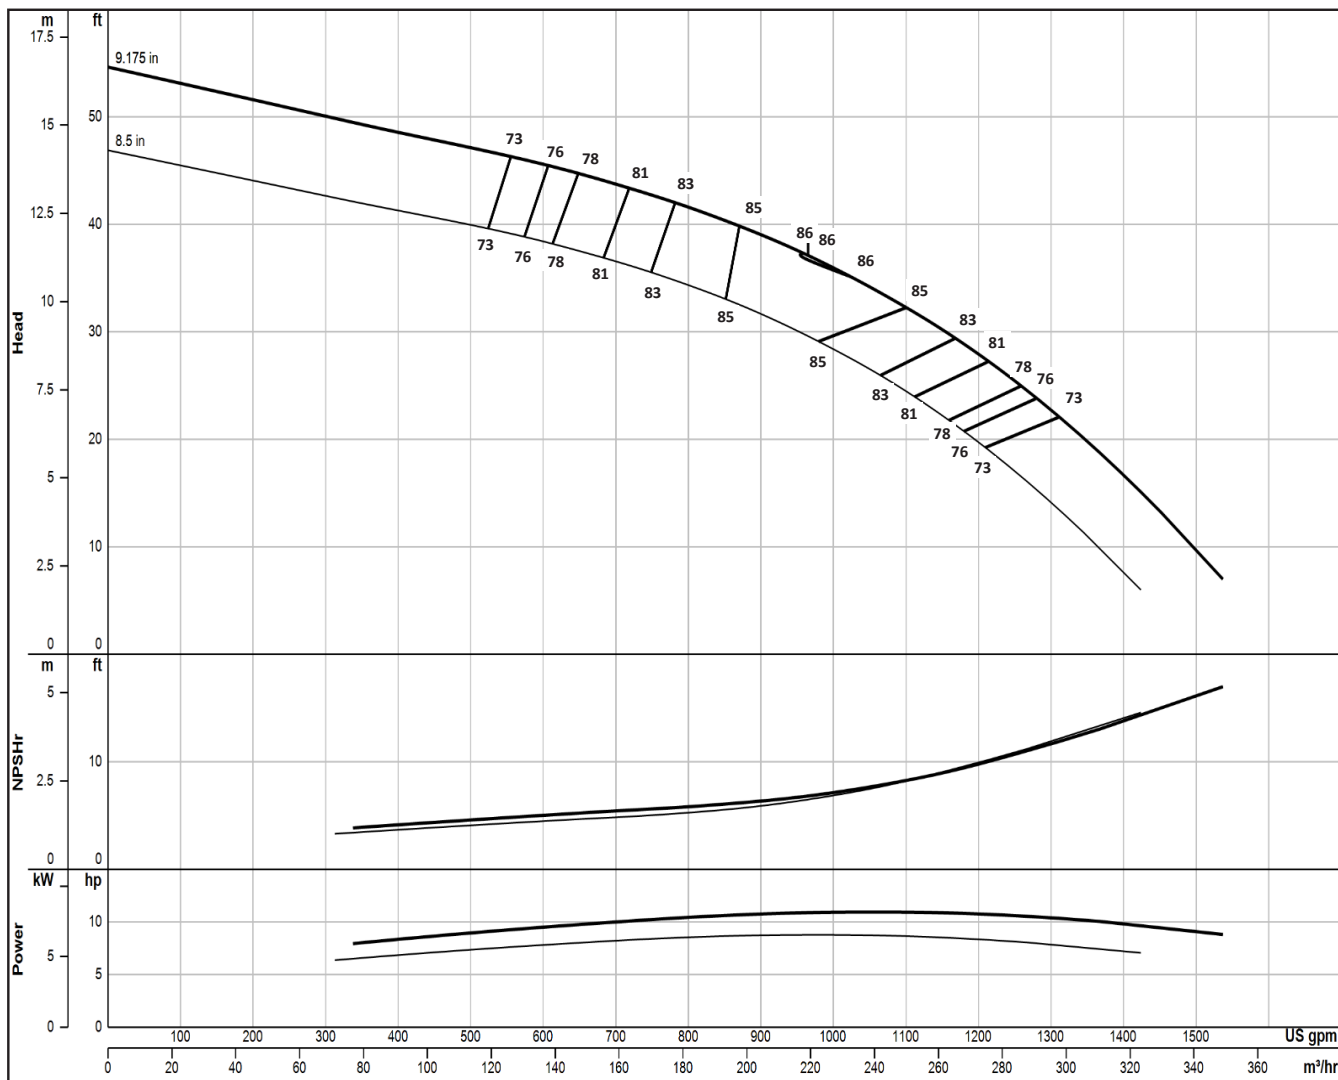

Impeller Type	Enclosed	Bowl Ø (cm)	28.6	ns (SI)	60	Qty.	Eff.
Impeller Model	SP11M	Thd'd Discharge (cm)	20, 25, 15	S (SI)	210	Stages	Change
One Stage Weight (kg)	131.5	Thd'd Suction (cm)	20	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	47.6	Bell Suction Ø (cm)	28.9	Bowl Shaft Ø (cm)	4.92	2	-2
Impeller Wt. (kg)	6.5	Sub. Mtr. (cm)	20, 25, 30	Total Lateral (cm)	2.86	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	2941	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	72.4	D.I. Bowl Rating (kPa)	6372	K-Factor (kg/m-tdh)	15.3	5	0
Add'l Stage Length (cm)	25.4	316 Bowl Rating (kPa)	6862	Imp. WR ² (kg-m²)	0.028		

Δ Consult factory for availability

2023-08-18

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SP11H

1450 RPM

ONE ()
STAGE STAGE

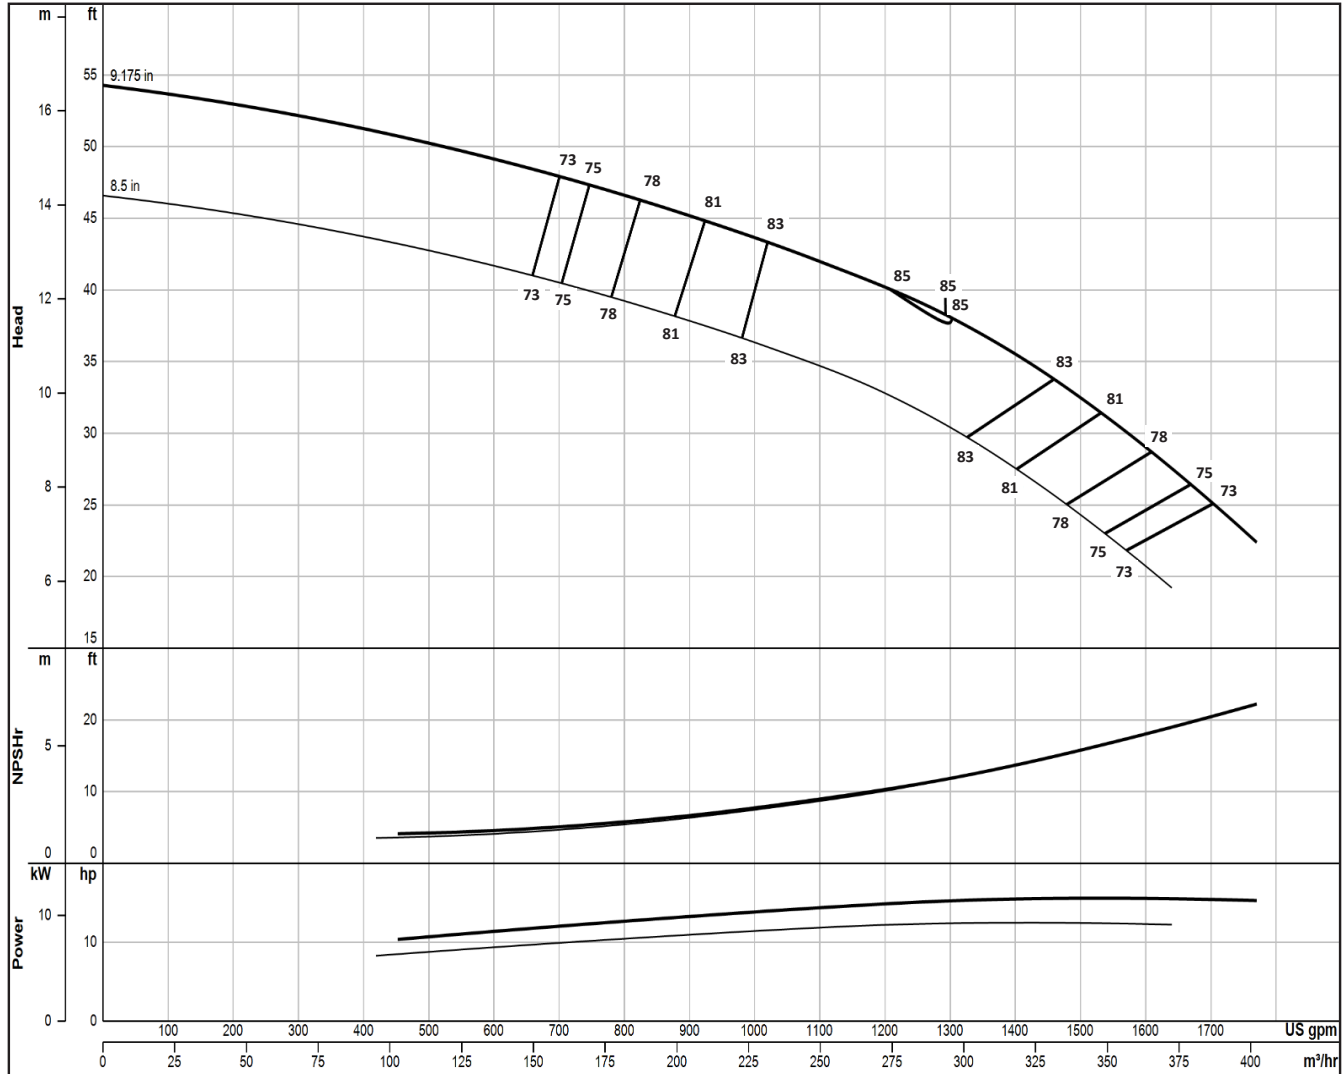

Impeller Type	Enclosed	Bowl Ø (cm)	28.6	ns (SI)	64	Qty.	Eff.
Impeller Model	SP11H	Thd'd Discharge (cm)	20, 25, 15	S (SI)	165	Stages	Change
One Stage Weight (kg)	131.5	Thd'd Suction (cm)	20	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	47.6	Bell Suction Ø (cm)	28.9	Bowl Shaft Ø (cm)	4.92	2	-2
Impeller Wt. (kg)	6.8	Sub. Mtr. (cm)	20, 25, 30	Total Lateral (cm)	2.86	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	2941	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	72.4	D.I. Bowl Rating (kPa)	6372	K-Factor (kg/m-tdh)	22.5	5	0
Add'l Stage Length (cm)	25.4	316 Bowl Rating (kPa)	6862	Imp. WR² (kg-m²)	0.030		

Δ Consult factory for availability

2023-08-18

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SW12L

1450 RPM

ONE ()
STAGE STAGE

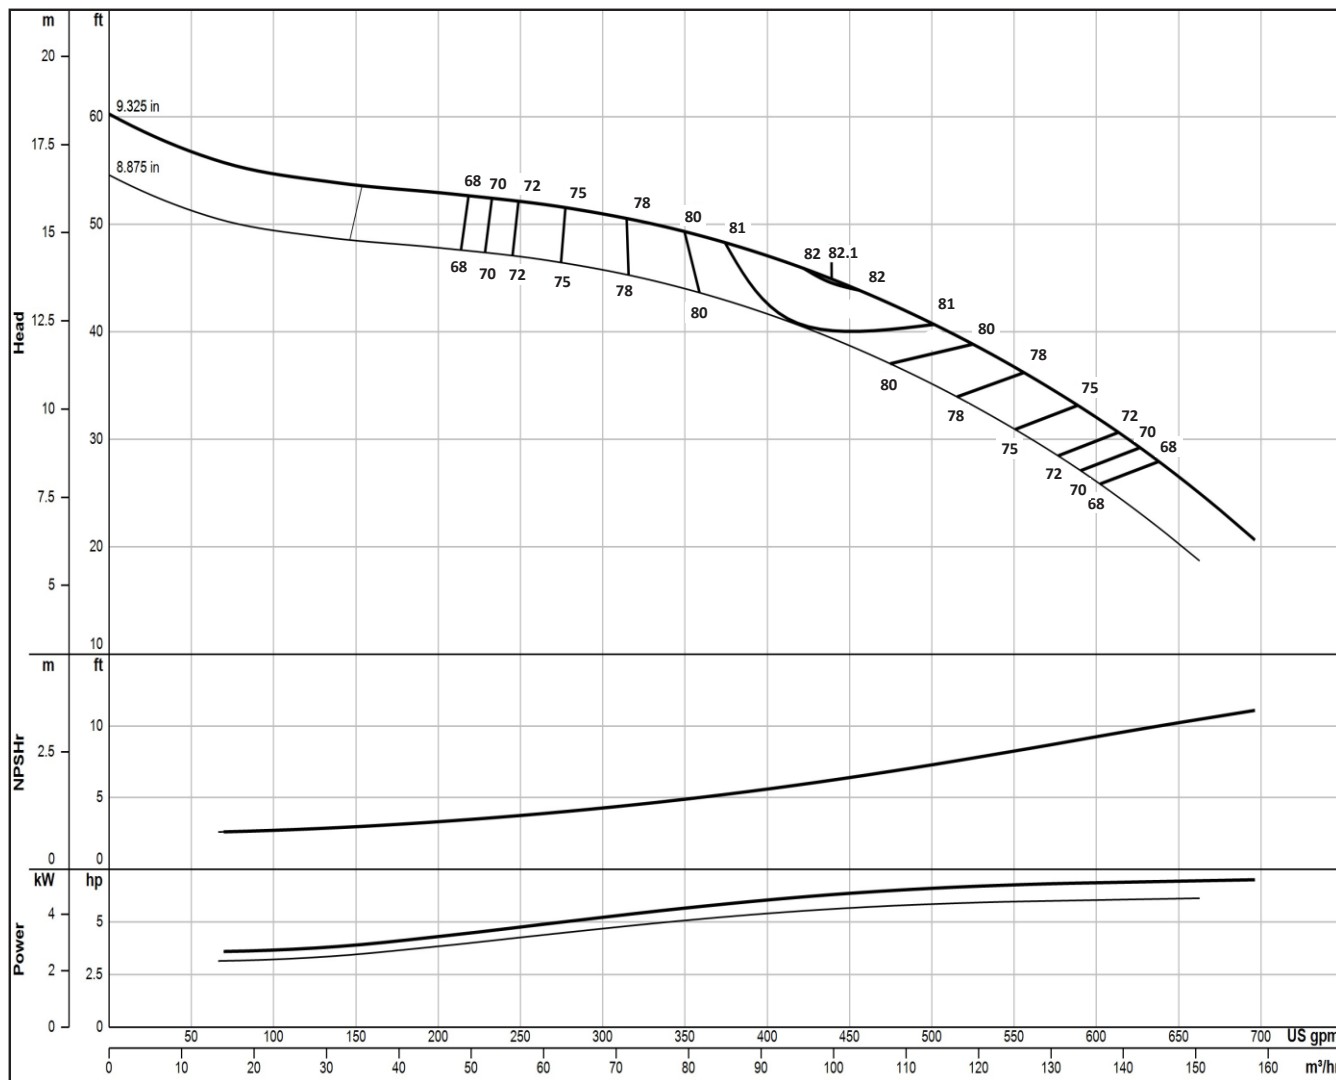

Impeller Type	Enclosed	Bowl Ø (cm)	30.5	ns (SI)	34	Qty.	Eff.
Impeller Model	SW12L	Thd'd Discharge (cm)	20, 25, 15	S (SI)	150	Stages	Change
One Stage Weight (kg)	106.6	Thd'd Suction (cm)	20	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	47.6	Bell Suction Ø (cm)	28.9	Bowl Shaft Ø (cm)	4.29	2	-2
Impeller Wt. (kg)	6.3	Sub. Mtr. (cm)	20, 25, 30	Total Lateral (cm)	2.87	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	3624	Imp. Setting (cm)	0.64	4	0
One Stage Length (cm)	69.9	D.I. Bowl Rating (kPa)	7852	K-Factor (kg/m-tdh)	9.7	5	0
Add'l Stage Length (cm)	22.9	316 Bowl Rating (kPa)	8456	Imp. WR ² (kg-m²)	0.027		

Δ Consult factory for availability

2025-10-31

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SW12M

1450 RPM

ONE ()
STAGE STAGE

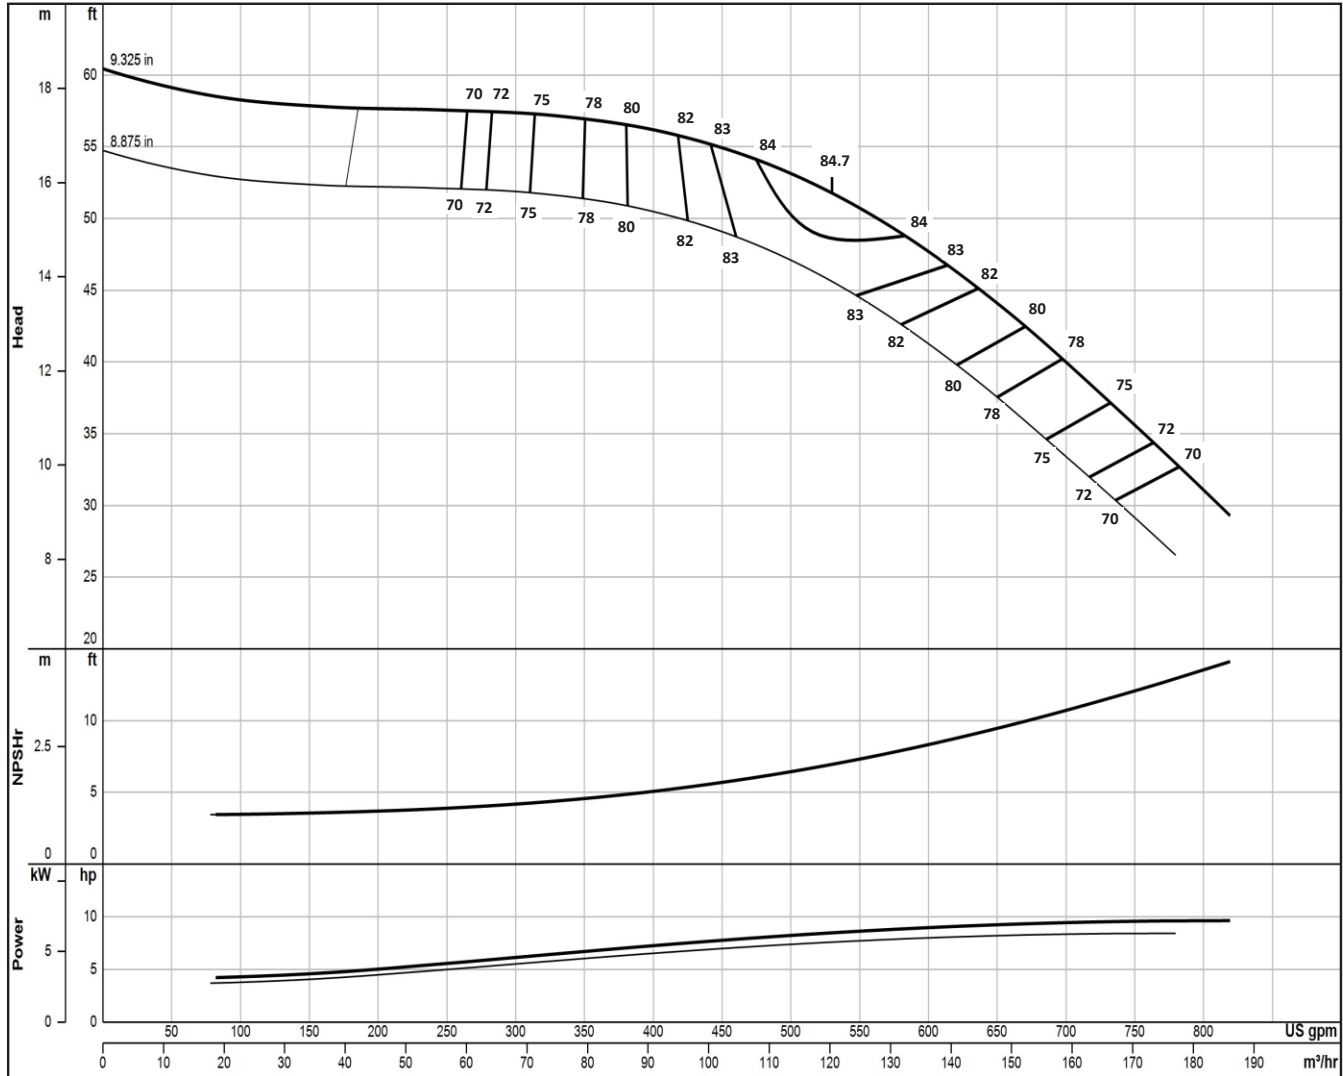

Impeller Type	Enclosed	Bowl Ø (cm)	30.5	ns (SI)	34	Qty.	Eff.
Impeller Model	SW12M	Thd'd Discharge (cm)	20, 25, 15	S (SI)	151	Stages	Change
One Stage Weight (kg)	106.6	Thd'd Suction (cm)	20	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	47.6	Bell Suction Ø (cm)	28.9	Bowl Shaft Ø (cm)	4.29	2	-2
Impeller Wt. (kg)	6.6	Sub. Mtr. (cm)	20, 25, 30	Total Lateral (cm)	2.87	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	3624	Imp. Setting (cm)	0.64	4	0
One Stage Length (cm)	69.9	D.I. Bowl Rating (kPa)	7852	K-Factor (kg/m-tdh)	9.7	5	0
Add'l Stage Length (cm)	22.9	316 Bowl Rating (kPa)	8456	Imp. WR ² (kg-m ²)	0.028		

Δ Consult factory for availability

2025-10-31

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SL12M

1450 RPM

ONE ()
STAGE STAGE

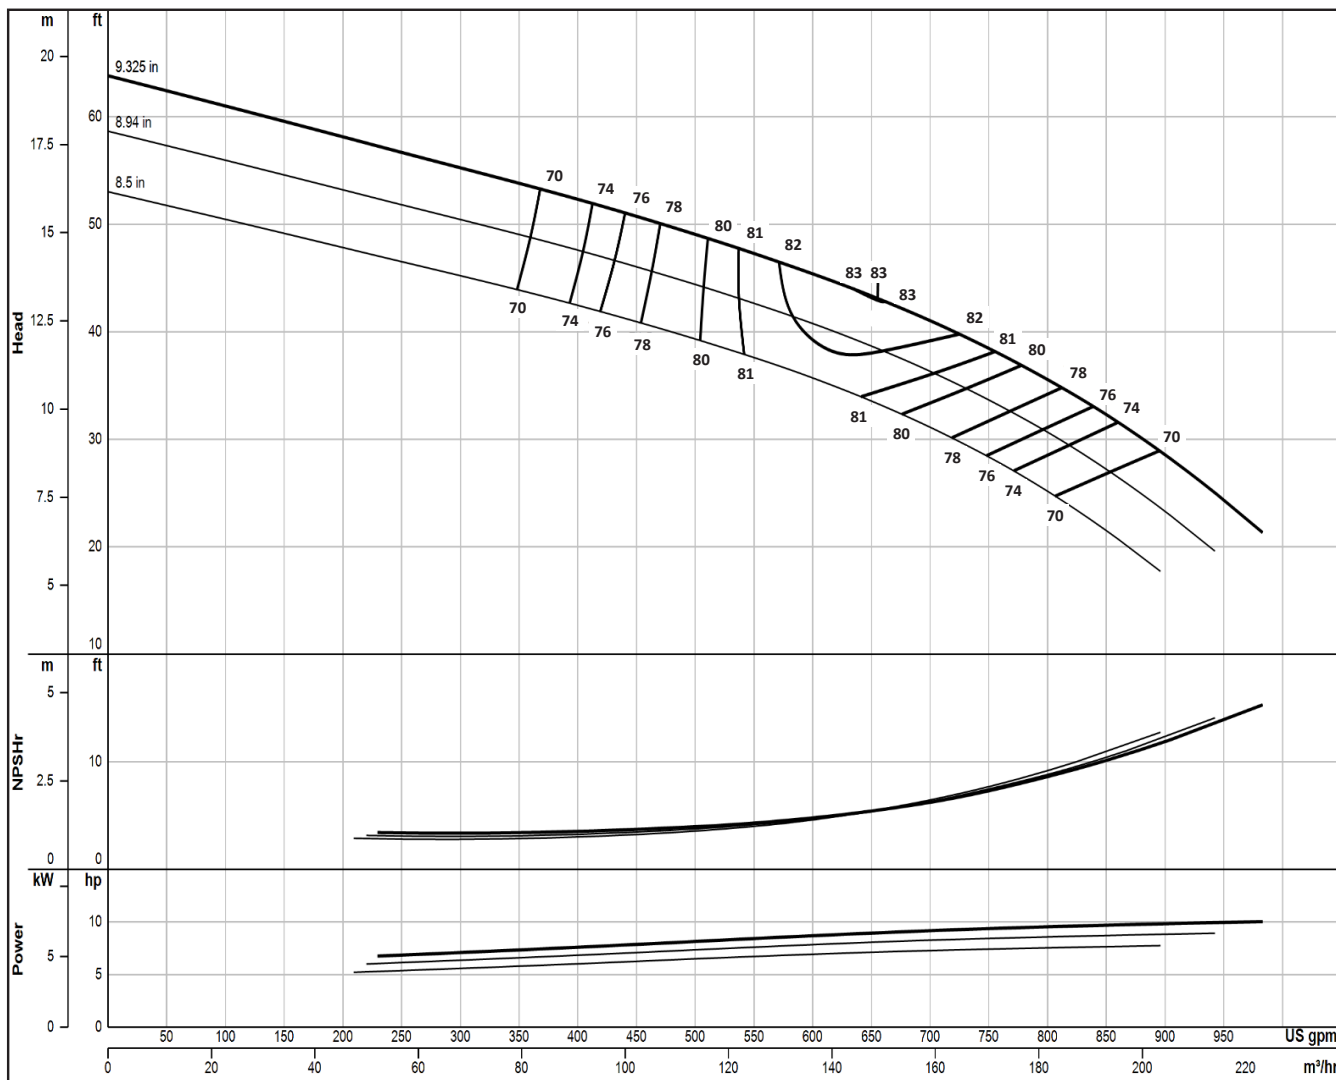

Impeller Type	Enclosed	Bowl Ø (cm)	29.8	ns (SI)	42	Qty.	Eff.
Impeller Model	SL12M	Thd'd Discharge (cm)	20, 25, 15	S (SI)	202	Stages	Change
One Stage Weight (kg)	113.4	Thd'd Suction (cm)	20	PEIcl	N/A	1	-3.5
Add'l Stage Wt. (kg)	48.5	Bell Suction Ø (cm)	28.9	Bowl Shaft Ø (cm)	4.29	2	-2
Impeller Wt. (kg)	6.0	Sub. Mtr. (cm)	20, 25, 30	Total Lateral (cm)	2.86	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	3785	Imp. Setting (cm)	0.64	4	0
One Stage Length (cm)	72.4	D.I. Bowl Rating (kPa)	8200	K-Factor (kg/m-tdh)	11.6	5	0
Add'l Stage Length (cm)	25.4	316 Bowl Rating (kPa)	8831	Imp. WR² (kg-m²)	0.028		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SL12H

1450 RPM

ONE ()
STAGE STAGE

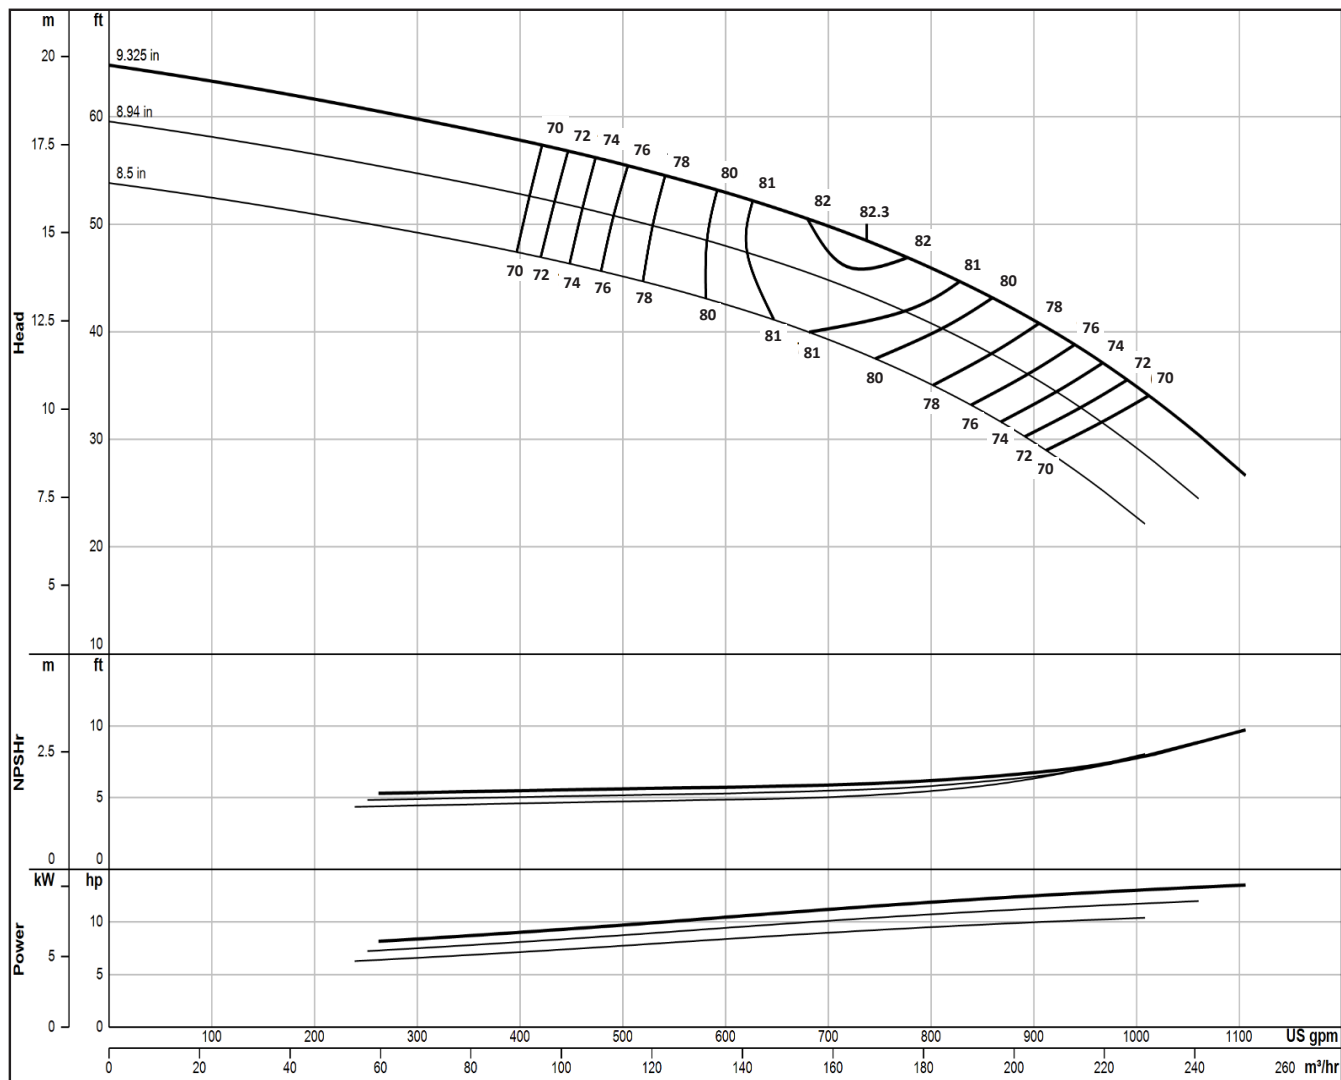

Impeller Type	Enclosed	Bowl Ø (cm)	29.8	ns (SI)	41	Qty.	Eff.
Impeller Model	SL12H	Thd'd Discharge (cm)	20, 25, 15	S (SI)	202	Stages	Change
One Stage Weight (kg)	113.4	Thd'd Suction (cm)	20	PEIcl	N/A	1	-3.5
Add'l Stage Wt. (kg)	48.5	Bell Suction Ø (cm)	28.9	Bowl Shaft Ø (cm)	4.29	2	-2
Impeller Wt. (kg)	6.1	Sub. Mtr. (cm)	20, 25, 30	Total Lateral (cm)	2.86	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	3785	Imp. Setting (cm)	0.64	4	0
One Stage Length (cm)	72.4	D.I. Bowl Rating (kPa)	8200	K-Factor (kg/m-tdh)	11.9	5	0
Add'l Stage Length (cm)	25.4	316 Bowl Rating (kPa)	8831	Imp. WR² (kg-m²)	0.028		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SJ12M

1450 RPM

ONE ()
STAGE STAGE

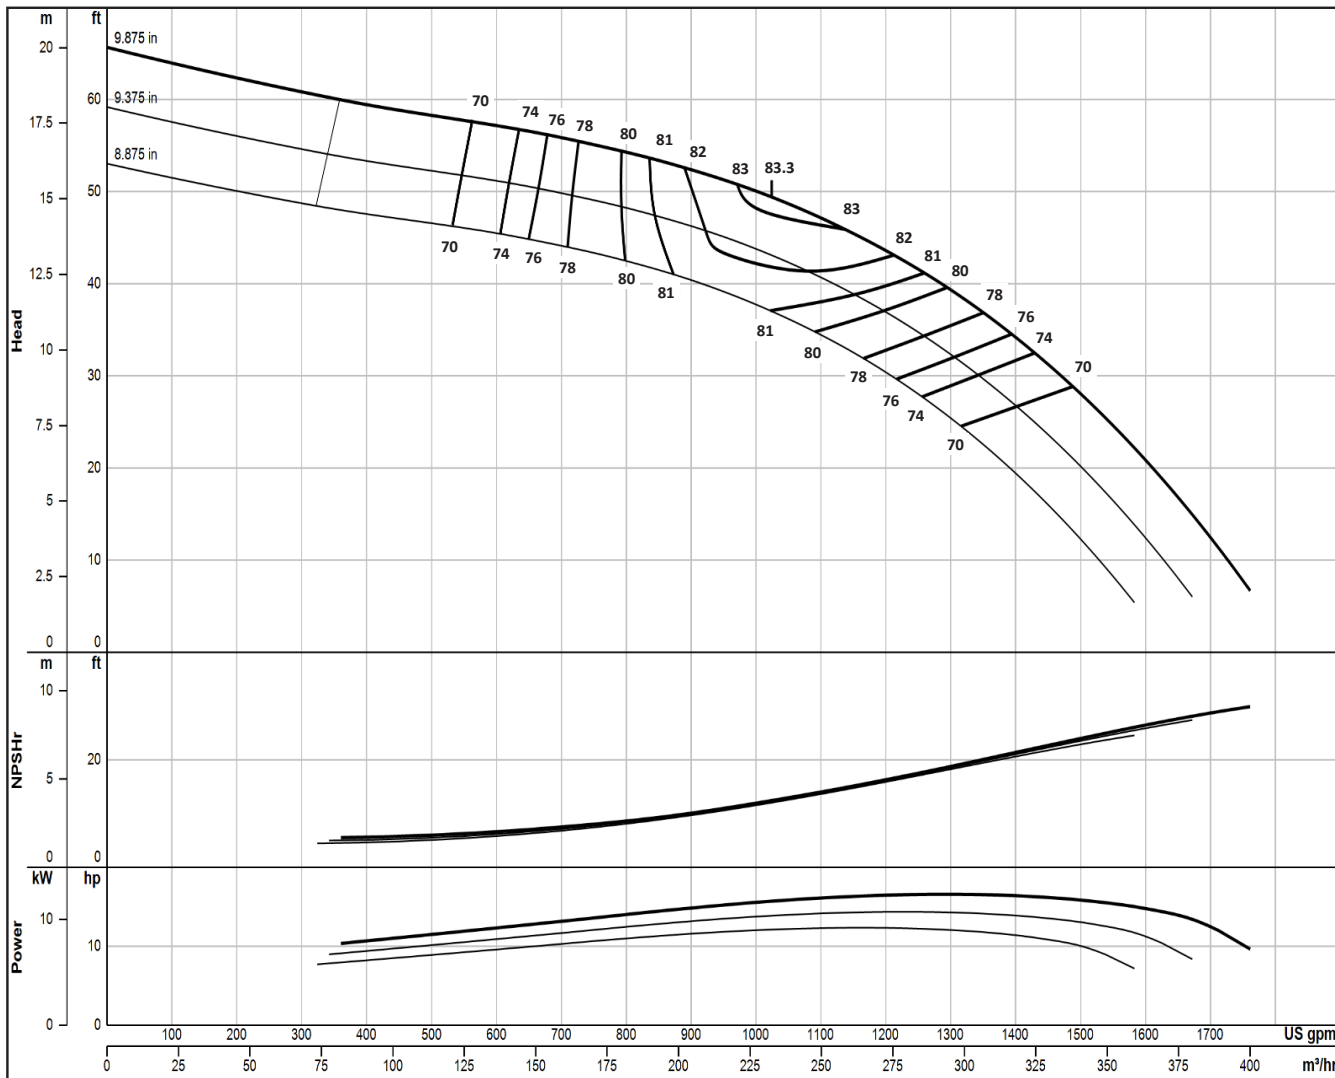

Impeller Type	Enclosed	Bowl Ø (cm)	30.5	ns (SI)	50	Qty.	Eff.
Impeller Model	SJ12M	Thd'd Discharge (cm)	20, 25, 15	S (SI)	133	Stages	Change
One Stage Weight (kg)	122.5	Thd'd Suction (cm)	20	PEIcl	N/A	1	-2
Add'l Stage Wt. (kg)	49.9	Bell Suction Ø (cm)	28.9	Bowl Shaft Ø (cm)	4.29	2	-1
Impeller Wt. (kg)	7.7	Sub. Mtr. (cm)	20, 25, 30	Total Lateral (cm)	3.02	3	0
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	3357	Imp. Setting (cm)	0.48	4	0
One Stage Length (cm)	74.3	D.I. Bowl Rating (kPa)	7274	K-Factor (kg/m-tdh)	16.4	5	0
Add'l Stage Length (cm)	27.3	316 Bowl Rating (kPa)	Δ	Imp. WR ² (kg-m²)	0.034		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SJ12H

1450 RPM

ONE ()
STAGE STAGE

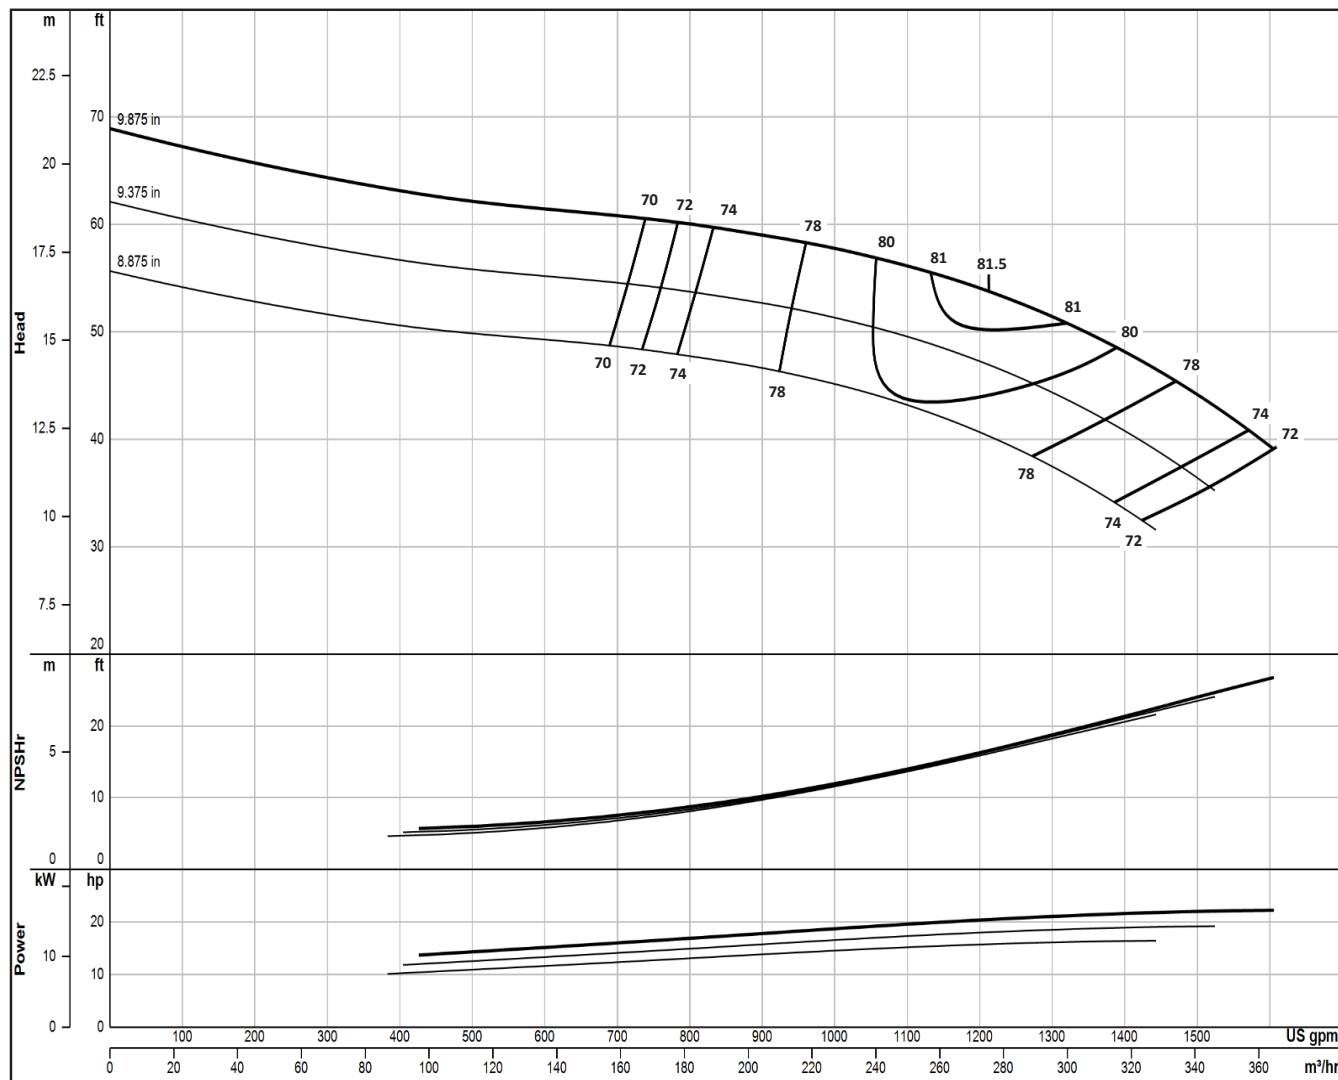

Impeller Type	Enclosed	Bowl Ø (cm)	30.5	ns (SI)	50	Qty.	Eff.
Impeller Model	SJ12H	Thd'd Discharge (cm)	20, 25, 15	S (SI)	120	Stages	Change
One Stage Weight (kg)	122.5	Thd'd Suction (cm)	20	PEIcl	N/A	1	-1
Add'l Stage Wt. (kg)	49.9	Bell Suction Ø (cm)	28.9	Bowl Shaft Ø (cm)	4.29	2	0
Impeller Wt. (kg)	6.9	Sub. Mtr. (cm)	20, 25, 30	Total Lateral (cm)	3.02	3	0
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	3357	Imp. Setting (cm)	0.48	4	0
One Stage Length (cm)	74.3	D.I. Bowl Rating (kPa)	7274	K-Factor (kg/m-tdh)	17.8	5	0
Add'l Stage Length (cm)	27.3	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.031		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM12L

1450 RPM

ONE ()
STAGE STAGE

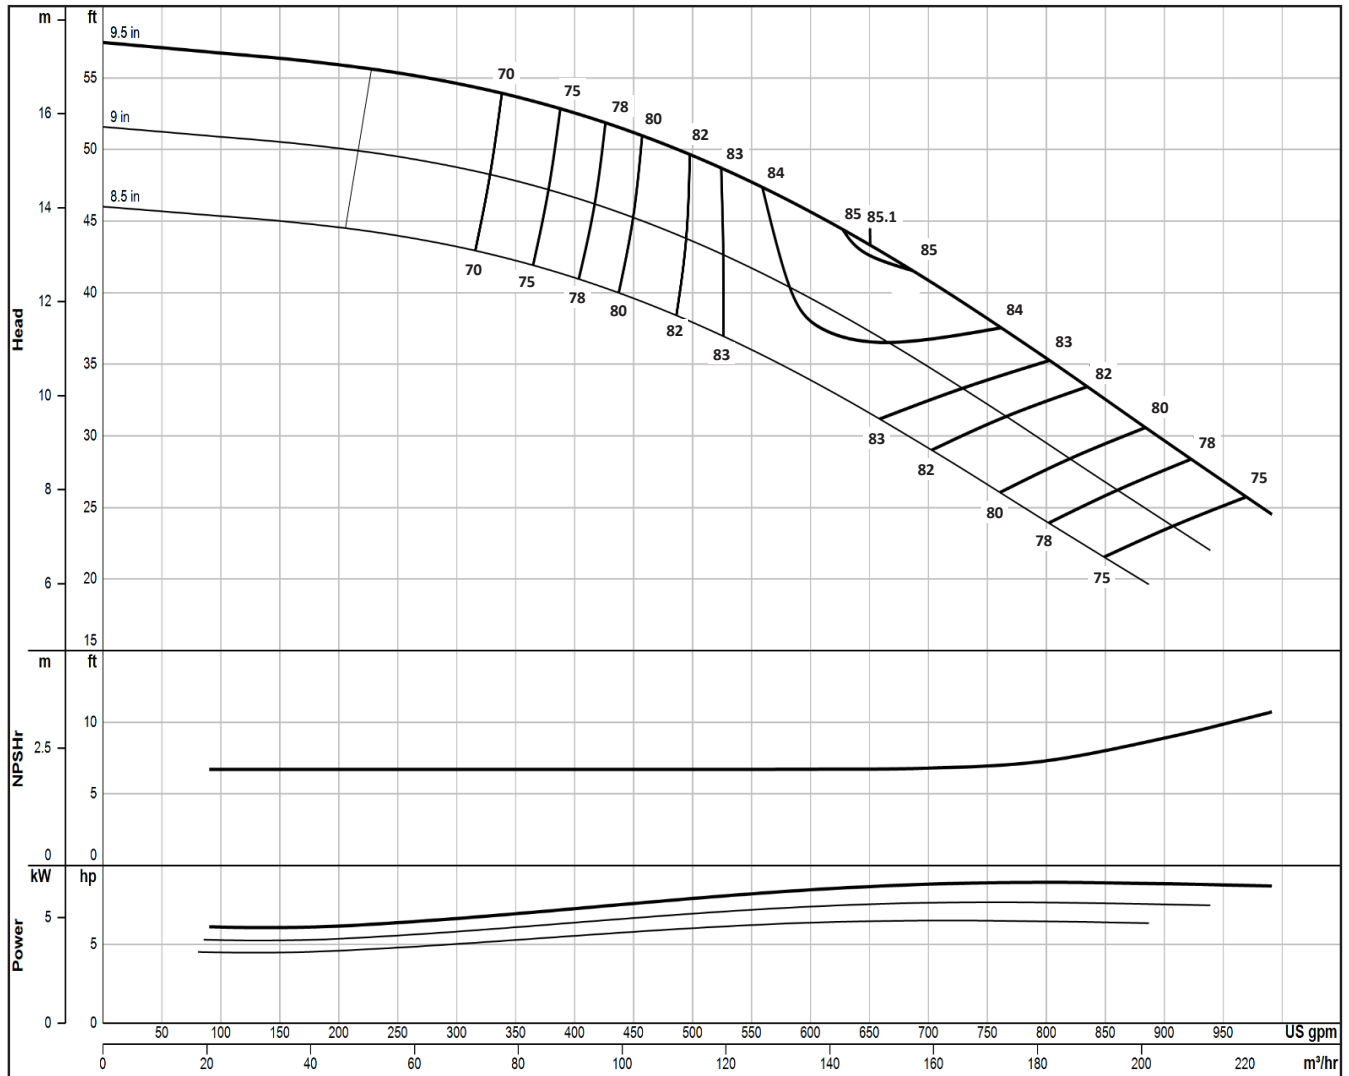

Impeller Type	Enclosed	Bowl Ø (cm)	30.2	ns (SI)	42	Qty.	Eff.
Impeller Model	SM12L	Thd'd Discharge (cm)	20, 25, 15	S (SI)	167	Stages	Change
One Stage Weight (kg)	140.6	Thd'd Suction (cm)	20	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	56.7	Bell Suction Ø (cm)	28.9	Bowl Shaft Ø (cm)	4.92	2	-2
Impeller Wt. (kg)	6.9	Sub. Mtr. (cm)	20, 25, 30	Total Lateral (cm)	3.65	3	-1
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	2646	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	74.9	D.I. Bowl Rating (kPa)	5733	K-Factor (kg/m-tdh)	11.2	5	0
Add'l Stage Length (cm)	27.9	316 Bowl Rating (kPa)	6174	Imp. WR² (kg-m²)	0.024		

Δ Consult factory for availability

2025-05-09

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM12M

1450 RPM

ONE ()
STAGE STAGE

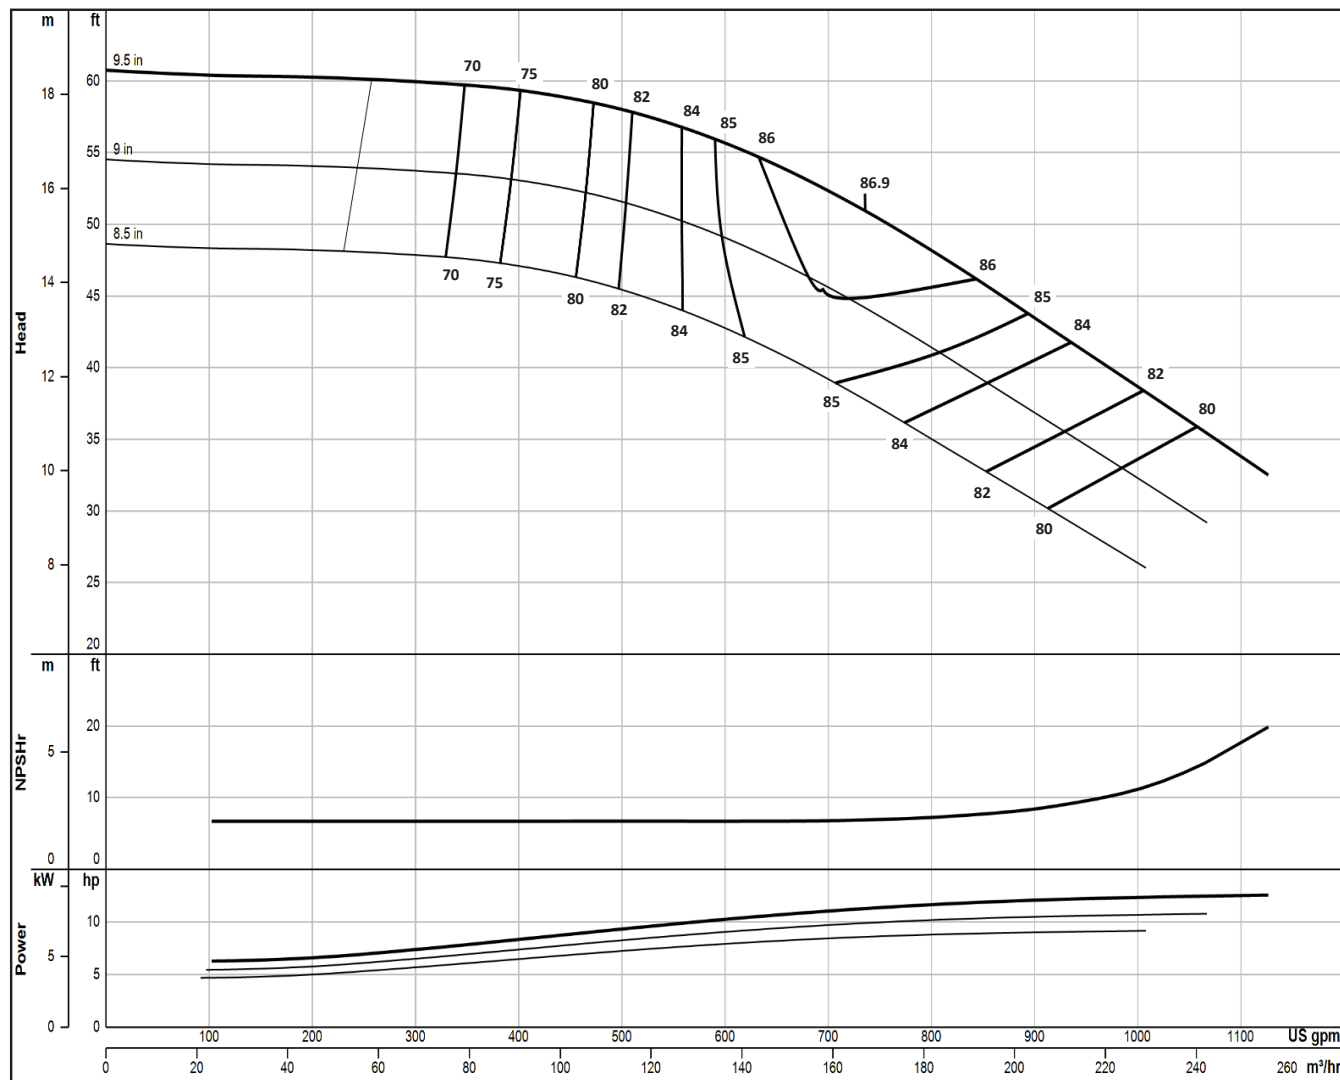

Impeller Type	Enclosed	Bowl Ø (cm)	30.2	ns (SI)	40	Qty.	Eff.
Impeller Model	SM12M	Thd'd Discharge (cm)	20, 25, 15	S (SI)	172	Stages	Change
One Stage Weight (kg)	140.6	Thd'd Suction (cm)	20	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	56.7	Bell Suction Ø (cm)	28.9	Bowl Shaft Ø (cm)	4.92	2	-2
Impeller Wt. (kg)	6.4	Sub. Mtr. (cm)	20, 25, 30	Total Lateral (cm)	3.65	3	-1
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	2646	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	74.9	D.I. Bowl Rating (kPa)	5733	K-Factor (kg/m-tdh)	11.2	5	0
Add'l Stage Length (cm)	27.9	316 Bowl Rating (kPa)	6174	Imp. WR² (kg-m²)	0.024		

Δ Consult factory for availability

2025-05-09

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM12H

1450 RPM

ONE ()
STAGE STAGE

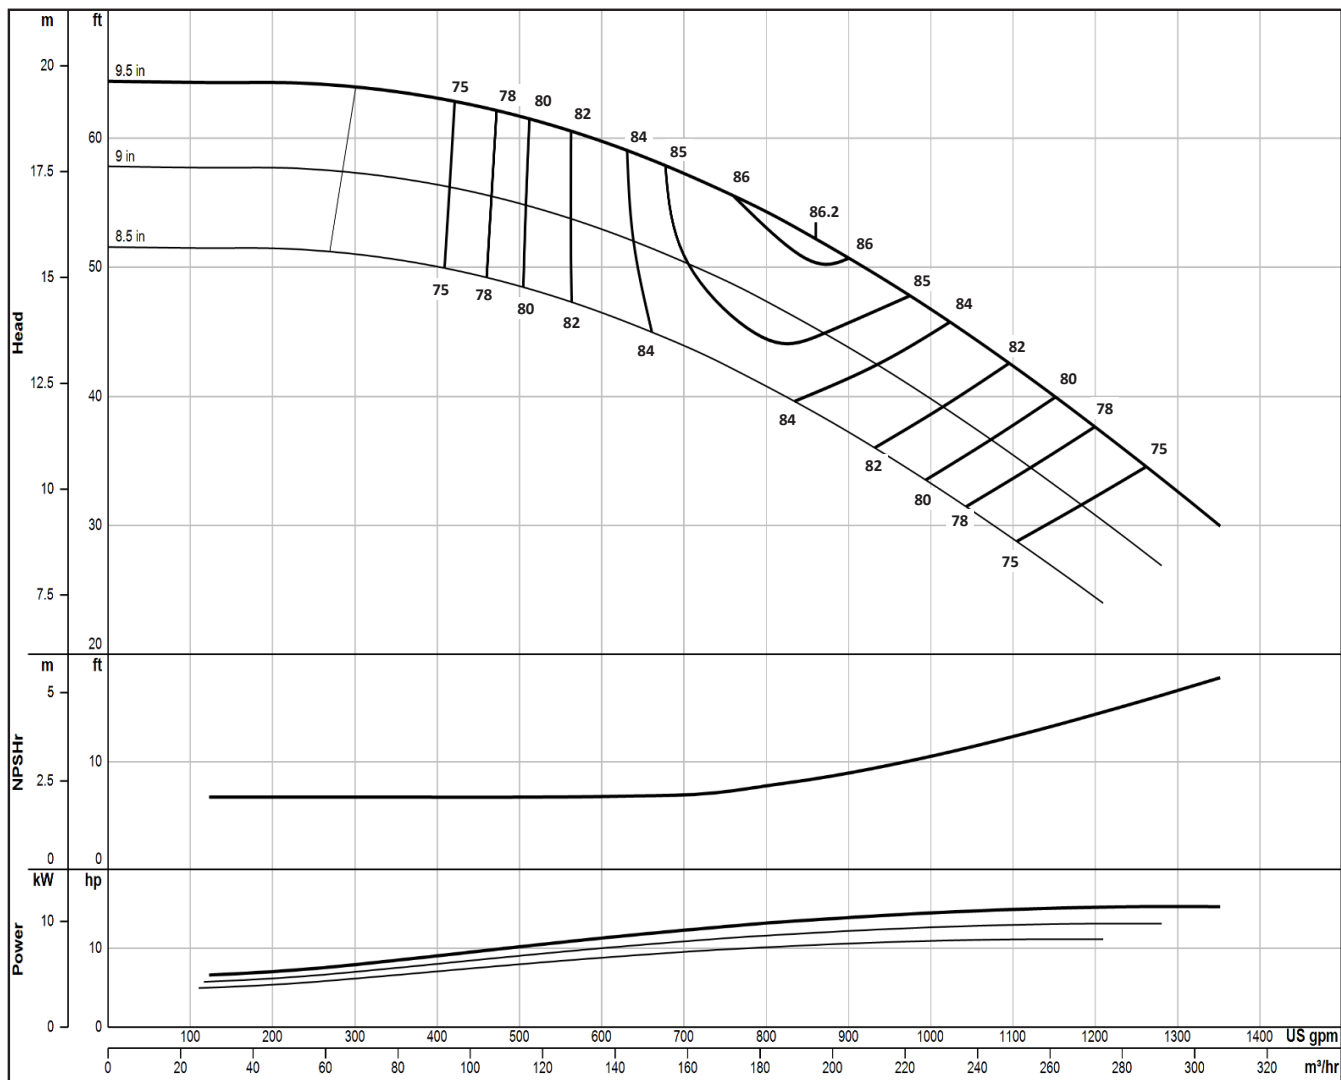

Impeller Type	Enclosed	Bowl Ø (cm)	30.2	ns (SI)	40	Qty.	Eff.
Impeller Model	SM12H	Thd'd Discharge (cm)	20, 25, 15	S (SI)	167	Stages	Change
One Stage Weight (kg)	140.6	Thd'd Suction (cm)	20	PEIcI	N/A	1	-3
Add'l Stage Wt. (kg)	56.7	Bell Suction Ø (cm)	28.9	Bowl Shaft Ø (cm)	4.92	2	-2
Impeller Wt. (kg)	6.2	Sub. Mtr. (cm)	20, 25, 30	Total Lateral (cm)	3.65	3	-1
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	2646	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	74.9	D.I. Bowl Rating (kPa)	5733	K-Factor (kg/m-tdh)	11.2	5	0
Add'l Stage Length (cm)	27.9	316 Bowl Rating (kPa)	6174	Imp. WR ² (kg-m²)	0.024		

Δ Consult factory for availability

2025-05-09

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM14LL

1450 RPM

ONE ()
STAGE STAGE

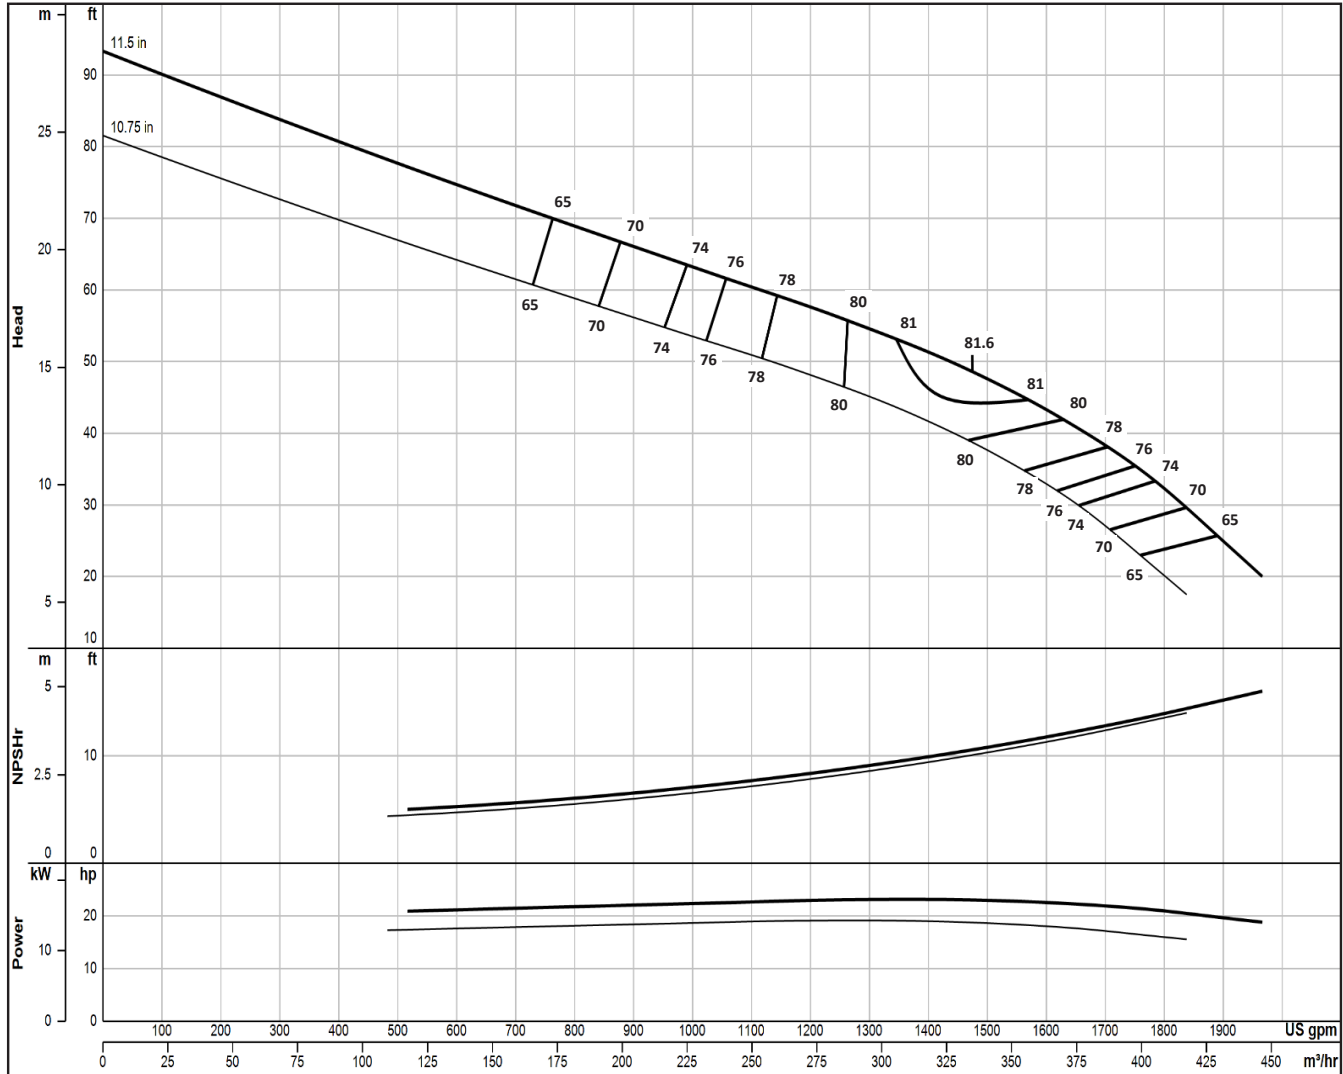

Impeller Type	Enclosed	Bowl Ø (cm)	35.6	ns (SI)	58	Qty.	Eff.
Impeller Model	SM14LL	Thd'd Discharge (cm)	25, 80	S (SI)	185	Stages	Change
One Stage Weight (kg)	249.5	Thd'd Suction (cm)	25	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	106.6	Bell Suction Ø (cm)	46.0, 35.3	Bowl Shaft Ø (cm)	5.56	2	-2
Impeller Wt. (kg)	14.1	Sub. Mtr. (cm)	25, 30	Total Lateral (cm)	3.18	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	3164	Imp. Setting (cm)	0.64	4	0
One Stage Length (cm)	87.0	D.I. Bowl Rating (kPa)	5989	K-Factor (kg/m-tdh)	26.6	5	0
Add'l Stage Length (cm)	34.3	316 Bowl Rating (kPa)	6450	Imp. WR² (kg-m²)	0.093		

Δ Consult factory for availability

2022-12-28


Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

SM14M

1450 RPM

ONE ()
STAGE STAGE

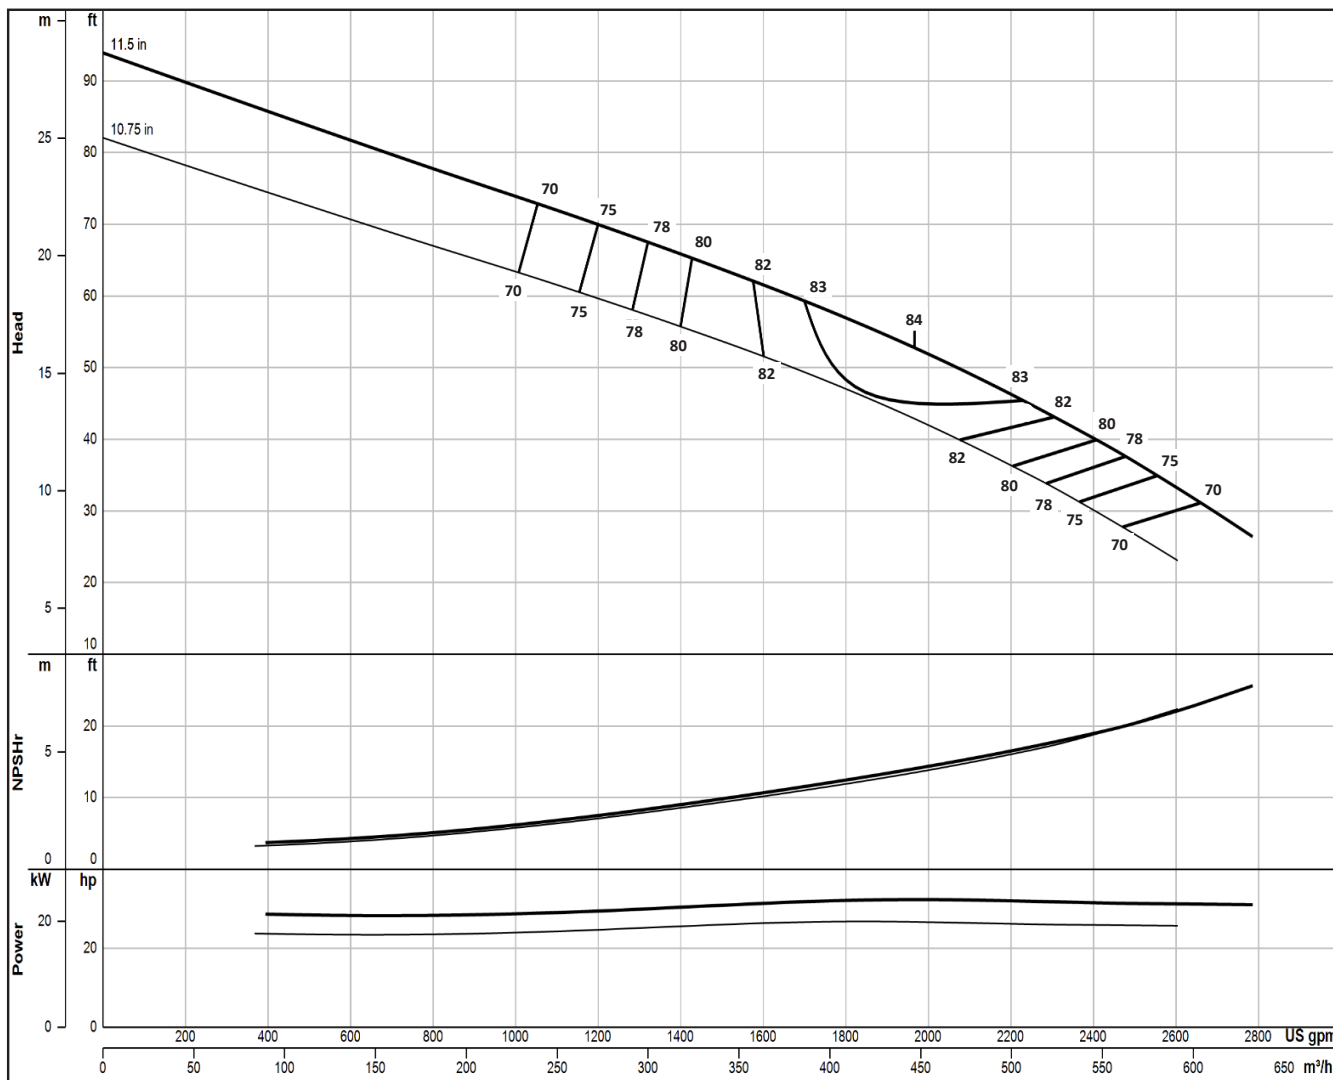

Impeller Type	Enclosed	Bowl Ø (cm)	35.6	ns (SI)	63	Qty.	Eff.
Impeller Model	SM14M	Thd'd Discharge (cm)	25, 80	S (SI)	172	Stages	Change
One Stage Weight (kg)	249.5	Thd'd Suction (cm)	25	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	106.6	Bell Suction Ø (cm)	46.0, 35.3	Bowl Shaft Ø (cm)	5.56	2	-1
Impeller Wt. (kg)	14.4	Sub. Mtr. (cm)	25, 30	Total Lateral (cm)	3.18	3	0
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	3164	Imp. Setting (cm)	0.64	4	0
One Stage Length (cm)	87.0	D.I. Bowl Rating (kPa)	5989	K-Factor (kg/m-tdh)	21.0	5	0
Add'l Stage Length (cm)	34.3	316 Bowl Rating (kPa)	6450	Imp. WR ² (kg-m²)	0.092		

Δ Consult factory for availability

2024-01-15

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM14H

1450 RPM

ONE ()
STAGE STAGE

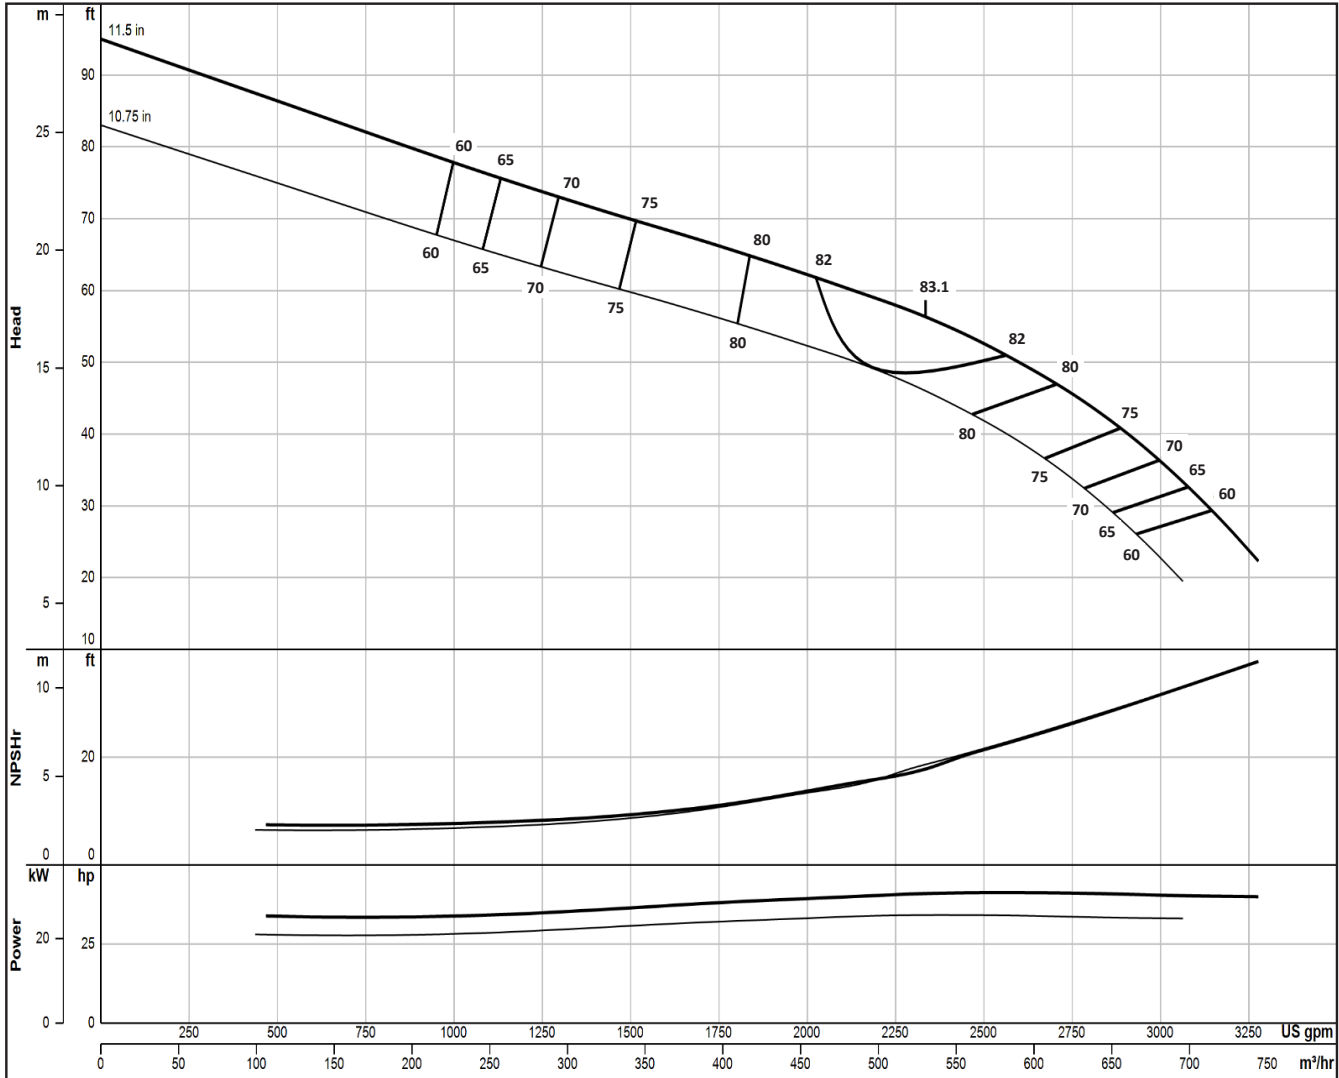

Impeller Type	Enclosed	Bowl Ø (in)	14.00	Ns (US)	3397	Qty.	Eff.
Impeller Model	SM14H	Thd'd Discharge (in)	10, 12	Nss (US)	7958	Stages	Change
One Stage Weight (lbf)	550.0	Thd'd Suction (in)	10	PEIcl	N/A	1	-2
Add'l Stage Wt. (lbf)	235.0	Bell Suction Ø (in)	18.13, 13.88	Bowl Shaft Ø (in)	2.19	2	-1
Impeller Wt. (lbf)	29.0	Sub. Mtr. (in)	10, 12	Total Lateral (in)	1.25	3	0
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (psi)	459	Imp. Setting (in)	0.25	4	0
One Stage Length (in)	34.25	D.I. Bowl Rating (psi)	869	K-Factor (lbf/ft-tdh)	13.9	5	0
Add'l Stage Length (in)	13.50	316 Bowl Rating (psi)	936	Imp. WR² (lbf-ft²)	2.023		

Δ Consult factory for availability

2024-01-15

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM14HH

1450 RPM

ONE ()
STAGE STAGE

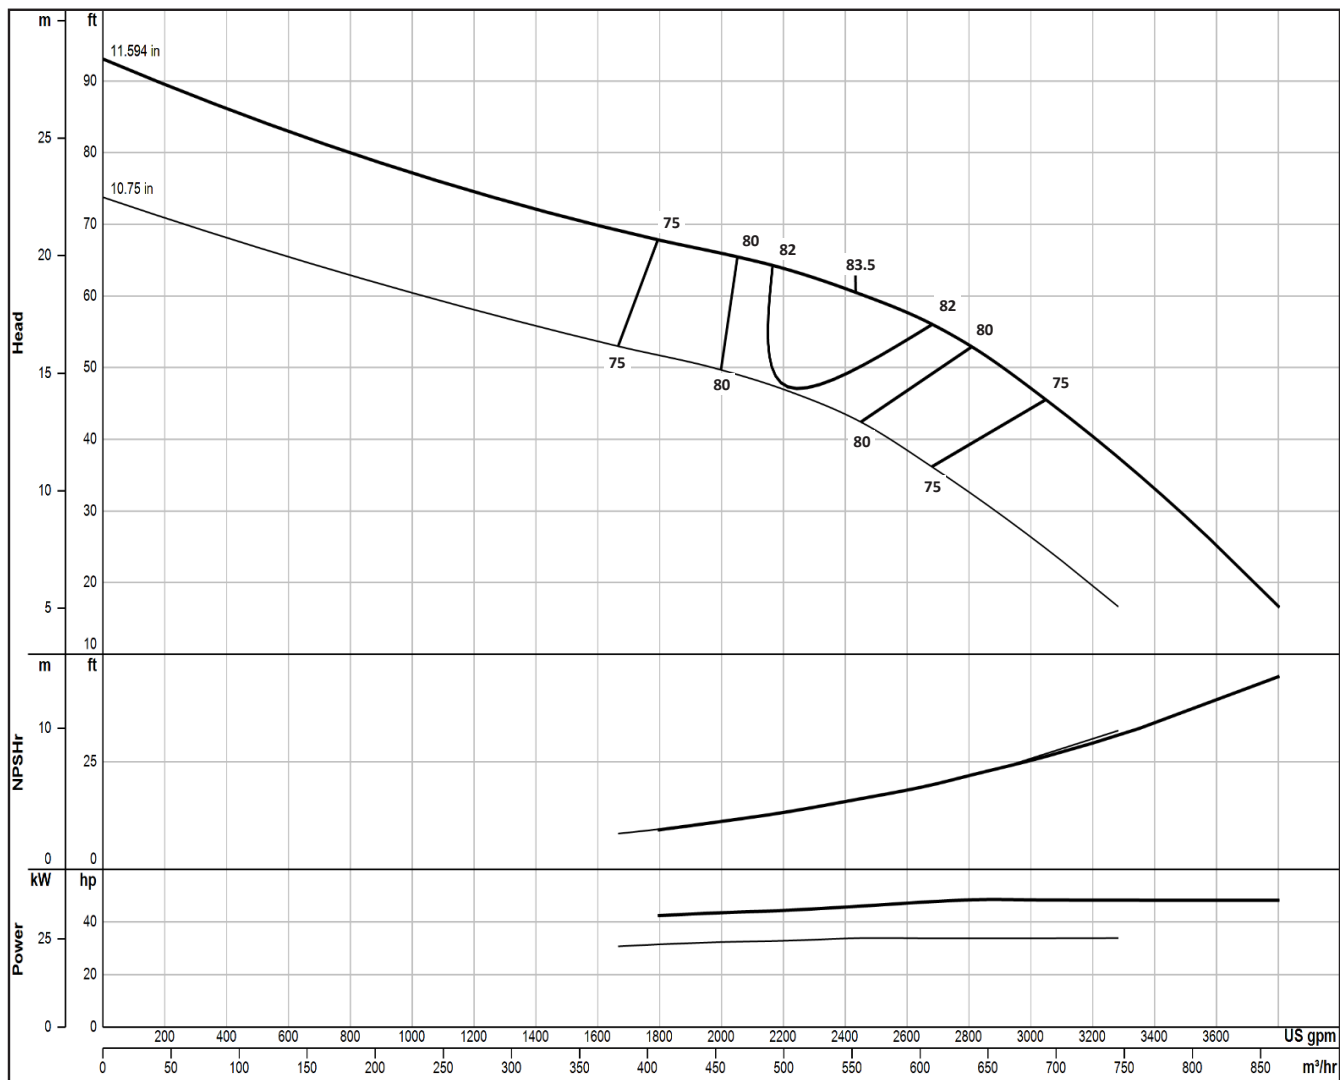

Impeller Type	Enclosed	Bowl Ø (cm)	35.6	ns (SI)	64	Qty.	Eff.
Impeller Model	SM14HH	Thd'd Discharge (cm)	25, 80	S (SI)	180	Stages	Change
One Stage Weight (kg)	244.9	Thd'd Suction (cm)	25	PEIcl	N/A	1	-2.5
Add'l Stage Wt. (kg)	102.1	Bell Suction Ø (cm)	46.0, 35.3	Bowl Shaft Ø (cm)	5.56	2	-1.5
Impeller Wt. (kg)	12.9	Sub. Mtr. (cm)	25, 30	Total Lateral (cm)	3.18	3	-0.5
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	3164	Imp. Setting (cm)	0.64	4	0
One Stage Length (cm)	87.0	D.I. Bowl Rating (kPa)	5989	K-Factor (kg/m-tdh)	25.3	5	0
Add'l Stage Length (cm)	34.3	316 Bowl Rating (kPa)	6450	Imp. WR ² (kg-m²)	0.097		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM14MO

1450 RPM

ONE ()
STAGE STAGE

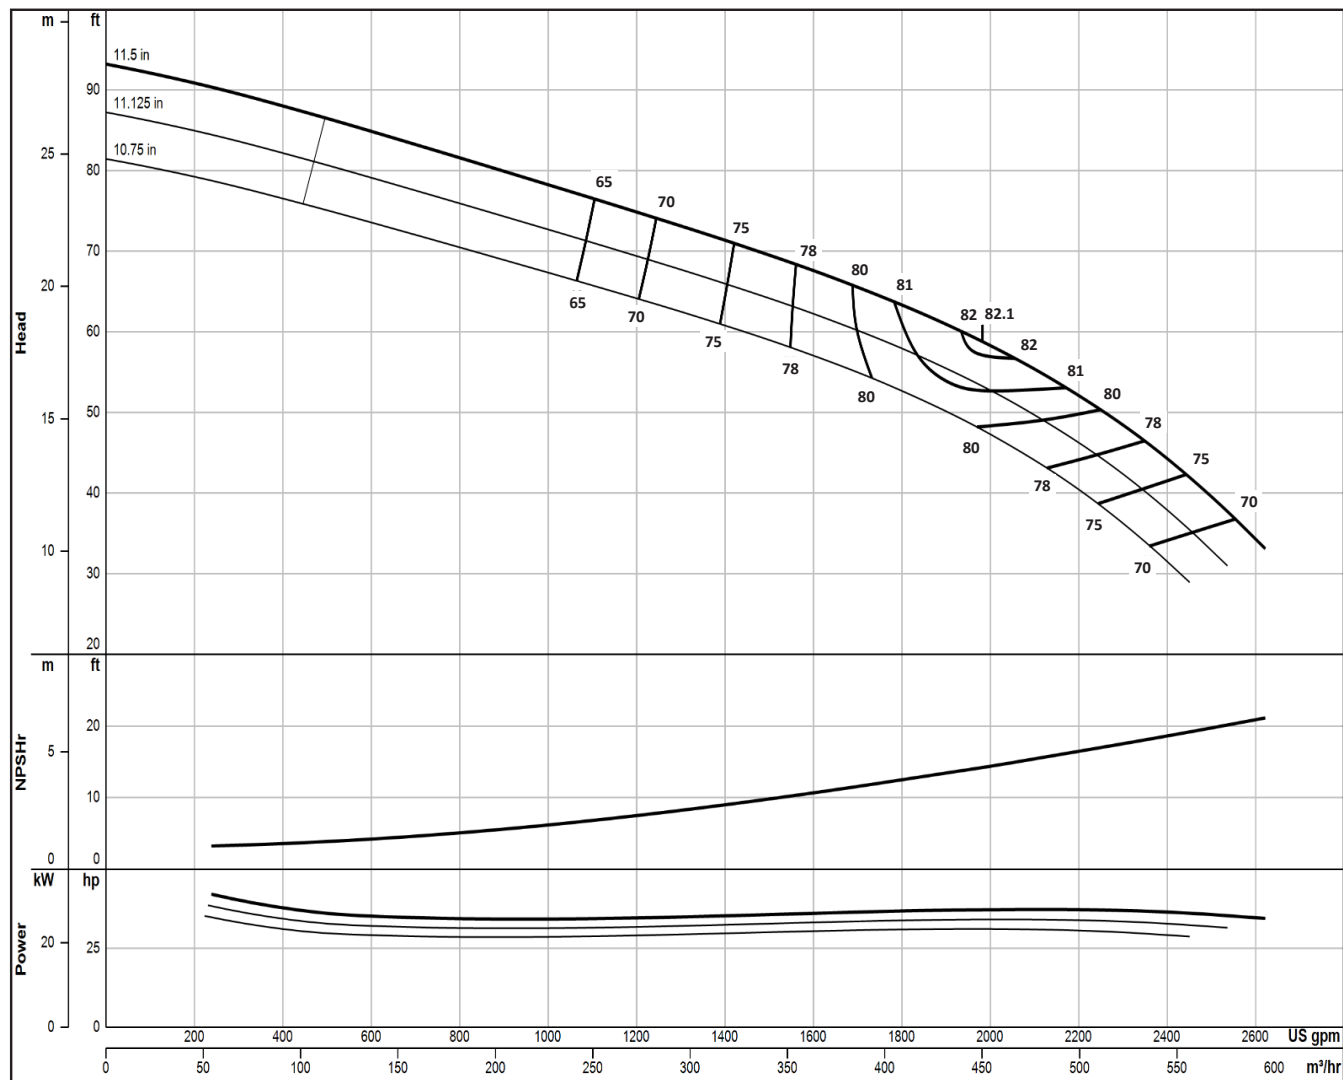

Impeller Type	Semi-Open	Bowl Ø (cm)	35.6	ns (SI)	59	Qty.	Eff.
Impeller Model	SM14MO	Thd'd Discharge (cm)	25, 80	S (SI)	171	Stages	Change
One Stage Weight (kg)	242.7	Thd'd Suction (cm)	25	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	99.8	Bell Suction Ø (cm)	46.0, 35.3	Bowl Shaft Ø (cm)	5.56	2	-1
Impeller Wt. (kg)	7.7	Sub. Mtr. (cm)	25, 30	Total Lateral (cm)	3.97	3	0
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.08	4	0
One Stage Length (cm)	87.0	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	25.2	5	0
Add'l Stage Length (cm)	34.3	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.055		

Δ Consult factory for availability

2025-07-14

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM14HO

1450 RPM

ONE ()
STAGE STAGE

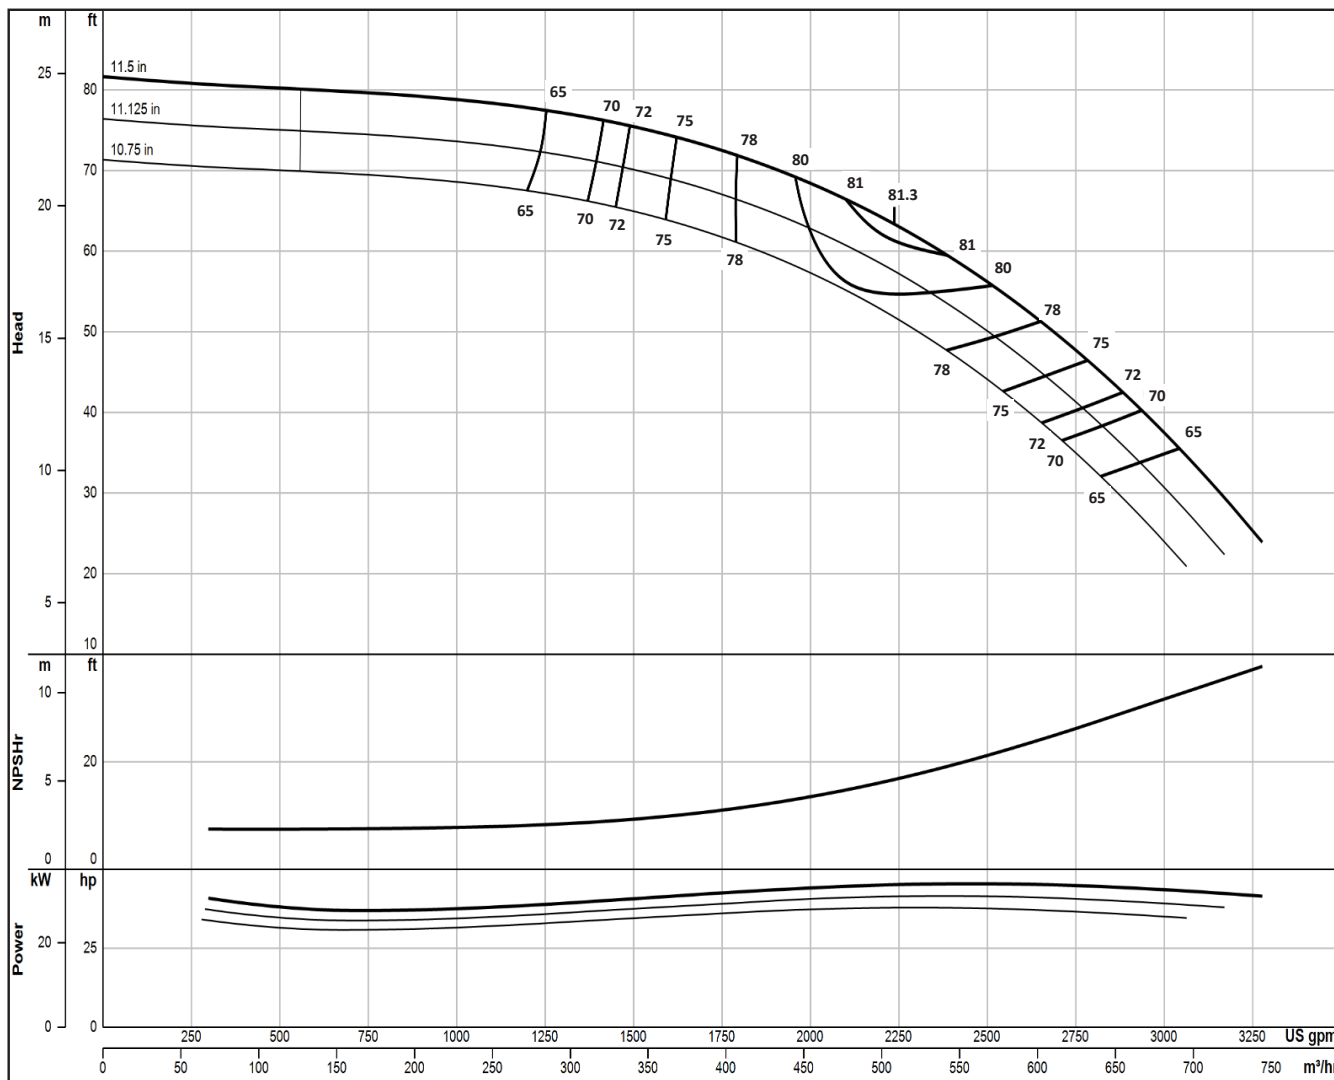

Impeller Type	Semi-Open	Bowl Ø (cm)	35.6	ns (SI)	59	Qty.	Eff.
Impeller Model	SM14HO	Thd'd Discharge (cm)	25, 80	S (SI)	161	Stages	Change
One Stage Weight (kg)	242.7	Thd'd Suction (cm)	25	PEIcl	N/A	1	-2
Add'l Stage Wt. (kg)	99.8	Bell Suction Ø (cm)	46.0, 35.3	Bowl Shaft Ø (cm)	5.56	2	-1
Impeller Wt. (kg)	7.6	Sub. Mtr. (cm)	25, 30	Total Lateral (cm)	3.97	3	0
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.08	4	0
One Stage Length (cm)	87.0	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	24.8	5	0
Add'l Stage Length (cm)	34.3	316 Bowl Rating (kPa)	Δ	Imp. WR² (kg-m²)	0.056		

Δ Consult factory for availability

2025-07-14

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM16MO

1450 RPM

ONE ()
STAGE STAGE

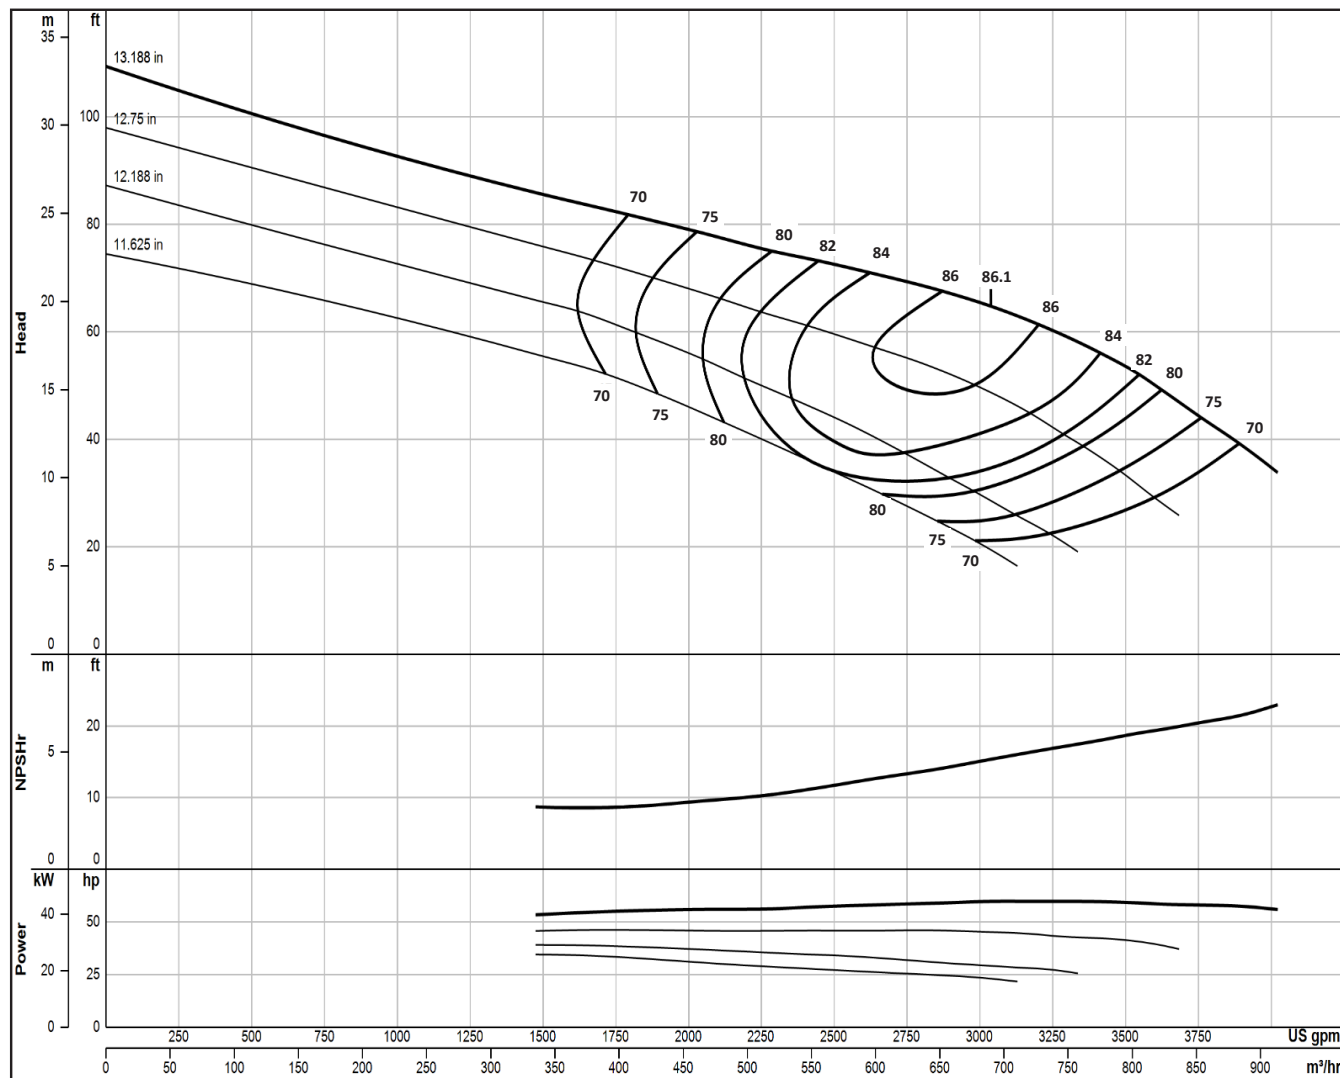

Impeller Type	Semi-Open	Bowl Ø (cm)	38.7	ns (SI)	68	Qty.	Eff.
Impeller Model	SM16MO	Thd'd Discharge (cm)	80	S (SI)	204	Stages	Change
One Stage Weight (kg)	272.2	Thd'd Suction (cm)	30	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	113.4	Bell Suction Ø (cm)	48.9, 15.25	Bowl Shaft Ø (cm)	5.56	2	-2
Impeller Wt. (kg)	9.9	Sub. Mtr. (cm)	25, 30	Total Lateral (cm)	3.18	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.08	4	0
One Stage Length (cm)	103.0	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	53.8	5	0
Add'l Stage Length (cm)	38.1	316 Bowl Rating (kPa)	7116	Imp. WR ² (kg-m²)	0.083		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM16HO

1450 RPM

ONE ()
STAGE STAGE

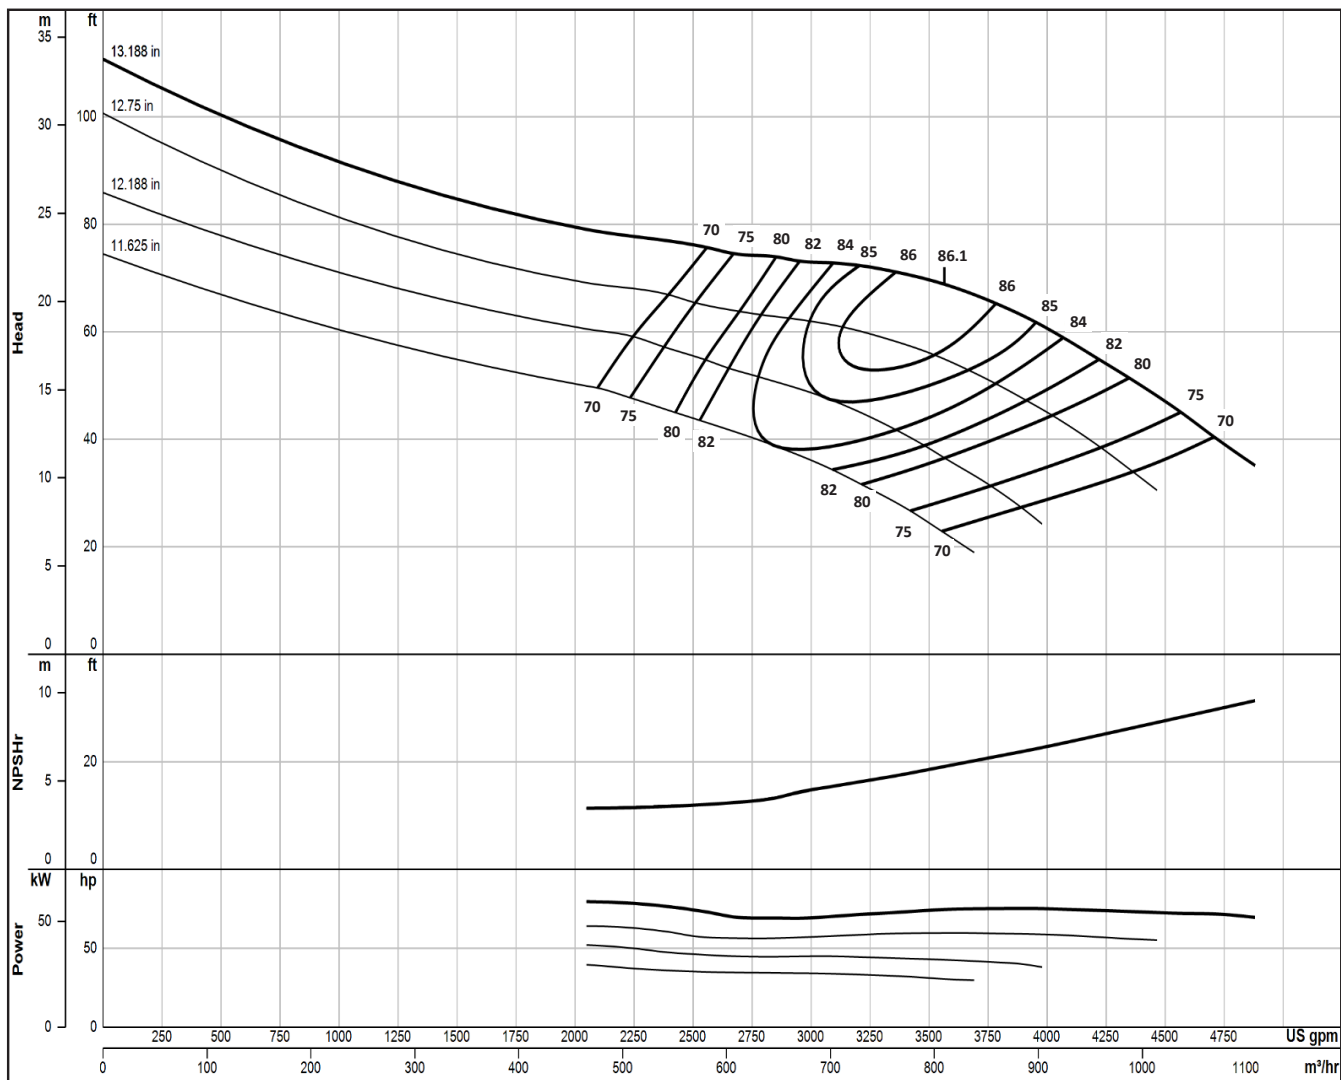

Impeller Type	Semi-Open	Bowl Ø (cm)	38.7	ns (SI)	71	Qty.	Eff.
Impeller Model	SM16HO	Thd'd Discharge (cm)	80	S (SI)	186	Stages	Change
One Stage Weight (kg)	272.2	Thd'd Suction (cm)	30	PEIcI	N/A	1	-3
Add'l Stage Wt. (kg)	113.4	Bell Suction Ø (cm)	48.9, 15.25	Bowl Shaft Ø (cm)	5.56	2	-2
Impeller Wt. (kg)	9.7	Sub. Mtr. (cm)	25, 30	Total Lateral (cm)	2.54	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.08	4	0
One Stage Length (cm)	103.0	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	53.7	5	0
Add'l Stage Length (cm)	38.1	316 Bowl Rating (kPa)	7116	Imp. WR² (kg-m²)	0.079		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM16M

1450 RPM

ONE ()
STAGE STAGE

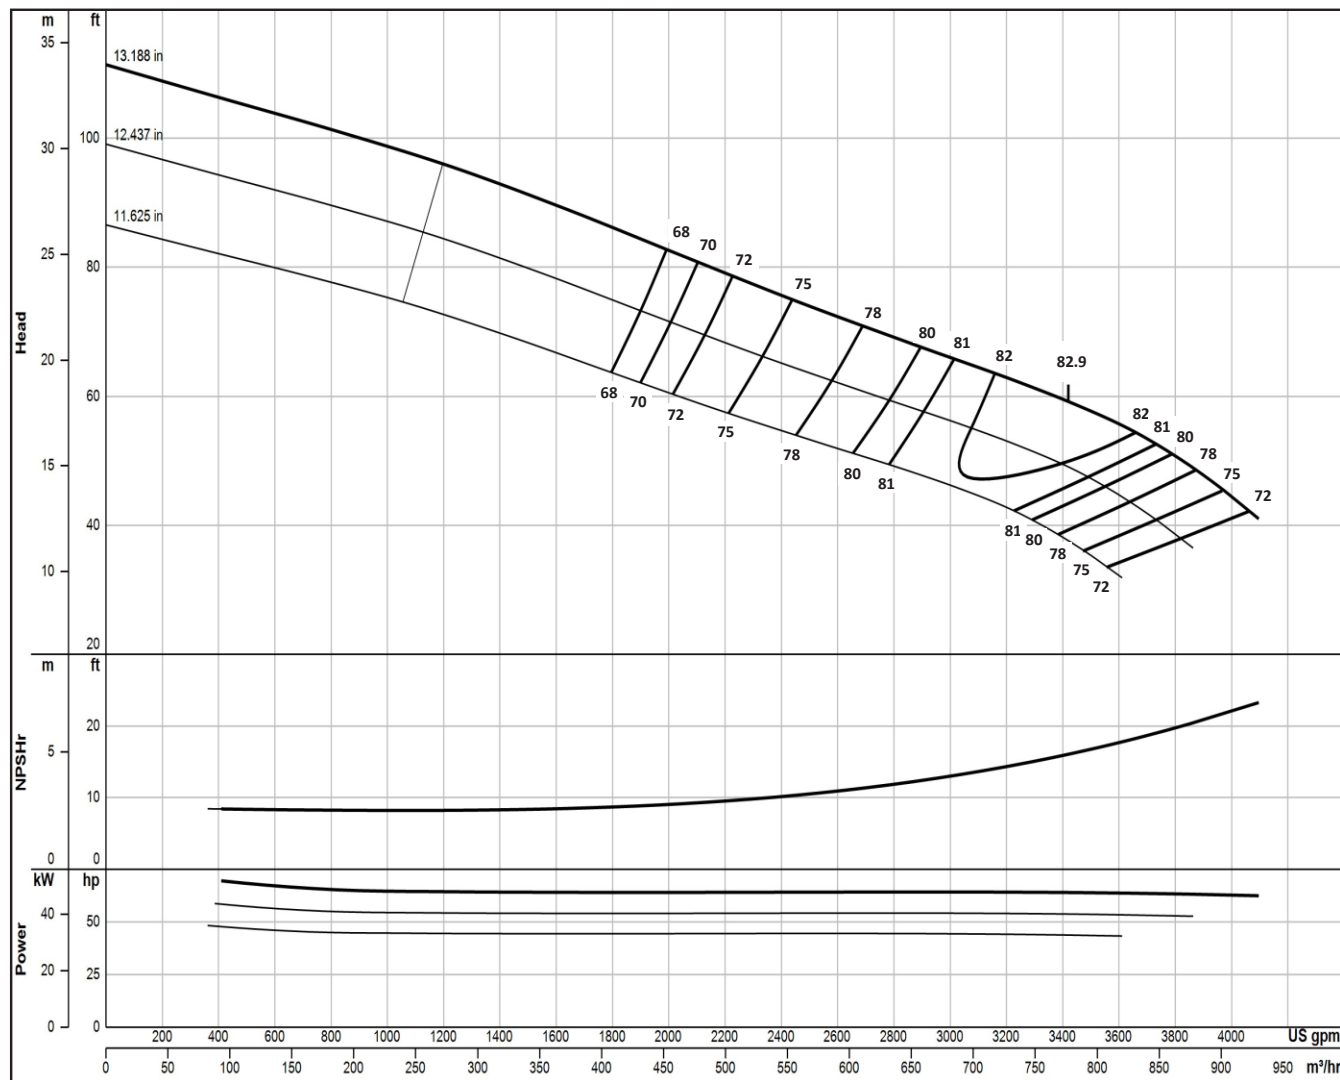

Impeller Type	Enclosed	Bowl Ø (cm)	38.7	ns (SI)	77	Qty.	Eff.
Impeller Model	SM16M	Thd'd Discharge (cm)	80	S (SI)	205	Stages	Change
One Stage Weight (kg)	272.2	Thd'd Suction (cm)	30	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	113.4	Bell Suction Ø (cm)	48.9, 15.25	Bowl Shaft Ø (cm)	5.56	2	-2
Impeller Wt. (kg)	14.7	Sub. Mtr. (cm)	25, 30	Total Lateral (cm)	3.18	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	103.0	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	49.1	5	0
Add'l Stage Length (cm)	38.1	316 Bowl Rating (kPa)	7116	Imp. WR² (kg-m²)	0.168		

Δ Consult factory for availability

2026-06-10

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM16H

1450 RPM

ONE ()
STAGE STAGE

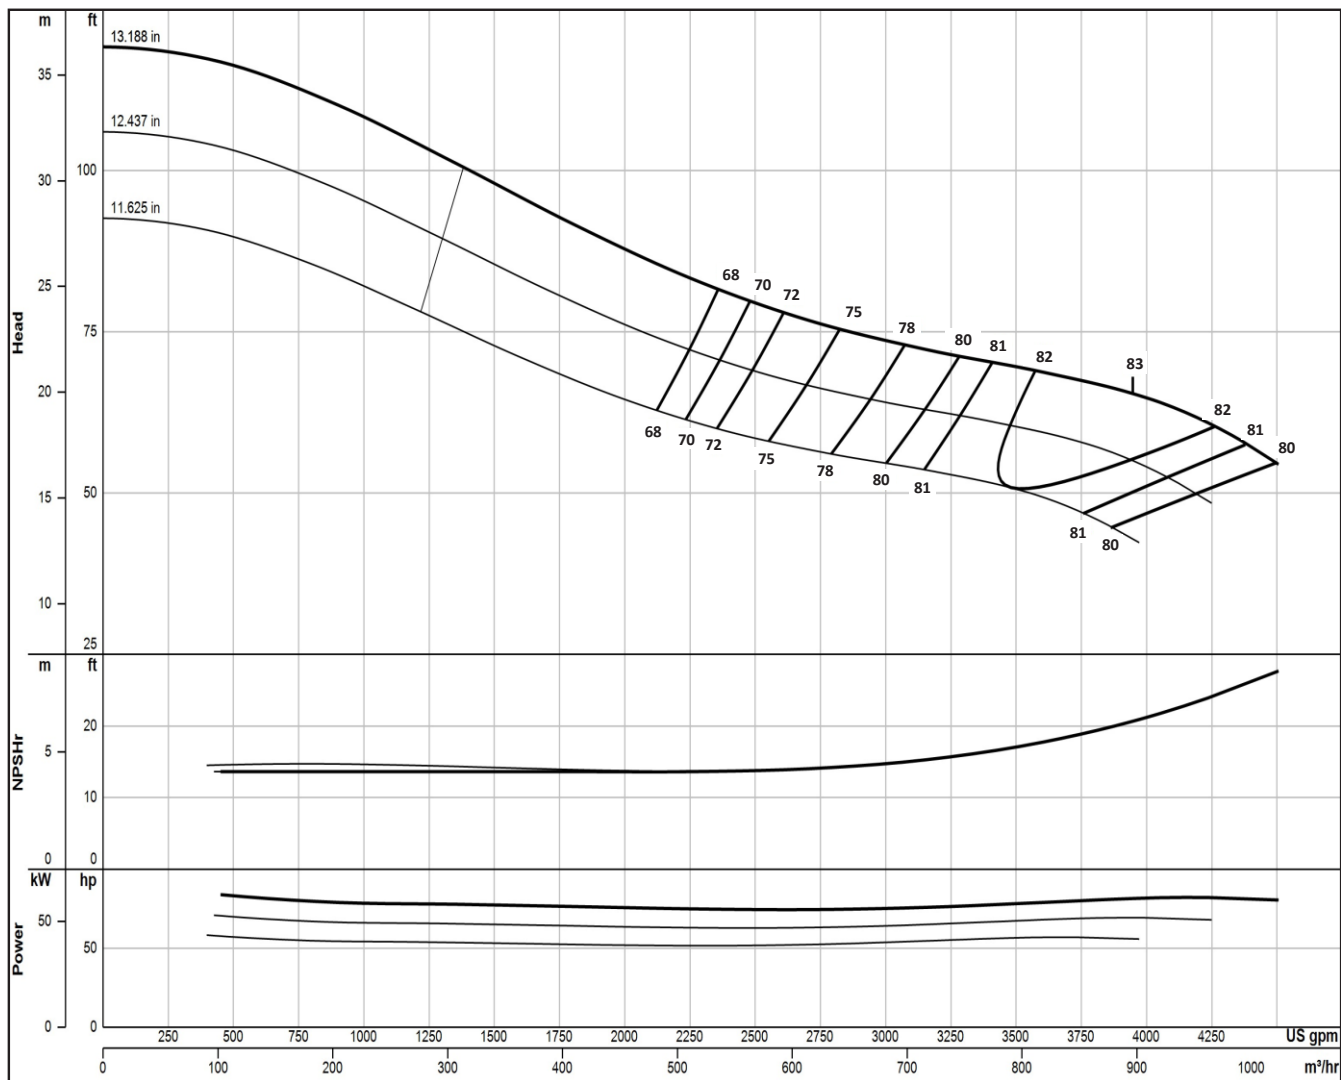

Impeller Type	Enclosed	Bowl Ø (cm)	38.7	ns (SI)	77	Qty.	Eff.
Impeller Model	SM16H	Thd'd Discharge (cm)	80	S (SI)	182	Stages	Change
One Stage Weight (kg)	272.2	Thd'd Suction (cm)	30	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	113.4	Bell Suction Ø (cm)	48.9, 15.25	Bowl Shaft Ø (cm)	5.56	2	-2
Impeller Wt. (kg)	13.8	Sub. Mtr. (cm)	25, 30	Total Lateral (cm)	2.54	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	103.0	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	47.2	5	0
Add'l Stage Length (cm)	38.1	316 Bowl Rating (kPa)	7116	Imp. WR² (kg-m²)	0.153		

Δ Consult factory for availability

2026-06-10

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SJ18M

1450 RPM

ONE ()
STAGE STAGE

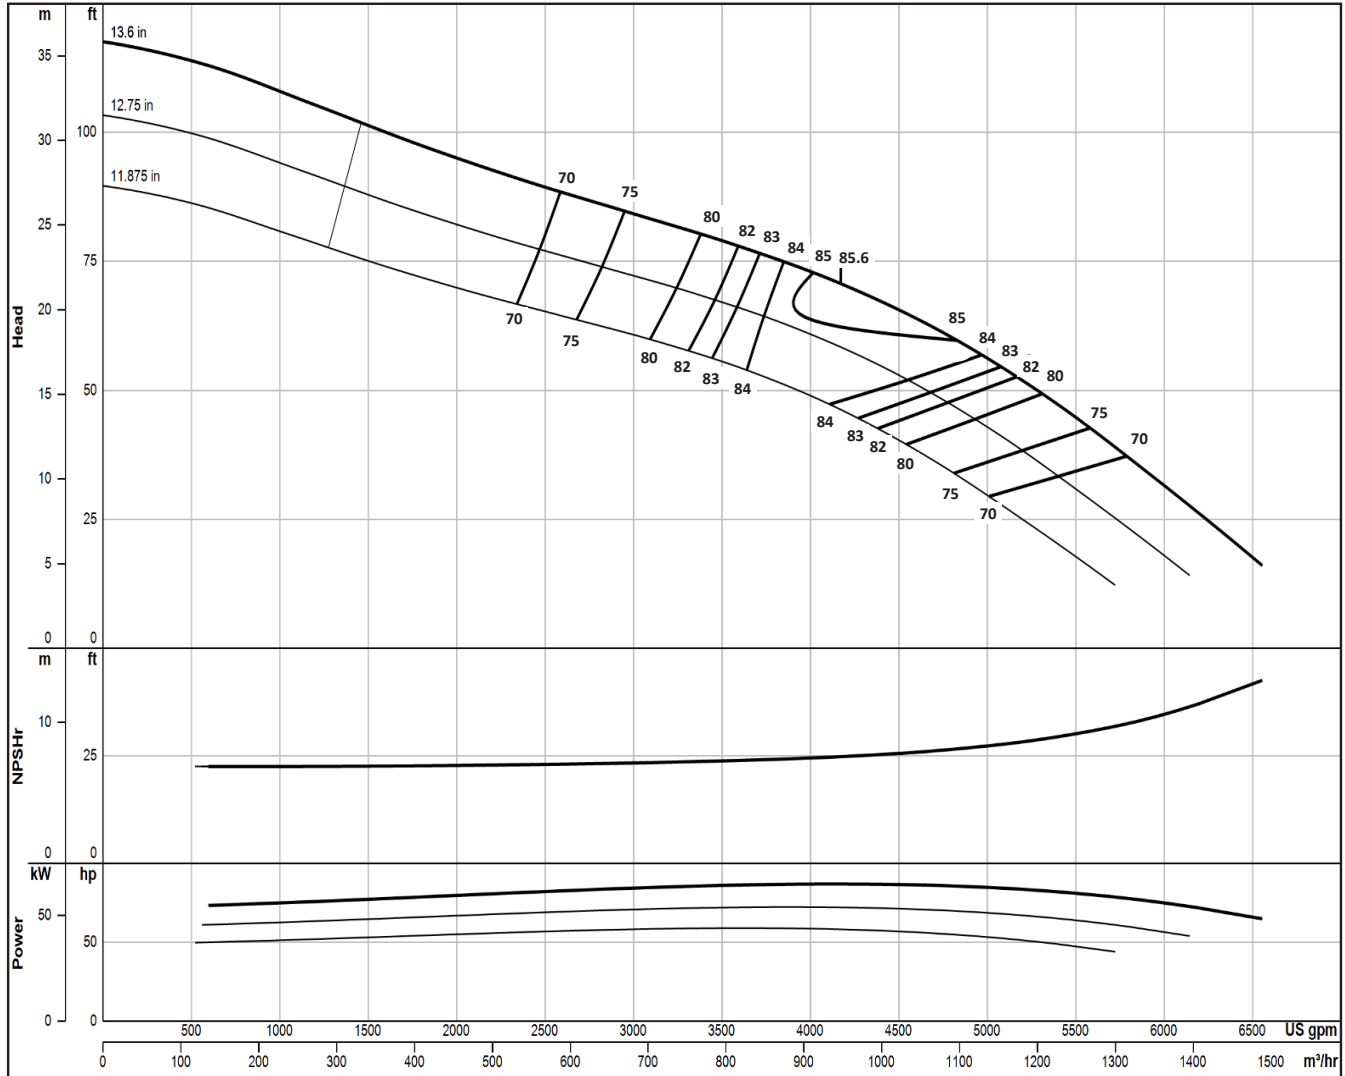

Impeller Type	Enclosed	Bowl Ø (cm)	45.1	ns (SI)	80	Qty.	Eff.
Impeller Model	SJ18M	Thd'd Discharge (cm)	Δ	S (SI)	165	Stages	Change
One Stage Weight (kg)	294.8	Thd'd Suction (cm)	N/A	PEIcl	N/A	1	0
Add'l Stage Wt. (kg)	142.9	Bell Suction Ø (cm)	48.9, 46.0	Bowl Shaft Ø (cm)	6.19	2	0
Impeller Wt. (kg)	19.9	Sub. Mtr. (cm)	25, 30	Total Lateral (cm)	2.92	3	0
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	116.2	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	56.2	5	0
Add'l Stage Length (cm)	45.7	316 Bowl Rating (kPa)	5967	Imp. WR² (kg-m²)	0.187		

Δ Consult factory for availability

2025-07-14

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SJ18H

1450 RPM

ONE ()
STAGE STAGE

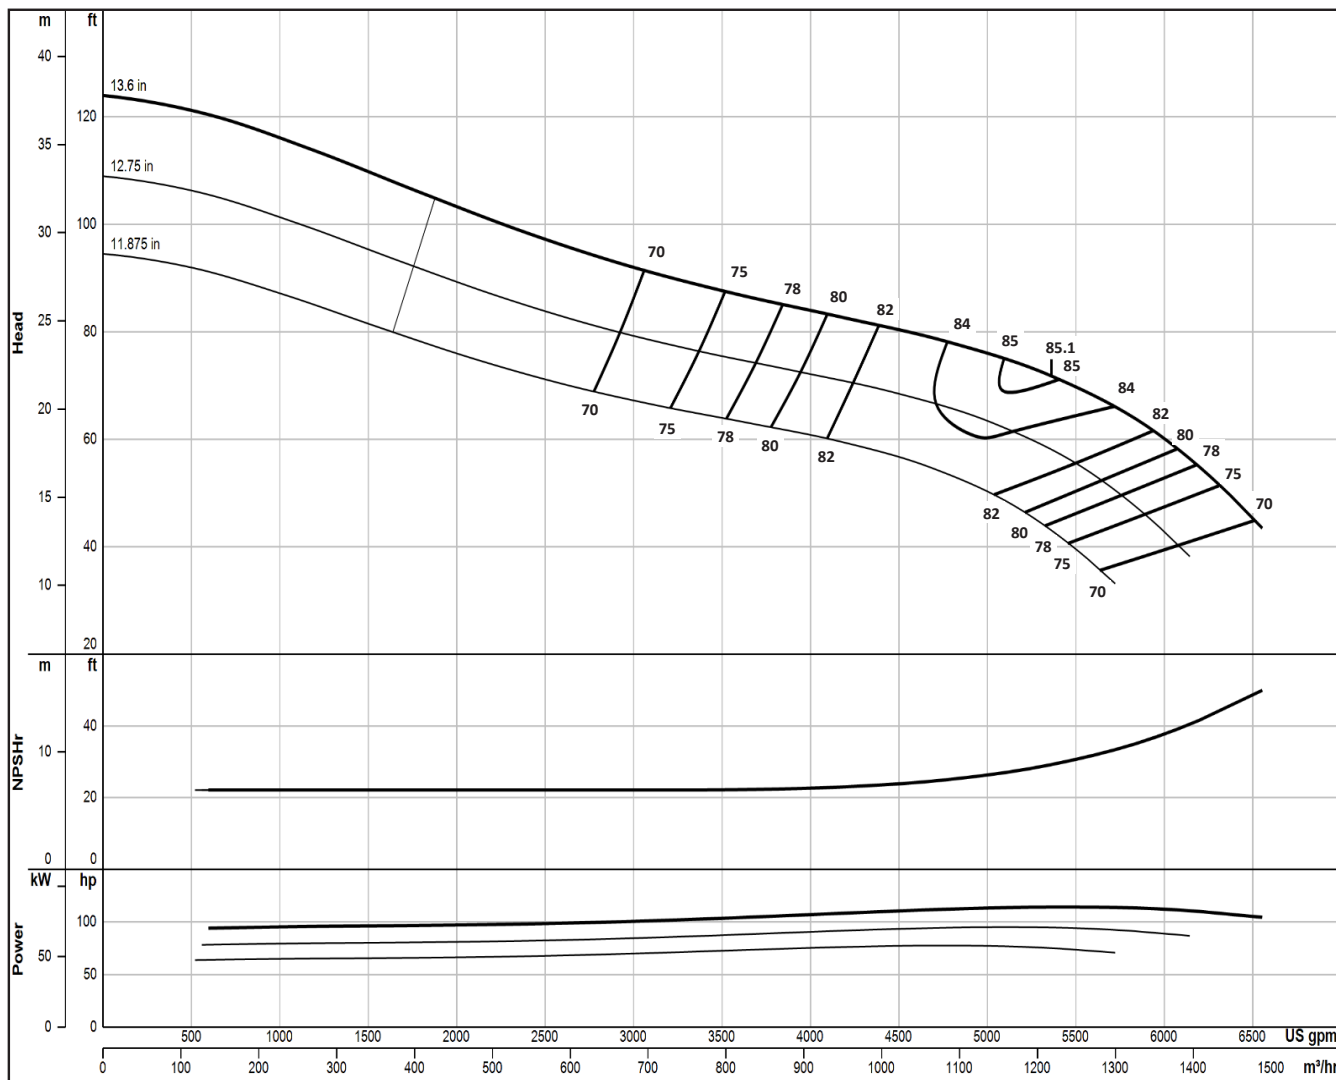

Impeller Type	Enclosed	Bowl Ø (cm)	45.1	ns (SI)	79	Qty.	Eff.
Impeller Model	SJ18H	Thd'd Discharge (cm)	Δ	S (SI)	170	Stages	Change
One Stage Weight (kg)	294.8	Thd'd Suction (cm)	N/A	PEIcl	N/A	1	0
Add'l Stage Wt. (kg)	142.9	Bell Suction Ø (cm)	48.9, 46.0	Bowl Shaft Ø (cm)	6.19	2	0
Impeller Wt. (kg)	20.7	Sub. Mtr. (cm)	25, 30	Total Lateral (cm)	2.92	3	0
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	116.2	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	51.3	5	0
Add'l Stage Length (cm)	45.7	316 Bowl Rating (kPa)	5967	Imp. WR ² (kg-m²)	0.172		

Δ Consult factory for availability

2025-07-14

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SJ18N

1450 RPM

ONE ()
STAGE STAGE

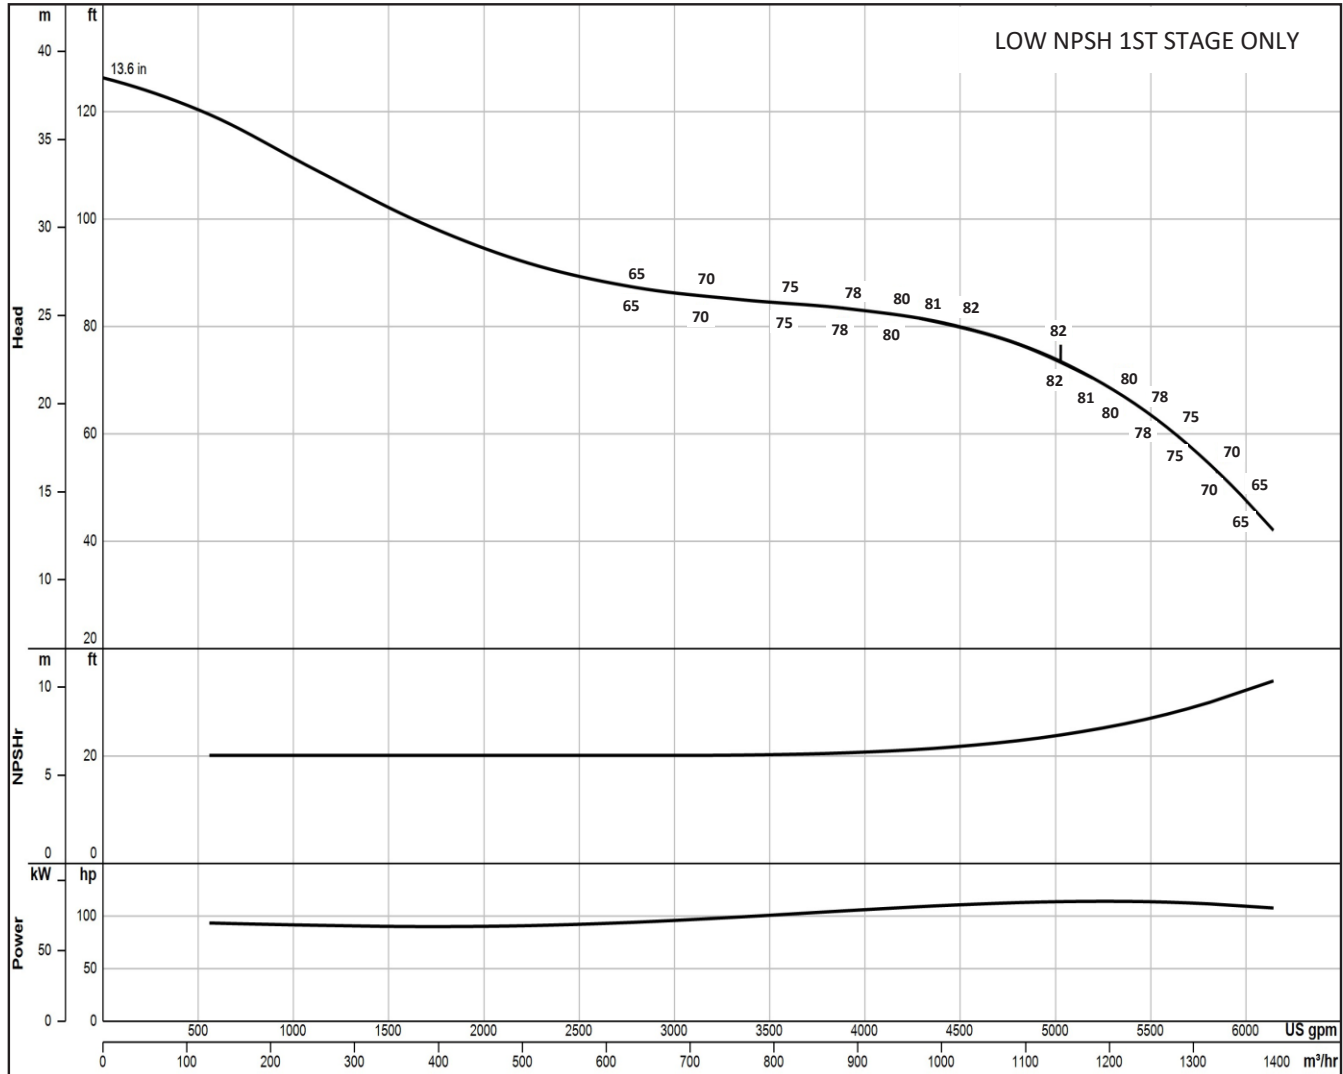

Impeller Type	Enclosed	Bowl Ø (cm)	45.1	ns (SI)	74	Qty.	Eff. Change
Impeller Model	SJ18N	Thd'd Discharge (cm)	Δ	S (SI)	187	Stages	
One Stage Weight (kg)	294.8	Thd'd Suction (cm)	N/A	PEIcl	N/A	1	0
Add'l Stage Wt. (kg)	#VALUE!	Bell Suction Ø (cm)	48.9, 46.0	Bowl Shaft Ø (cm)	6.19	2	0
Impeller Wt. (kg)	21.8	Sub. Mtr. (cm)	25, 30	Total Lateral (cm)	2.92	3	0
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	116.2	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	58.8	5	0
Add'l Stage Length (cm)	#VALUE!	316 Bowl Rating (kPa)	5967	Imp. WR² (kg-m²)	0.188		

Δ Consult factory for availability

2025-07-14


Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.

SM20M

1450 RPM

ONE ()
STAGE STAGE

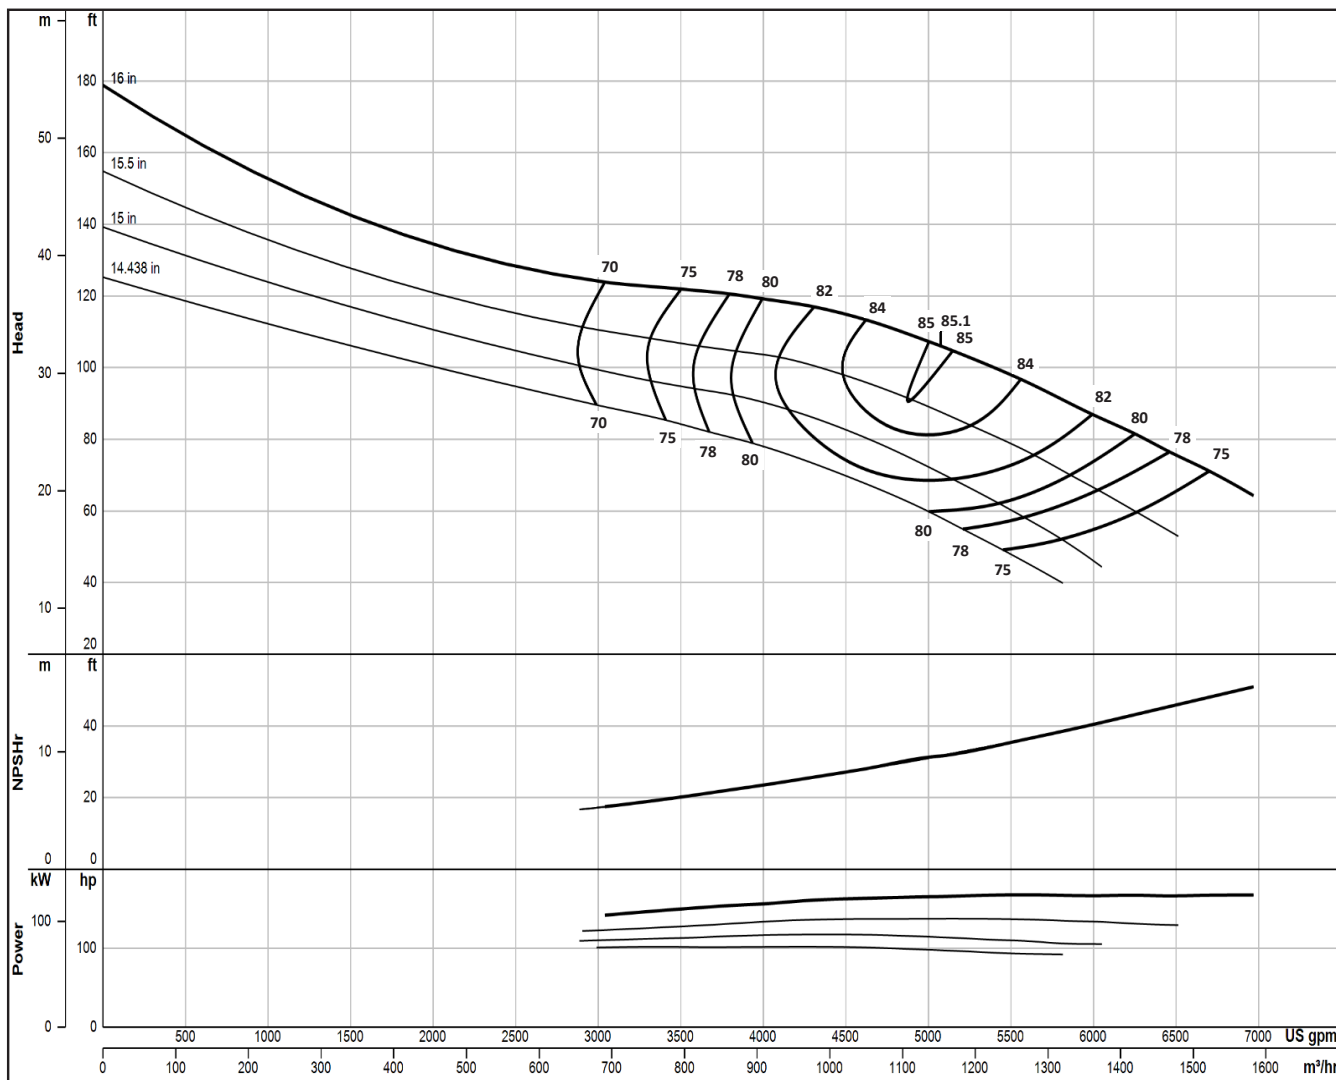

Impeller Type	Enclosed	Bowl Ø (cm)	48.9	ns (SI)	62	Qty.	Eff.
Impeller Model	SM20M	Thd'd Discharge (cm)	Δ	S (SI)	150	Stages	Change
One Stage Weight (kg)	453.6	Thd'd Suction (cm)	N/A	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	204.1	Bell Suction Ø (cm)	48.9	Bowl Shaft Ø (cm)	6.19	2	-2
Impeller Wt. (kg)	34.5	Sub. Mtr. (cm)	25, 30	Total Lateral (cm)	3.81	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	126.7	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	49.1	5	0
Add'l Stage Length (cm)	45.7	316 Bowl Rating (kPa)	7166	Imp. WR² (kg-m²)	0.346		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SM20H

1450 RPM

ONE ()
STAGE STAGE

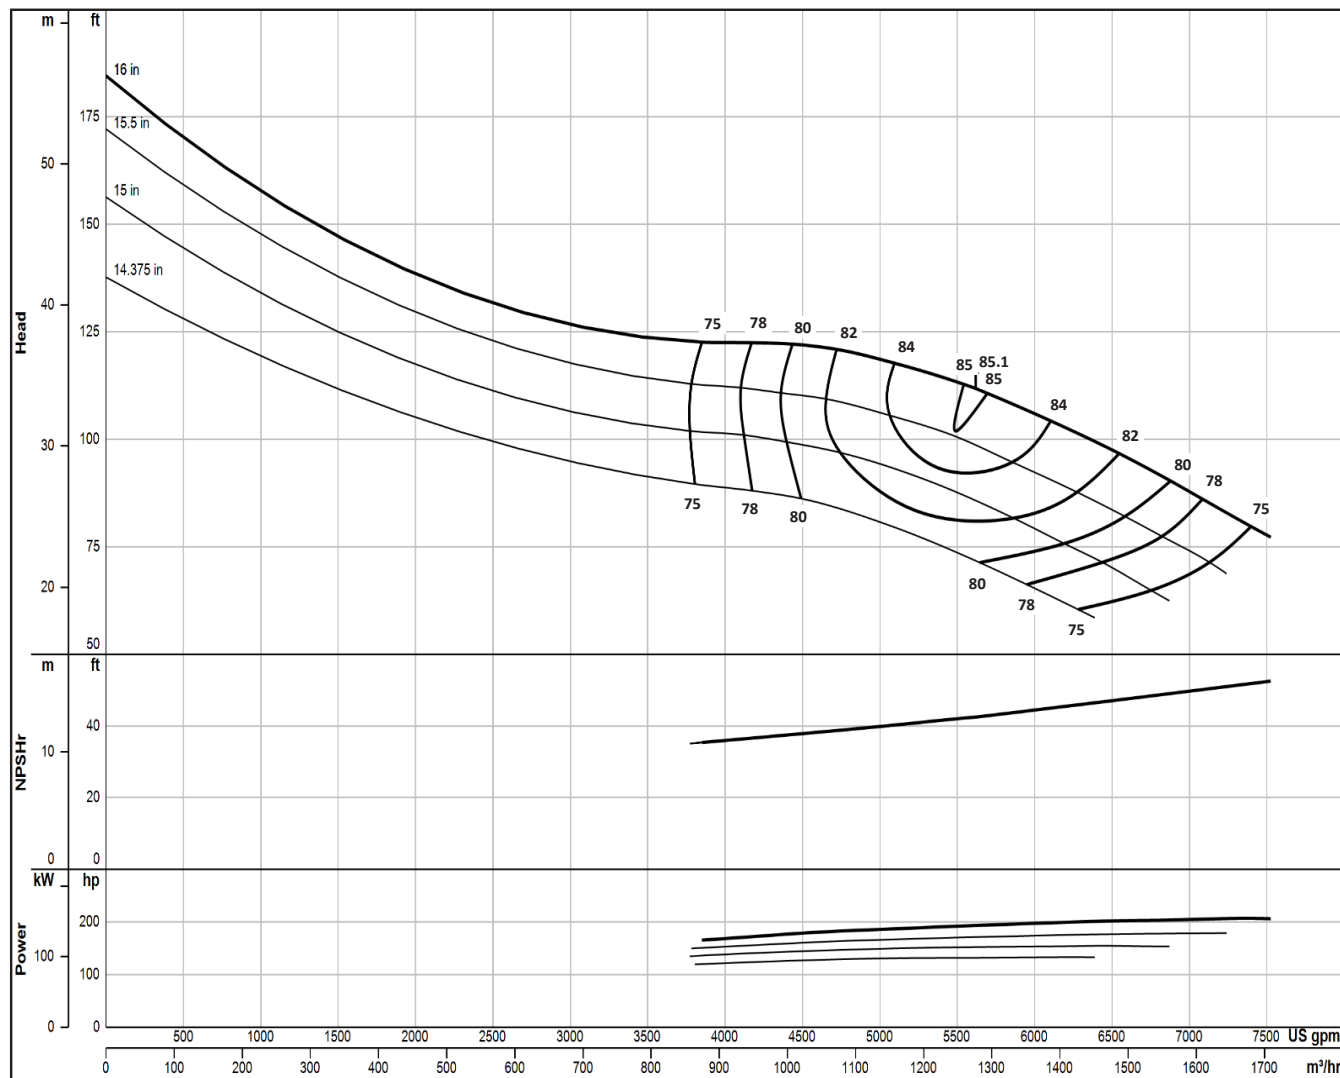

Impeller Type	Enclosed	Bowl Ø (cm)	48.9	ns (SI)	61	Qty.	Eff.
Impeller Model	SM20H	Thd'd Discharge (cm)	Δ	S (SI)	129	Stages	Change
One Stage Weight (kg)	453.6	Thd'd Suction (cm)	N/A	PEIcl	N/A	1	-3
Add'l Stage Wt. (kg)	204.1	Bell Suction Ø (cm)	48.9	Bowl Shaft Ø (cm)	6.19	2	-2
Impeller Wt. (kg)	31.3	Sub. Mtr. (cm)	25, 30	Total Lateral (cm)	3.33	3	-1
Impeller Mtrl.	316/ NaB	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	126.7	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	47.3	5	0
Add'l Stage Length (cm)	45.7	316 Bowl Rating (kPa)	7166	Imp. WR² (kg-m²)	0.346		

Δ Consult factory for availability

2022-12-28

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SJ20M

1450 RPM

ONE ()
STAGE STAGE

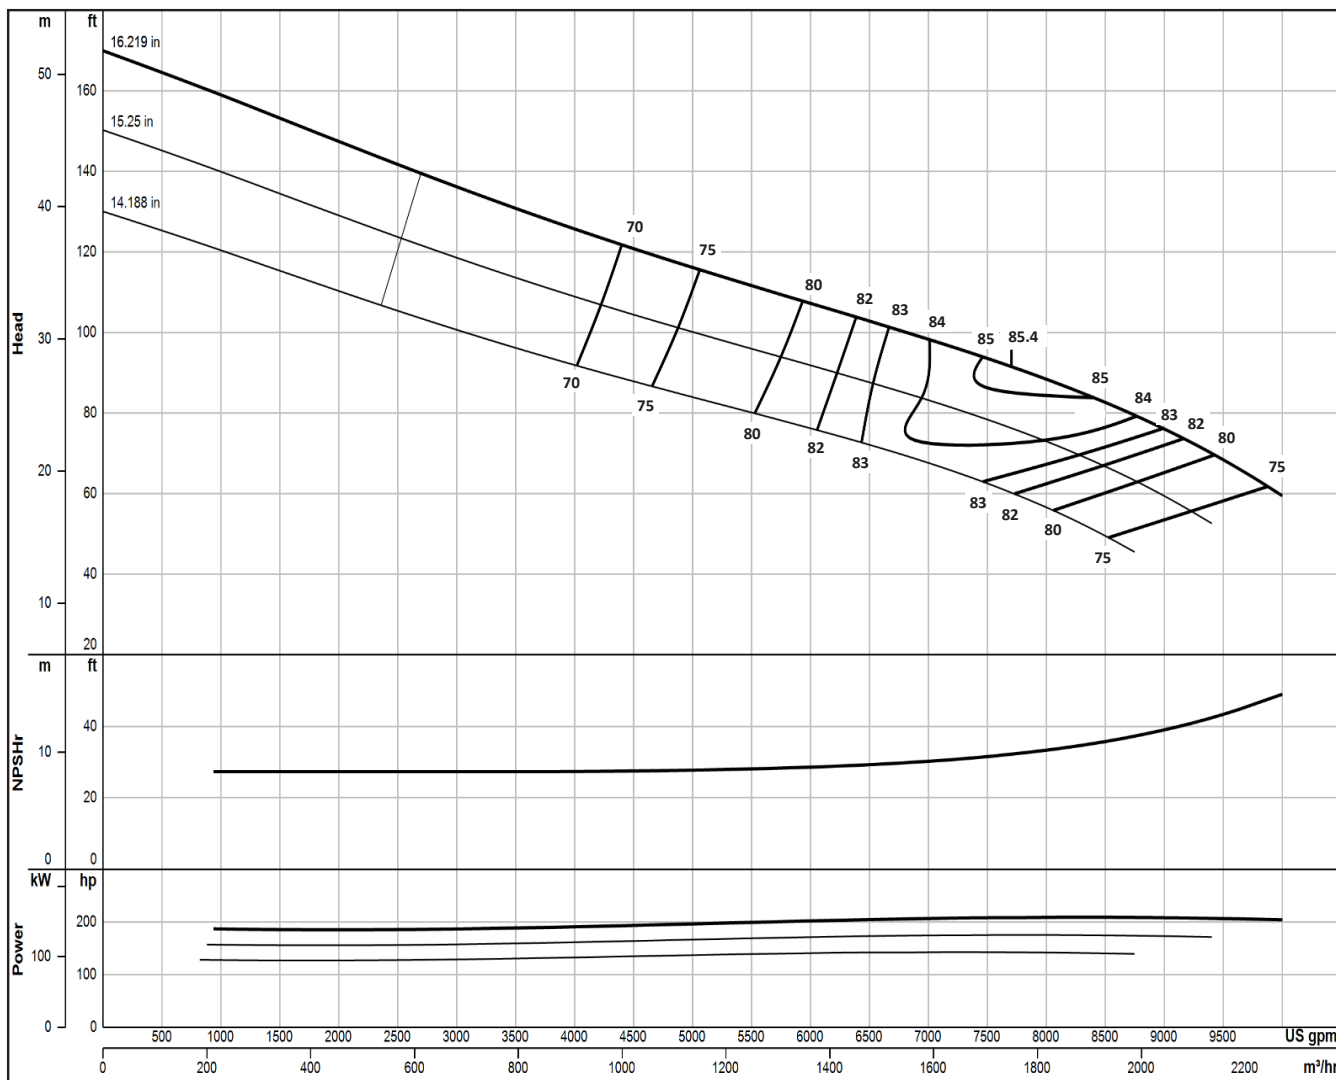

Impeller Type	Enclosed	Bowl Ø (cm)	53.0	ns (SI)	83	Qty.	Eff.
Impeller Model	SJ20M	Thd'd Discharge (cm)	Δ S (SI)		243	Stages	Change
One Stage Weight (kg)	453.6	Thd'd Suction (cm)	N/A	PEIcl	N/A	1	0
Add'l Stage Wt. (kg)	210.9	Bell Suction Ø (cm)	57.8, 48.9	Bowl Shaft Ø (cm)	6.19	2	0
Impeller Wt. (kg)	33.9	Sub. Mtr. (cm)	25, 30	Total Lateral (cm)	3.65	3	0
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	130.2	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	67.0	5	0
Add'l Stage Length (cm)	54.6	316 Bowl Rating (kPa)	4602	Imp. WR² (kg-m²)	0.415		

Δ Consult factory for availability

2025-05-09

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SJ20H

1450 RPM

ONE ()
STAGE STAGE

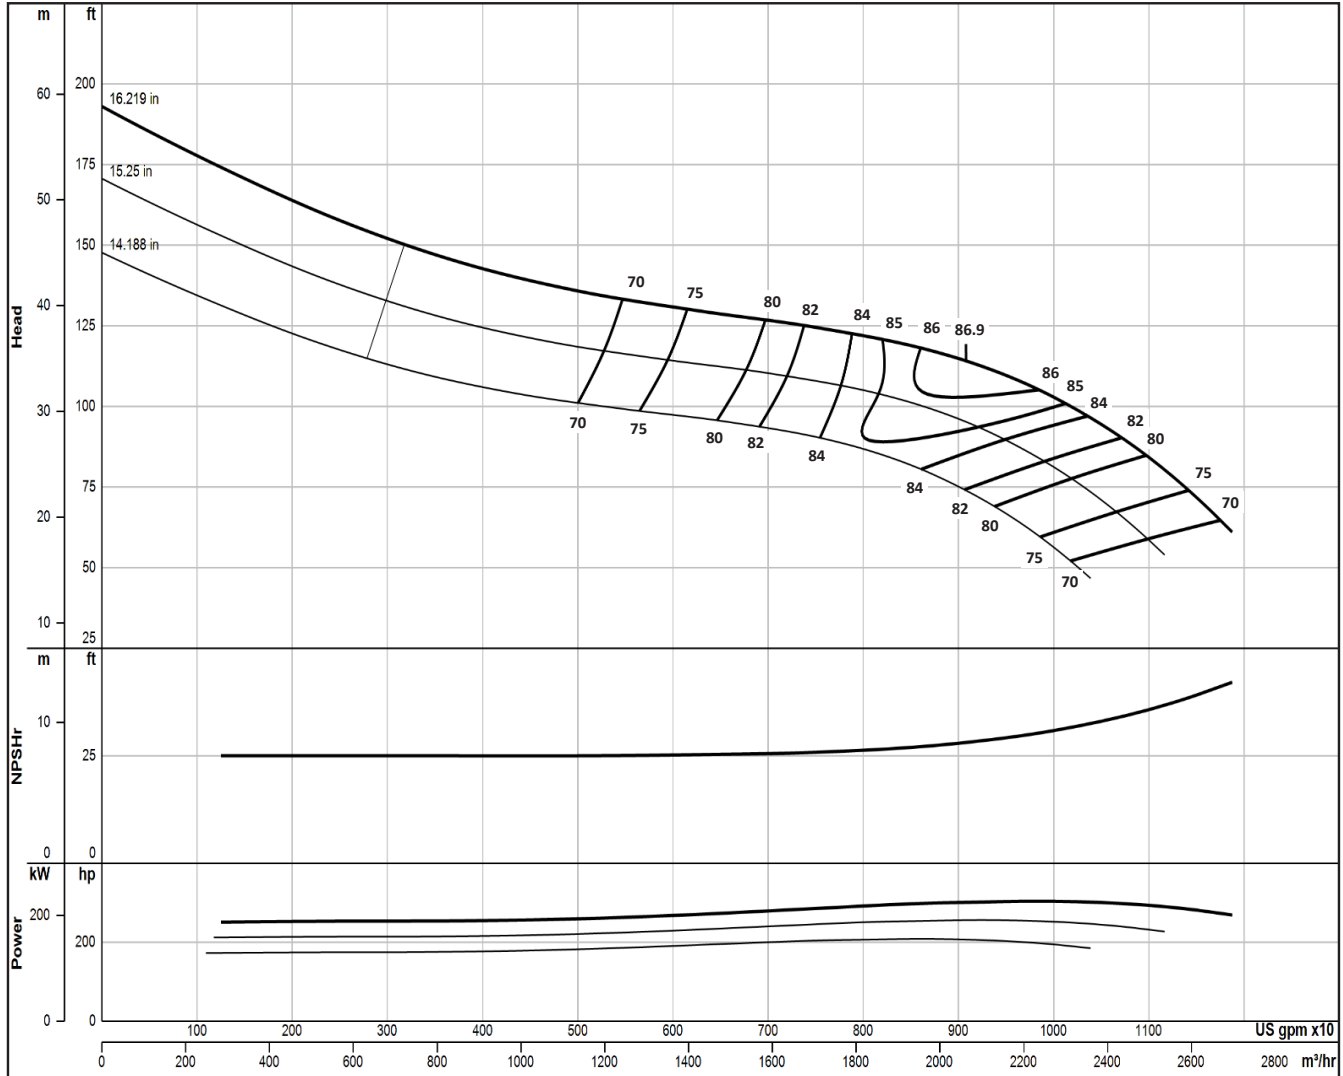

Impeller Type	Enclosed	Bowl Ø (cm)	53.0	ns (SI)	77	Qty.	Eff.
Impeller Model	SJ20H	Thd'd Discharge (cm)	Δ	S (SI)	284	Stages	Change
One Stage Weight (kg)	453.6	Thd'd Suction (cm)	N/A	PEIcl	N/A	1	0
Add'l Stage Wt. (kg)	210.9	Bell Suction Ø (cm)	57.8, 48.9	Bowl Shaft Ø (cm)	6.19	2	0
Impeller Wt. (kg)	35.0	Sub. Mtr. (cm)	25, 30	Total Lateral (cm)	3.65	3	0
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	130.2	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	61.3	5	0
Add'l Stage Length (cm)	54.6	316 Bowl Rating (kPa)	4602	Imp. WR ² (kg-m²)	0.417		

Δ Consult factory for availability

2025-05-09

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.


Weights and lengths listed are approximate and subject to change. Consult factory.



SJ20N

1450 RPM

ONE ()
STAGE STAGE

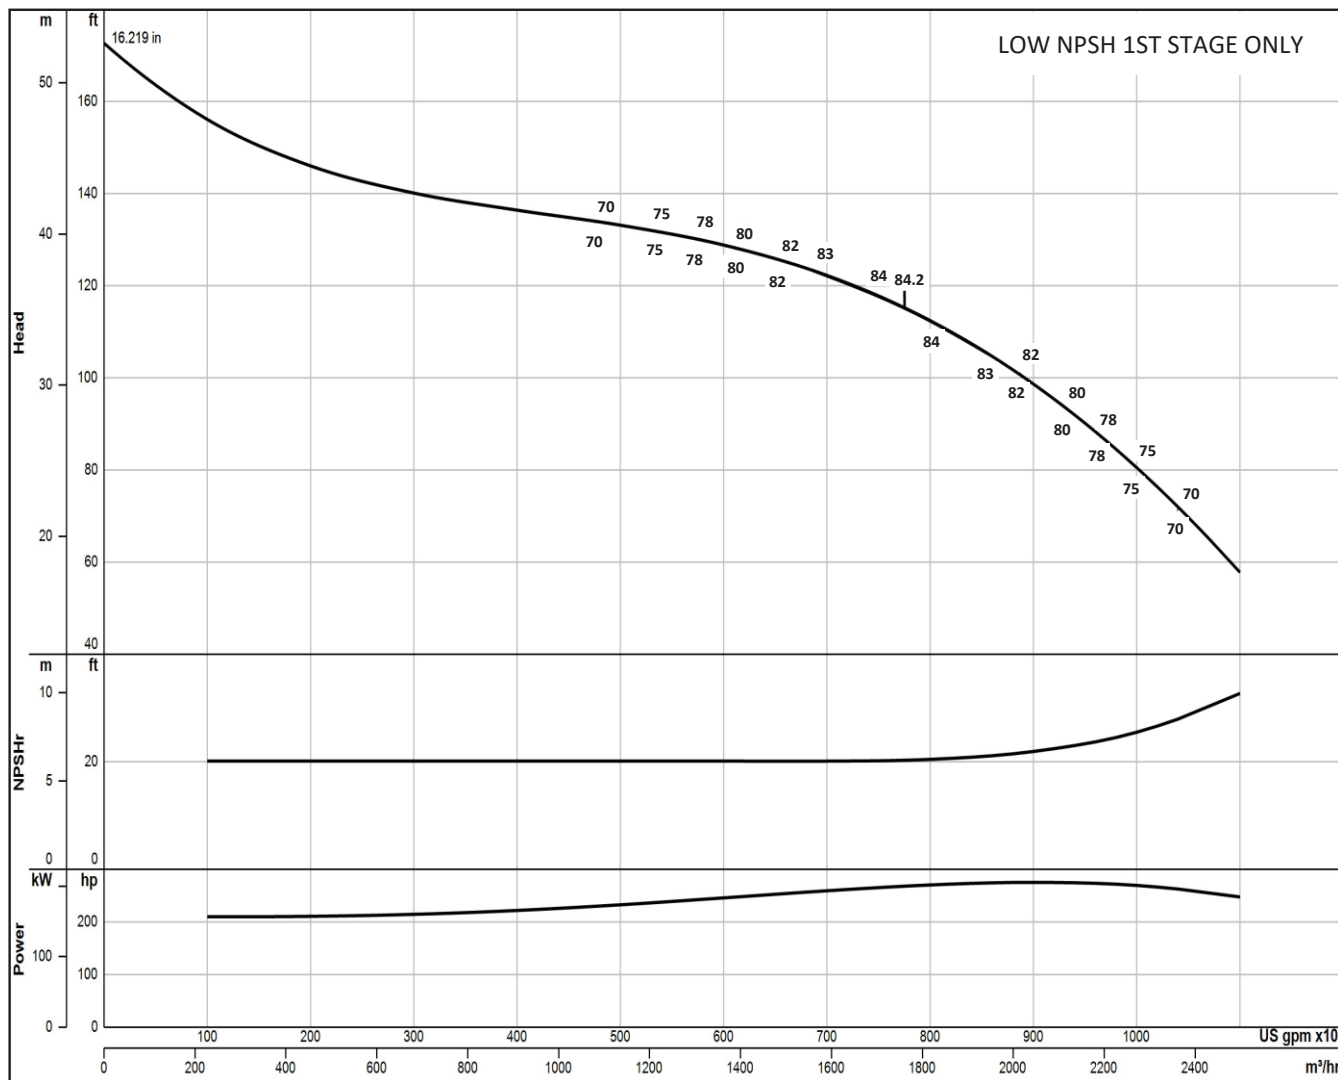

Impeller Type	Enclosed	Bowl Ø (cm)	53.0	ns (SI)	70	Qty.	Eff.
Impeller Model	SJ20N	Thd'd Discharge (cm)	Δ	S (SI)	259	Stages	Change
One Stage Weight (kg)	453.6	Thd'd Suction (cm)	N/A	PEIcl	N/A	1	0
Add'l Stage Wt. (kg)	#VALUE!	Bell Suction Ø (cm)	57.8, 48.9	Bowl Shaft Ø (cm)	6.19	2	0
Impeller Wt. (kg)	36.9	Sub. Mtr. (cm)	25, 30	Total Lateral (cm)	3.65	3	0
Impeller Mtrl.	316	C.I. Bowl Rating (kPa)	Δ	Imp. Setting (cm)	0.32	4	0
One Stage Length (cm)	130.2	D.I. Bowl Rating (kPa)	Δ	K-Factor (kg/m-tdh)	77.4	5	0
Add'l Stage Length (cm)	#VALUE!	316 Bowl Rating (kPa)	4602	Imp. WR² (kg-m²)	0.450		

Δ Consult factory for availability


2025-05-09

Data reflects nominal performance and may be derated for specified ANSI/HI 14.6 acceptance grade and/or materials of construction. Consult factory.

Weights and lengths listed are approximate and subject to change. Consult factory.



Open Lineshaft Turbine Bowl Assembly Dimensions

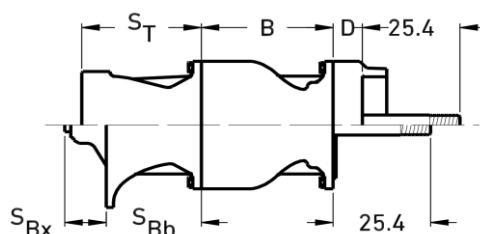


		Suction						Discharge			
Model	Bowl Dia.	Integral Bell			Threaded		Bowl B	Threaded			
		Bell Dia.	S _{Bh}	S _{Bx}	Size	S _T		Size	D	Size	D
SP5	13.3	20.3/15.2	12.1	7.9	4" NPT	17.1	11.7	8	10.2	10	13.7
SM5	13.3	20.3/15.2	12.1	7.9	4" NPT	17.1	12.4	8	10.2	10	13.7
SP5(O)	13.3	20.3/15.2	12.1	7.9	4" NPT	17.1	11.0	8	10.2	10	13.7
SP6	15.2	20.3/15.2	11.7	7.9	4" NPT	17.1	12.2	8	11.4	10	14.9
SP6(O)	15.2	20.3/15.2	11.7	7.9	4" NPT	17.1	12.2	8	11.4	10	14.9
SM6	15.2	20.3/15.2	11.9	7.9	4" NPT	17.1	13.3	8	10.8	10	14.3
SK6	14.0	20.3/15.2	11.7	7.9	4" NPT	17.1	14.0	8	11.4	10	14.9
SP7	18.3	23.8/20.3	14.6	9.8	5" NPT	16.5	16.2	10	13.7	13	17.1
SK7	16.7	23.8/20.3	14.3	9.8	5" NPT	16.5	16.2	13	2.4	15	6.4
SM7	17.8	23.8/20.3	14.6	9.8	5" NPT	16.5	17.8	10	13.7	13	17.1
SP8	20.0	23.8/20.3	14.6	9.8	5" NPT	15.7	16.2	10	14.3	13	17.8
SM8	19.5	23.8/20.3	14.6	9.8	5" NPT	15.7	15.2	10	14.3	13	17.8
SK8	19.1	---	---	---	6" NPT	21.9	22.9	15	7.6	---	---
SP9	24.1	25.4	14.9	9.5	6" NPT	21.9	19.7	15	7.6	20	7.6
SM9	24.1	25.4	14.9	9.5	6" NPT	21.9	19.7	15	7.6	20	7.6
SL9	22.9	25.4	14.9	9.5	6" NPT	22.9	21.6	15	7.6	20	7.6
SF9	24.1	25.4	14.3	9.5	6" NPT	21.9	19.1	15	7.6	20	7.6
SK9	24.0	---	---	---	8" NPT	24.4	27.0	15	7.6	20	7.6
SP10	25.9	25.4	14.9	9.5	6" NPT	21.9	18.4	15	7.6	20	7.6
SM10(O)	25.9	25.4	14.9	9.5	6" NPT	23.8	22.5	15	7.6	20	7.6
SM10	25.9	25.4	14.9	9.5	6" NPT	21.9	22.5	15	7.6	20	7.6
SM11	27.0	28.9	16.5	11.4	8" NPT	25.4	21.9	15	7.6	20	7.6
SL11	27.9	28.9	16.5	11.4	8" NPT	25.4	25.4	15	7.6	20	7.6
SR11(O)	29.2	28.9	16.5	11.4	8" NPT	23.2	24.1	20	7.6	25	7.6
SP11	28.6	28.9	16.5	11.4	8" NPT	25.4	25.4	20	7.6	25	7.6
SW12	30.5	28.9	16.5	11.4	8" NPT	25.4	22.9	20	7.6	25	7.6
SL12	29.8	28.9	16.5	11.4	8" NPT	25.4	25.4	20	7.6	25	7.6
SM12	30.2	28.9	16.5	11.4	8" NPT	25.4	27.9	20	7.6	25	7.6
SJ12	30.5	28.9	16.5	11.4	8" NPT	25.4	27.3	20	7.6	25	7.6
SM14	35.6	46.0/35.2	24.8	10.8	10" NPT	31.1	34.3	25	4.8	30	4.8
SM14(O)	35.6	46.0/35.2	24.8	10.8	10" NPT	31.1	34.3	25	4.8	30	4.8
SM16(O)	38.7	48.9/38.7	26.5	5.6	12" NPT	31.4	38.1	30	4.8	---	---
SM16	38.7	48.9/38.7	26.5	5.6	12" NPT	31.4	38.1	30	4.8	---	---
SJ18	45.1	48.9/46.0	27.3	7.6	---	---	45.7	---	---	---	---
SM20	48.9	48.9	30.5	14.9	---	---	45.7	---	---	---	---
SJ20	53.0	57.8/48.9	32.1	7.9	---	---	54.6	---	---	---	---

Dimensions are in centimeters unless noted and are subject to change without notice.

26.1



Enclosed Lineshaft Turbine Bowl Assembly Dimensions

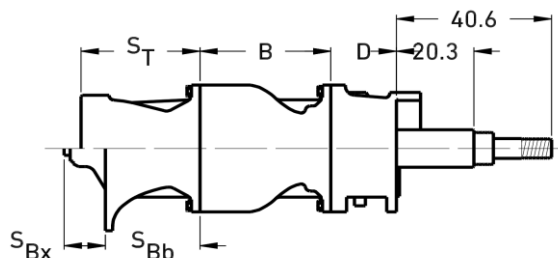

		Suction						Discharge			
Model	Bowl Dia.	Integral Bell			Threaded		Bowl	Threaded			
		Bell Dia.	S _{Bb}	S _{Bx}	Size	S _T		B	Size	D	Size
SP6	15.2	20.3/15.2	11.7	7.9	4" NPT	17.1	12.2	10	14.0	---	---
SP6(O)	15.2	20.3/15.2	11.7	7.9	4" NPT	17.1	12.2	10	14.0	---	---
SM6	15.2	20.3/15.2	11.9	7.9	4" NPT	17.1	13.3	10	13.3	---	---
SK6	14.0	20.3/15.2	11.7	7.9	4" NPT	17.1	14.0	10	14.0	---	---
SP7	18.3	23.8/20.3	14.6	9.8	5" NPT	16.5	16.2	13	13.3	15	17.1
SM7	17.8	23.8/20.3	14.6	9.8	5" NPT	16.5	17.8	13	13.3	15	17.1
SP8	20.0	23.8/20.3	14.6	9.8	5" NPT	15.7	16.2	13	15.6	15	19.4
SM8	19.5	23.8/20.3	14.6	9.8	5" NPT	15.7	15.2	13	15.6	15	19.4
SK8	19.1	---	---	---	6" NPT	21.9	22.9	15	19.4	---	---
SP9	24.1	25.4	14.9	9.5	6" NPT	21.9	19.7	15	17.1	20	17.1
SM9	24.1	25.4	14.9	9.5	6" NPT	21.9	19.7	15	17.1	20	17.1
SL9	22.9	25.4	14.9	9.5	6" NPT	22.9	21.6	15	16.2	20	17.1
SF9	24.1	25.4	14.3	9.5	6" NPT	21.9	19.1	15	17.1	20	17.1
SK9	24.0	---	---	---	8" NPT	24.4	27.0	20	17.1	---	---
SP10	25.9	25.4	14.9	9.5	6" NPT	21.9	18.4	15	16.5	20	16.5
SM10(O)	25.9	25.4	14.9	9.5	6" NPT	23.8	22.5	15	16.5	20	16.5
SM10	25.9	25.4	14.9	9.5	6" NPT	21.9	22.5	15	16.5	20	16.5
SM11	27.0	28.9	16.5	11.4	8" NPT	25.4	21.9	15	16.5	20	16.5
SL11	27.9	28.9	16.5	11.4	8" NPT	25.4	25.4	15	16.5	20	16.5
SR11(O)	29.2	28.9	16.5	11.4	8" NPT	23.2	24.1	20	19.1	25	19.1
SP11	28.6	28.9	16.5	11.4	8" NPT	25.4	25.4	20	19.1	25	19.1
SW12	30.5	28.9	16.5	11.4	8" NPT	25.4	22.9	20	19.1	25	19.1
SL12	29.8	28.9	16.5	11.4	8" NPT	25.4	25.4	20	19.1	25	19.1
SM12	30.2	28.9	16.5	11.4	8" NPT	25.4	27.9	20	19.1	25	19.1
SJ12	30.5	28.9	16.5	11.4	8" NPT	25.4	27.3	20	19.1	25	19.1
SM14	35.6	46.0/35.2	24.8	10.8	10" NPT	31.1	34.3	25	17.1	30	17.1
SM14(O)	35.6	46.0/35.2	24.8	10.8	10" NPT	31.1	34.3	25	17.1	30	17.1
SM16(O)	38.7	48.9/38.7	26.5	5.6	12" NPT	31.4	38.1	30	26.5	36	32.9
SM16	38.7	48.9/38.7	26.5	5.6	12" NPT	31.4	38.1	30	26.5	36	32.9
SJ18	45.1	48.9/46.0	27.3	7.6	---	---	45.7	36*	35.6	---	---
SM20	48.9	48.9	30.5	14.9	---	---	45.7	41*	35.6	---	---
SJ20	53.0	57.8/48.9	32.1	7.9	---	---	54.6	41*	35.6	---	---


* Flanged discharge only / Threaded discharge available with adapter. Consult factory.

26.1

Dimensions are in centimeters unless noted and are subject to change without notice.



Submersible Turbine Bowl Assembly Dimensions

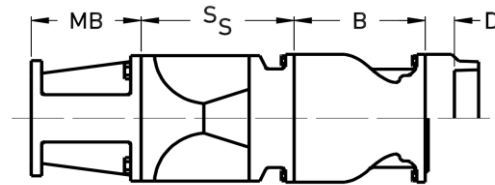

Model	Bowl Dia.	Motor Bracket								Suction	Bowl B	Discharge Threaded			
		Size	MB	Size	MB	Size	MB	Size	MB	Sub. S _s		Size	D	Size	D
SP5	13.3	10	20.5	15	14.9	20	22.2	---	---	13.8	11.7	8	10.2	10	13.7
SM5	13.3	10	20.5	15	14.9	20	22.2	---	---	13.8	12.4	8	10.2	10	13.7
SP5(O)	13.3	10	20.5	15	14.9	20	22.2	---	---	13.8	11.0	8	10.2	10	13.7
SP6	15.2	10	20.5	15	14.9	20	22.2	---	---	13.8	12.2	8	11.4	10	14.9
SP6(O)	15.2	10	20.5	15	14.9	20	22.2	---	---	13.8	12.2	8	11.4	10	14.9
SM6	15.2	10	20.5	15	14.9	20	22.2	---	---	13.8	13.3	8	10.8	10	14.3
SK6	14.0	10	20.5	15	14.9	20	22.2	---	---	13.8	14.0	8	11.4	10	14.9
SP7	18.3	10	21.1	15	15.6	20	21.6	---	---	15.9	16.2	10	13.7	13	17.1
SK7	16.7	10	21.1	15	15.6	20	21.6	---	---	15.9	16.2	13	2.4	15	6.4
SM7	17.8	10	21.1	15	15.6	20	21.6	---	---	18.7	17.8	10	13.7	13	17.1
SP8	20.0	10	21.1	15	15.6	20	21.6	---	---	15.9	16.2	10	14.3	13	17.8
SM8	19.5	15	15.6	20	21.6	---	---	---	---	18.7	15.2	10	14.3	13	17.8
SK8	19.1	15	15.6	20	21.6	---	---	---	---	19.4	22.9	15	7.6	---	---
SP9	24.1	15	15.2	20	20.3	10A	20.3	10B	22.9	23.3	19.7	15	7.6	20	7.6
SM9	24.1	15	15.2	20	20.3	10A	20.3	10B	22.9	23.3	19.7	15	7.6	20	7.6
SL9	22.9	15	15.2	20	20.3	10A	20.3	10B	22.9	23.3	21.6	15	7.6	20	7.6
SF9	24.1	15	15.2	20	20.3	10A	20.3	10B	22.9	22.7	19.1	15	7.6	20	7.6
SK9	24.0	15	15.2	20	20.3	10A	20.3	10B	22.9	23.3	27.0	15	7.6	20	7.6
SP10	25.9	15	15.2	20	20.3	10A	20.3	10B	22.9	23.3	18.4	15	7.6	20	7.6
SM10(O)	25.9	15	15.2	20	20.3	10A	20.3	10B	22.9	23.3	22.5	15	7.6	20	7.6
SM10	25.9	15	15.2	20	20.3	10A	20.3	10B	22.9	23.3	22.5	15	7.6	20	7.6
SM11	27.0	20	20.3	10A	20.3	10B	22.9	14H	22.9	28.9	21.9	15	7.6	20	7.6
SL11	27.9	20	20.3	10A	20.3	10B	22.9	14H	22.9	28.9	25.4	15	7.6	20	7.6
SR11(O)	29.2	20	20.3	10A	20.3	10B	22.9	14H	22.9	28.9	24.1	20	7.6	25	7.6
SP11	28.6	20	20.3	10A	20.3	10B	22.9	14H	22.9	28.9	25.4	20	7.6	25	7.6
SW12	30.5	20	20.3	10A	20.3	10B	22.9	14H	22.9	28.9	22.9	20	7.6	25	7.6
SL12	29.8	20	20.3	10A	20.3	10B	22.9	14H	22.9	28.9	25.4	20	7.6	25	7.6
SM12	30.2	20	20.3	10A	20.3	10B	22.9	14H	22.9	28.9	27.9	20	7.6	25	7.6
SJ12	30.5	20	20.3	10A	20.3	10B	22.9	14H	22.9	28.9	27.3	20	7.6	25	7.6
SM14	35.6	10A	20.3	10B	22.9	14H	22.9	---	---	40.0	34.3	25	4.8	30	4.8
SM14(O)	35.6	10A	20.3	10B	22.9	14H	22.9	---	---	40.0	34.3	25	4.8	30	4.8
SM16(O)	38.7	10B	22.9	14H	22.9	---	---	---	---	43.5	38.1	30	4.8	---	---
SM16	38.7	10B	22.9	14H	22.9	---	---	---	---	43.5	38.1	30	4.8	---	---
SJ18	45.1	10B	22.9	14H	22.9	---	---	---	---	45.7	45.7	---	---	---	---
SM20	48.9	10B	22.9	14H	22.9	---	---	---	---	53.3	45.7	---	---	---	---
SJ20	53.0	10B	22.9	14H	22.9	---	---	---	---	53.3	54.6	---	---	---	---

Dimensions are in centimeters unless noted and are subject to change without notice.

26.1

WORLD-CLASS
PUMP PRODUCTS,
SYSTEMS AND
SOLUTIONS.

SIMFLO®



LUBBOCK | 2605 INTERSTATE 27 | LUBBOCK, TX | 79404 | 806.747.3411

SOUTHAVEN | 8500 AARON LANE | SOUTHAVEN, MS | 38671 | 662.793.8090